

SUMMARY OF DOCUMENTS		Compiled 24 Aug 2019	
#	Document Name	Description	# of Pages
1	01-2004 04 Lead Inspection 917 Main Street-redacted	17 page document containing lead test results	17
2	02-2004 04 Lead Inspection 921 Main Street-redacted	18 page document containing lead test results	17
3	03-2012 09 XRF Lead Test Results-redacted	48 page document that presents X-Ray Fluorescence (XRF) results from interior and exterior painted surfaces	48
4	04-2012 09 Lead Inspection Risk Assessment 917 and 920 (921) Main St-redacted	54 page document that presents lead test results for 917 and 920 (921) Main Street	52
5	05-2012 10 Hazardous Building Material Report West Chop Final Survey-redacted	131 page survey for asbestos containing material, lead paint, and Radon	131
6	06-2014 07 LBP Inspection and Risk Assessment-redacted	48 page report on Lead Based Paint Inspection and Risk Assessment Report	47
7	07-2015 05 Lead Abatement Work Plan-redacted	24 page scope of work for Contract No. HSCGG1-15-C-PRV100 dated 21 May 2015	24
8	08-2015 12 Lead Asbestos Work Review Results-redacted	28 page work completion report after abatement project	24
9	09-2015 12 Survey of Lead Abatement Work-redacted	6 page report on lead retesting after work completion	6
10	10-2015 12 West Chop Contract Substantially Complete-redacted	22 page document on Government declaration of contract substantial completion	19
11	11-2018 08 Lead Dust Results 917 Main Street-redacted	1 page of lead dust test results	1
12	12-2018 08 Lead Dust Results 921 Main Street-redacted	2 pages of lead test results	2
13	13-2018 08 Lead Dust Results-redacted	1 page of lead test results	1
14	14-2018 08 Lead in Soil Photos	3 pages of photos showing locations of lead test samples	3
15	15-2018 08 Lead in Soil Results-redacted	6 page document includes photos and lead test results from soil samples	5
16	16-2018 08 Lead Results-redacted	7 page document contains lead dust results, and paint chip lead test results for both houses and other areas	7
17	17-2018 08 Lead Results Paint Chips Tests-redacted	2 pages of paint chip lead testing results	2
18	18-2018 08 Water Test Results	2 pages of results from testing water for lead content	2
Total # of Pages			408

Lead Inspection / Risk Assessment Report

Page 1 Of 17

Franklin Analytical Services, Inc.

401 Delano Road • Marion, MA 02738 • Tel: (508) 748-3156 • Fax: (508) 748-9713

Method Used:

☐ Na₂S Exp. Date _____
☒ X-Ray Fluorescence
 Model XK3 Serial # 511

Apt. _____

St.# 917 Address MARION
 City VINYARD HAVEN Zip Code 02568

Owner Name: USCG AIR STATION CAPE COD

Owner Address: 0715 ANGB

BARN STABLE, MA 02542-5024

Client Name (if different from owner): _____

Client Address: _____

Single Family ☒
 Multi Family _____
 # Units _____
 Condominium _____
 Day Care _____


Key:	Inspection	Deleading	Other
A/M	Accessible/Mouthable	CAP	Capped
CAP	Capped	COV	Covered
COV	Covered	DIP	Dipped
INT	Intact	ENC	Encapsulated
L	Loose	MI	Made Intact
MI	Moveable/Impacted	PRE	Prepared
MET	Metal	REM	Removed
NA	Not Accessible	REP	Replaced
NC	No Coating	REV	Reversed
NEG	Negative	SCR	Scraped
POS	Positive	VR	Vinyl Replacement
VR	Vinyl Replacement		

☒ Comprehensive Inspection (Y/N)

Comments:


WEST CHOP LIGHT
UNIT 2

Floor# 1 C

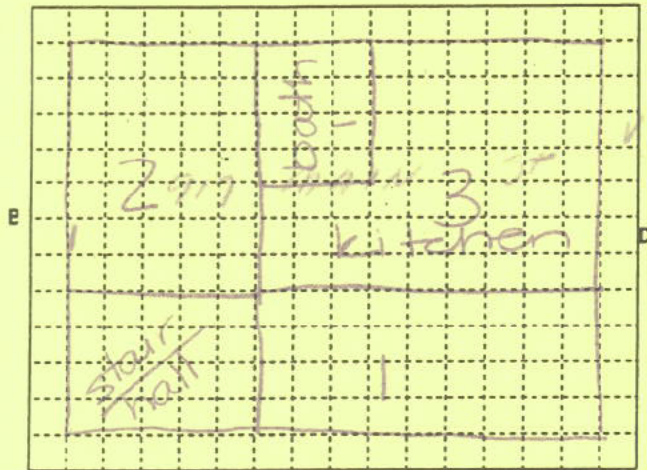

A (Street Side)

Floor# 2 C

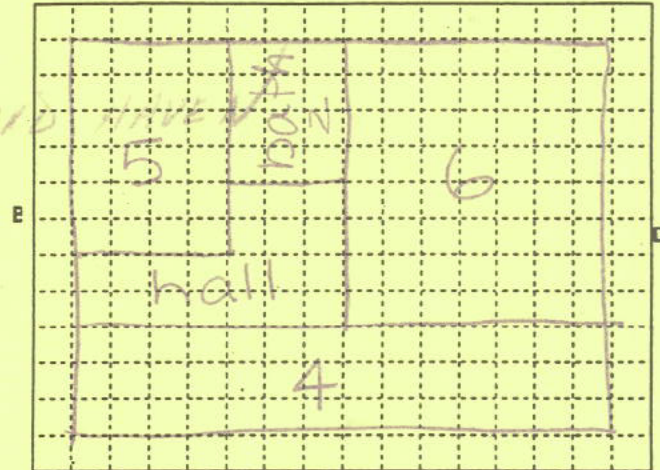

A (Street Side)

Pb (lead) equal to or greater than 1.0 mg/cm² with x-ray fluorescence or positive with Na₂S is Dangerous.

INSP. DATE
041304

Lead Hazards? (Y or N)
☒ Y

(b) (6)

Inspector (print)

Signature

Lic.#

R. A. DATE

Urgent Lead Hazards? (Y or N)
☐

Risk Assessor (print)

Signature

Lic.#

Inspector (print)

Lic #

Signature

Date

Risk Assessor (print)

Lic #

Signature

Date

Address of Property

917 MAIN ST

Apt #

City VINEYARD HAVEN

ROOM

1

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH	SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A B C D	Up Walls	2.3	A/M L N/A	Y						Window Sill	0.1	M/I A/M L N/A	Y				
A B C D	Low Walls		A/M L N/A	Y						Win Apron	0.3	A/M L N/A	Y				
A B C D	Baseboards	10.0	A/M L N/A	Y						Win Casing	0.0	A/M L N/A	Y				
A B C D	Chair Rail		A/M L N/A	Y					D	Header Stop	N/A	M/I A/M L N/A	Y				
	Radiator	0.7	A/M L N/A	Y						Int Stops	0.2	M/I A/M L N/A	Y				
	Floor	N/C	A/M L N/A	Y						Win Int Sash	0.4	M/I A/M L N/A	Y				
	Ceiling	N/A	A/M L N/A	Y						Exterior Sill	0.6	M/I L N/A	Y				
	Door		A/M L N/A	Y						Part Bead	0.2	M/I L N/A	Y				
B	Door Casing	2.1	A/M L N/A	Y						Blind Stop	0.3	M/I L N/A	Y				
	Door Jamb	0.2	A/M L N/A	Y						Win Ext Sash	0.2	M/I L N/A	Y				
	Threshold	0.7	A/M L N/A	Y						Window Sill		M/I A/M L N/A	Y				
	Door		A/M L N/A	Y						Win Apron		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y						Win Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y						Header Stop		M/I A/M L N/A	Y				
	Threshold		A/M L N/A	Y						Int Stops		M/I A/M L N/A	Y				
	Door		A/M L N/A	Y						Win Int Sash		M/I A/M L N/A	Y				
	Door Casing		A/M L N/A	Y						Exterior Sill		M/I L N/A	Y				
	Door Jamb		A/M L N/A	Y						Part Bead		M/I L N/A	Y				
	Threshold		A/M L N/A	Y						Blind Stop		M/I L N/A	Y				
	Door		A/M L N/A	Y						Win Ext Sash		M/I L N/A	Y				
	Door Casing		A/M L N/A	Y						Closet Door		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y						Cl Casing		A/M L N/A	Y				
	Threshold		A/M L N/A	Y						Closet Jamb		A/M L N/A	Y				
	Window Sill	0.3	M/I A/M L N/A	Y						Closet Walls		A/M L N/A	Y				
	Win Apron	0.2	A/M L N/A	Y						Cl Baseboard		A/M L N/A	Y				
	Win Casing	0.6	A/M L N/A	Y						Closet Pole		A/M L N/A	Y				
	Header Stop	N/A	M/I A/M L N/A	Y						Closet Shelf		A/M L N/A	Y				
	Int Stops	0.4	M/I A/M L N/A	Y						Cl Supports		A/M L N/A	Y				
	Win Int Sash	0.3	M/I A/M L N/A	Y						Closet Floor		A/M L N/A	Y				
	Exterior Sill	0.4	M/I L N/A	Y						Closet Ceiling		A/M L N/A	Y				
	Part Bead	0.2	M/I L N/A	Y						Fireplace		A/M L N/A	Y				
	Blind Stop	0.2	M/I L N/A	Y						Mantle		A/M L N/A	Y				
	Win Ext Sash	0.0	M/I L N/A	Y								M/I A/M L N/A	Y				
COMMENTS / STRUCTURAL DEFECTS:												M/I A/M L N/A	Y				
												M/I A/M L N/A	Y				
												M/I A/M L N/A	Y				
												M/I A/M L N/A	Y				
												M/I A/M L N/A	Y				

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD	SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

Inspector (print)

Lic #

Signature

Date

Risk Assessor (print)

Lic #

Signature

Date

Address of Property

917 MAIN ST

Apt #

City

VINEYARD HAVEN

ROOM

2

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A B C D	Up Walls	4.4	A/M L N/A	Y				
A B C D	Low Walls		A/M L N/A	Y				
A B C D	Baseboards	10.0	A/M L N/A	Y				
A B C D	Chair Rail		A/M L N/A	Y				
	Radiator	1.9	A/M L N/A	Y				
	Floor	N/A	A/M L N/A	Y				
	Ceiling	N/A	A/M L N/A	Y				
D (C)	Door	6.1	A/M L N/A	Y				
	Door Casing	0.2	A/M L N/A	Y				
	Door Jamb	6.0	A/M L N/A	Y				
	Threshold	0.3	A/M L N/A	Y				
D (C)	Door	0.1	A/M L N/A	Y				
	Door Casing	0.0	A/M L N/A	Y				
	Door Jamb	0.2	A/M L N/A	Y				
	Threshold	0.0	A/M L N/A	Y				
X	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
X	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
B (W)	Window Sill	0.1	M/I A/M L N/A	Y				
	Win Apron	6.6	A/M L N/A	Y				
	Win Casing	4.3	A/M L N/A	Y				
	Header Stop	N/A	M/I A/M L N/A	Y				
	Int Stops	0.2	M/I A/M L N/A	Y				
	Win Int Sash	0.6	M/I A/M L N/A	Y				
	Exterior Sill	0.5	M/I L N/A	Y				
	Part Bead	CN	M/I L N/A	Y				
	Blind Stop	0.3	M/I L N/A	Y				
	Win Ext Sash	0.5	M/I L N/A	Y				

COMMENTS / STRUCTURAL DEFECTS:

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
B (W)	Window Sill	0.2	M/I A/M L N/A	Y				
	Win Apron	0.5	A/M L N/A	Y				
	Win Casing	0.1	A/M L N/A	Y				
	Header Stop	N/A	M/I A/M L N/A	Y				
	Int Stops	0.2	M/I A/M L N/A	Y				
	Win Int Sash	6.4	M/I A/M L N/A	Y				
	Exterior Sill	0.1	M/I L N/A	Y				
	Part Bead	CN	M/I L N/A	Y				
	Blind Stop	0.2	M/I L N/A	Y				
	Win Ext Sash	0.4	M/I L N/A	Y				
D	Window Sill		M/I A/M L N/A	Y				
	Win Apron		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Header Stop		M/I A/M L N/A	Y				
	Int Stops		M/I A/M L N/A	Y				
	Win Int Sash		M/I A/M L N/A	Y				
	Exterior Sill		M/I L N/A	Y				
	Part Bead		M/I L N/A	Y				
	Blind Stop		M/I L N/A	Y				
	Win Ext Sash		M/I L N/A	Y				
D	Closet Door	0.2	A/M L N/A	Y				
	Cl Casing	6.1	A/M L N/A	Y				
	Closet Jamb	5.7	A/M L N/A	Y				
	Closet Walls	3.5	A/M L N/A	Y				
	Cl Baseboard	10.0	A/M L N/A	Y				
	Closet Pole	Approx 8'	A/M L N/A	Y				
	Closet Shelf	4.6	A/M L N/A	Y				
	Cl Supports	10.0	A/M L N/A	Y				
	Closet Floor	0.2	A/M L N/A	Y				
	Closet Ceiling	N/A	A/M L N/A	Y				
	Fireplace		A/M L N/A	Y				
	Mantle		A/M L N/A	Y				
			M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				

4/13/04

Inspector (print) _____ Lic# _____ Signature _____ Date _____

Risk Assessor (print) _____ Lic# _____ Signature _____ Date _____

Address of Property 917 MAIN ST Apt# _____ City VINEYARD HAVEN
ROOM - 4

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A B C D	Up Walls	10.0	A/M L N/A	Y				
A B C D	Low Walls		A/M L N/A	Y				
A B C D	Baseboards	10.0	A/M L N/A	Y				
A B C D	Chair Rail		A/M L N/A	Y				
	Radiator		A/M L N/A	Y				
	Floor	N/A	A/M L N/A	Y				
	Ceiling	2.0	A/M L N/A	Y				
	Door	0.2	A/M L N/A	Y				
	Door Casing	4.3	A/M L N/A	Y				
	Door Jamb	1.1	A/M L N/A	Y				
	Threshold	0.6	A/M L N/A	Y				
	Door	0.5	A/M L N/A	Y				
	Door Casing	4.5	A/M L N/A	Y				
	Door Jamb	10.0	A/M L N/A	Y				
	Threshold	0.2	A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Window Sill	2.0	M/I A/M L N/A	Y				
	Win Apron	1.9	A/M L N/A	Y				
	Win Casing	3.5	A/M L N/A	Y				
	Header Stop	N/A	M/I A/M L N/A	Y				
	Int Stops	0.6	M/I A/M L N/A	Y				
	Win Int Sash	0.9	M/I A/M L N/A	Y				
	Exterior Sill	0.5	M/I L N/A	Y				
	Part Bead	0.0	M/I L N/A	Y				
	Blind Stop	0.0	M/I L N/A	Y				
	Win Ext Sash	0.9	M/I L N/A	Y				

COMMENTS / STRUCTURAL DEFECTS:

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
	Window Sill		M/I A/M L N/A	Y				
	Win Apron		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Header Stop		M/I A/M L N/A	Y				
	Int Stops		M/I A/M L N/A	Y				
	Win Int Sash		M/I A/M L N/A	Y				
	Exterior Sill		M/I L N/A	Y				
	Part Bead		M/I L N/A	Y				
	Blind Stop		M/I L N/A	Y				
	Win Ext Sash		M/I L N/A	Y				
	Window Sill		M/I A/M L N/A	Y				
	Win Apron		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Header Stop		M/I A/M L N/A	Y				
	Int Stops		M/I A/M L N/A	Y				
	Win Int Sash		M/I A/M L N/A	Y				
	Exterior Sill		M/I L N/A	Y				
	Part Bead		M/I L N/A	Y				
	Blind Stop		M/I L N/A	Y				
	Win Ext Sash		M/I L N/A	Y				
	Closet Door	0.2	A/M L N/A	Y				
	Cl Casing	4.1	A/M L N/A	Y				
	Closet Jamb	4.5	A/M L N/A	Y				
	Closet Walls	10.4	A/M L N/A	Y				
	Cl Baseboard	10.0	A/M L N/A	Y				
	Closet Pole	0.0	A/M L N/A	Y				
	Closet Shelf	10.0	A/M L N/A	Y				
	Cl Supports	10.0	A/M L N/A	Y				
	Closet Floor	N/A	A/M L N/A	Y				
	Closet Ceiling	N/A	A/M L N/A	Y				
	Fireplace		A/M L N/A	Y				
	Mantle		A/M L N/A	Y				
			M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

4/13/04

Inspector (print) _____ Lic# _____ Signature _____ Date _____

Risk Assessor (print) _____ Lic# _____ Signature _____ Date _____

Address of Property ROOM 5 917 MAIN ST Apt # _____ City VINEYARD HAVEN

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A B C D	Up Walls	10.0	A/M L N/A	Y				
A B C D	Low Walls		A/M L N/A	Y				
A B C D	Baseboards	10.0	A/M L N/A	Y				
A B C D	Chair Rail		A/M L N/A	Y				
	Radiator	2.0	A/M L N/A	Y				
	Floor	N/A	A/M L N/A	Y				
	Ceiling	N/A	A/M L N/A	Y				
	Door	0.3	A/M L N/A	Y				
	Door Casing	9.1	A/M L N/A	Y				
	Door Jamb	N/A	A/M L N/A	Y				
	Threshold	N/A	A/M L N/A	Y				
	Door	10.0	A/M L N/A	Y				
	Door Casing	10.0	A/M L N/A	Y				
	Door Jamb	N/A	A/M L N/A	Y				
	Threshold	N/A	A/M L N/A	Y				
	Door	0.3	A/M L N/A	Y				
	Door Casing	6.5	A/M L N/A	Y				
	Door Jamb	3.1	A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Window Sill	4.5	M/I A/M L N/A	Y				
	Win Apron	3.6	A/M L N/A	Y				
	Win Casing	5.1	A/M L N/A	Y				
	Header Stop	N/A	M/I A/M L N/A	Y				
	Int Stops	0.3	M/I A/M L N/A	Y				
	Win Int Sash	0.2	M/I A/M L N/A	Y				
	Exterior Sill	0.7	M/I L N/A	Y				
	Part Bead	0.2	M/I L N/A	Y				
	Blind Stop	0.2	M/I L N/A	Y				
	Win Ext Sash	0.5	M/I L N/A	Y				

COMMENTS / STRUCTURAL DEFECTS:

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
	Window Sill		M/I A/M L N/A	Y				
	Win Apron		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Header Stop		M/I A/M L N/A	Y				
	Int Stops		M/I A/M L N/A	Y				
	Win Int Sash		M/I A/M L N/A	Y				
	Exterior Sill		M/I L N/A	Y				
	Part Bead		M/I L N/A	Y				
	Blind Stop		M/I L N/A	Y				
	Win Ext Sash		M/I L N/A	Y				
	Window Sill		M/I A/M L N/A	Y				
	Win Apron		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Header Stop		M/I A/M L N/A	Y				
	Int Stops		M/I A/M L N/A	Y				
	Win Int Sash		M/I A/M L N/A	Y				
	Exterior Sill		M/I L N/A	Y				
	Part Bead		M/I L N/A	Y				
	Blind Stop		M/I L N/A	Y				
	Win Ext Sash		M/I L N/A	Y				
	Closet Door		A/M L N/A	Y				
	Cl Casing		A/M L N/A	Y				
	Closet Jamb		A/M L N/A	Y				
	Closet Walls		A/M L N/A	Y				
	Cl Baseboard		A/M L N/A	Y				
	Closet Pole		A/M L N/A	Y				
	Closet Shelf		A/M L N/A	Y				
	Cl Supports		A/M L N/A	Y				
	Closet Floor		A/M L N/A	Y				
	Closet Ceiling		A/M L N/A	Y				
	Fireplace		A/M L N/A	Y				
	Mantle		A/M L N/A	Y				
	Closet to Eves - N/A		M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

Inspector (print)

Lic #

Signature

Date

Page 6 of 17

Risk Assessor (print)

Lic #

Signature

Date

Address of Property

917 MAIN ST

Apt #

City

VINEYARD HAVEN

ROOM

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A B C D	Up Walls	10.0	A/M L N/A	Y				
A B C D	Low Walls		A/M L N/A	Y				
A B C D	Baseboards	10.0	A/M L N/A	Y				
A B C D	Chair Rail		A/M L N/A	Y				
	Radiator		A/M L N/A	Y				
	Floor		A/M L N/A	Y				
	Ceiling		A/M L N/A	Y				
	Door	0.3	A/M L N/A	Y				
	Door Casing	9.7	A/M L N/A	Y				
	Door Jamb	10.0	A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Door	5.2	A/M L N/A	Y				
	Door Casing	10.9	A/M L N/A	Y				
	Door Jamb	4.5	A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Window Sill	4.3	M/I A/M L N/A	Y				
	Win Apron	5.1	A/M L N/A	Y				
	Win Casing	8.1	A/M L N/A	Y				
	Header Stop	N/A	M/I A/M L N/A	Y				
	Int Stops	0.2	M/I A/M L N/A	Y				
	Win Int Sash	0.1	M/I A/M L N/A	Y				
	Exterior Sill	0.5	M/I L N/A	Y				
	Part Bead	0.2	M/I L N/A	Y				
	Blind Stop	0.1	M/I L N/A	Y				
	Win Ext Sash	0.7	M/I L N/A	Y				

COMMENTS / STRUCTURAL DEFECTS:

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
	Window Sill		M/I A/M L N/A	Y				
	Win Apron		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Header Stop		M/I A/M L N/A	Y				
	Int Stops		M/I A/M L N/A	Y				
	Win Int Sash		M/I A/M L N/A	Y				
	Exterior Sill		M/I L N/A	Y				
	Part Bead		M/I L N/A	Y				
	Blind Stop		M/I L N/A	Y				
	Win Ext Sash		M/I L N/A	Y				
	Window Sill		M/I A/M L N/A	Y				
	Win Apron		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Header Stop		M/I A/M L N/A	Y				
	Int Stops		M/I A/M L N/A	Y				
	Win Int Sash		M/I A/M L N/A	Y				
	Exterior Sill		M/I L N/A	Y				
	Part Bead		M/I L N/A	Y				
	Blind Stop		M/I L N/A	Y				
	Win Ext Sash		M/I L N/A	Y				
	Closet Door	0.1	A/M L N/A	Y				
	Cl Casing	10.0	A/M L N/A	Y				
	Closet Jamb	10.0	A/M L N/A	Y				
	Closet Walls	10.0	A/M L N/A	Y				
	Cl Baseboard	10.0	A/M L N/A	Y				
	Closet Pole		A/M L N/A	Y				
	Closet Shelf		A/M L N/A	Y				
	Cl Supports		A/M L N/A	Y				
	Closet Floor	N/A	A/M L N/A	Y				
	Closet Ceiling	N/A	A/M L N/A	Y				
	Fireplace		A/M L N/A	Y				
	Mantle		A/M L N/A	Y				
			M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

4/13/04

Inspector (print)

Lic #

Signature

Date

Risk Assessor (print)

Lic#

Signature

Date

Address of Property

917 MAIN ST

Apt #

City

VINEYARD HAVEN

KITCHEN

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A B C D	Up Walls	3.5	A/M L N/A	Y				
A B C D	Low Walls		A/M L N/A	Y				
A B C D	Baseboards	10.0	A/M L N/A	Y				
A B C D	Chair Rail		A/M L N/A	Y				
	Radiator		A/M L N/A	Y				
	Floor	CN	A/M L N/A	Y				
	Ceiling	N/A	A/M L N/A	Y				
	Door		A/M L N/A	Y				
B C D	Door Casing	0.2	A/M L N/A	Y				
	Door Jamb	0.5	A/M L N/A	Y				
	Threshold	0.6	A/M L N/A	Y				
B	Door	0.2	A/M L N/A	Y				
	Door Casing	0.3	A/M L N/A	Y				
	Door Jamb	4.5	A/M L N/A	Y				
	Threshold	0.2	A/M L N/A	Y				
C	Door	0.4	A/M L N/A	Y				
	Door Casing	0.0	A/M L N/A	Y				
	Door Jamb	0.3	A/M L N/A	Y				
	Threshold	0.2	A/M L N/A	Y				
C	Door		A/M L N/A	Y				
	Door Casing	0.1	A/M L N/A	Y				
	Door Jamb	0.3	A/M L N/A	Y				
	Threshold	0.2	A/M L N/A	Y				
C	Window Sill	3.2	M/I A/M L N/A	Y				
	Win Apron	0.8	A/M L N/A	Y				
	Win Casing	0.3	A/M L N/A	Y				
	Header Stop	N/A	M/I A/M L N/A	Y				
	Int Stops	0.0	M/I A/M L N/A	Y				
	Win Int Sash	0.5	M/I A/M L N/A	Y				
	Exterior Sill	0.6	M/I L N/A	Y				
	Part Bead	0.2	M/I L N/A	Y				
	Blind Stop	0.4	M/I L N/A	Y				
	Win Ext Sash	0.6	M/I L N/A	Y				

COMMENTS / STRUCTURAL DEFECTS:

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
	Window Sill		M/I A/M L N/A	Y				
	Win Apron		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Header Stop		M/I A/M L N/A	Y				
	Int Stops		M/I A/M L N/A	Y				
	Win Int Sash		M/I A/M L N/A	Y				
	Exterior Sill		M/I A/M L N/A	Y				
	Part Bead		M/I A/M L N/A	Y				
	Blind Stop		M/I A/M L N/A	Y				
	Win Ext Sash		M/I A/M L N/A	Y				
	Closet Door		A/M L N/A	Y				
	CI Casing		A/M L N/A	Y				
	Closet Jamb		A/M L N/A	Y				
	Closet Walls		A/M L N/A	Y				
	CI Baseboard		A/M L N/A	Y				
	Closet Pole		A/M L N/A	Y				
	Closet Shelf		A/M L N/A	Y				
	CI Supports		A/M L N/A	Y				
	Closet Floor		A/M L N/A	Y				
	Closet Ceiling		A/M L N/A	Y				
	Up Cab Frame	0.1	A/M L N/A	Y				
	Cab Door	0.0	A/M L N/A	Y				
	Up Cab Walls	0.2	A/M L N/A	Y				
	Up Cab Shlvs	0.0	A/M L N/A	Y				
	Supports	0.2	A/M L N/A	Y				
	Low Cab Fram	0.3	A/M L N/A	Y				
	Cab Door	0.0	A/M L N/A	Y				
	Low Cab Walls	0.1	A/M L N/A	Y				
	Low Cab Shlvs	0.0	A/M L N/A	Y				
	Supports	0.3	A/M L N/A	Y				
	Drawers	0.0	A/M L N/A	Y				
			M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

Inspector (print)

Lic #

Signature

Date

Page 8 Of 17

Risk Assessor (print)

Lic#

Signature

Date

Address of Property

917 MAIN ST

Apt #

City

VINEYARD HAVEN

BATHROOM

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A B C D	Up Walls	0.6	A/M L N/A	Y				
A B C D	Low Walls		A/M L N/A	Y				
A B C D	Baseboards	10.0	A/M L N/A	Y				
A B C D	Chair Rail		A/M L N/A	Y				
	Radiator		A/M L N/A	Y				
	Floor	CM	A/M L N/A	Y				
	Ceiling	N/A	A/M L N/A	Y				
	Door		A/M L N/A	Y				
B	Door Casing	4.3	A/M L N/A	Y				
	Door Jamb	4.0	A/M L N/A	Y				
	Threshold	2.3	A/M L N/A	Y				
A	Door	0.4	A/M L N/A	Y				
	Door Casing	10.0	A/M L N/A	Y				
	Door Jamb	0.6	A/M L N/A	Y				
	Threshold	0.4	A/M L N/A	Y				
	Window Sill	0.8/0.2	M/I A/M L N/A	Y				
	Win Apron	0.1/0.2	A/M L N/A	Y				
	Win Casing	4.5/2.0	A/M L N/A	Y				
	Header Stop	N/A/N/A	M/I A/M L N/A	Y				
2C	Int Stops	0.1/0.2	M/I A/M L N/A	Y				
	Win Int Sash	0.1/0.2	M/I A/M L N/A	Y				
	Exterior Sill	0.3/0.5	M/I A/M L N/A	Y				
	Part Bead	0.2	M/I A/M L N/A	Y				
	Blind Stop	0.2/0.2	M/I A/M L N/A	Y				
	Win Ext Sash	0.4/0.2	M/I A/M L N/A	Y				
	Up Cab Frame		A/M L N/A	Y				
	Up Cab Door		A/M L N/A	Y				
	Up Cab Walls		A/M L N/A	Y				
	Up Cab Shlvs		A/M L N/A	Y				
	Supports		A/M L N/A	Y				
			M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				

COMMENTS / STRUCTURAL DEFECTS:

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
	Low Cab Fram		A/M L N/A	Y				
	Low Cab Door		A/M L N/A	Y				
	Low Cab Walls		A/M L N/A	Y				
	Low Cab Shlvs		A/M L N/A	Y				
	Supports		A/M L N/A	Y				
	Drawers		A/M L N/A	Y				
	Closet Door		A/M L N/A	Y				
	Closet Casing		A/M L N/A	Y				
	Closet Jamb		A/M L N/A	Y				
	Closet Walls		A/M L N/A	Y				
	Cl Baseboard		A/M L N/A	Y				
	Closet Pole		A/M L N/A	Y				
	Closet Shelf		A/M L N/A	Y				
	Clos Supports		A/M L N/A	Y				
	Closet Floor		A/M L N/A	Y				
	Closet Ceiling		A/M L N/A	Y				
			M/I A/M L NA	Y				
			M/I A/M L NA	Y				
			M/I A/M L NA	Y				
			M/I A/M L NA	Y				
			M/I A/M L NA	Y				
			M/I A/M L NA	Y				
			M/I A/M L NA	Y				
			M/I A/M L NA	Y				
			M/I A/M L NA	Y				
			M/I A/M L NA	Y				
			M/I A/M L NA	Y				
			M/I A/M L NA	Y				
			M/I A/M L NA	Y				
			M/I A/M L NA	Y				

COMMENTS / STRUCTURAL DEFECTS:

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD
	LL/RA RepBath	1/17/02		

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

4/13/04

Inspector (print)

Lic #

Signature

Date

Risk Assessor (print)

Lic #

Signature

Date

Address of Property

917 MAIN ST

Apt #

City

VINEYARD HAVEN

ROOM

BATH #2

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A B C D	Up Walls	0.1	A/M L N/A	Y				
A B C D	Low Walls	CN	A/M L N/A	Y				
A B C D	Baseboards	0.2	A/M L N/A	Y				
A B C D	Chair Rail	0.0	A/M L N/A	Y				
	Radiator	0.6	A/M L N/A	Y				
	Floor	CN	A/M L N/A	Y				
	Ceiling	N/A	A/M L N/A	Y				
	Door	0.2	A/M L N/A	Y				
	Door Casing	0.0	A/M L N/A	Y				
	Door Jamb	0.3	A/M L N/A	Y				
	Threshold	N/A	A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Window Sill	0.1	M/I A/M L N/A	Y				
	Win Apron	0.0	A/M L N/A	Y				
	Win Casing	0.6	A/M L N/A	Y				
	Header Stop	N/A	M/I A/M L N/A	Y				
	Int Stops	0.2	M/I A/M L N/A	Y				
	Win Int Sash	0.3	M/I A/M L N/A	Y				
	Exterior Sill	0.0	M/I L N/A	Y				
	Part Bead	CN	M/I L N/A	Y				
	Blind Stop	0.2	M/I L N/A	Y				
	Win Ext Sash	0.1	M/I L N/A	Y				

COMMENTS / STRUCTURAL DEFECTS:

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
	Window Sill		M/I A/M L N/A	Y				
	Win Apron		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Header Stop		M/I A/M L N/A	Y				
	Int Stops		M/I A/M L N/A	Y				
	Win Int Sash		M/I A/M L N/A	Y				
	Exterior Sill		M/I L N/A	Y				
	Part Bead		M/I L N/A	Y				
	Blind Stop		M/I L N/A	Y				
	Win Ext Sash		M/I L N/A	Y				
	Window Sill		M/I A/M L N/A	Y				
	Win Apron		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Header Stop		M/I A/M L N/A	Y				
	Int Stops		M/I A/M L N/A	Y				
	Win Int Sash		M/I A/M L N/A	Y				
	Exterior Sill		M/I L N/A	Y				
	Part Bead		M/I L N/A	Y				
	Blind Stop		M/I L N/A	Y				
	Win Ext Sash		M/I L N/A	Y				
	Closet Door		A/M L N/A	Y				
	Cl Casing		A/M L N/A	Y				
	Closet Jamb		A/M L N/A	Y				
	Closet Walls		A/M L N/A	Y				
	Cl Baseboard		A/M L N/A	Y				
	Closet Pole		A/M L N/A	Y				
	Closet Shelf		A/M L N/A	Y				
	Cl Supports		A/M L N/A	Y				
	Closet Floor		A/M L N/A	Y				
	Closet Ceiling		A/M L N/A	Y				
	Fireplace		A/M L N/A	Y				
	Mantle		A/M L N/A	Y				
			M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

Inspector (print)

Lic #

Signature

Date

Risk Assessor (print)

Lic #

Signature

Date

Address of Property

917 MAIN ST

Apt #

City

VINEYARD HAVEN

HALLWAY

off kitchen

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A B C D	Up Walls	4.3	A/M L N/A	Y				
A B C D	Low Walls		A/M L N/A	Y				
A B C D	Baseboards	10.0	A/M L N/A	Y				
A B C D	Chair Rail		A/M L N/A	Y				
	Radiator		A/M L N/A	Y				
	Floor		A/M L N/A	Y				
	Ceiling		A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing	0.6	A/M L N/A	Y				
	Door Jamb	0.2	A/M L N/A	Y				
	Threshold	0.1	A/M L N/A	Y				
	Door	0.2	A/M L N/A	Y				
	Door Casing	5.5	A/M L N/A	Y				
	Door Jamb	5.9	A/M L N/A	Y				
	Threshold	2.0	A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Window Sill		M/I A/M L N/A	Y				
	Win Apron		A/M L N/A	Y				
	Win Casing		L N/A	Y				
	Header Stop		M/I L N/A	Y				
	Int Stops		M/I L N/A	Y				
	Win Int Sash		M/I L N/A	Y				
	Exterior Sill		M/I A/M L N/A	Y				
	Part Bead		M/I A/M L N/A	Y				
	Blind Stop		M/I A/M L N/A	Y				
	Win Ext Sash		M/I A/M L N/A	Y				

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
	Window Sill		M/I A/M L N/A	Y				
	Win Apron		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Header Stop		M/I A/M L N/A	Y				
	Int Stops		M/I A/M L N/A	Y				
	Win Int Sash		M/I A/M L N/A	Y				
	Exterior Sill		M/I A/M L N/A	Y				
	Part Bead		M/I A/M L N/A	Y				
	Blind Stop		M/I A/M L N/A	Y				
	Win Ext Sash		M/I A/M L N/A	Y				
	Closet Door		A/M L N/A	Y				
	Cl Casing		A/M L N/A	Y				
	Closet Jamb		A/M L N/A	Y				
	Closet Walls		A/M L N/A	Y				
	Cl Baseboard		A/M L N/A	Y				
	Closet Pole		A/M L N/A	Y				
	Closet Shelf		A/M L N/A	Y				
	Cl Supports		A/M L N/A	Y				
	Closet Floor		A/M L N/A	Y				
	Cl Ceiling		A/M L N/A	Y				
	Closet Door		A/M L N/A	Y				
	Cl Casing		A/M L N/A	Y				
	Closet Jamb		A/M L N/A	Y				
	Closet Walls		A/M L N/A	Y				
	Cl Baseboard		A/M L N/A	Y				
	Closet Pole		A/M L N/A	Y				
	Closet Shelf		A/M L N/A	Y				
	Cl Supports		A/M L N/A	Y				
	Closet Floor		A/M L N/A	Y				
	Cl Ceiling		A/M L N/A	Y				
			M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				

COMMENTS / STRUCTURAL DEFECTS:

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

4/13/04

Inspector (print)

Lic #

Signature

Date

Risk Assessor (print)

Lic #

Signature

Date

Address of Property

917 MAIN ST

Apt #

City

VINEYARD HAVEN

ROOM

HALL - 2ND FL.

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A B C D	Up Walls	10.0	A/M L N/A	Y				
A B C D	Low Walls		A/M L N/A	Y				
A B C D	Baseboards	10.0	A/M L N/A	Y				
A B C D	Chair Rail		A/M L N/A	Y				
	Radiator		A/M L N/A	Y				
	Floor	0.0	A/M L N/A	Y				
	Ceiling	N/A	A/M L N/A	Y				
	Door	0.6	A/M L N/A	Y				
A	Door Casing	2.5	A/M L N/A	Y				
U	Door Jamb	3.1	A/M L N/A	Y				
	Threshold	0.2	A/M L N/A	Y				
	Door	0.4	A/M L N/A	Y				
A	Door Casing	3.4	A/M L N/A	Y				
U	Door Jamb	2.1	A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Door	0.1	A/M L N/A	Y				
B	Door Casing	4.3	A/M L N/A	Y				
	Door Jamb	2.5	A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
C	Door	0.6	A/M L N/A	Y				
	Door Casing	1.9	A/M L N/A	Y				
	Door Jamb	0.1	A/M L N/A	Y				
	Threshold	N/A	A/M L N/A	Y				
	Window Sill		M/I A/M L N/A	Y				
	Win Apron		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Header Stop	M/I	A/M L N/A	Y				
	Int Stops	M/I	A/M L N/A	Y				
	Win Int Sash	M/I	A/M L N/A	Y				
	Exterior Sill	M/I	L N/A	Y				
	Part Bead	M/I	L N/A	Y				
	Blind Stop	M/I	L N/A	Y				
	Win Ext Sash	M/I	L N/A	Y				

COMMENTS / STRUCTURAL DEFECTS:

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
	Window Sill		M/I A/M L N/A	Y				
	Win Apron		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Header Stop	M/I	A/M L N/A	Y				
	Int Stops	M/I	A/M L N/A	Y				
	Win Int Sash	M/I	A/M L N/A	Y				
	Exterior Sill	M/I	L N/A	Y				
	Part Bead	M/I	L N/A	Y				
	Blind Stop	M/I	L N/A	Y				
	Win Ext Sash	M/I	L N/A	Y				
	Window Sill		M/I A/M L N/A	Y				
	Win Apron		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Header Stop	M/I	A/M L N/A	Y				
	Int Stops	M/I	A/M L N/A	Y				
	Win Int Sash	M/I	A/M L N/A	Y				
	Exterior Sill	M/I	L N/A	Y				
	Part Bead	M/I	L N/A	Y				
	Blind Stop	M/I	L N/A	Y				
	Win Ext Sash	M/I	L N/A	Y				
	Closet Door	0.1	A/M L N/A	Y				
	Cl Casing	10.0	A/M L N/A	Y				
	Closet Jamb	3.2	A/M L N/A	Y				
	Closet Walls	10.0	A/M L N/A	Y				
A	Cl Baseboard	10.0	A/M L N/A	Y				
	Closet Pole		A/M L N/A	Y				
	Closet Shelf	10.0	A/M L N/A	Y				
	Cl Supports	10.0	A/M L N/A	Y				
	Closet Floor	0.0	A/M L N/A	Y				
	Closet Ceiling	N/A	A/M L N/A	Y				
	Fireplace		A/M L N/A	Y				
	Mantle		A/M L N/A	Y				
D	Door	0.2	M/I A/M L N/A	Y				
	Casing	3.6	M/I A/M L N/A	Y				
	Jamb	4.1	M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

4/13/04

Page 12 Of 17

Inspector (print)

Lic #

Signature

Date

Risk Assessor (print)

Lic #

Signature

Date

Address of Property

917 MAIN ST.

Apt #

City

VINEYARD HAVEN

STAIRCASE

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A B C D	Up Walls	10.0	A/M L N/A	Y				
A B C D	Low Walls		A/M L N/A	Y				
A B C D	Baseboards	10.0	A/M L N/A	Y				
A B C D	Chair Rail		A/M L N/A	Y				
	Radiator	0.5	A/M L N/A	Y				
	Floor	CN	A/M L N/A	Y				
	Ceiling	N/A	A/M L N/A	Y				
	Door	0.6	A/M L N/A	Y				
A 1st	Door Casing	0.2	A/M L N/A	Y				
	Door Jamb	5.1	A/M L N/A	Y				
	Threshold	1.9	A/M L N/A	Y				
B 1st	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
2D 1st	Door		A/M L N/A	Y				
	Door Casing	0.6 0.3	A/M L N/A	Y				
	Door Jamb	0.2 0.1	A/M L N/A	Y				
	Threshold	N/C	A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Window Sill	0.5	M/I A/M L N/A	Y				
	Win Apron	4.0	A/M L N/A	Y				
	Win Casing	3.7	A/M L N/A	Y				
	Header Stop	N/A	M/I A/M L N/A	Y				
A 1st	Int Stops	0.5	M/I A/M L N/A	Y				
	Win Int Sash	0.0	M/I A/M L N/A	Y				
	Exterior Sill	0.6	M/I A/M L N/A	Y				
	Part Bead	CN	M/I A/M L N/A	Y				
	Blind Stop	0.2	M/I A/M L N/A	Y				
	Win Ext Sash	0.5	M/I A/M L N/A	Y				

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
	Closet Door		A/M L N/A	Y				
	Cl Casing		A/M L N/A	Y				
	Closet Jamb		A/M L N/A	Y				
	Closet Walls		A/M L N/A	Y				
	Cl Baseboard		A/M L N/A	Y				
	Closet Pole		A/M L N/A	Y				
	Closet Shelf		A/M L N/A	Y				
	Cl Supports		A/M L N/A	Y				
	Closet Floor		A/M L N/A	Y				
	Closet Ceiling		A/M L N/A	Y				
	Newel Post	0.1	A/M L N/A	Y				
	Railing Cap	0.0	A/M L N/A	Y				
	Handrail	0.2	A/M L N/A	Y				
	Balusters	0.0	A/M L N/A	Y				
	Lower rail		A/M L N/A	Y				
	Treads	0.1	A/M L N/A	Y				
	Risers	10.0	A/M L N/A	Y				
	Stringer	10.0	A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Floor Casing		A/M L N/A	Y				
			M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				

COMMENTS / STRUCTURAL DEFECTS:

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

4/13/04

Inspector (print)

Lic #

Signature

Date

Risk Assessor (print)

Lic #

Signature

Date

Address of Property

917 MAIN ST

Apt #

City VINEYARD

HAVEN

ROOM

to basement

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A B C D	Up Walls	5.9	A/M L N/A	Y				
A B C D	Low Walls	10.0	A/M L N/A	Y				
A B C D	Baseboards		A/M L N/A	Y				
A B C D	Chair Rail		A/M L N/A	Y				
	Radiator		A/M L N/A	Y				
	Floor		A/M L N/A	Y				
	Ceiling		A/M L N/A	Y				
	Door	10.0	A/M L N/A	Y				
D	Door Casing	10.0	A/M L N/A	Y				
	Door Jamb	10.0	A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Door	10.0	A/M L N/A	Y				
B	Door Casing	10.0	A/M L N/A	Y				
	Door Jamb	10.0	A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Window Sill	10.0	M/I A/M L N/A	Y				
	Win Apron	10.0	A/M L N/A	Y				
	Win Casing	10.0	A/M L N/A	Y				
	Header Stop		M/I A/M L N/A	Y				
	Int Stops		M/I A/M L N/A	Y				
	Win Int Sash		M/I A/M L N/A	Y				
	Exterior Sill		M/I L N/A	Y				
	Part Bead		M/I L N/A	Y				
	Blind Stop		M/I L N/A	Y				
	Win Ext Sash		M/I L N/A	Y				

COMMENTS / STRUCTURAL DEFECTS:

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
	Window Sill		M/I A/M L N/A	Y				
	Win Apron		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Header Stop		M/I A/M L N/A	Y				
	Int Stops		M/I A/M L N/A	Y				
	Win Int Sash		M/I A/M L N/A	Y				
	Exterior Sill		M/I L N/A	Y				
	Part Bead		M/I L N/A	Y				
	Blind Stop		M/I L N/A	Y				
	Win Ext Sash		M/I L N/A	Y				
	Window Sill		M/I A/M L N/A	Y				
	Win Apron		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Header Stop		M/I A/M L N/A	Y				
	Int Stops		M/I A/M L N/A	Y				
	Win Int Sash		M/I A/M L N/A	Y				
	Exterior Sill		M/I L N/A	Y				
	Part Bead		M/I L N/A	Y				
	Blind Stop		M/I L N/A	Y				
	Win Ext Sash		M/I L N/A	Y				
	Closet Door	10.0	A/M L N/A	Y				
	Cl Casing	10.0	A/M L N/A	Y				
	Closet Jamb	10.0	A/M L N/A	Y				
	Closet Walls	10.0	A/M L N/A	Y				
	Cl Baseboard		A/M L N/A	Y				
	Closet Pole		A/M L N/A	Y				
	Closet Shelf	10.0	A/M L N/A	Y				
	Cl Supports	10.0	A/M L N/A	Y				
	Closet Floor		A/M L N/A	Y				
	Closet Ceiling		A/M L N/A	Y				
	Fireplace		A/M L N/A	Y				
	Mantle		A/M L N/A	Y				
	Tread	10.0	M/I A/M L N/A	Y				
	Riser	10.0	M/I A/M L N/A	Y				
	Lower Wall	10.0	M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

4/13/04

Page 14 Of 17

Inspector (print)

Lic #

Signature

Date

Risk Assessor (print)

Lic#

Signature

Date

Address of Property

917 MAIN ST.

Apt #

City

VINEYARD HAVEN

EXTERIOR

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A	Siding	0.2	A/M L N/A	Y				
	Corner Boards		A/M L N/A	Y				
	Lower Trim		A/M L N/A	Y				
	Upper Trim	N/A	A/M L N/A	Y				
	Win Above 5'		A/M L N/A	Y				
	Porch Above 5'		A/M L N/A	Y				
A	Storm Door	0.0	A/M L N/A	Y				
	Door	0.3	A/M L N/A	Y				
	Door Casing	0.6	A/M L N/A	Y				
	Door Jamb	5.9	A/M L N/A	Y				
	Threshold	1.4	A/M L N/A	Y				
	Kickplate		A/M L N/A	Y				
A	Storm Door		A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Kickplate		A/M L N/A	Y				
A	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
A	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
A	Window Sill	0.2	A/M L N/A	Y				
	Win Casing	5.1	A/M L N/A	Y				
	Window Sash	0.2	A/M L N/A	Y				
A	Window Sill		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Window Sash		A/M L N/A	Y				

COMMENTS / STRUCTURAL DEFECTS:

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A	Window Sill		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Window Sash		A/M L N/A	Y				
A	Window Sill		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Window Sash		A/M L N/A	Y				
A	Cellar Win Sill	10.0	A/M L N/A	Y				
	Cel Win Sash	10.0	A/M L N/A	Y				
	Cel Win Frame	10.0	A/M L N/A	Y				
A	Cellar Win Sill		A/M L N/A	Y				
	Cel Win Sash		A/M L N/A	Y				
	Cel Win Frame		A/M L N/A	Y				
A	Cellar Win Sill		A/M L N/A	Y				
	Cel Win Sash		A/M L N/A	Y				
	Cel Win Frame		A/M L N/A	Y				
A	Foundation	1.1	A/M L N/A	Y				
	Bulkhead		A/M L N/A	Y				
	Fences	6.0	A/M L N/A	Y				
A	Shutters		A/M L N/A	Y				
	Newel post	2.9	A/M L N/A	Y				
	Railing Cap	0.3	A/M L N/A	Y				
A	Handrail	0.0	A/M L N/A	Y				
	Balusters		A/M L N/A	Y				
	Lower Rail	0.0	A/M L N/A	Y				
A	Treads	0.4	A/M L N/A	Y				
	Risers	0.3	A/M L N/A	Y				
	Stringer	0.6	A/M L N/A	Y				
A	Floor	0.2	A/M L N/A	Y				
	Ceiling	N/A	A/M L N/A	Y				
			A/M L N/A	Y				
A			A/M L N/A	Y				
			A/M L N/A	Y				
			A/M L N/A	Y				

Excluded Surfaces: Surfaces listed in this box can be made
intact only by a licensed deleader

Soil Test Results

(Must be less than 400 ppm for play area / 1200 ppm for bare soil)

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 1440 SQ. IN.)	IC DATE	IC METH
A				
A				
A				
A				

LOCATION	AREA MEASUREMENT (Square Feet)	RESULT (PPM)	REMED DATE	REMED METH
Play Area				
Bare soil				
Comments:				

Inspector (print)

Lic #

Signature

Date

Page 15 Of 17

Risk Assessor (print)

Lic#

Signature

Date

Address of Property

917 MAIN ST

Apt #

City

VINEYARD HAVEN

EXTERIOR

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
B	Siding	0.6	A/M L N/A	Y				
	Corner Boards		A/M L N/A	Y				
	Lower Trim		A/M L N/A	Y				
	Upper Trim	N/A	A/M L N/A	Y				
	Win Above 5'		A/M L N/A	Y				
	Porch Above 5'		A/M L N/A	Y				
B	Storm Door		A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Kickplate		A/M L N/A	Y				
B	Storm Door		A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Kickplate		A/M L N/A	Y				
B	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
B	Window Sill	0.3	A/M L N/A	Y				
	Win Casing	0.6	A/M L N/A	Y				
	Window Sash	0.2	A/M L N/A	Y				
B	Window Sill		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Window Sash		A/M L N/A	Y				

COMMENTS / STRUCTURAL DEFECTS:

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
B	Window Sill		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Window Sash		A/M L N/A	Y				
B	Window Sill		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Window Sash		A/M L N/A	Y				
B	Cellar Win Sill	10.0	A/M L N/A	Y				
	Cel Win Sash	10.0	A/M L N/A	Y				
	Cel Win Frame	10.0	A/M L N/A	Y				
B	Cellar Win Sill		A/M L N/A	Y				
	Cel Win Sash		A/M L N/A	Y				
	Cel Win Frame		A/M L N/A	Y				
B	Cellar Win Sill		A/M L N/A	Y				
	Cel Win Sash		A/M L N/A	Y				
	Cel Win Frame		A/M L N/A	Y				
B	Foundation	2.0	A/M L N/A	Y				
	Bulkhead		A/M L N/A	Y				
	Fences		A/M L N/A	Y				
	Shutters		A/M L N/A	Y				
B	Newel post		A/M L N/A	Y				
	Railing Cap		A/M L N/A	Y				
	Handrail		A/M L N/A	Y				
	Balusters		A/M L N/A	Y				
	Lower Rail		A/M L N/A	Y				
	Treads		A/M L N/A	Y				
	Risers		A/M L N/A	Y				
	Stringer		A/M L N/A	Y				
B			A/M L N/A	Y				
			A/M L N/A	Y				
			A/M L N/A	Y				
			A/M L N/A	Y				

Excluded Surfaces: Surfaces listed in this box can be made
intact only by a licensed deleader

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 1440 SQ. IN.)	IC DATE	IC METH
B				
B				
B				
B				

Soil Test Results

(Must be less than 400 ppm for play area / 1200 ppm for bare soil)

LOCATION	AREA MEASUREMENT (Square Feet)	RESULT (PPM)	REMED DATE	REMED METH
Play Area				
Bare soil				
Comments:				

Inspector (print)

Lic #

Signature

Date

Page 16 Of 17

Risk Assessor (print)

Lic#

Signature

Date

Address of Property

917 MAIN ST.

Apt #

City

VINEYARD HAVEN

EXTERIOR

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
C	Siding	0.4	A/M L N/A	Y				
	Corner Boards		A/M L N/A	Y				
	Lower Trim		A/M L N/A	Y				
	Upper Trim	N/A	A/M L N/A	Y				
	Win Above 5'		A/M L N/A	Y				
	Porch Above 5'		A/M L N/A	Y				
C	Storm Door	0.3	A/M L N/A	Y				
	Door	0.5	A/M L N/A	Y				
	Door Casing	0.9	A/M L N/A	Y				
	Door Jamb	8.1	A/M L N/A	Y				
	Threshold	2.0	A/M L N/A	Y				
	Kickplate		A/M L N/A	Y				
C	Storm Door		A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Kickplate		A/M L N/A	Y				
C	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
C	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
C	Window Sill	N/A	A/M L N/A	Y				
	Win Casing	N/A	A/M L N/A	Y				
	Window Sash	ON	A/M L N/A	Y				
C	Window Sill		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Window Sash		A/M L N/A	Y				

COMMENTS / STRUCTURAL DEFECTS:

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
C	Window Sill		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Window Sash		A/M L N/A	Y				
C	Window Sill		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Window Sash		A/M L N/A	Y				
C	Cellar Win Sill		A/M L N/A	Y				
	Cel Win Sash		A/M L N/A	Y				
	Cel Win Frame		A/M L N/A	Y				
C	Cellar Win Sill		A/M L N/A	Y				
	Cel Win Sash		A/M L N/A	Y				
	Cel Win Frame		A/M L N/A	Y				
C	Cellar Win Sill		A/M L N/A	Y				
	Cel Win Sash		A/M L N/A	Y				
	Cel Win Frame		A/M L N/A	Y				
C	Foundation	0.3	A/M L N/A	Y				
	Bulkhead		A/M L N/A	Y				
	Fences		A/M L N/A	Y				
	Shutters		A/M L N/A	Y				
C	Newel post	0.6	A/M L N/A	Y				
	Railing Cap	0.2	A/M L N/A	Y				
	Handrail	0.5	A/M L N/A	Y				
	Balusters		A/M L N/A	Y				
	Lower Rail	0.2	A/M L N/A	Y				
	Treads	0.6	A/M L N/A	Y				
	Risers	0.3	A/M L N/A	Y				
C	Stringer	0.3	A/M L N/A	Y				
	Floor	0.3	A/M L N/A	Y				
	Ceiling	N/A	A/M L N/A	Y				
			A/M L N/A	Y				
			A/M L N/A	Y				
			A/M L N/A	Y				
			A/M L N/A	Y				

Soil Test Results

(Must be less than 400 ppm for play area / 1200 ppm for bare soil)

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 1440 SQ. IN.)	IC DATE	IC METH
C				
C				
C				
C				

LOCATION	AREA MEASUREMENT (Square Feet)	RESULT (PPM)	REMED DATE	REMED METH
Play Area				
Bare soil				
Comments:				

Inspector (print)

Lic#

Signature

Date

Page 17 Of 17

Risk Assessor (print)

Lic#

Signature

Date

Address of Property

Apt #

City

EXTERIOR

SIDE D	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
D	Siding	0.4	A/M L N/A	Y				
	Corner Boards		A/M L N/A	Y				
	Lower Trim		A/M L N/A	Y				
	Upper Trim	N/A	A/M L N/A	Y				
	Win Above 5'		A/M L N/A	Y				
	Porch Above 5'		A/M L N/A	Y				
D	Storm Door		A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Kickplate		A/M L N/A	Y				
D	Storm Door		A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Kickplate		A/M L N/A	Y				
D	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
D	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
D	Window Sill		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Window Sash		A/M L N/A	Y				
	Window Sill	0.2	A/M L N/A	Y				
D	Win Casing	0.6	A/M L N/A	Y				
	Window Sash	0.2	A/M L N/A	Y				

COMMENTS / STRUCTURAL DEFECTS:

SIDE D	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
D	Window Sill		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Window Sash		A/M L N/A	Y				
D	Window Sill		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Window Sash		A/M L N/A	Y				
D	Cellar Win Sill	0.2	A/M L N/A	Y				
	Cel Win Sash	0.2	A/M L N/A	Y				
	Cel Win Frame	0.2	A/M L N/A	Y				
D	Cellar Win Sill		A/M L N/A	Y				
	Cel Win Sash		A/M L N/A	Y				
	Cel Win Frame		A/M L N/A	Y				
D	Cellar Win Sill		A/M L N/A	Y				
	Cel Win Sash		A/M L N/A	Y				
	Cel Win Frame		A/M L N/A	Y				
D	Foundation	0.2	A/M L N/A	Y				
	Bulkhead	0.2	A/M L N/A	Y				
	Fences		A/M L N/A	Y				
	Shutters		A/M L N/A	Y				
D	Newel post		A/M L N/A	Y				
	Railing Cap		A/M L N/A	Y				
	Handrail		A/M L N/A	Y				
	Balusters		A/M L N/A	Y				
	Lower Rail		A/M L N/A	Y				
	Treads		A/M L N/A	Y				
	Risers		A/M L N/A	Y				
	Stringer		A/M L N/A	Y				
			A/M L N/A	Y				
D			A/M L N/A	Y				
			A/M L N/A	Y				
			A/M L N/A	Y				
			A/M L N/A	Y				
			A/M L N/A	Y				

Excluded Surfaces: Surfaces listed in this box can be made
intact only by a licensed deleader

Soil Test Results

(Must be less than 400 ppm for play area / 1200 ppm for bare soil)

SIDE D	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 1440 SQ. IN.)	IC DATE	IC METH
D				
D				
D				
D				

LOCATION	AREA MEASUREMENT (Square Feet)	RESULT (PPM)	REMED DATE	REMED METH
Play Area				
Bare soil				
Comments:				

Lead Inspection / Risk Assessment Report

Page 1 of 17

Franklin Analytical Services, Inc.

401 Delano Road • Marion, MA 02738 • Tel: (508) 748-3156 • Fax: (508) 748-9713

Method Used:

☐ Na₂S Exp. Date _____

☒ X-Ray Fluorescence

Model XK3 Serial 1511

St.# 921 Address 1A1A

City VINEYARD HAVEN Zip Code 02542

Apt.

Owner Name: USCG AIR STATION CAPE (U)

Owner Address: OTIS ANG B
BARNSTABLE, MA 02542-5024

Client Name (if different from owner): _____

Client Address: _____

Single Family ☒
Multi Family _____
Units _____
Condominium _____
Day Care _____

Key:	Inspection	Defecting	Other
A/M	Accessible/Mouthable	CAP	Capped
CAP	Capped	COV	Covered
COV	Covered	DIP	Dipped
INT	Intact	ENC	Encapsulated
L	Loose	MI	Made Intact
MI	Moveable/Impacted	PRE	Prepared
MET	Metal	REM	Removed
NA	Not Accessible	REP	Replaced
NC	No Coating	REV	Reversed
NEG	Negative	SCR	Scraped
POS	Positive	VR	Vinyl Replacement
VR	Vinyl Replacement		

☒ Comprehensive Inspection (Y/N)

Comments:


WEST CHOP LIGHT
UNIT 1

Floor# 1 C



A (Street Side)

Floor# 2 C

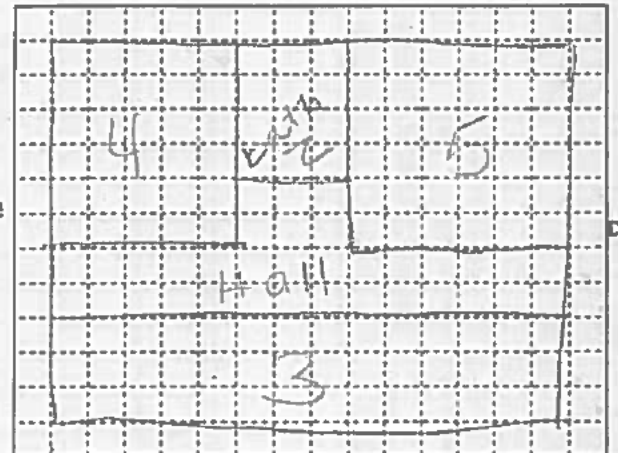

A (Street Side)

Pb (lead) equal to or greater than 1.0 mg/cm² with x-ray fluorescence or positive with Na₂S is Dangerous.

INSP. DATE
04/13/04

Lead Hazards? (Y or N)
Y

(b) (6)

Inspector (print)

Signature

Lic.#

R.A. DATE

Urgent Lead Hazards? (Y or N)

Risk Assessor (print)

Signature

Lic.#

(b) (6)

4/13/04

Page 2 of 17

Inspector (print)

Lic #

Signature

Date

Risk Assessor (print)

Lic #

Signature

Date

Address of Property

921 MAIN ST

Apt #

City VINEYARD HAVEN

ROOM - 1

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A B C D	Up Walls	3.2	A/M L N/A	Y				
A B C D	Low Walls		A/M L N/A	Y				
A B C D	Baseboards	4.5	A/M L N/A	Y				
A B C D	Chair Rail		A/M L N/A	Y				
	Radiator		A/M L N/A	Y				
	Floor	N/C	A/M L N/A	Y				
	Ceiling	N/C	A/M L N/A	Y				
	Door		A/M L N/A	Y				
C	Door Casing	0.2	A/M L N/A	Y				
	Door Jamb	0.6	A/M L N/A	Y				
	Threshold	N/C	A/M L N/A	Y				
D	Door		A/M L N/A	Y				
	Door Casing	0.2	A/M L N/A	Y				
	Door Jamb	0.0	A/M L N/A	Y				
	Threshold	N/C	A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Window Sill	0.4	M1 A/M L N/A	Y				
	Win Apron	0.5	A/M L N/A	Y				
	Win Casing	0.5	A/M L N/A	Y				
	Header Stop	N/A	M1 A/M L N/A	Y				
	Int Stops	0.1	M1 A/M L N/A	Y				
	Win Int Sash	0.3	M1 A/M L N/A	Y				
	Exterior Sill	0.4	M1 L N/A	Y				
	Part Bead	N	M1 L N/A	Y				
	Blind Stop	0.3	M1 L N/A	Y				
	Win Ext Sash	0.4	M1 L N/A	Y				

COMMENTS / STRUCTURAL DEFECTS:

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
	Window Sill	0.4	M1 A/M L N/A	Y				
	Win Apron	0.5	A/M L N/A	Y				
	Win Casing	0.2	A/M L N/A	Y				
B	Header Stop	N/A	M1 A/M L N/A	Y				
	Int Stops	0.3	M1 A/M L N/A	Y				
	Win Int Sash	0.4	M1 A/M L N/A	Y				
	Exterior Sill	0.4	M1 L N/A	Y				
	Part Bead	N	M1 L N/A	Y				
	Blind Stop	0.2	M1 L N/A	Y				
	Win Ext Sash	0.7	M1 L N/A	Y				
	Window Sill	0.4	M1 A/M L N/A	Y				
	Win Apron	0.6	A/M L N/A	Y				
	Win Casing	0.5	A/M L N/A	Y				
D	Header Stop	N/A	M1 A/M L N/A	Y				
	Int Stops	0.0	M1 A/M L N/A	Y				
	Win Int Sash	0.1	M1 A/M L N/A	Y				
	Exterior Sill	0.3	M1 L N/A	Y				
	Part Bead	N	M1 L N/A	Y				
	Blind Stop	0.2	M1 L N/A	Y				
	Win Ext Sash	0.6	M1 L N/A	Y				
	Closet Door		A/M L N/A	Y				
	Cl Casing		A/M L N/A	Y				
	Closet Jamb		A/M L N/A	Y				
	Closet Walls		A/M L N/A	Y				
	Cl Baseboard		A/M L N/A	Y				
	Closet Pole		A/M L N/A	Y				
	Closet Shelf		A/M L N/A	Y				
	Cl Supports		A/M L N/A	Y				
	Closet Floor		A/M L N/A	Y				
	Closet Ceiling		A/M L N/A	Y				
	Fireplace		A/M L N/A	Y				
	Mantle		A/M L N/A	Y				
			M1 A/M L N/A	Y				
			M1 A/M L N/A	Y				
			M1 A/M L N/A	Y				
			M1 A/M L N/A	Y				
			M1 A/M L N/A	Y				

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

(b) (6)

4/13/04

Page 3 of 17

Inspector (print)

Lic #

Signature

Date

Risk Assessor (print)

Lic #

Signature

Date

Address of Property

921 MAIN ST

Apt #

City VINEYARD HAVEN

ROOM

2

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A B C D	Up Walls	3.1	A/M L N/A	Y				
A B C D	Low Walls		A/M L N/A	Y				
A B C D	Baseboards	4.5	A/M L N/A	Y				
A B C D	Chair Rail		A/M L N/A	Y				
	Radiator	0.9	A/M L N/A	Y				
	Floor	N/A	A/M L N/A	Y				
	Ceiling	N/A	A/M L N/A	Y				
A	Door	0.2	A/M L N/A	Y				
	Door Casing	0.2	A/M L N/A	Y				
	Door Jamb	0.5	A/M L N/A	Y				
	Threshold	N/A	A/M L N/A	Y				
C	Door	0.2	A/M L N/A	Y				
	Door Casing	2.5	A/M L N/A	Y				
	Door Jamb	2.3	A/M L N/A	Y				
	Threshold	N/A	A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
D	Window Sill	0.3	M/L A/M L N/A	Y				
	Win Apron	0.6	A/M L N/A	Y				
	Win Casing	0.5	A/M L N/A	Y				
	Header Stop	N/A	M/L A/M L N/A	Y				
	Int Stops	2.0	M/L A/M L N/A	Y				
	Win Int Sash	0.2	M/L A/M L N/A	Y				
	Exterior Sill	5.1	M/L L N/A	Y				
	Part Bead	0.0	M/L L N/A	Y				
	Blind Stop	0.6	M/L L N/A	Y				
	Win Ext Sash	0.5	M/L L N/A	Y				

COMMENTS / STRUCTURAL DEFECTS:

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
	Window Sill		M/L A/M L N/A	Y				
	Win Apron		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Header Stop		M/L A/M L N/A	Y				
	Int Stops		M/L A/M L N/A	Y				
	Win Int Sash		M/L A/M L N/A	Y				
	Exterior Sill		M/L L N/A	Y				
	Part Bead		M/L L N/A	Y				
	Blind Stop		M/L L N/A	Y				
	Win Ext Sash		M/L L N/A	Y				
Hu	Closet Door	2.3	A/M L N/A	Y				
	Cl Casing	2.5	A/M L N/A	Y				
	Closet Jamb	2.6	A/M L N/A	Y				
	Closet Walls	3.1	A/M L N/A	Y				
	Cl Baseboard		A/M L N/A	Y				
	Closet Pole		A/M L N/A	Y				
	Closet Shelf	10.0	A/M L N/A	Y				
	Cl Supports	10.0	A/M L N/A	Y				
	Closet Floor	N/A	A/M L N/A	Y				
	Closet Ceiling	N/A	A/M L N/A	Y				
	Fireplace		A/M L N/A	Y				
	Mantle		A/M L N/A	Y				
			M/L A/M L N/A	Y				
			M/L A/M L N/A	Y				
			M/L A/M L N/A	Y				
			M/L A/M L N/A	Y				
			M/L A/M L N/A	Y				

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

(b) (6)

4-13-04

Page 4 of 17

Inspector (print)

Lic #

Signature

Date

Risk Assessor (print)

Lic #

Signature

Date

Address of Property

921 MAIN ST

Apt #

City VINEYARD HAVEN

ROOM

3

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A B C D	Up Walls	10.0	A/M L N/A	Y				
A B C D	Low Walls		A/M L N/A	Y				
A B C D	Baseboards	10.0	A/M L N/A	Y				
A B C D	Chair-Rail		A/M L N/A	Y				
	Radiator		A/M L N/A	Y				
	Floor	N/A	A/M L N/A	Y				
	Ceiling	N/A	A/M L N/A	Y				
	Door	0.2	A/M L N/A	Y				
	Door Casing	2.0	A/M L N/A	Y				
	Door Jamb	2.1	A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Door	0.2	A/M L N/A	Y				
	Door Casing	2.5	A/M L N/A	Y				
	Door Jamb	1.1	A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Window Sill	10.0	M/I A/M L N/A	Y				
	Win Apron	2.0	A/M L N/A	Y				
	Win Casing	3.1	A/M L N/A	Y				
	Header Stop	N/A	M/I A/M L N/A	Y				
	Int Stops	5.7	M/I A/M L N/A	Y				
	Win Int Sash	0.5	M/I A/M L N/A	Y				
	Exterior Sill	0.7	M/I L N/A	Y				
	Part Bead	0.2	M/I L N/A	Y				
	Blind Stop	0.3	M/I L N/A	Y				
	Win Ext Sash	0.6	M/I L N/A	Y				

COMMENTS / STRUCTURAL DEFECTS:

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
	Window Sill		M/I A/M L N/A	Y				
	Win Apron		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Header Stop	M/I	A/M L N/A	Y				
	Int Stops	M/I	A/M L N/A	Y				
	Win Int Sash	M/I	A/M L N/A	Y				
	Exterior Sill	M/I	L N/A	Y				
	Part Bead	M/I	L N/A	Y				
	Blind Stop	M/I	L N/A	Y				
	Win Ext Sash	M/I	L N/A	Y				
	Closet Door	3.1	A/M L N/A	Y				
	Cl Casing	2.8	A/M L N/A	Y				
	Closet Jamb	3.1	A/M L N/A	Y				
	Closet Walls	10.0	A/M L N/A	Y				
	Cl Baseboard	10.0	A/M L N/A	Y				
	Closet Pole	4.0	A/M L N/A	Y				
	Closet Shelf	5.1	A/M L N/A	Y				
	Cl Supports	10.0	A/M L N/A	Y				
	Closet Floor	N/A	A/M L N/A	Y				
	Closet Ceiling	N/A	A/M L N/A	Y				
	Fireplace		A/M L N/A	Y				
	Mantle		A/M L N/A	Y				
			M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

(b) (6)

4.13.04

Page 5 of 17

Inspector (print)

Lic #

Signature

Date

Risk Assessor (print)

Lic #

Signature

Date

Address of Property

921

MAIN

ST.

Apt #

City VINEYARD HAVEN

ROOM

4

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A B C D	Up Walls	3.5	A/M L N/A	Y				
A B C D	Low Walls		A/M L N/A	Y				
A B C D	Baseboards	10.0	A/M L N/A	Y				
A B C D	Chair Rail		A/M L N/A	Y				
	Radiator	2.3	A/M L N/A	Y				
	Floor	N/A	A/M L N/A	Y				
	Ceiling	N/A	A/M L N/A	Y				
	Door	2.4	A/M L N/A	Y				
A	Door Casing	3.5	A/M L N/A	Y				
	Door Jamb	2.1	A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
D	Door	0.0	A/M L N/A	Y				
	Door Casing	3.9	A/M L N/A	Y				
	Door Jamb	2.8	A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
B	Window Sill	0.4	M1 A/M L N/A	Y				
	Win Apron	1.9	A/M L N/A	Y				
	Win Casing	3.5	A/M L N/A	Y				
	Header Stop	N/A	M1 A/M L N/A	Y				
	Int Stops	0.3	M1 A/M L N/A	Y				
	Win Int Sash	0.1	M1 A/M L N/A	Y				
	Exterior Sill	0.5	M1 L N/A	Y				
	Part Bead	0.2	M1 L N/A	Y				
	Blind Stop	0.0	M1 L N/A	Y				
	Win Ext Sash	0.6	M1 L N/A	Y				

COMMENTS / STRUCTURAL DEFECTS:

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
	Window Sill		M1 A/M L N/A	Y				
	Win Apron		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Header Stop	M1	A/M L N/A	Y				
	Int Stops	M1	A/M L N/A	Y				
	Win Int Sash	M1	A/M L N/A	Y				
	Exterior Sill	M1	L N/A	Y				
	Part Bead	M1	L N/A	Y				
	Blind Stop	M1	L N/A	Y				
	Win Ext Sash	M1	L N/A	Y				
	Window Sill		M1 A/M L N/A	Y				
	Win Apron		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Header Stop	M1	A/M L N/A	Y				
	Int Stops	M1	A/M L N/A	Y				
	Win Int Sash	M1	A/M L N/A	Y				
	Exterior Sill	M1	L N/A	Y				
	Part Bead	M1	L N/A	Y				
	Blind Stop	M1	L N/A	Y				
	Win Ext Sash	M1	L N/A	Y				
	Closet Door	0.2	A/M L N/A	Y				
	Cl Casing	3.9	A/M L N/A	Y				
	Closet Jamb	2.5	A/M L N/A	Y				
	Closet Walls	10.0	A/M L N/A	Y				
	Cl Baseboard	10.0	A/M L N/A	Y				
	Closet Pole		A/M L N/A	Y				
	Closet Shelf	N/A	A/M L N/A	Y				
	Cl Supports	5	A/M L N/A	Y				
	Closet Floor	N/A	A/M L N/A	Y				
	Closet Ceiling	N/A	A/M L N/A	Y				
	Fireplace		A/M L N/A	Y				
	Mantle		A/M L N/A	Y				
			M1 A/M L N/A	Y				
			M1 A/M L N/A	Y				
			M1 A/M L N/A	Y				
			M1 A/M L N/A	Y				
			M1 A/M L N/A	Y				

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

4-13-04

Page 6 of 17

Inspector (print)

Lic #

Signature

Date

Risk Assessor (print)

Lic #

Signature

Date

Address of Property

921 MAIN ST

Apt #

City VINEYARD HAVEN

ROOM

5

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A B C D	Up Walls	0.1	A/M L N/A	Y				
A B C D	Low Walls		A/M L N/A	Y				
A B C D	Baseboards	0.1	A/M L N/A	Y				
A B C D	Chair Rail		A/M L N/A	Y				
	Radiator	0.1	A/M L N/A	Y				
	Floor	N/A	A/M L N/A	Y				
	Ceiling	N/A	A/M L N/A	Y				
B	Door	0.1	A/M L N/A	Y				
	Door Casing	3.6	A/M L N/A	Y				
	Door Jamb	0.8	A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
C	Door	0.2	A/M L N/A	Y				
	Door Casing	0.0	A/M L N/A	Y				
	Door Jamb	N/A	A/M L N/A	Y				
	Threshold	N/A	A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
D	Window Sill	3.2	M/L A/M L N/A	Y				
	Win Apron	2.0	A/M L N/A	Y				
	Win Casing	3.2	A/M L N/A	Y				
	Header Stop	N/A	M/L A/M L N/A	Y				
	Int Stops	5.1	M/L A/M L N/A	Y				
	Win Int Sash	5.4	M/L A/M L N/A	Y				
	Exterior Sill	5.1	M/L L N/A	Y				
	Part Bead	N	M/L L N/A	Y				
	Blind Stop	0.1	M/L L N/A	Y				
	Win Ext Sash	0.3	M/L L N/A	Y				

COMMENTS / STRUCTURAL DEFECTS:

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
	Window Sill	M/L	A/M L N/A	Y				
	Win Apron		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Header Stop	M/L	A/M L N/A	Y				
	Int Stops	M/L	A/M L N/A	Y				
	Win Int Sash	M/L	A/M L N/A	Y				
	Exterior Sill	M/L	L N/A	Y				
	Part Bead	M/L	L N/A	Y				
	Blind Stop	M/L	L N/A	Y				
	Win Ext Sash	M/L	L N/A	Y				
	Closet Door		A/M L N/A	Y				
	Cl Casing		A/M L N/A	Y				
	Closet Jamb		A/M L N/A	Y				
	Closet Walls		A/M L N/A	Y				
	Cl Baseboard		A/M L N/A	Y				
	Closet Pole		A/M L N/A	Y				
	Closet Shelf		A/M L N/A	Y				
	Cl Supports		A/M L N/A	Y				
	Closet Floor		A/M L N/A	Y				
	Closet Ceiling		A/M L N/A	Y				
	Fireplace		A/M L N/A	Y				
	Mantle		A/M L N/A	Y				
		M/L	A/M L N/A	Y				
		M/L	A/M L N/A	Y				
		M/L	A/M L N/A	Y				
		M/L	A/M L N/A	Y				
		M/L	A/M L N/A	Y				

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

4/13/04

Page 7 of 17

Inspector (print)

Lic #

Signature

Date

Risk Assessor (print)

Lic#

Signature

Date

Address of Property

921 MAIN ST

Apt #

City

VINEYARD HAVEN

KITCHEN

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A B C D	Up Walls	4.4	A/M L N/A	Y				
A B C D	Low Walls		A/M L N/A	Y				
A B C D	Baseboards	10.0	A/M L N/A	Y				
A B C D	Chair Rail		A/M L N/A	Y				
	Radiator		A/M L N/A	Y				
	Floor	N/A	A/M L N/A	Y				
	Ceiling	N/A	A/M L N/A	Y				
	Door	0.6	A/M L N/A	Y				
	Door Casing	0.5	A/M L N/A	Y				
	Door Jamb	0.1	A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing	0.4	A/M L N/A	Y				
	Door Jamb	0.2	A/M L N/A	Y				
	Threshold	N/A	A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing	0.5	A/M L N/A	Y				
	Door Jamb	0.6	A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Window Sill	M/I	A/M L N/A	Y				
	Win Apron		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Header Stop	M/I	A/M L N/A	Y				
	Int Stops	M/I	A/M L N/A	Y				
	Win Int Sash	M/I	A/M L N/A	Y				
	Exterior Sill	M/I	A/M L N/A	Y				
	Part Bead	M/I	A/M L N/A	Y				
	Blind Stop	M/I	A/M L N/A	Y				
	Win Ext Sash	M/I	A/M L N/A	Y				
	Closet Door	0.5	A/M L N/A	Y				
	CI Casing	1.1	A/M L N/A	Y				
	Closet Jamb	1.2	A/M L N/A	Y				
	Closet Walls	4.3	A/M L N/A	Y				
	CI Baseboard	10.0	A/M L N/A	Y				
	Closet Pole		A/M L N/A	Y				
	Closet Shelf	10.0	A/M L N/A	Y				
	CI Supports	10.0	A/M L N/A	Y				
	Closet Floor	0.1	A/M L N/A	Y				
	Closet Ceiling	N/A	A/M L N/A	Y				
	Up Cab Frame	0.2	A/M L N/A	Y				
	Cab Door	0.0	A/M L N/A	Y				
	Up Cab Walls	0.1	A/M L N/A	Y				
	Up Cab Shlvs	0.3	A/M L N/A	Y				
	Supports	0.0	A/M L N/A	Y				
	Low Cab Frame	0.0	A/M L N/A	Y				
	Cab Door	0.1	A/M L N/A	Y				
	Low Cab Walls	0.4	A/M L N/A	Y				
	Low Cab Shlvs	0.3	A/M L N/A	Y				
	Supports	0.2	A/M L N/A	Y				
	Drawers	0.0	A/M L N/A	Y				
			M/I	A/M L N/A	Y			
			M/I	A/M L N/A	Y			
			M/I	A/M L N/A	Y			
			M/I	A/M L N/A	Y			
			M/I	A/M L N/A	Y			
			M/I	A/M L N/A	Y			

COMMENTS / STRUCTURAL DEFECTS:

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

(b) (6)

Date _____

Page 8 of 11

Lic #

Signature _____

Date _____

Lic#

Signature _____

Date _____

921

MAIN ST

Adt #

City VINE VALD

HAFEN

4

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A B C D	Up Walls	4.5	A/M L N/A	Y				
A B C D	Low Walls		A/M L N/A	Y				
A B C D	Baseboards	10.0	A/M L N/A	Y				
A B C D	Chair Rail		A/M L N/A	Y				
	Radiator		A/M L N/A	Y				
	Floor	1.2	A/M L N/A	Y				
	Ceiling	1.4	A/M L N/A	Y				
	Door	2.1	A/M L N/A	Y				
	Door Casing	3.5	A/M L N/A	Y				
	Door Jamb	2.2	A/M L N/A	Y				
	Threshold	N/C	A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Window Sill	1.9	M/A/M L N/A	Y				
	Win Apron	3.0	A/M L N/A	Y				
	Win Casing	2.2	A/M L N/A	Y				
	Header Stop	N/A	M/A/M L N/A	Y				
	Int Stops	2.4	M/A/M L N/A	Y				
	Win Int Sash	2.6	M/A/M L N/A	Y				
	Exterior Sill	2.5	M/A/M L N/A	Y				
	Part Bead	2.2	M/A/M L N/A	Y				
	Blind Stop	2.2	M/A/M L N/A	Y				
	Win Ext Sash	3.5	M/A/M L N/A	Y				
	Up Cab Frame		A/M L N/A	Y				
	Up Cab Door		A/M L N/A	Y				
	Up Cab Walls		A/M L N/A	Y				
	Up Cab Shlvs		A/M L N/A	Y				
	Supports		A/M L N/A	Y				
			M/A/M L N/A	Y				
			M/A/M L N/A	Y				
			M/A/M L N/A	Y				

1998, 1999, 2000, 2001, 2002, 2003, 2004, 2005, 2006, 2007, 2008, 2009, 2010, 2011, 2012, 2013, 2014, 2015, 2016, 2017, 2018, 2019, 2020, 2021, 2022, 2023, 2024, 2025, 2026, 2027, 2028, 2029, 2030, 2031, 2032, 2033, 2034, 2035, 2036, 2037, 2038, 2039, 2040, 2041, 2042, 2043, 2044, 2045, 2046, 2047, 2048, 2049, 2050, 2051, 2052, 2053, 2054, 2055, 2056, 2057, 2058, 2059, 2060, 2061, 2062, 2063, 2064, 2065, 2066, 2067, 2068, 2069, 2070, 2071, 2072, 2073, 2074, 2075, 2076, 2077, 2078, 2079, 2080, 2081, 2082, 2083, 2084, 2085, 2086, 2087, 2088, 2089, 2090, 2091, 2092, 2093, 2094, 2095, 2096, 2097, 2098, 2099, 2100, 2101, 2102, 2103, 2104, 2105, 2106, 2107, 2108, 2109, 2110, 2111, 2112, 2113, 2114, 2115, 2116, 2117, 2118, 2119, 2120, 2121, 2122, 2123, 2124, 2125, 2126, 2127, 2128, 2129, 2130, 2131, 2132, 2133, 2134, 2135, 2136, 2137, 2138, 2139, 2140, 2141, 2142, 2143, 2144, 2145, 2146, 2147, 2148, 2149, 2150, 2151, 2152, 2153, 2154, 2155, 2156, 2157, 2158, 2159, 2160, 2161, 2162, 2163, 2164, 2165, 2166, 2167, 2168, 2169, 2170, 2171, 2172, 2173, 2174, 2175, 2176, 2177, 2178, 2179, 2180, 2181, 2182, 2183, 2184, 2185, 2186, 2187, 2188, 2189, 2190, 2191, 2192, 2193, 2194, 2195, 2196, 2197, 2198, 2199, 2200, 2201, 2202, 2203, 2204, 2205, 2206, 2207, 2208, 2209, 2210, 2211, 2212, 2213, 2214, 2215, 2216, 2217, 2218, 2219, 2220, 2221, 2222, 2223, 2224, 2225, 2226, 2227, 2228, 2229, 2230, 2231, 2232, 2233, 2234, 2235, 2236, 2237, 2238, 2239, 2240, 2241, 2242, 2243, 2244, 2245, 2246, 2247, 2248, 2249, 2250, 2251, 2252, 2253, 2254, 2255, 2256, 2257, 2258, 2259, 2260, 2261, 2262, 2263, 2264, 2265, 2266, 2267, 2268, 2269, 2270, 2271, 2272, 2273, 2274, 2275, 2276, 2277, 2278, 2279, 2280, 2281, 2282, 2283, 2284, 2285, 2286, 2287, 2288, 2289, 2290, 2291, 2292, 2293, 2294, 2295, 2296, 2297, 2298, 2299, 2300, 2301, 2302, 2303, 2304, 2305, 2306, 2307, 2308, 2309, 2310, 2311, 2312, 2313, 2314, 2315, 2316, 2317, 2318, 2319, 2320, 2321, 2322, 2323, 2324, 2325, 2326, 2327, 2328, 2329, 2330, 2331, 2332, 2333, 2334, 2335, 2336, 2337, 2338, 2339, 2340, 2341, 2342, 2343, 2344, 2345, 2346, 2347, 2348, 2349, 2350, 2351, 2352, 2353, 2354, 2355, 2356, 2357, 2358, 2359, 2360, 2361, 2362, 2363, 2364, 2365, 2366, 2367, 2368, 2369, 2370, 2371, 2372, 2373, 2374, 2375, 2376, 2377, 2378, 2379, 2380, 2381, 2382, 2383, 2384, 2385, 2386, 2387, 2388, 2389, 2390, 2391, 2392, 2393, 2394, 2395, 2396, 2397, 2398, 2399, 2400, 2401, 2402, 2403, 2404, 2405, 2406, 2407, 2408, 2409, 2410, 2411, 2412, 2413, 2414, 2415, 2416, 2417, 2418, 2419, 2420, 2421, 2422, 2423, 2424, 2425, 2426, 2427, 2428, 2429, 2430, 2431, 2432, 2433, 2434, 2435, 2436, 2437, 2438, 2439, 2440, 2441, 2442, 2443, 2444, 2445, 2446, 2447, 2448, 2449, 2450, 2451, 2452, 2453, 2454, 2455, 2456, 2457, 2458, 2459, 2460, 2461, 2462, 2463, 2464, 2465, 2466, 2467, 2468, 2469, 2470, 2471, 2472, 2473, 2474, 2475, 2476, 2477, 2478, 2479, 2480, 2481, 2482, 2483, 2484, 2485, 2486, 2487, 2488, 2489, 2490, 2491, 2492, 2493, 2494, 2495, 2496, 2497, 2498, 2499, 2500, 2501, 2502, 2503, 2504, 2505, 2506, 2507, 2508, 2509, 2510, 2511, 2512, 2513, 2514, 2515, 2516, 2517, 2518, 2519, 2520, 2521, 2522, 2523, 2524, 2525, 2526, 2527, 2528, 2529, 2530, 2531, 2532, 2533, 2534, 2535, 2536, 2537, 2538, 2539, 2540, 2541, 2542, 2543, 2544, 2545, 2546, 2547, 2548, 2549, 2550, 2551, 2552, 2553, 2554, 2555, 2556, 2557, 2558, 2559, 2560, 2561, 2562, 2563, 2564, 2565, 2566, 2567, 2568, 2569, 2570, 2571, 2572, 2573, 2574, 2575, 2576, 2577, 2578, 2579, 2580, 2581, 2582, 2583, 2584, 2585, 2586, 2587, 2588, 2589, 2590, 2591, 2592, 2593, 2594, 2595, 2596, 2597, 2598, 2599, 2600, 2601, 2602, 2603, 2604, 2605, 2606, 2607, 2608, 2609, 2610, 2611, 2612, 2613, 2614, 2615, 2616, 2617, 2618, 2619, 2620, 2621, 2622, 2623, 2624, 2625, 2626, 2627, 2628, 2629, 2630, 2631, 2632, 2633, 2634, 2635, 2636, 2637, 2638, 2639, 2640, 2641, 2642, 2643, 2644, 2645, 2646, 2647, 2648, 2649, 2650, 2651, 2652, 2653, 2654, 2655, 2656, 2657, 2658, 2659, 2660, 2661, 2662, 2663, 2664, 2665, 2666, 2667, 2668, 2669, 2670, 2671, 2672, 2673, 2674, 2675, 2676, 2677, 2678, 2679, 26

[illegible]

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed dealer.

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD
	LI/RA Rcp Bath	1/17/02		

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

4-13-04

Page 9 of 17

Inspector (print)

Lic #

Signature

Date

Risk Assessor (print)

Lic #

Signature

Date

Address of Property

921 MAIN ST

Apt #

City VINETARDS HAVEN

ROOM BATH #2

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A B C D	Up Walls	10.0	A/M L N/A	Y				
A B C D	Low Walls	CN	A/M L N/A	Y				
A B C D	Baseboards	10.0	A/M L N/A	Y				
A B C D	Chair Rail	CN	A/M L N/A	Y				
	Radiator	1.5	A/M L N/A	Y				
	Floor	CN	A/M L N/A	Y				
	Ceiling	N/A	A/M L N/A	Y				
	Door	0.2	A/M L N/A	Y				
	Door Casing	2.5	A/M L N/A	Y				
	Door Jamb	1.3	A/M L N/A	Y				
	Threshold	N/A	A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Window Sill	5.5	M1 A/M L N/A	Y				
	Win Apron	0.6	A/M L N/A	Y				
	Win Casing	0.11	A/M L N/A	Y				
	Header Stop	N/A	M1 A/M L N/A	Y				
	Int Stops	0.2	M1 A/M L N/A	Y				
	Win Int Sash	0.4	M1 A/M L N/A	Y				
	Exterior Sill	0.3	M1 L N/A	Y				
	Part Bead	CN	M1 L N/A	Y				
	Blind Stop	0.1	M1 L N/A	Y				
	Win Ext Sash	3.2	M1 L N/A	Y				

COMMENTS / STRUCTURAL DEFECTS:

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
	Window Sill		M1 A/M L N/A	Y				
	Win Apron		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Header Stop	M1	A/M L N/A	Y				
	Int Stops	M1	A/M L N/A	Y				
	Win Int Sash	M1	A/M L N/A	Y				
	Exterior Sill	M1	L N/A	Y				
	Part Bead	M1	L N/A	Y				
	Blind Stop	M1	L N/A	Y				
	Win Ext Sash	M1	L N/A	Y				
	Window Sill	M1	A/M L N/A	Y				
	Win Apron		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Header Stop	M1	A/M L N/A	Y				
	Int Stops	M1	A/M L N/A	Y				
	Win Int Sash	M1	A/M L N/A	Y				
	Exterior Sill	M1	L N/A	Y				
	Part Bead	M1	L N/A	Y				
	Blind Stop	M1	L N/A	Y				
	Win Ext Sash	M1	L N/A	Y				
	Closet Door		A/M L N/A	Y				
	Cl Casing		A/M L N/A	Y				
	Closet Jamb		A/M L N/A	Y				
	Closet Walls		A/M L N/A	Y				
	Cl Baseboard		A/M L N/A	Y				
	Closet Pole		A/M L N/A	Y				
	Closet Shelf		A/M L N/A	Y				
	Cl Supports		A/M L N/A	Y				
	Closet Floor		A/M L N/A	Y				
	Closet Ceiling		A/M L N/A	Y				
	Fireplace		A/M L N/A	Y				
	Mantle		A/M L N/A	Y				
			M1 A/M L N/A	Y				
			M1 A/M L N/A	Y				
			M1 A/M L N/A	Y				
			M1 A/M L N/A	Y				
			M1 A/M L N/A	Y				

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

4.13.04

Page 10 of 17

Inspector (print)

Lic #

Signature

Date

Risk Assessor (print)

Lic #

Signature

Date

Address of Property

921 MAIN ST.

Apt #

City VINEYARD HAVEN

HALLWAY

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A B C D	Up Walls	0.0	A/M L N/A	Y				
A B C D	Low Walls		A/M L N/A	Y				
A B C D	Baseboards	0.0	A/M L N/A	Y				
A B C D	Chair Rail		A/M L N/A	Y				
	Radiator		A/M L N/A	Y				
	Floor	N/A	A/M L N/A	Y				
	Ceiling	N/A	A/M L N/A	Y				
	Door	0.2	A/M L N/A	Y				
	Door Casing	2.5	A/M L N/A	Y				
	Door Jamb	4.0	A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Door	0.3	A/M L N/A	Y				
	Door Casing	0.6	A/M L N/A	Y				
	Door Jamb	0.1	A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Door	0.4	A/M L N/A	Y				
	Door Casing	0.0	A/M L N/A	Y				
	Door Jamb	0.1	A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Door	0.1	A/M L N/A	Y				
	Door Casing	2.5	A/M L N/A	Y				
	Door Jamb	2.4	A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Door	0.3	A/M L N/A	Y				
	Door Casing	2.1	A/M L N/A	Y				
	Door Jamb	0.3	A/M L N/A	Y				
	Threshold	N/A	A/M L N/A	Y				
	Window Sill		M/L A/M L N/A	Y				
	Win Apron		A/M L N/A	Y				
	Win Casing		L N/A	Y				
	Header Stop		M/L L N/A	Y				
	Int Stops		M/L L N/A	Y				
	Win Int Sash		M/L L N/A	Y				
	Exterior Sill		M/L A/M L N/A	Y				
	Part Bead		M/L A/M L N/A	Y				
	Blind Stop		M/L A/M L N/A	Y				
	Win Ext Sash		M/L A/M L N/A	Y				

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
	Window Sill		M/L A/M L N/A	Y				
	Win Apron		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Header Stop		M/L A/M L N/A	Y				
	Int Stops		M/L A/M L N/A	Y				
	Win Int Sash		M/L A/M L N/A	Y				
	Exterior Sill		M/L A/M L N/A	Y				
	Part Bead		M/L A/M L N/A	Y				
	Blind Stop		M/L A/M L N/A	Y				
	Win Ext Sash		M/L A/M L N/A	Y				
	Closet Door	0.2	A/M L N/A	Y				
	CI Casing	0.0	A/M L N/A	Y				
	Closet Jamb	0.1	A/M L N/A	Y				
	Closet Walls	3.1	A/M L N/A	Y				
	CI Baseboard	10.4	A/M L N/A	Y				
	Closet Pole		A/M L N/A	Y				
	Closet Shelf	0.4	A/M L N/A	Y				
	CI Supports	0.6	A/M L N/A	Y				
	Closet Floor	N/A	A/M L N/A	Y				
	CI Ceiling	N/A	A/M L N/A	Y				
	Closet Door	0.4	A/M L N/A	Y				
	CI Casing	0.3	A/M L N/A	Y				
	Closet Jamb	0.6	A/M L N/A	Y				
	Closet Walls	4.3	A/M L N/A	Y				
	CI Baseboard	N/A	A/M L N/A	Y				
	Closet Pole	0.0	A/M L N/A	Y				
	Closet Shelf		A/M L N/A	Y				
	CI Supports		A/M L N/A	Y				
	Closet Floor	N/A	A/M L N/A	Y				
	CI Ceiling	N/A	A/M L N/A	Y				
	Closet Door	0.2	M/L A/M L N/A	Y				
	Closet Walls	2.3	M/L A/M L N/A	Y				
	Trim	2.5	M/L A/M L N/A	Y				

COMMENTS / STRUCTURAL DEFECTS:

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

(b) (6)

4-13-04

Page 11 of 17

Inspector (print)

Lic #

Signature

Date

Risk Assessor (print)

Lic #

Signature

Date

Address of Property

921 MAIN ST

Apt #

City VINEYARD HAVEN

ROOM

HALL OFF KITCHEN / Laundry

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A B C D	Up Walls	4.3	A/M L N/A	Y				
A B C D	Low Walls		A/M L N/A	Y				
A B C D	Baseboards	10.0	A/M L N/A	Y				
A B C D	Chair Rail		A/M L N/A	Y				
	Radiator	0.1	A/M L N/A	Y				
	Floor	N/A	A/M L N/A	Y				
	Ceiling	N/A	A/M L N/A	Y				
A	Door		A/M L N/A	Y				
	Door Casing	2.5	A/M L N/A	Y				
	Door Jamb	0.3	A/M L N/A	Y				
	Threshold	N/A	A/M L N/A	Y				
B	Door	0.2	A/M L N/A	Y				
	Door Casing	0.5	A/M L N/A	Y				
	Door Jamb	5.1	A/M L N/A	Y				
	Threshold	1.9	A/M L N/A	Y				
D	Door	0.2	A/M L N/A	Y				
	Door Casing	0.4	A/M L N/A	Y				
	Door Jamb	0.0	A/M L N/A	Y				
	Threshold	N/A	A/M L N/A	Y				
B	Door	0.2	A/M L N/A	Y				
	Door Casing	0.1	A/M L N/A	Y				
	Door Jamb	0.0	A/M L N/A	Y				
	Threshold	N/A	A/M L N/A	Y				
C	Window Sill	0.4	M/I A/M L N/A	Y				
	Win Apron	0.6	A/M L N/A	Y				
	Win Casing	0.5	A/M L N/A	Y				
	Header Stop	N/A	M/I A/M L N/A	Y				
	Int Slops	0.2	M/I A/M L N/A	Y				
	Win Int Sash	0.0	M/I A/M L N/A	Y				
	Exterior Sill	0.4	M/I L N/A	Y				
	Part Bead	N/A	M/I L N/A	Y				
	Blind Stop	0.1	M/I L N/A	Y				
	Win Ext Sash	0.5	M/I L N/A	Y				

COMMENTS / STRUCTURAL DEFECTS:

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
	Window Sill		M/I A/M L N/A	Y				
	Win Apron		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Header Stop	M/I	A/M L N/A	Y				
	Int Slops	M/I	A/M L N/A	Y				
	Win Int Sash	M/I	A/M L N/A	Y				
	Exterior Sill	M/I	L N/A	Y				
	Part Bead	M/I	L N/A	Y				
	Blind Stop	M/I	L N/A	Y				
	Win Ext Sash	M/I	L N/A	Y				
	Closet Door		A/M L N/A	Y				
	Ct Casing		A/M L N/A	Y				
	Closet Jamb		A/M L N/A	Y				
	Closet Walls		A/M L N/A	Y				
	Ct Baseboard		A/M L N/A	Y				
	Closet Pole		A/M L N/A	Y				
	Closet Shelf		A/M L N/A	Y				
	Ct Supports		A/M L N/A	Y				
	Closet Floor		A/M L N/A	Y				
	Closet Ceiling		A/M L N/A	Y				
	Fireplace		A/M L N/A	Y				
	Mantle		A/M L N/A	Y				
			M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				
			M/I A/M L N/A	Y				

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

4/13/04

Page 12 of 17

Inspector (print)

Lic #

Signature

Date

Risk Assessor (print)

Lic #

Signature

Date

Address of Property 921 MAIN ST

Apt #

City VINEYARD HAVEN

STAIRCASE

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A B C D	Up Walls	10.0	A/M L N/A	Y				
A B C D	Low Walls		A/M L N/A	Y				
A B C D	Baseboards	10.0	A/M L N/A	Y				
A B C D	Chair Rail		A/M L N/A	Y				
	Radiator	0.9	A/M L N/A	Y				
	Floor	N/A	A/M L N/A	Y				
	Ceiling	N/A	A/M L N/A	Y				
A	Door	0.5	A/M L N/A	Y				
	Door Casing	0.6	A/M L N/A	Y				
	Door Jamb	0.5	A/M L N/A	Y				
	Threshold	N/A	A/M L N/A	Y				
B	Door	0.2	A/M L N/A	Y				
	Door Casing	3.5	A/M L N/A	Y				
	Door Jamb	1.1	A/M L N/A	Y				
	Threshold	N/A	A/M L N/A	Y				
C	Door	0.2	A/M L N/A	Y				
	Door Casing	11.0	A/M L N/A	Y				
	Door Jamb	8.1	A/M L N/A	Y				
	Threshold	2.3	A/M L N/A	Y				
D	Door		A/M L N/A	Y				
	Door Casing	3.2	A/M L N/A	Y				
	Door Jamb	0.1	A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Window Sill	1.9	M/A/M L N/A	Y				
	Win Apron	2.0	M/A/M L N/A	Y				
	Win Casing	2.5	M/A/M L N/A	Y				
	Header Stop	N/A	M/A/M L N/A	Y				
	Int Stops	0.6	M/A/M L N/A	Y				
	Win Int Sash	6.2	M/A/M L N/A	Y				
	Exterior Sill	0.2	M/A/M L N/A	Y				
	Part Bead	0.1	M/A/M L N/A	Y				
	Blind Stop	0.1	M/A/M L N/A	Y				
	Win Ext Sash	0.7	M/A/M L N/A	Y				

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
	Closet Door		A/M L N/A	Y				
	Cl Casing		A/M L N/A	Y				
	Closet Jamb		A/M L N/A	Y				
	Closet Walls		A/M L N/A	Y				
	Cl Baseboard		A/M L N/A	Y				
	Closet Pole		A/M L N/A	Y				
	Closet Shelf		A/M L N/A	Y				
	Cl Supports		A/M L N/A	Y				
	Closet Floor		A/M L N/A	Y				
	Closet Ceiling		A/M L N/A	Y				
	Newel Post	0.5	A/M L N/A	Y				
	Railing Cap	0.5	A/M L N/A	Y				
	Handrail	0.5	A/M L N/A	Y				
	Balusters	0.1	A/M L N/A	Y				
	Lower rail		A/M L N/A	Y				
	Treads	0.2	A/M L N/A	Y				
	Risers	10.5	A/M L N/A	Y				
	Stringer	10.5	A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Floor Casing		A/M L N/A	Y				
			M/A/M L N/A	Y				
			M/A/M L N/A	Y				
			M/A/M L N/A	Y				
			M/A/M L N/A	Y				
			M/A/M L N/A	Y				
			M/A/M L N/A	Y				
			M/A/M L N/A	Y				

COMMENTS / STRUCTURAL DEFECTS:

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

4-13-04

Page 13 of 17

Inspector (print)

Lic #

Signature

Date

Risk Assessor (print)

Lic #

Signature

Date

Address of Property

921 MAIN ST.

Apt #

City

VINEYARD HAVEN

STAIRCASE TO BASEMENT

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A B C D	Up Walls	0.5	A/M L N/A	Y				
A B C D	Low Walls		A/M L N/A	Y				
A B C D	Baseboards		A/M L N/A	Y				
A B C D	Chair Rail		A/M L N/A	Y				
	Radiator		A/M L N/A	Y				
	Floor	N/A	A/M L N/A	Y				
	Ceiling		A/M L N/A	Y				
B	Door	0.4	A/M L N/A	Y				
	Door Casing	0.4	A/M L N/A	Y				
	Door Jamb	0.1	A/M L N/A	Y				
	Threshold	N/A	A/M L N/A	Y				
D	Door	0.4	A/M L N/A	Y				
	Door Casing	N/A	A/M L N/A	Y				
	Door Jamb	N/A	A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Window Sill		M1 A/M L N/A	Y				
	Win Apron		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Header Stop		M1 A/M L N/A	Y				
	Int Stops		M1 A/M L N/A	Y				
	Win Int Sash		M1 A/M L N/A	Y				
	Exterior Sill		M1 A/M L N/A	Y				
	Part Bead		M1 A/M L N/A	Y				
	Blind Stop		M1 A/M L N/A	Y				
	Win Ext Sash		M1 A/M L N/A	Y				

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
	Closet Door		A/M L N/A	Y				
	CI Casing		A/M L N/A	Y				
	Closet Jamb		A/M L N/A	Y				
	Closet Walls		A/M L N/A	Y				
	CI Baseboard		A/M L N/A	Y				
	Closet Frie		A/M L N/A	Y				
	Closet Shelf		A/M L N/A	Y				
	CI Supports		A/M L N/A	Y				
	Closet Floor		A/M L N/A	Y				
	Closet Ceiling		A/M L N/A	Y				
	Newel Post		A/M L N/A	Y				
	Railing Cap		A/M L N/A	Y				
	Handrail	0.6	A/M L N/A	Y				
	Balusters		A/M L N/A	Y				
	Lower Rail	10.4	A/M L N/A	Y				
	Treads	10.4	A/M L N/A	Y				
	Risers	10.4	A/M L N/A	Y				
	Stringer		A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Floor Casing		A/M L N/A	Y				
			M1 A/M L N/A	Y				
			M1 A/M L N/A	Y				
			M1 A/M L N/A	Y				
			M1 A/M L N/A	Y				
			M1 A/M L N/A	Y				
			M1 A/M L N/A	Y				
			M1 A/M L N/A	Y				
			M1 A/M L N/A	Y				

COMMENTS / STRUCTURAL DEFECTS:

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

Inspector (print)

Lic #

Signature

Date

Page 14 Of 17

Risk Assessor (print)

Lic#

Signature

Date

Address of Property

921 MAIN ST.

Apt #

City VINEYARD HAVEN

EXTERIOR

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A	Siding	0.2	A/M L N/A	Y				
	Corner Boards		A/M L N/A	Y				
	Lower Trim		A/M L N/A	Y				
	Upper Trim	N/A	A/M L N/A	Y				
	Win Above 5'		A/M L N/A	Y				
	Port Above 5'		A/M L N/A	Y				
A	Storm Door	2.0	A/M L N/A	Y				
	Door	0.7	A/M L N/A	Y				
	Door Casing	0.5	A/M L N/A	Y				
	Door Jamb	0.1	A/M L N/A	Y				
	Threshold	0.9	A/M L N/A	Y				
	Kickplate		A/M L N/A	Y				
A	Storm Door		A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Kickplate		A/M L N/A	Y				
A	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
A	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
A	Window Sill	0.0	A/M L N/A	Y				
	Win Casing	0.7	A/M L N/A	Y				
	Window Sash	0.2	A/M L N/A	Y				
A	Window Sill		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Window Sash		A/M L N/A	Y				

COMMENTS / STRUCTURAL DEFECTS:

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A	Window Sill		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Window Sash		A/M L N/A	Y				
A	Window Sill		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Window Sash		A/M L N/A	Y				
A	Cellar Win Sill	0.2	A/M L N/A	Y				
	Cel Win Sash	0.3	A/M L N/A	Y				
	Cel Win Frame	0.1	A/M L N/A	Y				
A	Cellar Win Sill		A/M L N/A	Y				
	Cel Win Sash		A/M L N/A	Y				
	Cel Win Frame		A/M L N/A	Y				
A	Cellar Win Sill		A/M L N/A	Y				
	Cel Win Sash		A/M L N/A	Y				
	Cel Win Frame		A/M L N/A	Y				
A	Foundation	0.9	A/M L N/A	Y				
	Bulkhead		A/M L N/A	Y				
	Fences	0.2	A/M L N/A	Y				
A	Shutters		A/M L N/A	Y				
	Newel post	0.0	A/M L N/A	Y				
	Railing Cap	0.4	A/M L N/A	Y				
A	Handrail	0.0	A/M L N/A	Y				
	Balusters		A/M L N/A	Y				
	Lower Rail		A/M L N/A	Y				
A	Treads	0.0	A/M L N/A	Y				
	Risers	0.3	A/M L N/A	Y				
	Stringer	0.7	A/M L N/A	Y				
A	Floor	0.2	A/M L N/A	Y				
	Celling	N/A	A/M L N/A	Y				
			A/M L N/A	Y				
A			A/M L N/A	Y				
			A/M L N/A	Y				
			A/M L N/A	Y				

Excluded Surfaces: Surfaces listed in this box can be made
intact only by a licensed deleader

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 1440 SQ. IN.)	IC DATE	IC METH
A				
A				
A				
A				

Soil Test Results

(Must be less than 400 ppm for play area / 1200 ppm for bare soil)

LOCATION	AREA MEASUREMENT (Square Feet)	RESULT (PPM)	REMED DATE	REMED METH
Play Area				
Bare soil				
Comments:				

(b) (6)

4-13-04

Page 15 of 17

Inspector (print)

Lic #

Signature

Date

Risk Assessor (print)

Lic#

Signature

Date

Address of Property

921 MAIN ST.

Apt #

City VINEYARD HAVEN

EXTERIOR

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
B	Siding	0.4	A/M L N/A	Y				
	Corner Boards		A/M L N/A	Y				
	Lower Trim		A/M L N/A	Y				
	Upper Trim	N/A	A/M L N/A	Y				
	Win Above 5'		A/M L N/A	Y				
	Porch Above 5'		A/M L N/A	Y				
B	Storm Door	0.4	A/M L N/A	Y				
	Door	0.5	A/M L N/A	Y				
	Door Casing	0.2	A/M L N/A	Y				
	Door Jamb	0.6	A/M L N/A	Y				
	Threshold	5.0	A/M L N/A	Y				
	Kickplate		A/M L N/A	Y				
B	Storm Door		A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Kickplate		A/M L N/A	Y				
B	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
B	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
B	Window Sill	0.1	A/M L N/A	Y				
	Win Casing	0.6	A/M L N/A	Y				
	Window Sash	0.2	A/M L N/A	Y				
B	Window Sill		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Window Sash		A/M L N/A	Y				

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
B	Window Sill		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Window Sash		A/M L N/A	Y				
B	Window Sill		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Window Sash		A/M L N/A	Y				
B	Cellar Win Sill		A/M L N/A	Y				
	Cel Win Sash		A/M L N/A	Y				
	Cel Win Frame		A/M L N/A	Y				
B	Cellar Win Sill		A/M L N/A	Y				
	Cel Win Sash		A/M L N/A	Y				
	Cel Win Frame		A/M L N/A	Y				
B	Cellar Win Sill		A/M L N/A	Y				
	Cel Win Sash		A/M L N/A	Y				
	Cel Win Frame		A/M L N/A	Y				
B	Cellar Win Sill		A/M L N/A	Y				
	Cel Win Sash		A/M L N/A	Y				
	Cel Win Frame		A/M L N/A	Y				
B	Foundation	0.6	A/M L N/A	Y				
	Bulkhead		A/M L N/A	Y				
	Fences		A/M L N/A	Y				
B	Shutters		A/M L N/A	Y				
	Newel post	0.1	A/M L N/A	Y				
	Railing Cap	0.1	A/M L N/A	Y				
B	Handrail	0.8	A/M L N/A	Y				
	Balusters	0.8	A/M L N/A	Y				
	Lower Rail		A/M L N/A	Y				
B	Treads	0.2	A/M L N/A	Y				
	Risers	0.1	A/M L N/A	Y				
	Stringer	0.6	A/M L N/A	Y				
B			A/M L N/A	Y				
			A/M L N/A	Y				
			A/M L N/A	Y				
			A/M L N/A	Y				
			A/M L N/A	Y				

COMMENTS / STRUCTURAL DEFECTS:

Excluded Surfaces: Surfaces listed in this box can be made
intact only by a licensed deleader

Soil Test Results
(Must be less than 400 ppm for play area / 1200 ppm for bare soil)

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 1440 SQ. IN.)	IC DATE	IC METH
B				
B				
B				
B				

LOCATION	AREA MEASUREMENT (Square Feet)	RESULT (PPM)	REMED DATE	REMED METH
Play Area				
Bare soil				
Comments:				

Inspector (print)

Lic #

Signature

Date

Risk Assessor (print)

Lic#

Signature

Date

Address of Property 981 MAIN ST.

Apt #

City VINEYARD HAVEN

EXTERIOR

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
C	Siding	6.4	A/M L N/A	Y				
	Corner Boards		A/M L N/A	Y				
	Lower Trim		A/M L N/A	Y				
	Upper Trim	11.4	A/M L N/A	Y				
	Win Above 5'		A/M L N/A	Y				
	Porch Above 5'		A/M L N/A	Y				
C	Storm Door		A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Kickplate		A/M L N/A	Y				
C	Storm Door		A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Kickplate		A/M L N/A	Y				
C	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
C	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
C	Window Sill	12.2	A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Window Sash	5	A/M L N/A	Y				
C	Window Sill		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Window Sash		A/M L N/A	Y				

COMMENTS / STRUCTURAL DEFECTS:

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
C	Window Sill		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Window Sash		A/M L N/A	Y				
C	Window Sill		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Window Sash		A/M L N/A	Y				
C	Cellar Win Sill		A/M L N/A	Y				
	Cell Win Sash		A/M L N/A	Y				
	Cell Win Frame		A/M L N/A	Y				
C	Cellar Win Sill		A/M L N/A	Y				
	Cell Win Sash		A/M L N/A	Y				
	Cell Win Frame		A/M L N/A	Y				
C	Cellar Win Sill		A/M L N/A	Y				
	Cell Win Sash		A/M L N/A	Y				
	Cell Win Frame		A/M L N/A	Y				
C	Foundation	5.2	A/M L N/A	Y				
	Bulkhead		A/M L N/A	Y				
	Fences		A/M L N/A	Y				
	Shutters		A/M L N/A	Y				
C	Newel post		A/M L N/A	Y				
	Railing Cap		A/M L N/A	Y				
	Handrail		A/M L N/A	Y				
	Balusters		A/M L N/A	Y				
	Lower Rail		A/M L N/A	Y				
	Treads		A/M L N/A	Y				
	Risers		A/M L N/A	Y				
	Stringer		A/M L N/A	Y				
C			A/M L N/A	Y				
			A/M L N/A	Y				
			A/M L N/A	Y				
			A/M L N/A	Y				
			A/M L N/A	Y				

Excluded Surfaces: Surfaces listed in this box can be made
intact only by a licensed deleader

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 1440 SQ. IN.)	IC DATE	IC METH
C				
C				
C				
C				

Soil Test Results

(Must be less than 400 ppm for play area / 1200 ppm for bare soil)

LOCATION	AREA MEASUREMENT (Square Feet)	RESULT (PPM)	REMED DATE	REMED METH
Play Area				
Bare soil				
Comments:				

4-13-04

Page 17 of 17

Inspector (print)

Lic #

Signature

Date

Risk Assessor (print)

Lic#

Signature

Date

Address of Property 921 MAIN ST

Apt #

City VINEYARD HAVEN

EXTERIOR

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
D	Siding	5.5	A/M L N/A	Y				
	Corner Boards		A/M L N/A	Y				
	Lower Trim		A/M L N/A	Y				
	Upper Trim	4.0	A/M L N/A	Y				
	Win Above 5'		A/M L N/A	Y				
	Porch Above 5'		A/M L N/A	Y				
D	Storm Door		A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Kickplate		A/M L N/A	Y				
D	Storm Door		A/M L N/A	Y				
	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
	Kickplate		A/M L N/A	Y				
D	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
D	Door		A/M L N/A	Y				
	Door Casing		A/M L N/A	Y				
	Door Jamb		A/M L N/A	Y				
	Threshold		A/M L N/A	Y				
D	Window Sill	6.6	A/M L N/A	Y				
	Win Casing	5.4	A/M L N/A	Y				
	Window Sash	5.2	A/M L N/A	Y				
D	Window Sill		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Window Sash		A/M L N/A	Y				
	Window Sill		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Window Sash		A/M L N/A	Y				
	Window Sill		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Window Sash		A/M L N/A	Y				
	Window Sill		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Window Sash		A/M L N/A	Y				
D	Window Sill		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Window Sash		A/M L N/A	Y				
	Window Sill		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Window Sash		A/M L N/A	Y				
	Window Sill		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Window Sash		A/M L N/A	Y				
	Window Sill		A/M L N/A	Y				
	Win Casing		A/M L N/A	Y				
	Window Sash		A/M L N/A	Y				

COMMENTS / STRUCTURAL DEFECTS:

Excluded Surfaces: Surfaces listed in this box can be made
intact only by a licensed deleader

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 1440 SQ. IN.)	IC DATE	IC METH
D				
D				
D				
D				

Soil Test Results

(Must be less than 400 ppm for play area / 1200 ppm for bare soil)

LOCATION	AREA MEASUREMENT (Square Feet)	RESULT (PPM)	REMED DATE	REMED METH
Play Area				
Bare soil				
Comments:				

September 23, 2012

US Coast Guard Air Station Cape Cod
Martha's Vineyard Housing
West Chop #1 & #2
(917 & 920 Main Street)
Vineyard Haven, MA 02568

XRF Lead Paint Narrative

This report presents the results of testing for the presence of lead by X-Ray Fluorescence (XRF) analysis on interior and exterior painted surfaces at the above-referenced location. The lead testing was performed on September 20, 2012, by (b) (6) Commonwealth of Massachusetts Licensed Lead Inspector (b) (6) (b) (6) is trained in the proper use and interpretation of results of the XRF Spectrum Analyzer.

The XRF testing was performed to evaluate the lead content on painted surfaces for interior and exterior surfaces in housing, and determine the presence of lead hazards as defined by the Massachusetts Lead Law (105 CMR 460.000 – Lead Poisoning Prevention and Control). Surfaces tested included: walls, ceilings, floors, shelving, closet features, window systems, door systems, exterior siding, exterior trim, porch trim and features, garage exterior components, and any other component with a surface coating that was visible and reachable during the inspection.

Lead paint content of components was not consistent or representative from one area to another; this is likely due to previous work that has been performed to the property from over the years of maintenance and updates. The following building components were commonly found to contain dangerous levels of lead (see individual reports for exact results):

- Plaster walls and ceilings
- Baseboards
- Doors, door casings, and door jambs
- Window sills, casings, interior stop edges, aprons, exterior sills, blind stops, and exterior casings.
- Stair risers, treads, stringers, floor edges, and floor casings
- Shelves and shelf supports
- Garage exterior components

Less commonly found to contain lead, but still having at least some locations which are considered to have dangerous amounts of lead are:

- Door thresholds and kickplates
- Exterior Cornerboards
- Porch columns

In addition to these components containing dangerous levels of lead, many of these components present one or more lead hazards as defined by 105 CMR 460.000. These

hazards are either: Accessible/mouthable surfaces, moveable/impact surfaces, and/or loose/chipping/peeling/deteriorated paint.

Anyone who performs work to correct lead hazards must be authorized and licensed according to 105 CMR 460.00 – Lead Poisoning Prevention and Control and 454 CMR 22.00 – Deleading and Lead Safe Renovation Regulations.

Additionally, the employer of workers who disturb or remove lead paint must comply with OSHA Standard 29 CFR 1926.62 - Lead. This applies to all construction work, alteration, or repair, including painting, where an employee may be occupationally exposed to lead.

Limitations


Lead testing was limited to accessible interior and exterior painted surfaces located at 917 & 920 Main Street, Vineyard Haven, Massachusetts. Additional lead-containing building substrates and components may be present in inaccessible building areas or areas not tested.

Sincerely,

(b) (6)

Master Lead Inspector/Risk Assessor

(b) (6)

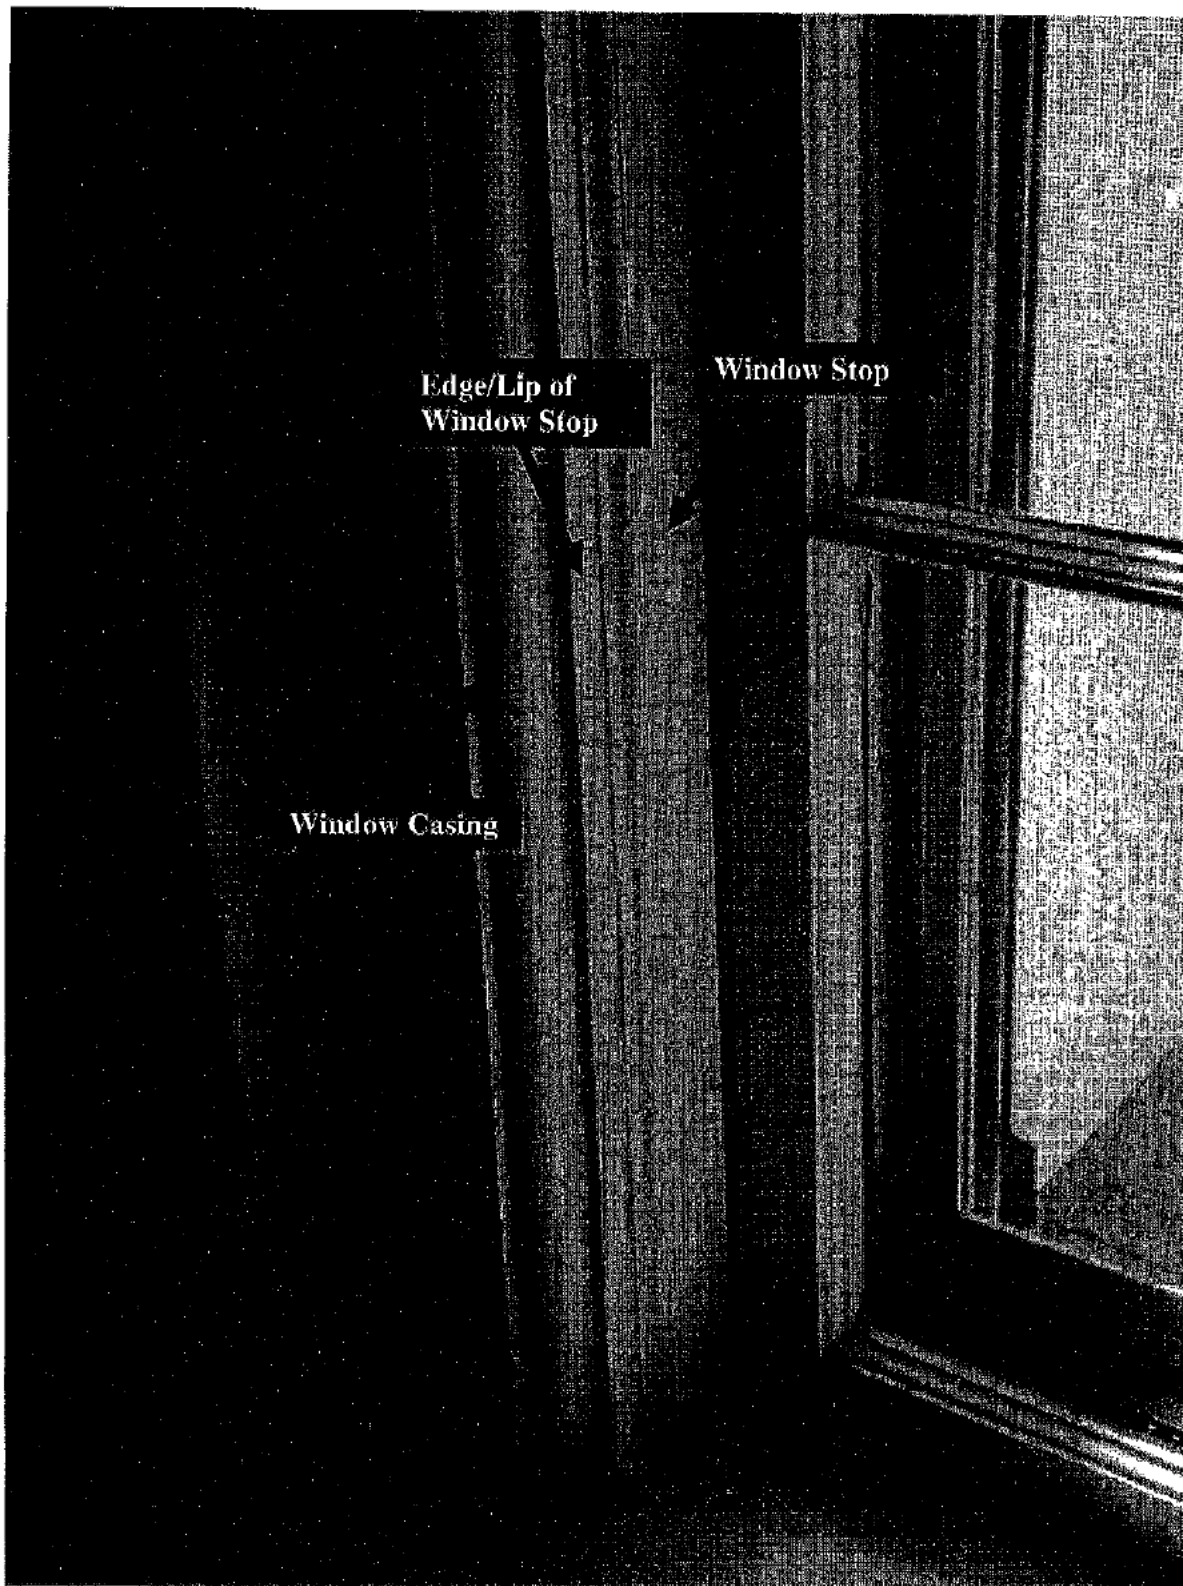

Edge/Lip of
Window Stop

Window Stop

Window Casing

Positive Lead Paint Results by XRF
US Coast Guard Air Base Cape Cod
Martha's Vineyard Housing
917 Main St.
Vineyard Haven, Massachusetts
September 20, 2012

Location/Component	Substrate	Results (mg/cm ²)
Room # 1		
Baseboards	Wood	22.6
B Door Casing	Wood	2.6
A1 Window Sill	Wood	2.1
A1 Window Casing	Wood	5.1
A1 Exterior Window Sill	Wood	2.2
A1 Blind Stop	Wood	2.1
A2 Window Sill	Wood	2.6
A2 Window Casing	Wood	5.4
A2 Exterior Window Sill	Wood	2.6
A2 Blind Stop	Wood	2.1
D Window Sill	Wood	2.6
D Window Casing	Wood	4.1
D Exterior Window Sill	Wood	1.4
D Blind Stop	Wood	1.6
Room # 2		
Baseboards	Wood	31.8
D1 Door Casing	Wood	4.6
D1 Door Jamb	Wood	7.1
D2 Door Casing	Wood	2.1
D2 Door Jamb	Wood	4.1
B1 Window Sill	Wood	4.1
B1 Window Casing	Wood	4.1
B1 Exterior Window Sill	Wood	1.6
B2 Window Sill	Wood	4.2
B2 Window Casing	Wood	4.0
B2 Exterior Window Sill	Wood	1.7
D1 Closet Door Casing	Wood	7.1
D1 Closet Door Jamb	Wood	7.0

- Dangerous level of lead by XRF is equal to or greater than 1.0 mg/cm²
- mg/cm² = milligrams of lead per square centimeter of sampled surface area.
- NA = not able to test, assume positive

Positive Lead Paint Results by XRF
US Coast Guard Air Base Cape Cod
Martha's Vineyard Housing
917 Main St.
Vineyard Haven, Massachusetts
September 20, 2012

Location/Component	Substrate	Results (mg/cm ²)
D1 Closet Walls	Plaster	10.1
D1 Closet Baseboard	Wood	17.4
D1 Closet Shelf	Wood	4.2
D1 Closet Shelf Supports	Wood	12.6
D1 Closet Ceiling	Plaster	NA
Room # 3		
Walls	Plaster	10.4
Ceiling	Plaster	11.3
Baseboards	Wood	18.6
C1 Door Casing	Wood	6.1
C1 Door Jamb	Wood	8.3
C2 Door Casing	Wood	2.1
C2 Door Jamb	Wood	6.3
A1 Window Sill	Wood	4.1
A1 Window Casing	Wood	3.6
A1 Exterior Window Sill	Wood	3.9
A1 Blind Stop	Wood	3.6
A2 Window Sill	Wood	4.1
A2 Window Casing	Wood	4.0
A2 Exterior Window Sill	Wood	4.1
A2 Blind Stop	Wood	4.0
B1 Closet Door Casing	Wood	4.1
B1 Closet Door Jamb	Wood	5.2
B1 Closet Walls	Plaster	16.4
B1 Closet Baseboard	Wood	7.9
B1 Closet Shelf	Wood	8.5
B1 Closet Shelf Supports	Wood	8.1
B1 Closet Ceiling	Plaster	9.6
Room # 4		

- Dangerous level of lead by XRF is equal to or greater than 1.0 mg/cm²
- mg/cm² = milligrams of lead per square centimeter of sampled surface area.
- NA = not able to test, assume positive

Positive Lead Paint Results by XRF
US Coast Guard Air Base Cape Cod
Martha's Vineyard Housing
917 Main St.
Vineyard Haven, Massachusetts
September 20, 2012

Location/Component	Substrate	Results (mg/cm ²)
Walls	Plaster	7.1
Ceiling	Plaster	7.0
Baseboards	Wood	18.0
C1 Door	Wood	1.2
C1 Door Casing	Wood	4.1
C1 Door Jamb	Wood	2.6
C2 Door	Wood	1.2
C2 Door Casing	Wood	1.9
C2 Door Jamb	Wood	2.6
C2 Door (attic side)	Wood	1.2
C2 Door Jamb (attic side)	Wood	1.9
D Door Casing	Wood	7.1
D Door Jamb	Wood	7.6
B Window Sill	Wood	2.6
B Window Apron	Wood	5.7
B Window Casing	Wood	2.9
B Exterior Window Sill	Wood	1.3
B Blind Stop	Wood	1.6
C1 Closet Door	Wood	18.2
C1 Closet Door Casing	Wood	3.2
C1 Closet Door Jamb	Wood	3.0
C1 Closet Walls	Plaster	10.1
C1 Closet Baseboard	Wood	6.8
C1 Closet Shelf Supports	Wood	2.3
C1 Closet Ceiling	Plaster	7.1
Room # 5		
Walls	Plaster	15.0
Ceiling	Plaster	8.1
Baseboards	Wood	18.1

- Dangerous level of lead by XRF is equal to or greater than 1.0 mg/cm²
- mg/cm² = milligrams of lead per square centimeter of sampled surface area.
- NA = not able to test, assume positive

Positive Lead Paint Results by XRF
US Coast Guard Air Base Cape Cod
Martha's Vineyard Housing
917 Main St.
Vineyard Haven, Massachusetts
September 20, 2012

Location/Component	Substrate	Results (mg/cm ²)
A Door Casing	Wood	3.1
A Door Jamb	Wood	3.0
B Door Casing	Wood	4.4
B Door Jamb	Wood	3.8
D Window Sill	Wood	3.0
D Window Apron	Wood	3.1
D Window Casing	Wood	5.1
D Exterior Window Sill	Wood	1.8
D Blind Stop	Wood	2.6
A Closet Door Casing	Wood	3.6
A Closet Door Jamb	Wood	3.1
A Closet Walls	Plaster	11.3
A Closet Baseboard	Wood	29.6
A Closet Shelf Supports	Wood	12.6
A Closet Ceiling	Plaster	NA
A Shelf (in room)	Wood	4.2
Kitchen		
Ceiling	Plaster	NA
Baseboards	Wood	15.7
B1 Door Casing	Wood	2.1
B1 Door Jamb	Wood	4.5
B2 Door Casing	Wood	1.6
B2 Door Jamb	Wood	2.4
C1 Door Casing	Wood	3.8
C1 Door Jamb	Wood	3.2
C2 Door Casing	Wood	1.6
C2 Door Jamb	Wood	1.9
C Exterior Window Sill	Wood	4.0
C Blind Stop	Wood	4.1

- Dangerous level of lead by XRF is equal to or greater than 1.0 mg/cm²
- mg/cm² = milligrams of lead per square centimeter of sampled surface area.
- NA = not able to test, assume positive

Positive Lead Paint Results by XRF
US Coast Guard Air Base Cape Cod
Martha's Vineyard Housing
917 Main St.
Vineyard Haven, Massachusetts
September 20, 2012

Location/Component	Substrate	Results (mg/cm ²)
Bathroom # 1		
Baseboards	Wood	15.7
A Door Casing	Wood	2.1
A Door Jamb	Wood	2.0
B Door Casing	Wood	4.0
B Door Jamb	Wood	4.1
C Window Sill	Wood	4.1
C Window Casing	Wood	3.0
C Exterior Window Sill	Wood	2.1
C Blind Stop	Wood	2.3
Hallway # 1		
Baseboards	Wood	16.4
A Door Casing	Wood	2.3
A Door Jamb	Wood	2.4
D Door Jamb	Wood	2.9
Hallway # 2		
Walls	Plaster	9.1
Ceiling	Plaster	NA
Baseboards	Wood	7.8
A1 Door Casing	Wood	5.2
A1 Door Jamb	Wood	5.1
A2 Door Casing	Wood	3.6
A2 Door Jamb	Wood	3.8
A2 Closet Door Casing	Wood	3.9
A2 Closet Door Jamb	Wood	4.0
A2 Closet Walls	Plaster	11.1
A2 Closet Baseboard	Wood	14.1
A2 Closet Shelf	Wood	1.1
A2 Closet Shelf Supports	Wood	9.6

- Dangerous level of lead by XRF is equal to or greater than 1.0 mg/cm²
- mg/cm² = milligrams of lead per square centimeter of sampled surface area.
- NA = not able to test, assume positive

Positive Lead Paint Results by XRF
US Coast Guard Air Base Cape Cod
Martha's Vineyard Housing
917 Main St.
Vineyard Haven, Massachusetts
September 20, 2012

Location/Component	Substrate	Results (mg/cm ²)
A2 Closet Ceiling	Plaster	11.8
Hallway # 3		
Walls	Plaster	13.0
Ceiling	Plaster	9.3
Baseboards	Wood	6.0
B Door Casing	Wood	2.4
B Door Jamb	Wood	3.0
D Door Casing	Wood	2.6
D Door Jamb	Wood	2.8
A Header	Wood	5.7
Staircase 1st to 2nd		
Walls	Plaster	6.8
Radiator	Metal	1.1
Baseboards	Wood	19.7
A Door Casing	Wood	4.2
A Door Jamb	Wood	1.9
B Door Casing	Wood	1.9
B Door Jamb	Wood	7.1
D1 Door Casing	Wood	3.1
D2 Door Casing	Wood	2.6
D2 Door Jamb	Wood	2.8
A Window Sill	Wood	3.1
A Window Apron	Wood	3.0
A Window Casing	Wood	3.6
A Exterior Window Sill	Wood	4.5
A Blind Stop	Wood	4.2
Stair Risers	Wood	22.4
Stair Stringer	Wood	22.4
Floor Edge	Wood	24.1

- Dangerous level of lead by XRF is equal to or greater than 1.0 mg/cm²
- mg/cm² = milligrams of lead per square centimeter of sampled surface area.
- NA = not able to test, assume positive

Positive Lead Paint Results by XRF
US Coast Guard Air Base Cape Cod
Martha's Vineyard Housing
917 Main St.
Vineyard Haven, Massachusetts
September 20, 2012

Location/Component	Substrate	Results (mg/cm ²)
Floor Casing	Wood	22.4
A Window Above 5'	Wood	16.2
Staircase 1st to Basement		
Lower Walls	Wood	17.6
Wood Slats	Wood	14.0
D Door Casing	Wood	3.6
D Door Jamb	Wood	3.6
Screen Window	Wood	4.6
Columns	Wood	17.6
Stair Treads	Wood	18.1
Stair Risers	Wood	18.6
Stair Stringer	Wood	18.6
Floor Edge	Wood	2.6
Basement Area		
Walls	Wood	2.4
D Door (Interior Side)	Wood	18.6
D Door Casing (Interior Side)	Wood	19.0
D Door Jamb (Interior Side)	Wood	19.1
D Door (Exterior Side)	Wood	18.6
D Door Jamb (Exterior Side)	Wood	15.6
B Cabinet	Wood	19.6
Laundry Room		
Baseboards	Wood	16.1
C Window Sill	Wood	2.8
C Window Casing	Wood	4.6
C Exterior Window Sill	Wood	1.4
C Blind Stop	Wood	1.3
Front Porch (A-Side Porch)		
Upper Trim	Wood	NA

- Dangerous level of lead by XRF is equal to or greater than 1.0 mg/cm²
- mg/cm² = milligrams of lead per square centimeter of sampled surface area.
- NA = not able to test, assume positive

Positive Lead Paint Results by XRF
US Coast Guard Air Base Cape Cod
Martha's Vineyard Housing
917 Main St.
Vineyard Haven, Massachusetts
September 20, 2012

Location/Component	Substrate	Results (mg/cm ²)
Ceiling	Wood	NA
Joists	Wood	NA
A Door Jamb	Wood	2.6
A Door Threshold	Wood	1.6
A Door Kickplate	Wood	1.9
Rear Porch (C-Side Porch)		
Upper Trim	Wood	NA
Ceiling	Wood	NA
Joists	Wood	NA
D Door	Wood	2.5
D Door Casing	Wood	1.2
D Door Jamb	Wood	1.8
D Door Threshold	Wood	1.6
D Door Kickplate	Wood	1.3
C Exterior Window Sill	Wood	1.5
C Exterior Window Casing	Wood	1.4
Support Columns	Wood	3.3
Exterior A-Side		
Corner Boards	Wood	1.6
Upper Trim	Wood	NA
Windows Above 5'	Wood	NA
A Exterior Window Sill (x3)	Wood	1.5
A Exterior Window Casing (x3)	Wood	1.6
Exterior B-Side		
Corner Boards	Wood	1.2
Upper Trim	Wood	NA
Windows Above 5'	Wood	NA
B Door	Wood	3.8
B Door Casing	Wood	3.2

- Dangerous level of lead by XRF is equal to or greater than 1.0 mg/cm²
- mg/cm² = milligrams of lead per square centimeter of sampled surface area.
- NA = not able to test, assume positive

Positive Lead Paint Results by XRF
US Coast Guard Air Base Cape Cod
Martha's Vineyard Housing
917 Main St.
Vineyard Haven, Massachusetts
September 20, 2012

Location/Component	Substrate	Results (mg/cm²)
B Door Jamb	Wood	NA
Exterior C-Side		
Upper Trim	Wood	NA
Windows Above 5'	Wood	NA
Exterior D-Side		
Upper Trim	Wood	NA
Windows Above 5'	Wood	NA

- Dangerous level of lead by XRF is equal to or greater than 1.0 mg/cm²
- mg/cm² = milligrams of lead per square centimeter of sampled surface area.
- NA = not able to test, assume positive

ADDRESS: 917 Main St. Apt# _____ City Vineyard Haven, MA 02568 Page 2 of 25

INSPECTION HISTORY

Determination	<input type="checkbox"/> Y <input type="checkbox"/> N
Lead Hazards?	<input type="checkbox"/> Y <input type="checkbox"/> N

Inspector Name: _____ Lic# _____
Signature _____

Comprehensive (or Initial Inspection)	<input type="checkbox"/> Y <input type="checkbox"/> N
0 9 2 0 1 2	<input type="checkbox"/> Y <input type="checkbox"/> N
Lead Hazards?	<input type="checkbox"/> Y <input type="checkbox"/> N

Inspector (b) (6)
Signature _____

Comp Initial w/Partial PCAD	<input type="checkbox"/> Y <input type="checkbox"/> N
Lead Hazards?	<input type="checkbox"/> Y <input type="checkbox"/> N

Inspector Name: _____ Lic# _____
Signature _____

Additional (add-on to Initial Inspection)	<input type="checkbox"/> Y <input type="checkbox"/> N
Lead Hazards?	<input type="checkbox"/> Y <input type="checkbox"/> N

Inspector Name: _____ Lic# _____
Signature _____

Additional as Full Insp. (Last Date)	<input type="checkbox"/> Y <input type="checkbox"/> N
Lead Hazards?	<input type="checkbox"/> Y <input type="checkbox"/> N

Inspector Name: _____ Lic# _____
Signature _____

Walk through the Ed Construction	<input type="checkbox"/> Y <input type="checkbox"/> N
----------------------------------	---

Inspector Name: _____ Lic# _____
Signature _____

REINSPECTION HISTORY

Visual Portion of Reinspect	<input type="checkbox"/> P <input type="checkbox"/> F
-----------------------------	---

Inspector Name: _____ Lic# _____
Signature _____

Visual Portion of Reinspect	<input type="checkbox"/> P <input type="checkbox"/> F
-----------------------------	---

Inspector Name: _____ Lic# _____
Signature _____

Dust Taken for Reinspect	<input type="checkbox"/> P <input type="checkbox"/> F
--------------------------	---

Inspector Name: _____ Lic# _____
Signature _____

Dust Taken for Reinspect	<input type="checkbox"/> P <input type="checkbox"/> F
--------------------------	---

Inspector Name: _____ Lic# _____
Signature _____

Visual Portion of Final Reinspection	<input type="checkbox"/> P <input type="checkbox"/> F
--------------------------------------	---

Inspector Name: _____ Lic# _____
Signature _____

Visual Portion of Final Reinspection	<input type="checkbox"/> P <input type="checkbox"/> F
--------------------------------------	---

Inspector Name: _____ Lic# _____
Signature _____

Dust Taken for Final Reinspect (No Reinspect)	<input type="checkbox"/> P <input type="checkbox"/> F
---	---

Inspector Name: _____ Lic# _____
Signature _____

Dust Taken for Final Reinspect (No Reinspect)	<input type="checkbox"/> P <input type="checkbox"/> F
---	---

Inspector Name: _____ Lic# _____
Signature _____

INTERIM CONTROL

Risk Assessment	<input type="checkbox"/> Y <input type="checkbox"/> N
Urgent Pb. Search?	<input type="checkbox"/> Y <input type="checkbox"/> N

RA Name: _____ Lic# _____
Signature _____

Dust Taken for Risk Assessment	<input type="checkbox"/> P <input type="checkbox"/> F
--------------------------------	---

RA Name: _____ Lic# _____
Signature _____

Visual Portion of Reinspection for Interim Control	<input type="checkbox"/> P <input type="checkbox"/> F
--	---

RA Name: _____ Lic# _____
Signature _____

Dust Taken for Risk Assessment Reinspect	<input type="checkbox"/> P <input type="checkbox"/> F
--	---

RA Name: _____ Lic# _____
Signature _____

Visual Portion of Reinspection for Interim Control	<input type="checkbox"/> P <input type="checkbox"/> F
--	---

RA Name: _____ Lic# _____
Signature _____

Dust Taken for Risk Assessment Reinspect	<input type="checkbox"/> P <input type="checkbox"/> F
--	---

RA Name: _____ Lic# _____
Signature _____

Risk Assessment Reinspection	<input type="checkbox"/> Y <input type="checkbox"/> N
Urgent Pb. Hazards?	<input type="checkbox"/> Y <input type="checkbox"/> N

RA Name: _____ Lic# _____
Signature _____

Dust Taken for RA Reinspection	<input type="checkbox"/> P <input type="checkbox"/> F
--------------------------------	---

RA Name: _____ Lic# _____
Signature _____

POST COMPLIANCE ASSESSMENT DETERMINATIONS

PCAD	<input type="checkbox"/> Y <input type="checkbox"/> N
Lead Hazards?	<input type="checkbox"/> Y <input type="checkbox"/> N

Inspector Name: _____ Lic# _____
Signature _____

Full Inspection Acting as PCAD	<input type="checkbox"/> Y <input type="checkbox"/> N
Lead Hazards?	<input type="checkbox"/> Y <input type="checkbox"/> N

Inspector Name: _____ Lic# _____
Signature _____

Visual Portion of PCAD Reinspection	<input type="checkbox"/> P <input type="checkbox"/> F
-------------------------------------	---

Inspector Name: _____ Lic# _____
Signature _____

Dust Taken for PCAD Reinspection	<input type="checkbox"/> P <input type="checkbox"/> F
----------------------------------	---

Inspector Name: _____ Lic# _____
Signature _____

Dust Taken for PCAD Reinspection	<input type="checkbox"/> P <input type="checkbox"/> F
----------------------------------	---

Inspector Name: _____ Lic# _____
Signature _____

ADDRESS:

917 Main St.

Apt#

Vineyard Haven, MA 02568

City

Page 3 of 25

REOCCUPANCY CERTIFICATE HISTORY

Certificate of Reoccupancy
Only after High/Med Risk (# rooms rule)

Inspector Name: _____ Lic# _____

Signature _____

Certificate of Reoccupancy
Only after High/Med Risk (# rooms rule)

Inspector Name: _____ Lic# _____

Signature _____

Certificate of Reoccupancy
Only after High/Med Risk (# rooms rule)

Inspector Name: _____ Lic# _____

Signature _____

COMPLIANCE HISTORY

Letter of Full Initial Compliance
No prior history/No signs of IUD

Inspector Name: _____ Lic# _____

Signature _____

Letter of Interim Control
No prior Comp. Expires in 1 yr.

Inspector Name: _____ Lic# _____

Signature _____

Notification of Interim Control
Expires 2 yrs from original Interim Control

Inspector Name: _____ Lic# _____

Signature _____

Letter of Full Defending Compliance
Dust wipes if No Reocc.

Inspector Name: _____ Lic# _____

Signature _____

Certificate of Maintained Compliance
No Work- No Dust Work = 7 Dust

Inspector Name: _____ Lic# _____

Signature _____

Certificate of Restored Compliance
Dust wipes and with people

Inspector Name: _____ Lic# _____

Signature _____

COMPLIANCE HISTORY (CONT.)

Certificate of Maintained Compliance
No Work- No Dust Work = 7 Dust

Inspector Name: _____ Lic# _____

Signature _____

Certificate of Restored Compliance
Dust wipes and with people

Inspector Name: _____ Lic# _____

Signature _____

Certificate of Maintained Compliance
No Work- No Dust Work = 7 Dust

Inspector Name: _____ Lic# _____

Signature _____

Certificate of Restored Compliance
Dust wipes and with people

Inspector Name: _____ Lic# _____

Signature _____

OTHER HISTORY: WAIVERS/UD/EPA.BRP

Approved CLPPP Waiver
Attach to Comp Docs

CLPPP Insp. Name: _____ Lic# _____

Signature _____

Approved CLPPP Waiver
Attach to Comp Docs

CLPPP Insp. Name: _____ Lic# _____

Signature _____

UD / DES Visual Reinspection
No LOC Issued

Inspector Name: _____ Lic# _____

P
F

Signature _____

UD / DES Visual Reinspection
No LOC Issued

Inspector Name: _____ Lic# _____

P
F

Signature _____

UD / DES Dust Taken
No LOC Issued

Inspector Name: _____ Lic# _____

P
F

Signature _____

UNDES Dust Taken
No LOC Issued

Inspector Name: _____ Lic# _____

P
F

Signature _____

EXPLANATION OF LEAD INSPECTION / RISK ASSESSMENT REPORT FORM COLUMNS

This page provides general information needed to understand the lead inspection/risk assessment report. However, you should speak with the inspector/risk assessor before you start to do any work on your home.

SIDE	Refers to A, B, C, or D side of the building or room. See the diagram on the cover sheet. The "A" side of the building or room is the side facing the street that gives the property its address (usually, it is the front of the building). Keeping your back to this street, from the "A" side move clockwise to the "B" side on your left, the "C" side opposite you, and the "D" side to the right. Numbering is from left to right.
LOCATION/ SURFACE	Refers to the building component(s) being tested. Some surfaces may be made up of more than one part. For example, "Baseboard" may refer to four separate pieces of wood (one on each wall), but is still considered one surface.
LEAD	<p>The actual lead result. Each surface tested must have a result recorded in the "Lead" column.</p> <ul style="list-style-type: none"> A number shows that the surface was tested with an XRF analyzer. A number (or average number) equal to or greater than 1.0 mg/cm² is a dangerous level of lead. A "pos" or "neg" shows that the surface was tested with sodium sulfide. "Pos" means that there is a dangerous level of lead. "N/A" means that the inspector was not able to test the surface. Unless the owner can get a sample to test, the inspector must assume the surface contains lead and require it to be abated, if necessary. "MET" or "MR" means that a metal surface was not tested and only needs to be intact, even if it is a leaded surface. However, metal handrails, metal window sills, and metal railing caps, need to be abated if they test equal to or greater than 1.0 mg/cm², or is marked "N/A." For key to abbreviations like "COV", "VB", "VR" or "MR", "NC", "Tile", "DC", see the cover page. When a component box is slashed and there are test results above and below the diagonal line, the result on the "bottom" represents results below 5 ft. and the "top" result indicates the test result above 5 ft.
TYPE OF HAZARD	<p>Not all lead paint must be abated. This column tells you IF and WHY a surface needs abating. The abating standards below may not apply for Interim Control. Speak to your risk assessor for more information.</p> <ul style="list-style-type: none"> "M/I" circled means that the surface is a moveable/impaired surface and must be abated in its entirety. "SF" circled indicates that there is a storm frame present which requires the blind stop and exterior sill be abated as interior moveable / impaired surfaces. "A/M" circled means that the surface is "accessible mouthable" and must be abated to a minimum of five feet high, four inches in from the edge or corner. "L" circled means that the surface is loose and must, at minimum, be made intact. If more than one choice is circled, the rules for abating may change depending upon what method of abating you choose. Speak to the inspector for more information. "N/A" means the inspector was unable to determine if the surface was a lead hazard. The person doing the abating must check this surface and follow all the rules for abating. Speak to the inspector for more information. If nothing is circled in the column, then it is likely the surface does not need abating. Speak to the inspector for more information. Remember, this does not mean the entire surface is lead free, it just does not require abating in its current condition.
URG HAZ?	This column is only completed during a risk assessment. A risk assessment is an evaluation of a home's suitability for Interim Control. Only a licensed risk assessor can do a risk assessment, not all inspectors are risk assessors. If "Y" is circled, then this surface is considered an "Urgent Lead Hazard" and some type of abating work is required to qualify for Interim Control.
IC DATE	The date the licensed risk assessor determines the surface meets the standards for Interim Control.
IC METH	The abating method or structural repair done to qualify the surface for Interim Control. Refer to the abating codes key on the cover page.
DELEAD DATE	The date that the lead inspector reinspects the surface and finds that it has been successfully brought back into compliance.
DELEAD METH	The method used to bring a surface into full compliance. Refer to codes in the Key on the cover page of the PCAD.
EXCLUDED SURFACES	The amount of loose paint on a surface as measured by the lead inspector. "N/A" means that the inspector was not able to measure the loose paint, but has determined it is more than the cut-off for moderate risk making intact.

(b) (6)

09-20-2012

Page 5 of 25

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 917 Main St.

Apt #: 44444

City: Vineyard Haven, MA 02568

ROOM # 1

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A B	Up Walls	0.40	AM L N/A	Y				
A B	Low Walls		AM L N/A	Y				
A B	Baseboards	2.1	AM L N/A	Y				
A B	Closet Rail		AM L N/A	Y				
A B	Radiator	0.50	AM L N/A	Y				
A B	Floor	0.50	AM L N/A	Y				
A B	Ceiling	0.50	AM L N/A	Y				
A B	Door		AM L N/A	Y				
C D	Door Casing	2.1	AM L N/A	Y				
1 2	Door Jamb	0.50	AM L N/A	Y				
3 4	Threshold	0.50	AM L N/A	Y				
A B	Door		AM L N/A	Y				
C D	Door Casing		AM L N/A	Y				
1 2	Door Jamb		AM L N/A	Y				
3 4	Threshold		AM L N/A	Y				
A B	Door		AM L N/A	Y				
C D	Door Casing		AM L N/A	Y				
1 2	Door Jamb		AM L N/A	Y				
3 4	Threshold		AM L N/A	Y				
A B	Door		AM L N/A	Y				
C D	Door Casing		AM L N/A	Y				
1 2	Door Jamb		AM L N/A	Y				
3 4	Threshold		AM L N/A	Y				
A	Closet Door		AM L N/A	Y				
B	Closet Casing		AM L N/A	Y				
C	Closet Jamb		AM L N/A	Y				
D	Closet Wall		AM L N/A	Y				
	Closet Baseboard		AM L N/A	Y				
1	Closet Pole		AM L N/A	Y				
2	Closet Shelf		AM L N/A	Y				
3	Closet Support		AM L N/A	Y				
4	Closet Floor		AM L N/A	Y				
	Closet Ceiling		AM L N/A	Y				

COMMENTS / STRUCTURAL DEFECTS:

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 200 SQ. IN.)	IC DATE	IC METHOD

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 200 SQ. IN.)	IC DATE	IC METHOD

Date: _____

(b) (6)

Date _____

City: Vineyard Haven, MA 02568

ROOM# 2

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A B C D	Up Walls	8.05	AM L N/A	Y				
A B C D	Low Walls	/	AM L N/A	Y				
A B C D	Baseboards	31.2	AM L N/A	Y				
A B C D	Chair Rail	/	AM L N/A	Y				
A B C D	Radiator	3.15	AM L N/A	Y				
A B C D	Floor	0.00	AM L N/A	Y				
A B C D	Ceiling	0.00	AM L N/A	Y				
A B C D	Door	2.00	AM L N/A	Y				
A B C D	Door Casing	4.6	AM L N/A	Y				
A B C D	Door Jamb	2.1	AM L N/A	Y				
A B C D	Threshold	6.01	AM L N/A	Y				
A B C D	Door	6.02	AM L N/A	Y				
A B C D	Door Casing	2.1	AM L N/A	Y				
A B C D	Door Jamb	4.1	AM L N/A	Y				
A B C D	Threshold	2.11	AM L N/A	Y				
A B C D	Door	/	AM L N/A	Y				
A B C D	Door Casing	/	AM L N/A	Y				
A B C D	Door Jamb	/	AM L N/A	Y				
A B C D	Threshold	/	AM L N/A	Y				
A B C D	Door	/	AM L N/A	Y				
A B C D	Door Casing	/	AM L N/A	Y				
A B C D	Door Jamb	/	AM L N/A	Y				
A B C D	Threshold	/	AM L N/A	Y				
A B C D	Closet Door	2.02	AM L N/A	Y				
A B C D	Closet Casing	3.1	AM L N/A	Y				
A B C D	Closet Jamb	2.0	AM L N/A	Y				
A B C D	Closet Walls	1.01	AM L N/A	Y				
A B C D	Closet Baseboard	0.1	AM L N/A	Y				
A B C D	Closet Floor	0.11	AM L N/A	Y				
A B C D	Closet Shelf	1.1	AM L N/A	Y				
A B C D	Closet Supports	1.1	AM L N/A	Y				
A B C D	Closet Floor	0.20	AM L N/A	Y				
A B C D	Closet Ceiling	N/A	AM L N/A	Y				

COMMENTS/STRUCTURAL DEFECTS:

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A	Window Sill	4.1	MI AM L N/A	Y				
B	Win Apron	4.2	AM L N/A	Y				
C	Win Casing	4.1	MI L N/A	Y				
D	Header Stop	4.3	MI AM L N/A	Y				
	Int Stops	4.4	MI AM L N/A	Y				
1	Win Int Sash	4.5	MI AM L N/A	Y				
2	Exterior Sill	4.6	MI SF L N/A	Y				
3	Part Bead	4.7	MI L N/A	Y				
4	Blind Stop	4.8	MI SF L N/A	Y				
	Win Ext Sash	4.9	MI L N/A	Y				
A	Window Sill	4.1	MI AM L N/A	Y				
B	Win Apron	4.2	AM L N/A	Y				
C	Win Casing	4.3	MI L N/A	Y				
D	Header Stop	4.4	MI AM L N/A	Y				
	Int Stops	4.5	MI AM L N/A	Y				
1	Win Int Sash	4.6	MI AM L N/A	Y				
2	Exterior Sill	4.7	MI SF L N/A	Y				
3	Part Bead	4.8	MI L N/A	Y				
4	Blind Stop	4.9	MI SF L N/A	Y				
	Win Ext Sash	4.10	MI L N/A	Y				
A	Window Sill		MI AM L N/A	Y				
B	Win Apron		AM L N/A	Y				
C	Win Casing		AM L N/A	Y				
D	Header Stop		MI AM L N/A	Y				
	Int Stops		MI AM L N/A	Y				
1	Win Int Sash		MI AM L N/A	Y				
2	Exterior Sill		MI SF L N/A	Y				
3	Part Bead		MI L N/A	Y				
4	Blind Stop		MI SF L N/A	Y				
	Win Ext Sash		MI L N/A	Y				
A/B	Fireplace		AM L N/A	Y				
C/D	Mantle		AM L N/A	Y				
A/B	Win Above S		AM L N/A	Y				
C/D	Ceiling Molding		AM L N/A	Y				
A	F.P.C.	4.15	AM L N/A	Y				
			AM L N/A	Y				
			AM L N/A	Y				

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed dealer.

[illegible]

(b) (6)

09-20-2012

Page 7 of 25

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property:

917 Main St.

Apt #:

AMARA

City: Vineyard Haven, MA 02568

ROOM # 3

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A B	Up Walls	0.14	AM L N/A	Y				
A B	Low Walls		AM L N/A	Y				
A B	Baseboards	0.15	AM L N/A	Y				
A B	Chair Rail		AM L N/A	Y				
A B	Radiator	0.02	AM L N/A	Y				
A B	Floor	0.05	AM L N/A	Y				
A B	Ceiling	0.15	AM L N/A	Y				
A B	Door	0.03	AM L N/A	Y				
C D	Door Casing	0.1	AM L N/A	Y				
1 2	Door Jamb	0.13	AM L N/A	Y				
3 4	Threshold		AM L N/A	Y				
A B	Door	0.04	AM L N/A	Y				
C D	Door Casing	0.1	AM L N/A	Y				
1 2	Door Jamb	0.13	AM L N/A	Y				
3 4	Threshold		AM L N/A	Y				
A B	Door		AM L N/A	Y				
C D	Door Casing		AM L N/A	Y				
1 2	Door Jamb		AM L N/A	Y				
3 4	Threshold		AM L N/A	Y				
A B	Door		AM L N/A	Y				
C D	Door Casing		AM L N/A	Y				
1 2	Door Jamb		AM L N/A	Y				
3 4	Threshold		AM L N/A	Y				
A	Closet Door	0.01	AM L N/A	Y				
B	Closet Casing	0.1	AM L N/A	Y				
C	Closet Jamb	0.12	AM L N/A	Y				
D	Closet Walls	0.13	AM L N/A	Y				
	Closet Baseboard	0.19	AM L N/A	Y				
1	Closet Pole	0.00	AM L N/A	Y				
2	Closet Shelf	0.15	AM L N/A	Y				
3	Closet Supports	0.1	AM L N/A	Y				
4	Closet Floor	0.02	AM L N/A	Y				
	Closet Ceiling	0.16	AM L N/A	Y				

COMMENTS/STRUCTURAL DEFECTS:

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

(b) (6)

09-20-2012

Page 8 of 25

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property:

917 Main St.

Apt #:

N/A

City: Vineyard Haven, MA 02568

ROOM # 4

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A B	Up Walls	3.1	AM L N/A	Y				
A B	Low Walls		AM L N/A	Y				
A B	Baseboards	13.0	AM L N/A	Y				
A B	Chair Rail		AM L N/A	Y				
A B	Railings	0.04	AM L N/A	Y				
A B	Floor	0.01	AM L N/A	Y				
A B	Ceiling	7.0	AM L N/A	Y				
A B	Door	1.2	AM L N/A	Y				
C D	Door Casing	4.1	AM L N/A	Y				
1 2	Door Jamb	2.6	AM L N/A	Y				
3 4	Threshold		AM L N/A	Y				
A B	Door	1.2	AM L N/A	Y				
C D	Door Casing	1.9	AM L N/A	Y				
1 2	Door Jamb	2.6	AM L N/A	Y				
3 4	Threshold	0.01	AM L N/A	Y				
A B	Door	0.04	AM L N/A	Y				
C D	Door Casing	3.1	AM L N/A	Y				
1 2	Door Jamb	1.6	AM L N/A	Y				
3 4	Threshold	0.01	AM L N/A	Y				
A B	Door (1)	1.2	AM L N/A	Y				
C D	Door Casing		AM L N/A	Y				
1 2	Door Jamb	1.9	AM L N/A	Y				
3 4	Threshold	0.01	AM L N/A	Y				
A	Closet Door	15.2	AM L N/A	Y				
B	Closet Casing	3.2	AM L N/A	Y				
C	Closet Jamb	3.0	AM L N/A	Y				
D	Closet Walls	10.1	AM L N/A	Y				
	Closet Baseboard	6.8	AM L N/A	Y				
	Closet Pole	0.04	AM L N/A	Y				
2	Closet Shelf		AM L N/A	Y				
3	Closet Support	0.03	AM L N/A	Y				
4	Closet Floor	0.01	AM L N/A	Y				
	Closet Ceiling	7.1	AM L N/A	Y				

COMMENTS / STRUCTURAL DEFECTS:
 (1) other side of C2 door in
 CRAWL SPACE

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

(b) (6)

09-20-2012

Page 9 of 25

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property:

917 Main St.

Apt #:

AAAAA

City: Vineyard Haven, MA 02568

ROOM # 5

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A B	Up Walls	15.13	AM L N/A	Y				
A B	Low Walls		AM L N/A	Y				
A B	Baseboards	18.1	AM L N/A	Y				
A B	Chair Rail		AM L N/A	Y				
A B	Radiator	0.00	AM L N/A	Y				
A B	Floor	0.00	AM L N/A	Y				
A B	Ceiling	8.1	AM L N/A	Y				
A B	Door	0.00	AM L N/A	Y				
C D	Door Casing	3.1	AM L N/A	Y				
12	Door Jamb	3.0	AM L N/A	Y				
34	Threshold		AM L N/A	Y				
A B	Door	0.00	AM L N/A	Y				
C D	Door Casing	4.4	AM L N/A	Y				
12	Door Jamb	3.2	AM L N/A	Y				
34	Threshold	0.00	AM L N/A	Y				
A B	Door	0.00	AM L N/A	Y				
C D	Door Casing	0.00	AM L N/A	Y				
12	Door Jamb	0.00	AM L N/A	Y				
34	Threshold		AM L N/A	Y				
A B	Door		AM L N/A	Y				
C D	Door Casing		AM L N/A	Y				
12	Door Jamb		AM L N/A	Y				
34	Threshold		AM L N/A	Y				
A	Closet Door	0.00	AM L N/A	Y				
B	Ct Casing	3.0	AM L N/A	Y				
C	Closet Jamb	0.1	AM L N/A	Y				
D	Closet Walls	11.3	AM L N/A	Y				
	Ct Encased	2.4	AM L N/A	Y				
1	Closet Pate	0.00	AM L N/A	Y				
2	Closet Shelf	0.00	AM L N/A	Y				
3	Ct Supports	12.4	AM L N/A	Y				
4	Closet Floor	0.00	AM L N/A	Y				
	Closet Ceiling	N/A	AM L N/A	Y				

COMMENTS / STRUCTURAL DEFECTS:

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A	Window Sill	2.0	AM L N/A	Y				
B	Win Apron	3.1	AM L N/A	Y				
C	Win Casing	3.1	AM L N/A	Y				
D	Header Stop	0.00	AM L N/A	Y				
	Int Stops	0.00	AM L N/A	Y				
1	Win Int Sash	0.00	AM L N/A	Y				
2	Exterior Sill	1.2	AM SF L N/A	Y				
3	Part Bead	0.00	AM L N/A	Y				
4	Blind Stop	2.0	AM SF L N/A	Y				
	Win Ext Sash	0.00	AM L N/A	Y				
A	Window Sill		AM L N/A	Y				
B	Win Apron		AM L N/A	Y				
C	Win Casing		AM L N/A	Y				
D	Header Stop		AM L N/A	Y				
	Int Stops		AM L N/A	Y				
1	Win Int Sash		AM L N/A	Y				
2	Exterior Sill		AM SF L N/A	Y				
3	Part Bead		AM L N/A	Y				
4	Blind Stop		AM SF L N/A	Y				
	Win Ext Sash		AM L N/A	Y				
A	Window Sill		AM L N/A	Y				
B	Win Apron		AM L N/A	Y				
C	Win Casing		AM L N/A	Y				
D	Header Stop		AM L N/A	Y				
	Int Stops		AM L N/A	Y				
1	Win Int Sash		AM L N/A	Y				
2	Exterior Sill		AM SF L N/A	Y				
3	Part Bead		AM L N/A	Y				
4	Blind Stop		AM SF L N/A	Y				
	Win Ext Sash		AM L N/A	Y				
A B	Fireplace		AM L N/A	Y				
C D	Mantle		AM L N/A	Y				
A B	Win Above S		AM L N/A	Y				
C D	Ceiling Molding		AM L N/A	Y				
E	EXTERIOR	0.00	AM L N/A	Y				
F	SHED	4.2	AM L N/A	Y				
G	Support	0.00	AM L N/A	Y				

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

(b) (6)

09-20-2012

Page 10 of 25

Inspector (print)

Lic#

Signature

Date

(b) (6)

Risk Assessor (print)

Lic#

Signature

Date

Address of Property: 917 Main St.

Apt #: AAAAAA

City: Vineyard Haven, MA 02568

KITCHEN

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A/B	UP Walls	0.00	AM L N/A	Y				
A/B	Low Walls		AM L N/A	Y				
A/B	Baseboards	15.3	AM L N/A	Y				
A/B	Chair Rail		AM L N/A	Y				
A/B	Radiator	0.0	AM L N/A	Y				
	Floor	0.0	AM L N/A	Y				
	Ceiling	NA	AM L N/A	Y				
A/B	Door		AM L N/A	Y				
C/D	Door Casing	2.1	AM L N/A	Y				
1/2	Door Jamb	4.5	AM L N/A	Y				
3/4	Threshold	0.0	AM L N/A	Y				
A/B	Door	0.0	AM L N/A	Y				
C/D	Door Casing	1.6	AM L N/A	Y				
1/2	Door Jamb	2.4	AM L N/A	Y				
3/4	Threshold	0.0	AM L N/A	Y				
A/B	Door	0.0	AM L N/A	Y				
C/D	Door Casing	3.2	AM L N/A	Y				
1/2	Door Jamb	3.2	AM L N/A	Y				
3/4	Threshold	0.0	AM L N/A	Y				
A/B	Door		AM L N/A	Y				
C/D	Door Casing	1.6	AM L N/A	Y				
1/2	Door Jamb	1.9	AM L N/A	Y				
3/4	Threshold	0.0	AM L N/A	Y				
A	Closet Door		AM L N/A	Y				
B	Cl Casing		AM L N/A	Y				
C	Closet Jamb		AM L N/A	Y				
D	Closet Walls		AM L N/A	Y				
	Cl Baseboard		AM L N/A	Y				
1	Closet Pole		AM L N/A	Y				
2	Closet Shelf		AM L N/A	Y				
3	Cl Supports		AM L N/A	Y				
4	Closet Floor		AM L N/A	Y				
	Closet Ceiling		AM L N/A	Y				

COMMENTS / STRUCTURAL DEFECTS:

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

Page 1 of 25

ଜାତୀୟ

Date:

City: Vineyard Haven, MA 02568

start

[illegible]

COMMENTS / STRUCTURAL DEFECTS:

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

LIBRA RepBath, 8/08

Page 12 of 25

Date: _____

Date

City: Vineyard Haven, MA 02568

[illegible]

COMMENTS: STRUCTURAL DEFECTS:

COMMENTS / STRUCTURAL DEFECTS:

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed dealer.

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 286 SQ. IN.)	IC DATE	IC METHOD

(b) (6)

09-20-2012

Page 13 of 25

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property:

817 Main St

Apt #:

AARAAA

City: Vineyard Haven, MA 02568

HALLWAY

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A B	Up Walls	0.34	AM L N/A	Y				
A B	Low Walls		AM L N/A	Y				
A B	Baseboards	16.4	AM L N/A	Y				
A B	Chair Rail		AM L N/A	Y				
A B	Radiator		AM L N/A	Y				
A B	Floor	11.2	AM L N/A	Y				
A B	Ceiling	0.34	AM L N/A	Y				
A B	Door		AM L N/A	Y				
C D	Door Casing	2.3	AM L N/A	Y				
12	Door Jamb	2.4	AM L N/A	Y				
34	Threshold	0.01	AM L N/A	Y				
A B	Door	0.40	AM L N/A	Y				
C D	Door Casing	0.01	AM L N/A	Y				
12	Door Jamb	2.9	AM L N/A	Y				
34	Threshold	0.20	AM L N/A	Y				
A B	Door		AM L N/A	Y				
C D	Door Casing		AM L N/A	Y				
12	Door Jamb		AM L N/A	Y				
34	Threshold		AM L N/A	Y				
A B	Door		AM L N/A	Y				
C D	Door Casing		AM L N/A	Y				
12	Door Jamb		AM L N/A	Y				
34	Threshold		AM L N/A	Y				
A	Closet Door		AM L N/A	Y				
B	Cl Casing		AM L N/A	Y				
C	Closet Jamb		AM L N/A	Y				
D	Closet Walls		AM L N/A	Y				
	Cl Baseboard		AM L N/A	Y				
1	Closet Pole		AM L N/A	Y				
2	Closet Shelf		AM L N/A	Y				
3	Cl Supports		AM L N/A	Y				
4	Closet Floor		AM L N/A	Y				
	Closet Ceiling		AM L N/A	Y				
A	Window Sill		AM L N/A	Y				
B	Win Apron		AM L N/A	Y				
C	Win Casing		AM L N/A	Y				
D	Header Stop		AM L N/A	Y				
	Int Stops		AM L N/A	Y				
1	Win Int Sash		AM L N/A	Y				
2	Exterior Sill		AM SF L N/A	Y				
3	Part Bead		AM L N/A	Y				
4	Blind Stop		AM SF L N/A	Y				
	Win Ext Sash		AM L N/A	Y				
A	Window Sill		AM L N/A	Y				
B	Win Apron		AM L N/A	Y				
C	Win Casing		AM L N/A	Y				
D	Header Stop		AM L N/A	Y				
	Int Stops		AM L N/A	Y				
1	Win Int Sash		AM L N/A	Y				
2	Exterior Sill		AM SF L N/A	Y				
3	Part Bead		AM L N/A	Y				
4	Blind Stop		AM SF L N/A	Y				
	Win Ext Sash		AM L N/A	Y				
A B	Win Above 5'		AM L N/A	Y				
A B	Ceiling Molding		AM L N/A	Y				
B	Support	0.34	AM L N/A	Y				

COMMENTS / STRUCTURAL DEFECTS:

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

(b) (6)

09-20-2012

Page 14 of 25

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property:

917 Main St.

Apt #:

MAAAM

City: Vineyard Haven, MA 02568

HALLWAY # 2

SIDE	LOCATION/SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A B	Up Walls	9.1	AM L N/A	Y				
A B	Low Walls		AM L N/A	Y				
A B	Baseboards	7.8	AM L N/A	Y				
A B	Chair Rail		AM L N/A	Y				
A B	Radiator		AM L N/A	Y				
A B	Floor	2.0	AM L N/A	Y				
A B	Ceiling	1.0	AM L N/A	Y				
A B	Door	0.04	AM L N/A	Y				
A B	Door Casing	5.2	AM L N/A	Y				
A B	Door Jamb	5.1	AM L N/A	Y				
A B	Threshold	0.04	AM L N/A	Y				
A B	Door	0.01	AM L N/A	Y				
A B	Door Casing	3.6	AM L N/A	Y				
A B	Door Jamb	3.3	AM L N/A	Y				
A B	Threshold		AM L N/A	Y				
A B	Door		AM L N/A	Y				
A B	Door Casing		AM L N/A	Y				
A B	Door Jamb		AM L N/A	Y				
A B	Threshold		AM L N/A	Y				
A B	Door		AM L N/A	Y				
A B	Door Casing		AM L N/A	Y				
A B	Door Jamb		AM L N/A	Y				
A B	Threshold		AM L N/A	Y				
A B	Closet Door	0.10	AM L N/A	Y				
A B	Cl Casing	2.9	AM L N/A	Y				
A B	Closet Jamb	4.0	AM L N/A	Y				
A B	Closet Walls	11.1	AM L N/A	Y				
A B	Cl Baseboard	14.1	AM L N/A	Y				
A B	Closet Pole		AM L N/A	Y				
A B	Closet Shelf	1.1	AM L N/A	Y				
A B	Cl Supports	9.6	AM L N/A	Y				
A B	Closet Floor	10.0	AM L N/A	Y				
A B	Closet Ceiling	11.2	AM L N/A	Y				
A B	Closet Door		AM L N/A	Y				
A B	Cl Casing		AM L N/A	Y				
A B	Closet Jamb		AM L N/A	Y				
A B	Closet Walls		AM L N/A	Y				
A B	Cl Baseboard		AM L N/A	Y				
A B	Closet Pole		AM L N/A	Y				
A B	Closet Shelf		AM L N/A	Y				
A B	Cl Supports		AM L N/A	Y				
A B	Closet Floor		AM L N/A	Y				
A B	Closet Ceiling		AM L N/A	Y				

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 200 SQ. IN.)	IC DATE	IC METHOD

(b) (6)

09-20-2012

Page 15 of 25

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 917 Main St.

Apt #:

AAAAA

City: Vineyard Haven, MA 02568

SIDE	LOCATION/SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A/B	Up Walls	1.6	AM L N/A	Y				
A/B	Low Walls	1.6	AM L N/A	Y				
A/B	Baseboards	1.6	AM L N/A	Y				
A/B	Chair Rail	1.6	AM L N/A	Y				
A/B	Radiator	1.6	AM L N/A	Y				
A/B	Floor	1.6	AM L N/A	Y				
A/B	Ceiling	1.6	AM L N/A	Y				
A/B	Door	1.6	AM L N/A	Y				
C/D	Door Casing	2.1	AM L N/A	Y				
12	Door Jamb	3.5	AM L N/A	Y				
34	Threshold	0.4	AM L N/A	Y				
A/B	Door	0.2	AM L N/A	Y				
C/D	Door Casing	0.1	AM L N/A	Y				
12	Door Jamb	0.4	AM L N/A	Y				
34	Threshold	0.0	AM L N/A	Y				
A/B	Door	0.1	AM L N/A	Y				
C/D	Door Casing	2.1	AM L N/A	Y				
12	Door Jamb	2.9	AM L N/A	Y				
34	Threshold	0.0	AM L N/A	Y				
A/B	Door		AM L N/A	Y				
C/D	Door Casing		AM L N/A	Y				
12	Door Jamb		AM L N/A	Y				
34	Threshold		AM L N/A	Y				
A	Closet Door		AM L N/A	Y				
B	Closet Casing		AM L N/A	Y				
C	Closet Jamb		AM L N/A	Y				
D	Closet Walls		AM L N/A	Y				
	Closet Baseboard		AM L N/A	Y				
1	Closet Floor		AM L N/A	Y				
2	Closet Shelf		AM L N/A	Y				
3	Closet Support		AM L N/A	Y				
4	Closet Floor		AM L N/A	Y				
	Closet Ceiling		AM L N/A	Y				

COMMENTS / STRUCTURAL DEFECTS:

SIDE	LOCATION/SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A	Window Sill		AM L N/A	Y				
B	Win Apron		AM L N/A	Y				
C	Win Casing		AM L N/A	Y				
D	Header Stop		AM L N/A	Y				
	Int Stops		AM L N/A	Y				
1	Win Int Sash		AM L N/A	Y				
2	Exterior Sill		AM SF L N/A	Y				
3	Part Board		AM L N/A	Y				
4	Blind Stop		AM SF L N/A	Y				
	Win Ext Sash		AM L N/A	Y				
A	Window Sill		AM L N/A	Y				
B	Win Apron		AM L N/A	Y				
C	Win Casing		AM L N/A	Y				
D	Header Stop		AM L N/A	Y				
	Int Stops		AM L N/A	Y				
1	Win Int Sash		AM L N/A	Y				
2	Exterior Sill		AM SF L N/A	Y				
3	Part Board		AM L N/A	Y				
4	Blind Stop		AM SF L N/A	Y				
	Win Ext Sash		AM L N/A	Y				
A	Window Sill		AM L N/A	Y				
B	Win Apron		AM L N/A	Y				
C	Win Casing		AM L N/A	Y				
D	Header Stop		AM L N/A	Y				
	Int Stops		AM L N/A	Y				
1	Win Int Sash		AM L N/A	Y				
2	Exterior Sill		AM SF L N/A	Y				
3	Part Board		AM L N/A	Y				
4	Blind Stop		AM SF L N/A	Y				
	Win Ext Sash		AM L N/A	Y				
A/B	Fireplace		AM L N/A	Y				
C/D	Mantle		AM L N/A	Y				
A/B	Win Above S		AM L N/A	Y				
	Ceiling Molding		AM L N/A	Y				
A	Header	S.C.	AM L N/A	Y				
			AM L N/A	Y				
			AM L N/A	Y				

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

(b) (6)

09-20-2012

Page 16 of 25

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 917 Main St.

Apt #

City: Vineyard Haven, MA 02568

STAIRCASE 1ST TO 2ND

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A B	Up Walls	0.5	AM L N/A	Y				
A B	Low Walls		AM L N/A	Y				
A B	Baseboards	0.7	AM L N/A	Y				
A B	Chair Rail		AM L N/A	Y				
A B	Radiator	0.1	AM L N/A	Y				
	Floor	0.5	AM L N/A	Y				
	Ceiling	0.12	AM L N/A	Y				
A B	Door 1st	0.00	AM L N/A	Y				
C D	Door Casing	4.2	AM L N/A	Y				
12	Door Jamb	1.9	AM L N/A	Y				
34	Threshold	0.3	AM L N/A	Y				
A B	Door 1st	0.00	AM L N/A	Y				
C D	Door Casing	1.9	AM L N/A	Y				
12	Door Jamb	7.1	AM L N/A	Y				
34	Threshold	0.06	AM L N/A	Y				
A B	Door		AM L N/A	Y				
C D	Door Casing	3.1	AM L N/A	Y				
12	Door Jamb	0.4	AM L N/A	Y				
34	Threshold	0.01	AM L N/A	Y				
A B	Door		AM L N/A	Y				
C D	Door Casing	1.5	AM L N/A	Y				
12	Door Jamb	2.3	AM L N/A	Y				
34	Threshold	0.01	AM L N/A	Y				
A B	Door		AM L N/A	Y				
C D	Door Casing		AM L N/A	Y				
#	Door Jamb		AM L N/A	Y				
	Threshold		AM L N/A	Y				
A	Closet Door		AM L N/A	Y				
B	Closet Casing		AM L N/A	Y				
C	Closet Jamb		AM L N/A	Y				
D	Closet Walls		AM L N/A	Y				
	Closet Baseboard		AM L N/A	Y				
1	Closet Pole		AM L N/A	Y				
2	Closet Shelf		AM L N/A	Y				
3	Closet Supports		AM L N/A	Y				
4	Closet Floor		AM L N/A	Y				
	Closet Ceiling		AM L N/A	Y				

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A	Window Sill	3.1	AM L N/A	Y				
B	Win Apron	3.0	AM L N/A	Y				
C	Win Casing	3.6	AM L N/A	Y				
D	Header Stop	0.31	AM L N/A	Y				
	Int Stops	0.00	AM L N/A	Y				
1	Win Int Sash	0.01	AM L N/A	Y				
2	Exterior Sill	4.5	AM L N/A	Y				
3	Part Bead	0.00	AM L N/A	Y				
4	Blind Stop	4.2	AM L N/A	Y				
	Win Ext Sash	0.00	AM L N/A	Y				
A	Window Sill		AM L N/A	Y				
B	Win Apron		AM L N/A	Y				
C	Win Casing		AM L N/A	Y				
D	Header Stop		AM L N/A	Y				
	Int Stops		AM L N/A	Y				
1	Win Int Sash		AM L N/A	Y				
2	Exterior Sill		AM L N/A	Y				
3	Part Bead		AM L N/A	Y				
4	Blind Stop		AM L N/A	Y				
	Win Ext Sash		AM L N/A	Y				
	Nivel Post	0.00	AM L N/A	Y				
	Railing Cap	0.01	AM L N/A	Y				
	Handrail		AM L N/A	Y				
	Balusters	0.01	AM L N/A	Y				
	Lowerrail		AM L N/A	Y				
	Triade	0.6	AM L N/A	Y				
	Risers	22.4	AM L N/A	Y				
	Stringer	22.4	AM L N/A	Y				
	Floor Edge	24.1	AM L N/A	Y				
	Floor Casing	22.4	AM L N/A	Y				
A	Win Apron	10.2	AM L N/A	Y				

COMMENTS / STRUCTURAL DEFECTS:

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

(b) (6)

09-20-2012

Page 17 of 25

Inspector (print)

Lic#

Signature

Date

(b) (6)

Risk Assessor (print)

Lic#

Signature

Date

Address of Property: 917 Main St.

Apt #: 44444

City: Vineyard Haven, MA 02568

STAIRCASE 157 to 158

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A B	Up Walls	0.3	AM L N/A	Y				
A B	Low Walls	0.6	AM L N/A	Y				
A B	Baseboards		AM L N/A	Y				
A B	Staircase	0.6	AM L N/A	Y				
A B	Reflector		AM L N/A	Y				
A B	Floor	0.3	AM L N/A	Y				
A B	Ceiling	0.0	AM L N/A	Y				
A B	Door (set)	0.0	AM L N/A	Y				
C D	Door Casing	0.6	AM L N/A	Y				
1 2	Door Jamb	0.6	AM L N/A	Y				
3 4	Threshold		AM L N/A	Y				
A B	Door		AM L N/A	Y				
C D	Door Casing		AM L N/A	Y				
1 2	Door Jamb		AM L N/A	Y				
3 4	Threshold		AM L N/A	Y				
A B	Door		AM L N/A	Y				
C D	Door Casing		AM L N/A	Y				
1 2	Door Jamb		AM L N/A	Y				
3 4	Threshold		AM L N/A	Y				
A B	Door		AM L N/A	Y				
C D	Door Casing		AM L N/A	Y				
1 2	Door Jamb		AM L N/A	Y				
3 4	Threshold		AM L N/A	Y				
A B	Door		AM L N/A	Y				
C D	Door Casing		AM L N/A	Y				
1 2	Door Jamb		AM L N/A	Y				
3 4	Threshold		AM L N/A	Y				
A B	Door		AM L N/A	Y				
C D	Door Casing		AM L N/A	Y				
1 2	Door Jamb		AM L N/A	Y				
3 4	Threshold		AM L N/A	Y				
A	Closest Door		AM L N/A	Y				
B	Closest Casing		AM L N/A	Y				
C	Closest Jamb		AM L N/A	Y				
D	Closest Walls		AM L N/A	Y				
	Closest Baseboard		AM L N/A	Y				
1	Closest Pole		AM L N/A	Y				
2	Closest Shelf		AM L N/A	Y				
3	Closest Supports		AM L N/A	Y				
4	Closest Floor		AM L N/A	Y				
	Closest Ceiling		AM L N/A	Y				

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A	Window Sill	0.0	AM L N/A	Y				
B	Win Apron		AM L N/A	Y				
C	Win Casing	0.0	AM L N/A	Y				
D	Header Stop		AM L N/A	Y				
	Int Stop		AM L N/A	Y				
1	Win Int Sash	0.0	AM L N/A	Y				
2	Exterior Sill	0.0	AM SF L N/A	Y				
3	Part Sash	0.0	AM L N/A	Y				
4	Blind Stop		AM SF L N/A	Y				
	Win Ext Sash	0.0	AM L N/A	Y				
A	Window Sill	0.0	AM L N/A	Y				
B	Win Apron		AM L N/A	Y				
C	Win Casing		AM L N/A	Y				
D	Header Stop		AM L N/A	Y				
	Int Stop		AM L N/A	Y				
1	Win Int Sash		AM L N/A	Y				
2	Exterior Sill		AM SF L N/A	Y				
3	Part Sash		AM L N/A	Y				
4	Blind Stop		AM SF L N/A	Y				
	Win Ext Sash		AM L N/A	Y				
	Novel Post		AM L N/A	Y				
	Novel Post	0.0	AM L N/A	Y				
	Handrail	0.0	AM L N/A	Y				
	Balustrade		AM L N/A	Y				
	Lower rail		AM L N/A	Y				
	Hand	0.0	AM L N/A	Y				
	Rails	0.0	AM L N/A	Y				
	Stringer	0.0	AM L N/A	Y				
	Floor Edge	0.0	AM L N/A	Y				
	Floor Chisling	0.0	AM L N/A	Y				
D	Staircase	0.0	AM L N/A	Y				

COMMENTS/STRUCTURAL DEFECTS:
 (1) FOUNDATION SILL AND TANKS

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 200 SQ. IN.)	IC DATE	IC METHOD

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 200 SQ. IN.)	IC DATE	IC METHOD

(b) (6)

09-20-2012

Page 18 of 25

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 917 Main St

Apt #:

Apt #

City: Vineyard Haven, MA 02568

BASEMENT/LAUNDRY AREA

SIDE	LOCATION/SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH	SIDE	LOCATION/SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
AB	Walls	NC	A/M L N/A	Y					AB	Plugs	NC	A/M L N/A	Y				
AB	Walls	NC	A/M L N/A	Y					AB	Sink	NC	A/M L N/A	Y				
AB	Walls (2)	NC	A/M L N/A	Y					AB	Drainpipe	NC	A/M L N/A	Y				
AB	Walls	NC	A/M L N/A	Y					AB	Serviceboard	NC	A/M L N/A	Y				
AB	Baseboards	NC	A/M L N/A	Y					AB	Shelves	NC	A/M L N/A	Y				
AB	Chairs	NC	A/M L N/A	Y					CD	Supports	NC	A/M L N/A	Y				
AB	Floor	NC	A/M L N/A	Y					AB	Shelves	NC	A/M L N/A	Y				
AB	Ceiling	NC	A/M L N/A	Y					CD	Supports	NC	A/M L N/A	Y				
AB	Chimney	NC	A/M L N/A	Y					AB	Shelves	NC	A/M L N/A	Y				
AB	Support Column	NC	A/M L N/A	Y					CD	Supports	NC	A/M L N/A	Y				
AB	Door	NC	A/M L N/A	Y						Window frame	NC	A/M L N/A	Y				
CD	Door Casing	NC	A/M L N/A	Y					AB	Window Sash	NC	A/M L N/A	Y				
12	Door Jamb	NC	A/M L N/A	Y					CD	Exterior Sill	NC	A/M L N/A	Y				
34	Threshold	NC	A/M L N/A	Y					12	Part Board	NC	A/M L N/A	Y				
AB	Door (2)	NC	A/M L N/A	Y					34	Win Ext Sash	NC	A/M L N/A	Y				
CD	Door Casing	NC	A/M L N/A	Y						Window frame	NC	A/M L N/A	Y				
2	Door Jamb	NC	A/M L N/A	Y					AB	Window Sash	NC	A/M L N/A	Y				
34	Threshold	NC	A/M L N/A	Y					CD	Exterior Sill	NC	A/M L N/A	Y				
AB	Door	NC	A/M L N/A	Y					12	Part Board	NC	A/M L N/A	Y				
CD	Door Casing	NC	A/M L N/A	Y					34	Win Ext Sash	NC	A/M L N/A	Y				
12	Door Jamb	NC	A/M L N/A	Y						Window frame	NC	A/M L N/A	Y				
34	Threshold	NC	A/M L N/A	Y					AB	Window Sash	NC	A/M L N/A	Y				
AB	Cabinets	NC	A/M L N/A	Y					CD	Exterior Sill	NC	A/M L N/A	Y				
AB	Benches	NC	A/M L N/A	Y					12	Part Board	NC	A/M L N/A	Y				
CD	Supports	NC	A/M L N/A	Y					34	Win Ext Sash	NC	A/M L N/A	Y				
A	Closet Door	NC	A/M L N/A	Y						Window frame	NC	A/M L N/A	Y				
B	Closet Casing	NC	A/M L N/A	Y					AB	Window Sash	NC	A/M L N/A	Y				
C	Closet Jamb	NC	A/M L N/A	Y					CD	Exterior Sill	NC	A/M L N/A	Y				
D	Closet Walls	NC	A/M L N/A	Y					12	Part Board	NC	A/M L N/A	Y				
	Closet Baseboard	NC	A/M L N/A	Y					34	Win Ext Sash	NC	A/M L N/A	Y				
1	Closet Pole	NC	A/M L N/A	Y						Window frame	NC	A/M L N/A	Y				
2	Closet Shelf	NC	A/M L N/A	Y					AB	Handrail	NC	A/M L N/A	Y				
3	Closet Supports	NC	A/M L N/A	Y					CD	Handrails	NC	A/M L N/A	Y				
4	Closet Floor	NC	A/M L N/A	Y					12	Low rail	NC	A/M L N/A	Y				
	Closet Ceiling	NC	A/M L N/A	Y					34	Treads	NC	A/M L N/A	Y				
Comments/Structural Defects: (1) outside of D door (3) Bottom side of stairs										Stairs	NC	A/M L N/A	Y				
										Stringer	NC	A/M L N/A	Y				
									AB	Oil Tank	NC	L N/A	Y				
									CD	Oil Tank	NC	L N/A	Y				

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 200 SQ. IN.)	IC DATE	IC METHOD	SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 200 SQ. IN.)	IC DATE	IC METHOD
------	----------	---	---------	-----------	------	----------	---	---------	-----------

(b) (6)

9-20-2012

Page 19 of 25

Inspector (print)

Lic #

Signature

Date

(b) (6)

Asessor (print)

Lic #

Signature

Date

Address of Property:

917 Main St

Apt #

City: Vineyard

Haven, MA 02568

LAUNDRY ROOM

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A B	Up Walls	2.5	AM L N/A	Y				
A B	Low Walls		AM L N/A	Y				
A B	Baseboards	1.0	AM L N/A	Y				
A B	Chair Rail		AM L N/A	Y				
A B	Radiators		AM L N/A	Y				
A B	Floor	1.5	AM L N/A	Y				
A B	Ceiling	1.5	AM L N/A	Y				
A B	Door		AM L N/A	Y				
C D	Door Casing	2.15	AM L N/A	Y				
1 2	Door Jamb	0.22	AM L N/A	Y				
3 4	Threshold	2.15	AM L N/A	Y				
A B	Door		AM L N/A	Y				
C D	Door Casing		AM L N/A	Y				
1 2	Door Jamb		AM L N/A	Y				
3 4	Threshold		AM L N/A	Y				
A B	Door		AM L N/A	Y				
C D	Door Casing		AM L N/A	Y				
1 2	Door Jamb		AM L N/A	Y				
3 4	Threshold		AM L N/A	Y				
A B	Door		AM L N/A	Y				
C D	Door Casing		AM L N/A	Y				
1 2	Door Jamb		AM L N/A	Y				
3 4	Threshold		AM L N/A	Y				
A	Closet Door		AM L N/A	Y				
B	Dr Casing		AM L N/A	Y				
C	Closet Jamb		AM L N/A	Y				
D	Closet Walls		AM L N/A	Y				
	Closet Baseboard		AM L N/A	Y				
1	Closet Pole		AM L N/A	Y				
2	Closet Shelf		AM L N/A	Y				
3	Closet Supports		AM L N/A	Y				
4	Closet Floor		AM L N/A	Y				
	Closet Ceiling		AM L N/A	Y				

COMMENTS / STRUCTURAL DEFECTS:

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 200 SQ. IN.)	IC DATE	IC METHOD

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 200 SQ. IN.)	IC DATE	IC METHOD

(b) (6)

Date _____

Inspector (print)	Uic #	Signature
(b) (6)		

Date _____

Assessor (print): _____ Lic# _____ Signature _____
 Address of Property: 917 MAIN ST. Apt # _____

Date: 11/15/2011
 Viewed: 11/15/2011

Appendix 1

CITY: WINTERBURN, MA 02568

PORCH (A) B C D (circle one) 1st fl 2nd fl 3rd fl 4th fl (circle one)

[illegible]

EXCLUDED SURFACES: Surfaces listed in these boxes can be made in-act only by a licensed dealer.

SIDE	LOCATION	MEASURE LOOSE PAINT (MORE THAN 1440 SQ. IN.)	IC DATE	IC METHOD

SIDE	LOCATION	MEASURE LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

(b) (6)

09-20-2012

Page 21 of 25

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 917 Main St

Apt #:

A/A/A/A/A

City: Vineyard Haven, MA 02568

PORCH A B C D (circle one) (1st) 2nd fl 3rd fl 4th fl (circle one)

SIDE	LOCATION/SURFACE	LEAD	TYPE OF HAZARD	URG	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A B	Siding	0.01	L N/A	Y				
C D	Corner Boards	0.01	L N/A	Y				
	Upper Trim	0.01	L N/A	Y				
	Ceiling	N/A	L N/A	Y				
	Joists	N/A	L N/A	Y				
A	Door	0.01	AM L N/A	Y				
B	Storm Door	0.01	AM L N/A	Y				
C	Door Casing	0.01	AM L N/A	Y				
D	Door Jamb	0.01	AM L N/A	Y				
1 2	Threshold	0.01	AM L N/A	Y				
3 4	Kickplate	0.01	AM L N/A	Y				
A B	Window Sill	0.01	AM L N/A	Y				
C D	Win Casing	0.01	AM L N/A	Y				
1 2	Window Sash	0.01	AM L N/A	Y				
3 4	Mullions	0.01	AM L N/A	Y				
A B	Window Sill	0.01	AM L N/A	Y				
C D	Win Casing	0.01	AM L N/A	Y				
1 2	Window Sash	0.01	AM L N/A	Y				
3 4	Mullions	0.01	AM L N/A	Y				
A B	Window Sill	0.01	AM L N/A	Y				
C D	Win Casing	0.01	AM L N/A	Y				
1 2	Window Sash	0.01	AM L N/A	Y				
3 4	Mullions	0.01	AM L N/A	Y				
A B	Window Sill	0.01	AM L N/A	Y				
C D	Win Casing	0.01	AM L N/A	Y				
1 2	Window Sash	0.01	AM L N/A	Y				
3 4	Mullions	0.01	AM L N/A	Y				
A B	Window Sill	0.01	AM L N/A	Y				
C D	Win Casing	0.01	AM L N/A	Y				
1 2	Window Sash	0.01	AM L N/A	Y				
3 4	Mullions	0.01	AM L N/A	Y				

COMMENTS / STRUCTURAL DEFECTS:

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 1446 SQ. IN.)	IC DATE	IC METHOD

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

(b) (6)

09-20-2012

Page 22 of 25

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 817 Main St.

Apt #: AAAAAA

City: Vineyard Haven, MA 02568

EXTERIOR A Side

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A	Siding	0.00	L N/A	Y				
A	Comb. Boards	1.00	L N/A	Y				
A	Lower Trim	0.00	L N/A	Y				
A	Upper Trim	0.00	L N/A	Y				
A	Win Above 5'	0.00	L N/A	Y				
A	Porch Above 5'	0.00	L N/A	Y				
A	Storm Door	0.00	A/M L N/A	Y				
A	Door	0.00	A/M L N/A	Y				
A	Door Casing	0.00	A/M L N/A	Y				
1 2	Door Jamb	0.00	A/M L N/A	Y				
3 4	Threshold	0.00	A/M L N/A	Y				
A	Kickplate	0.00	A/M L N/A	Y				
A	Storm Door	0.00	A/M L N/A	Y				
A	Door	0.00	A/M L N/A	Y				
A	Door Casing	0.00	A/M L N/A	Y				
1 2	Door Jamb	0.00	A/M L N/A	Y				
3 4	Threshold	0.00	A/M L N/A	Y				
A	Kickplate	0.00	A/M L N/A	Y				
A	Door	0.00	A/M L N/A	Y				
A	Door Casing	0.00	A/M L N/A	Y				
1 2	Door Jamb	0.00	A/M L N/A	Y				
3 4	Threshold	0.00	A/M L N/A	Y				
A	Window Sill	1.00	A/M L N/A	Y				
A	Win Casing	1.00	A/M L N/A	Y				
A	Window Sash	0.00	A/M L N/A	Y				
A	Window Sill	0.00	A/M L N/A	Y				
A	Win Casing	0.00	A/M L N/A	Y				
A	Window Sash	0.00	A/M L N/A	Y				
A	Window Sill	0.00	A/M L N/A	Y				
A	Win Casing	0.00	A/M L N/A	Y				
A	Window Sash	0.00	A/M L N/A	Y				
A	Lamp Post	0.00	L N/A	Y				

COMMENTS / STRUCTURAL DEFECTS:

Excluded Surfaces: Surfaces listed in this box can be made

Infect only by a licensed deleader

Soil Test Results

(Must be less than 400 ppm for play area / 1200 ppm for bare soil)

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 1440 SQ. IN.)	IC DATE	IC METH
A				
A				
A				
A				

LOCATION	AREA MEASUREMENT (Square Feet)	RESULT (PPM)	REMED DATE	REMED METH
Play Area				
Bare Soil				
Comments:				

(b) (6)

09-20-2012

Page 23 of 25

Inspector (print)

Lic#

Signature

Date

(b) (6)

Risk Assessor (print)

Lic#

Signature

Date

Address of Property: 917 Main St.

Apt #: AAAAA

City: Vineyard Haven, MA 02568

EXTERIOR B Side

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH	SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
B	Siding	2.0	L N/A	Y					B	Window Sill		AM L N/A	Y				
	Corner Boards	1.2	L N/A	Y					B	Win Casing		AM L N/A	Y				
B	Lower Trim	2.0	L N/A	Y					#	Window Sash		AM L N/A	Y				
	Upper Trim	2.0	L N/A	Y					B	Cellar Win Sill	2.0	AM L N/A	Y				
	Win Above S	N/A	L N/A	Y					B	Cell Win Sash	2.0	AM L N/A	Y				
	Porch Above S		L N/A	Y					#	Cell Win Frame	2.0	AM L N/A	Y				
	Storm Door		AM L N/A	Y						Screen Frame		AM L N/A	Y				
B	Door	2.0	AM L N/A	Y					B	Cellar Win Sill		AM L N/A	Y				
	Door Casing	2.0	AM L N/A	Y					B	Cell Win Sash		AM L N/A	Y				
1 2	Door Jamb	2.0	AM L N/A	Y					#	Cell Win Frame		AM L N/A	Y				
3 4	Threshold	2.0	AM L N/A	Y						Screen Frame		AM L N/A	Y				
	Kickplate		AM L N/A	Y					B	Cellar Win Sill		AM L N/A	Y				
	Storm Door		AM L N/A	Y					B	Cell Win Sash		AM L N/A	Y				
B	Door		AM L N/A	Y					#	Cell Win Frame		AM L N/A	Y				
	Door Casing		AM L N/A	Y						Screen Frame		AM L N/A	Y				
1 2	Door Jamb		AM L N/A	Y					B	Cellar Win Sill		AM L N/A	Y				
3 4	Threshold		AM L N/A	Y					B	Cell Win Sash		AM L N/A	Y				
	Kickplate		AM L N/A	Y					#	Cell Win Frame		AM L N/A	Y				
	Door		AM L N/A	Y						Screen Frame		AM L N/A	Y				
B	Door Casing		AM L N/A	Y					B	Foundation	2.0	L N/A	Y				
1 2	Door Jamb		AM L N/A	Y					B	Buildhead		AM L N/A	Y				
3 4	Threshold		AM L N/A	Y						Fences		AM L N/A	Y				
	Window Sill		AM L N/A	Y						Shutters		AM L N/A	Y				
B	Win Casing		AM L N/A	Y						Newel post		AM L N/A	Y				
#	Window Sash		AM L N/A	Y					B	Railing Cap		AM L N/A	Y				
	Window Sill		AM L N/A	Y						Handrail		AM L N/A	Y				
B	Win Casing		AM L N/A	Y					B	Balusters		AM L N/A	Y				
#	Window Sash		AM L N/A	Y						Lower Rail		AM L N/A	Y				
	Window Sill		AM L N/A	Y						Treads		AM L N/A	Y				
B	Win Casing		AM L N/A	Y						Risers		AM L N/A	Y				
#	Window Sash		AM L N/A	Y						Stringer		AM L N/A	Y				
B	Lamp Post		L N/A	Y						Lattice		AM L N/A	Y				
COMMENTS / STRUCTURAL DEFECTS:												L N/A	Y				
									B	Elec Conduit		L N/A	Y				
										Oil Fill Pipe		L N/A	Y				
										Overhang Trim		AM L N/A	Y				

Excluded Surfaces: Surfaces listed in this box can be made
intact only by a licensed deleader

SIDE	LOCATION	MEASURE LOOSE PAINT (MORE THAN 1400 SQ. IN.)	IC DATE	IC METH
B				
B				
B				
B				

Soil Test Results

(Must be less than 400 ppm for play area / 1200 ppm for bare soil)

LOCATION	AREA MEASUREMENT (Square Feet)	RESULT (PPM)	REMED DATE	REMED METH
Play Area				
Bare Soil				
Comments:				

(b) (6)

09-20-2012

Page

24 of 25

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property:

917 Main St.

Apt #:

A A A A A

City: Vineyard Haven, MA 02588

EXTERIOR C Side

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH	SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
C	Siding	Good	L N/A	Y					C	Window Sill	Good	A/M L N/A	Y				
C	Corner Boards	Good	L N/A	Y					C	Win Casing	Good	A/M L N/A	Y				
C	Lower Trim	Good	L N/A	Y					#	Window Sash	Good	A/M L N/A	Y				
C	Upper Trim	Good	L N/A	Y					C	Cellar Win Sill	Good	A/M L N/A	Y				
C	Win Above B	Good	L N/A	Y					C	Cell Win Sash	Good	A/M L N/A	Y				
C	Porch Above B	Good	L N/A	Y					#	Cell Win Frame	Good	A/M L N/A	Y				
C	Storm Door	Good	A/M L N/A	Y					C	Screen Frame	Good	A/M L N/A	Y				
C	Door	Good	A/M L N/A	Y					C	Cellar Win Sill	Good	A/M L N/A	Y				
1 2	Door Casing	Good	A/M L N/A	Y					C	Cell Win Sash	Good	A/M L N/A	Y				
3 4	Door Jamb	Good	A/M L N/A	Y					#	Cell Win Frame	Good	A/M L N/A	Y				
3 4	Threshold	Good	A/M L N/A	Y					C	Screen Frame	Good	A/M L N/A	Y				
C	Kickplate	Good	A/M L N/A	Y					C	Cellar Win Sill	Good	A/M L N/A	Y				
C	Storm Door	Good	A/M L N/A	Y					C	Cell Win Sash	Good	A/M L N/A	Y				
C	Door	Good	A/M L N/A	Y					#	Cell Win Frame	Good	A/M L N/A	Y				
1 2	Door Casing	Good	A/M L N/A	Y					C	Screen Frame	Good	A/M L N/A	Y				
3 4	Door Jamb	Good	A/M L N/A	Y					C	Cellar Win Sill	Good	A/M L N/A	Y				
3 4	Threshold	Good	A/M L N/A	Y					C	Cell Win Sash	Good	A/M L N/A	Y				
C	Kickplate	Good	A/M L N/A	Y					#	Cell Win Frame	Good	A/M L N/A	Y				
C	Door	Good	A/M L N/A	Y					C	Screen Frame	Good	A/M L N/A	Y				
1 2	Door Casing	Good	A/M L N/A	Y					C	Foundation	Good	L N/A	Y				
3 4	Door Jamb	Good	A/M L N/A	Y					C	Bulkhead	Good	A/M L N/A	Y				
3 4	Threshold	Good	A/M L N/A	Y					C	Fence	Good	A/M L N/A	Y				
C	Window Sill	Good	A/M L N/A	Y					C	Shutters	Good	A/M L N/A	Y				
C	Win Casing	Good	A/M L N/A	Y					C	Knockpost	Good	A/M L N/A	Y				
#	Window Sash	Good	A/M L N/A	Y					C	Railing Cap	Good	A/M L N/A	Y				
C	Window Sill	Good	A/M L N/A	Y					C	Handrail	Good	A/M L N/A	Y				
C	Win Casing	Good	A/M L N/A	Y					C	Balustrade	Good	A/M L N/A	Y				
#	Window Sash	Good	A/M L N/A	Y					C	Lower Rail	Good	A/M L N/A	Y				
C	Window Sill	Good	A/M L N/A	Y					C	Treads	Good	A/M L N/A	Y				
C	Win Casing	Good	A/M L N/A	Y					C	Risers	Good	A/M L N/A	Y				
#	Window Sash	Good	A/M L N/A	Y					C	Stringer	Good	A/M L N/A	Y				
C	Lamp Post	Good	L N/A	Y					C	Carson	Good	A/M L N/A	Y				
COMMENTS / STRUCTURAL DEFECTS:									C	Elec Conduit	Good	L N/A	Y				
									C	Oil/Fill Pipe	Good	L N/A	Y				
									C	Overhang Trim	Good	A/M L N/A	Y				

Excluded Surfaces: Surfaces listed in this box can be made intact only by a licensed deleader

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 1440 SQ. IN.)	IC DATE	IC METH
C				
C				
C				
C				

Soil Test Results

(Must be less than 400 ppm for play area / 1200 ppm for bare soil)

LOCATION	AREA MEASUREMENT (Square Feet)	RESULT (PPM)	REMED DATE	REMED METH
Play Area				
Bare Soil				
Comments:				

(b) (6)

09-20-2012

Page 25 of 25

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 917 Main St

Apt #: 000000

City: Vineyard Haven, MA 02568

EXTERIOR D Side

SIDE	LOCATION	LEAD	TYPE OF HAZARD	URG	IC	IC	DELEAD	DELEAD
D	SURFACE			HAZ?	DATE	METH	DATE	METH
D	Siding	0.5	L N/A	Y				
	Corner Boards	0.5	L N/A	Y				
	Lower Trim	0.5	L N/A	Y				
	Upper Trim	0.5	L N/A	Y				
	Win Above S	0.5	L N/A	Y				
	Porch Above S	0.5	L N/A	Y				
D	Storm Door		AM L N/A	Y				
	Door		AM L N/A	Y				
	Door Casing		AM L N/A	Y				
	Door Jamb		AM L N/A	Y				
	Threshold		AM L N/A	Y				
	Kickplate		AM L N/A	Y				
D	Storm Door		AM L N/A	Y				
	Door		AM L N/A	Y				
	Door Casing		AM L N/A	Y				
	Door Jamb		AM L N/A	Y				
	Threshold		AM L N/A	Y				
	Kickplate		AM L N/A	Y				
D	Door		AM L N/A	Y				
	Door Casing		AM L N/A	Y				
	Door Jamb		AM L N/A	Y				
	Threshold		AM L N/A	Y				
	Window Sill		AM L N/A	Y				
	Win Casing		AM L N/A	Y				
D	Window Sash		AM L N/A	Y				
	Window Sill		AM L N/A	Y				
	Win Casing		AM L N/A	Y				
	Window Sash		AM L N/A	Y				
	Window Sill		AM L N/A	Y				
	Win Casing		AM L N/A	Y				
D	Window Sash		AM L N/A	Y				
	Window Sill		AM L N/A	Y				
	Win Casing		AM L N/A	Y				
	Window Sash		AM L N/A	Y				
	Window Sill		AM L N/A	Y				
	Win Casing		AM L N/A	Y				
D	Lamp Post		L N/A	Y				
	Foundation	0.5	L N/A	Y				
	Bulbhead	0.5	AM L N/A	Y				
	Fences		AM L N/A	Y				
	Shutters		AM L N/A	Y				
	Newel post		AM L N/A	Y				
D	Railing Cap		AM L N/A	Y				
	Handrail		AM L N/A	Y				
	Decorators		AM L N/A	Y				
	Corner Rail		AM L N/A	Y				
	Trunks		AM L N/A	Y				
	Risers		AM L N/A	Y				
D	Stringer		AM L N/A	Y				
	Lattice		AM L N/A	Y				
	Elec Conduit		L N/A	Y				
	Oil Pipe		L N/A	Y				
	Overhang Trim		AM L N/A	Y				
			L N/A	Y				

COMMENTS / STRUCTURAL DEFECTS:

Excluded Surfaces: Surfaces listed in this box can be made intact only by a licensed deleader

Soil Test Results

(Must be less than 400 ppm for play area / 1200 ppm for bare soil)

SIDE	LOCATION	MEASURED LOOSE PAINT (MORE THAN 1440 SQ. IN.)	IC	IC	LOCATION	AREA MEASUREMENT (Square Feet)	RESULT (PPM)	REMED DATE	REMED METH
D			DATE	METH					
D					Play Area				
D					Bare Soil				
D					Comments:				
D									



DEVAL L. PATRICK
GOVERNOR

TIMOTHY P. MURRAY
LIEUTENANT GOVERNOR

JUDYANN BIGBY, MD
SECRETARY

JOHN AUERBACH
COMMISSIONER

The Commonwealth of Massachusetts
Executive Office of Health and Human Services
Department of Public Health
Bureau of Environmental Health
Childhood Lead Poisoning Prevention Program
250 Washington Street, 7th floor
Boston, MA 02108
(800) 532-9571

RESIDENTIAL DELEADING ADVISORY

The process of removing or covering lead paint hazards, commonly called deleading, can be dangerous if it is not done properly. That's why the Lead Law (Massachusetts General Laws chapter 111, sections 189A through 199B), the Regulations for Lead Poisoning Prevention and Control (105 Code of Massachusetts Regulations 460.000) and the Deleading Regulations (454 CMR 22.00) have rules for how deleading is done in homes and apartments. These rules say who can do the work, safety steps that have to be taken while the work is done, how to clean up after the work and how the work is finally approved. These rules are enforced by the Department of Public Health's Childhood Lead Poisoning Prevention Program (CLPPP), the Division of Occupational Safety (DOS) and local boards of health.

Who can do deleading work

Under these laws, only a licensed deleading contractor can do high-risk work, such as scraping or stripping lead paint, repairing more than a small amount of chipping or peeling lead paint so it can be repainted, and demolishing lead-painted building parts. Besides deleaders, property owners and their agents who take a one-day course can do moderate-risk deleading work, such as removing windows, woodwork, and just about any surface of a house, as well as repairing small amounts of chipping and peeling lead paint so it can be repainted. Lead-safe renovators trained and licensed by DOS may also be hired to do moderate-risk deleading work. Finally, low-risk deleading work can be done by all the people who can do high- or moderate-risk deleading work, and also owners and their agents, including contractors, who just complete the CLPPP low-risk booklet (and/or encapsulant booklet). Low-risk deleading means covering surfaces, applying encapsulants, capping baseboards, removing doors, cabinet doors and shutters, and applying exterior siding. Property owners and their agents may also do structural repairs and lead-dust cleaning for interim control.

Staying out of the home or parts of the home during deleading

To protect the people who live in the home or apartment being delead, the law also has rules about making sure they stay out of the home or apartment, or the area being worked on, in these ways:

- All people and pets have to be temporarily moved from the home or apartment for the whole time that high- or moderate-risk deleading work is taking place inside the home or apartment. The owner has to provide residents with a reasonable alternative place to live for this time. Property owners and residents should refer to the CLPPP document, "Notice to Property Owners and Tenants: Tenants' Rights, Responsibilities, and Remedies" for more information on alternative housing during deleading.
- People and pets have to stay out of the work area while most low-risk deleading work,

structural repairs or cleaning of lead dust, is taking place. They also have to stay out of the work area when deleading work of any kind is taking place in common areas outside the home or apartment, as long as they have another regular way (not a fire escape) to go in and out of the building. In these cases, people and pets can use the area once cleanup is completed after all the work in the area is done.

- People and pets have to stay out of the home or apartment for the day during application of encapsulants with an airless sprayer. They also have to stay out for the day during deleading of common areas when they do not have another regular way to go in and out of the building. When people and pets are out of their home or apartment for the day, it means they can come back to the home or apartment after cleanup at the end of the workday, and don't have to be out overnight.

It is very important that people whose home or apartment is being delead think carefully about what they will need during the time they are away from home, and take it with them. No one can return to a home or apartment while deleading that requires them to be out is still taking place, and has not been properly cleaned up. Property owners and residents must take deleading safety rules seriously and cooperate fully to make sure everyone is protected. No one should interfere with the work being done safely.

Getting ready for deleading to begin

People who live in a home or apartment in which any kind of deleading work is going to be taking place have to get written notice at least 10 days before the start of this work. This applies also to other residents of a building, if any deleading work will take place in common areas. Before deleading work begins, all household possessions of every type should be removed or stored in plastic bags in non-work areas. Closets and cabinets to be delead must be emptied. As a last resort, large furniture and belongings not removed from the work area should be put in plastic bags and left in the center of the room, where they will be covered with heavy plastic by the person doing the deleading. The reason for this is to protect everything in the home or apartment from lead dust contamination. Belongings must also be protected before an owner or agent performs low-risk deleading work, or other work that may be required for interim control, but the precautions are not as extensive for this type of work. In general, it is recommended that furniture and belongings be moved outside the work area, or covered with thick plastic and sealed with duct tape, before low-risk deleading begins.

Cleanup after deleading and returning home

A final cleanup will be done at least two hours after all the interior high- or moderate-risk deleading work is done. This delay is to make sure that fine lead dust will settle out of the air and be removed in the final cleanup. People and pets who were temporarily moved to alternative housing can return only after a lead inspector or risk assessor says that the home is safe. The inspector decides this after doing a reoccupancy reinspection, which includes an analysis of lead dust levels within the home. Residents should leave a phone number where they can be reached so that the inspector or risk assessor can call them and let them know when it is safe to return home. If the property owner or agent is going to be doing low-risk deleading work or other work for interim control after the residents return home, they will be taking some safety steps for this, as described in the CLPPP low-risk booklet. They will also be doing a cleanup when they are done with the low-risk work. An inspector or risk assessor will return at the completion of all the work and do a reinspection to check the owner's or agent's work.

Temporary ways to protect children from lead poisoning

Children exposed to lead paint hazards are at risk of becoming lead poisoned. This disease can affect every part of a young child's developing body, and in particular, can seriously and permanently hurt the brain, kidneys and nervous system. Even at lower levels of exposure, lead can cause children to have learning and behavioral problems.

The best and only permanent way to protect children from lead poisoning is deleading. But even before that process begins, there are some important steps that can be taken to protect young children from lead poisoning. Your lead inspector's or risk assessor's advice should be carefully followed because he or she knows your child's home.


As part of their normal behavior, young children place things in their mouths, especially toys and their own fingers. If there are lead paint chips and dust in your home, they may be picked up by your child's fingers, as well as by toys, foods and pacifiers that fall on the floor, and end up in your child's mouth. It is especially important to wash your child's toys and to keep your child's hands clean, particularly before meals and at bedtime.

Areas of peeling or chipping lead paint and dust should be cleaned. Wet wiping with paper towels and a general household detergent is best. Do not use your household vacuum cleaner to clean up paint chips, because this will only send fine lead dust into the air. Windows, windowsills and the floors under windows in particular are often areas from which children can get exposed to lead. Sills should be cleaned regularly if paint dust or flakes collect there. If windows are in poor condition, the best thing to do may be to keep the lower sash closed and open only the upper sash for ventilation. (This also protects your child from accidentally falling from the window.) Contact paper may be applied to areas of peeling paint on windowsills, walls or other surfaces as a temporary measure.

Sometimes furniture can be moved to block children from deteriorating paint or plaster. If deteriorating paint or plaster is in the child's bedroom, use another room as the child's room, if possible. Think of those parts of the home where your child spends most of his or her time, and try to keep them as clean as you can before your home is deleaded.

Lead paint can also get into soil. If the outside of your home has chipping or peeling paint, do not let your child play in the soil closest to the house. Be careful to wipe your shoes off on a mat before walking into your house, so you don't track in soil from these areas. Follow the advice of your lead inspector or risk assessor about soil on the property.

For more information about how the deleading process works, and how to protect your children from lead poisoning, call the toll-free CLPPP information line, at 1(800) 532-9571.



The Commonwealth of Massachusetts

Executive Office of Health and Human Services

Department of Public Health

Bureau of Environmental Health

Childhood Lead Poisoning Prevention Program

250 Washington Street, 7th floor

Boston, MA 02108

(800) 532-9571

DEVAL L. PATRICK
GOVERNOR

TIMOTHY P. MURRAY
LIEUTENANT GOVERNOR

JUDYANN BIGBY, MD
SECRETARY

JOHN AUERBACH
COMMISSIONER

NOTICE TO PROPERTY OWNERS AND TENANTS: **TENANT'S RIGHTS AND RESPONSIBILITIES**

Violations

Lead paint violations under the Lead Law and the state Sanitary Code have been found in the home or apartment listed in the attached documents. These violations may be a danger to the health of the people living in the home or apartment. Children younger than six years old are at the most risk of being lead poisoned. Lead can damage a child's growing brain and other parts of the body. Even small amounts of lead can harm a child.

The owner of this home or apartment is responsible for removing or covering the lead violations. (This is called deleading.)

Legal Rights and Responsibilities

For these lead violations to be deleaded as quickly and safely as possible, it helps if both the owner and the tenant cooperate with each other. It is important that tenants and owners know their rights under state law. Because the laws are not simple, tenants may need to get legal help and/or legal advice before trying to use the rights found below.

- (1) Temporary Housing. (Massachusetts General Laws chapter 111, section 197)
Tenants and their pets **must** be temporarily moved out of the home or apartment for the whole time that high-risk or moderate-risk deleading work is taking place inside the home or apartment. They cannot return until that work is done, the unit is cleaned up and a licensed lead inspector finds that the home or apartment is safe.

The owner and tenants have to agree on a plan for temporary housing. If the tenants choose to move in with family or friends they do not have to pay rent to their landlord while they are out of their home. If they do not so choose, the owner finds the temporary housing and offers it to the tenant. The Law requires that owners pay any charges for the temporary housing the owner offers, and that tenants continue to pay their full normal rent during the time they live in the temporary housing. The temporary housing must be one that "does not cause undue economic or personal hardship to the tenant." If the temporary housing chosen by the owner would not cause a hardship, and the tenant still refuses to accept it, then the tenant has to find and arrange for his or her own temporary

housing during deleading. In this case, the tenant doesn't have to pay rent for the days he or she is not at home, but has to pay the cost of the temporary housing he or she has chosen. In this case, the owner has to pay the tenant any amount by which the cost of the temporary housing first chosen by the owner is more than the rent for that period. No matter where the tenant stays, the owner must pay reasonable moving costs. Tenants are advised to get legal help if they can not agree with the owner on a plan.

(2) Protection from Retaliatory Rent Increase or Eviction.

A property owner may not evict a tenant, or increase the rent or refuse to renew the lease of a tenant in retaliation (getting even) for the tenant reporting a suspected lead paint violation to a code enforcement agency such as the local board of health. If the rent is raised, or tenants get an eviction notice or their lease is not renewed within six months after the tenants called the board of health or got their home deleaded, a court can automatically find that the owner took this action in retaliation **unless** the owner can show clear evidence that he or she had other reasons, unrelated to the violations. **An eviction based on not paying the rent is not retaliatory.** Property owners who are found to have threatened or taken actions against tenants for exercising rights under the Lead Law are liable for damages under M.G.L. c. 186, s. 18 and M.G.L. c. 93A.

A tenant who believes that the owner has retaliated against him or her because of lead violations may also file a complaint with the Massachusetts Commission Against Discrimination (MCAD).

(3) Rent Withholding. (Massachusetts General Laws chapter 239, section 8A)

Tenants have a basic obligation to pay rent for their home or apartment to the owner. But, if lead violations are not being deleaded, tenants may have a right to hold back their rent payments. Tenants may take this step **only** if they were up to date in their rent at the time the owner was notified of the lead paint violations, and they did not begin withholding until this point. Owners have the right to go to court to evict tenants for not paying rent. To fully protect themselves against attempted evictions, tenants withholding rent for Lead Law violations may need to place withheld rent money in an escrow (separate savings) account, or may be ordered to do so by the court. If these conditions are met, tenants may not be evicted for not paying rent or for any other violation that is not the tenants' fault.

Owners have the right to enter the tenants' home or apartment, if possible by appointment, but in any case in emergencies, to inspect for lead violations and to have them repaired. Tenants have a responsibility to cooperate with owners and allow all necessary access to their home or apartment for repairs. Tenants who do not cooperate with this right of entry may be subject to eviction. If rent was withheld, the court may order that all or part of the withheld rent be paid to the owner after the violations are deleaded.

(4) Abatement of Rent or Damages. Even when the rent withholding statute does not apply, tenants may be able to have their rent reduced or get back rent they have already paid, if their home or apartment has Lead Law violations. The landlord always has a duty to provide housing that meets basic housing standards. A tenant can bring a court action for breach of this "implied warranty".

(5) "Rent Receivership". (Massachusetts General Laws, chapter 111, sections 127C - 127J)

This law allows tenants, the state Childhood Lead Poisoning Prevention Program or the local board of health to ask the court to find that Lead Law violations exist, and to allow rent to be paid into court rather than to the owner, to pay for necessary repairs.

(6) Owner Liability: Compensatory and Punitive Damages. (Massachusetts General Laws chapter 111, section 199)

The owner of a home or apartment built before 1978 is liable for damages to a child under age six who becomes lead poisoned as a result of the owner's failure to comply with the Lead Law and regulations. The owner of such home or apartment who is notified through an Order to Correct Violations or Order to Restore Interim Control Measures of lead violations, and who willfully fails to correct the violations, in accordance with the Lead Law and Regulations, is also subject to punitive damages, which are triple the actual damages found.

NOTE: All the information presented above is only a summary of the law. Before you decide to withhold your rent or take any other legal action, it is advisable that you consult an attorney. If you can not afford to consult an attorney, you should contact the nearest Legal Services office.

Repainting

Violations of the Lead Law are also violations of the state Sanitary Code. Surfaces from which lead paint or other coatings have been removed have to be repainted under 105 CMR 410.020 of the state Sanitary Code. Delead surfaces have to be sealed and made easy to clean. Delead surfaces can only be repainted **after** the surfaces have been reinspected while bare and approved by a licensed lead inspector.

Tenants may want to contact the owner if the required repainting is not done. If the owner does not respond, tenants should call the local board of health.



DEVAL L. PATRICK
GOVERNOR

TIMOTHY P. MURRAY
LIEUTENANT GOVERNOR

JUDYANN BIGBY, MD
SECRETARY

JOHN AUERBACH
COMMISSIONER

The Commonwealth of Massachusetts

Executive Office of Health and Human Services

Department of Public Health

Bureau of Environmental Health

Childhood Lead Poisoning Prevention Program

250 Washington Street, 7th floor

Boston, MA 02108

(800) 532-9571

NOTICE TO TENANTS OF LEAD PAINT HAZARDS

Lead in violation of the Lead Law (Massachusetts General Laws, chapter 111, sections 189A-199B) and the state Department of Public Health's Regulations for Lead Poisoning Prevention and Control (105 Code of Massachusetts Regulations 460.000) has been found in apartment _____, in this building. Children exposed to lead hazards are at risk of becoming lead poisoned. This disease can affect all parts of a young child's developing body, and in particular, can seriously and permanently hurt the brain, kidneys and nervous system. Even at lower levels of exposure, lead can cause children to have learning and behavioral problems.

If you have a child under six years of age, it is important that he or she be regularly tested for lead poisoning, as the law requires. If your child has not been tested recently, you should ask your child's doctor or health care provider to test him or her. If you don't have a regular health care provider, you can call your local board of health, or the state Childhood Lead Poisoning Prevention Program (CLPPP), at 1-800-532-9571, to find out where you can get your child tested for lead for free. Lead poisoning can only be detected by such testing.



Since lead violations have been found in an apartment in this building, it is quite possible that your unit may have lead violations too. If you have a child under six years of age, you should ask the owner of your building about having your apartment inspected for lead paint. You can call your local board of health to check for lead (ask for a lead determination), or call CLPPP at 1-800-532-9571 for further advice. It is against state law for property owners to discriminate against tenants with children because of lead paint hazards in their apartment.


If deleading of apartment _____ will also include deleading of common hallways, staircases and porches of your building, you will get a written notice 10 days before any deleading will begin. While the deleading is being done, everyone must keep out of the areas being worked on. You have to use another way to go in and out of your building during this time. If your apartment is on the same floor and is in the work area as a common area in which deleading is being done, the person or persons doing the deleading work will protect your apartment too. They will be temporarily covering your doorway with thick plastic sheeting and taping it down with masking tape, so that fine lead dust can't be blown in, around, or under your door. If they have not properly covered areas to protect them from lead dust and debris from the deleading work, tell the owner of your building or call the state Division of Occupational Safety (DOS) at 1-800-425-0004, or CLPPP at 1-800-532-9571. If you don't have an alternative way of


getting in and out of your building, talk to the owner of your building, or the person or people doing the deleading, and coordinate the work.

Check your windowsills and doorways for any visible dust after deleading. Lead dust can be cleaned up with paper towels and a mixture of regular household detergent and water. If you notice lead dust from deleading in your apartment, tell the person doing the deleading, and the owner of your building.

Deleading work that is done the right way should not result in lead contamination of your building. However, if you notice any lead paint dust or debris that has not been properly cleaned up at the end of the workday, tell the owner of your building. You can also call DOS at 1-800-425-0004 or CLPPP at 1-800-532-9571 or the local health department.

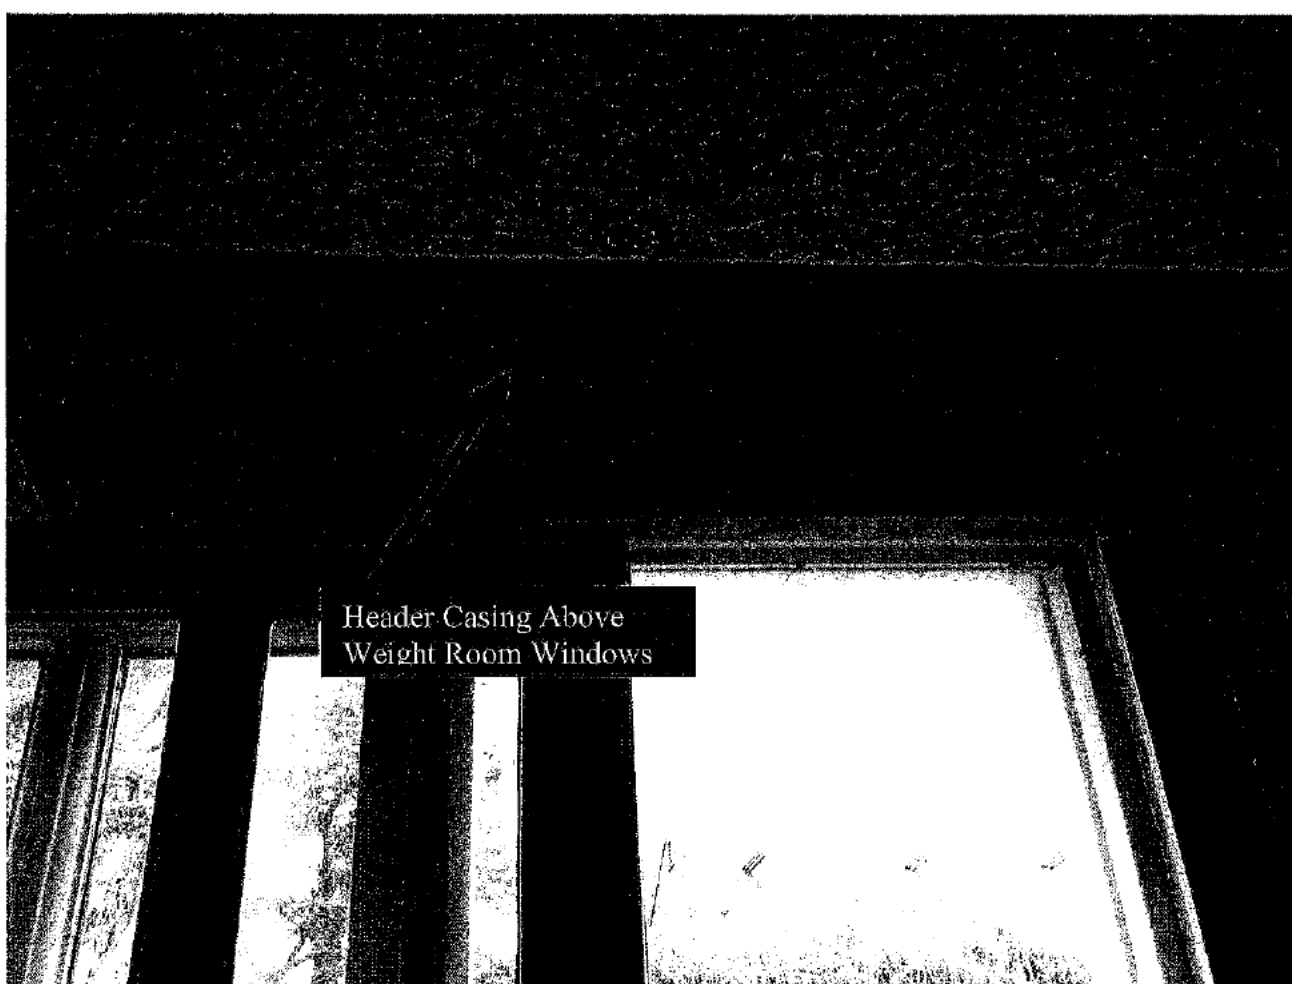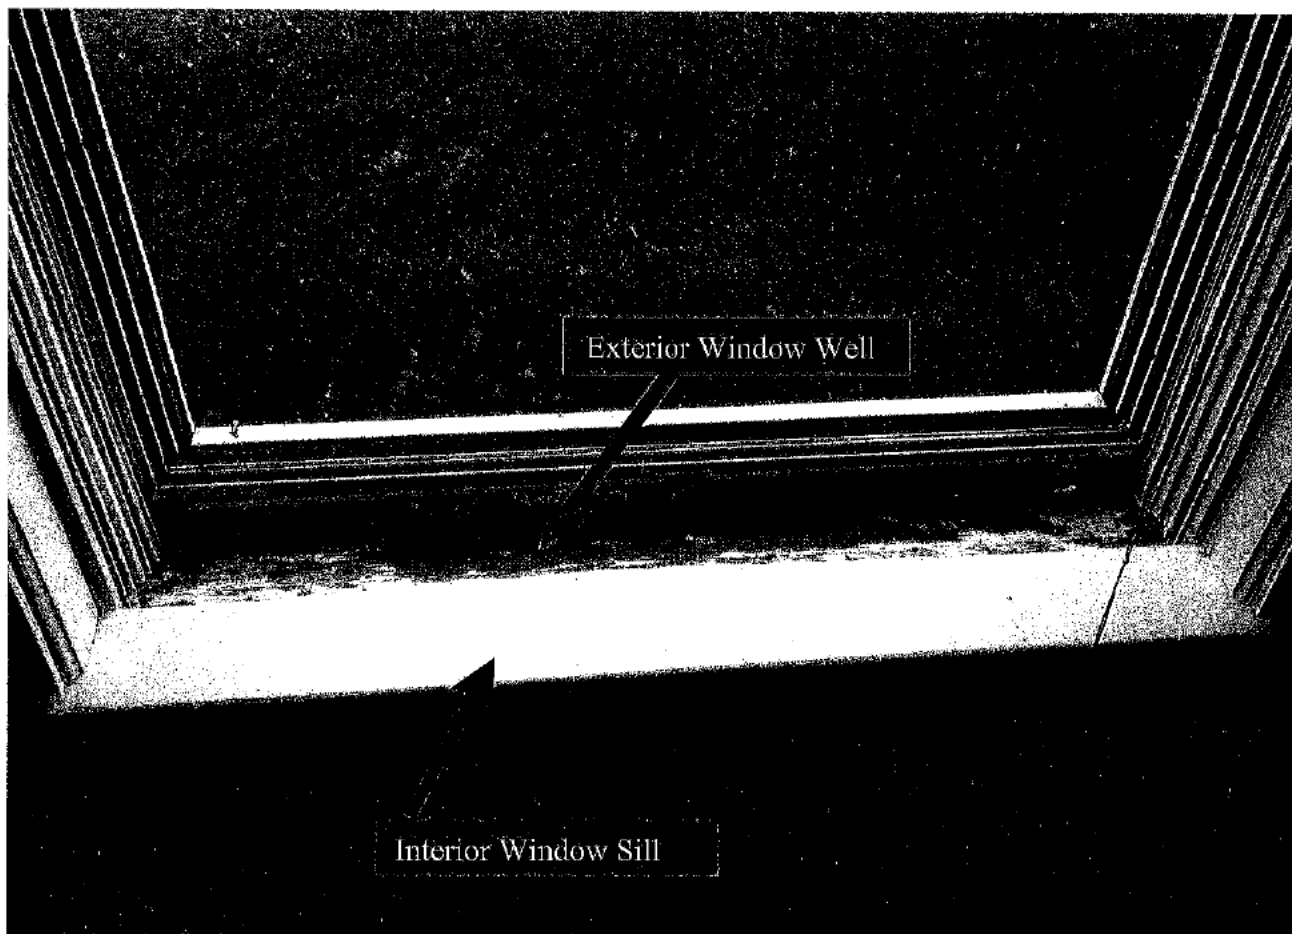


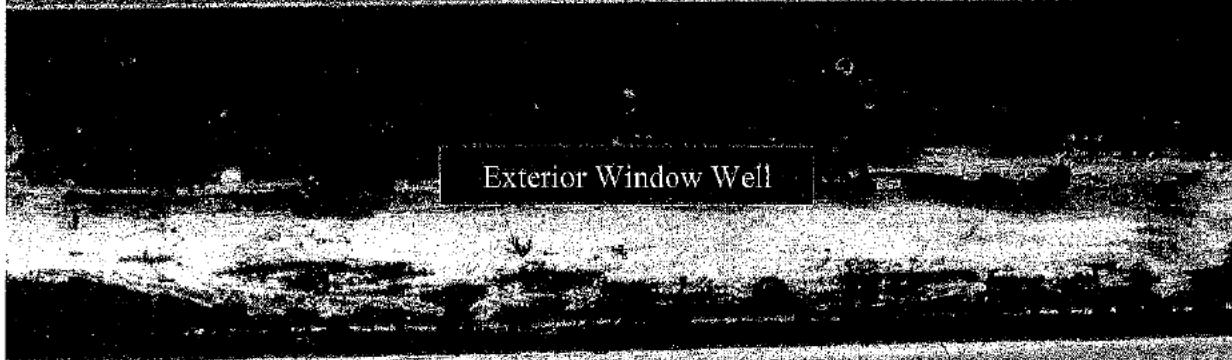

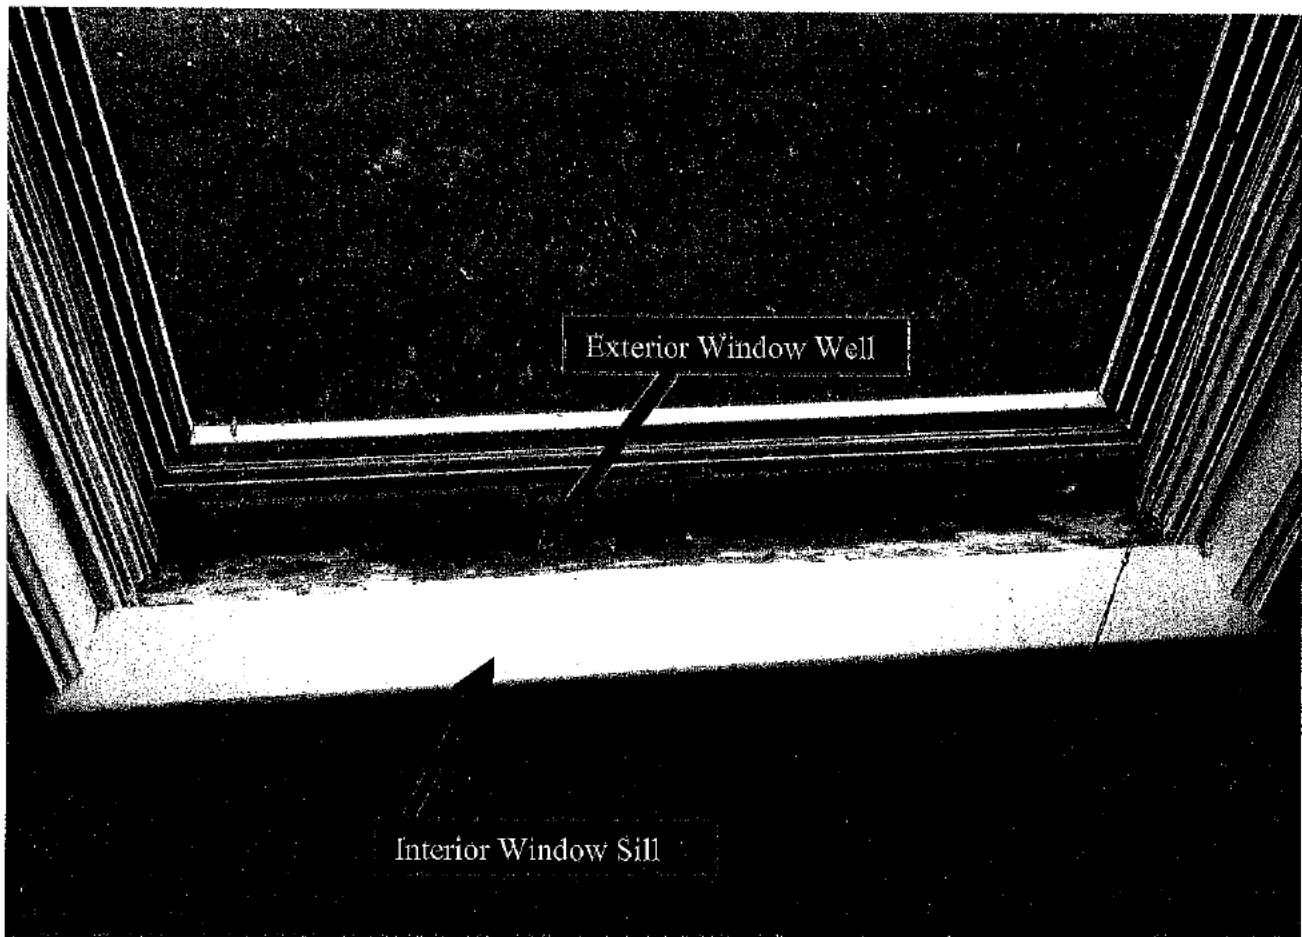

Exterior Window Well

Interior Window Sill

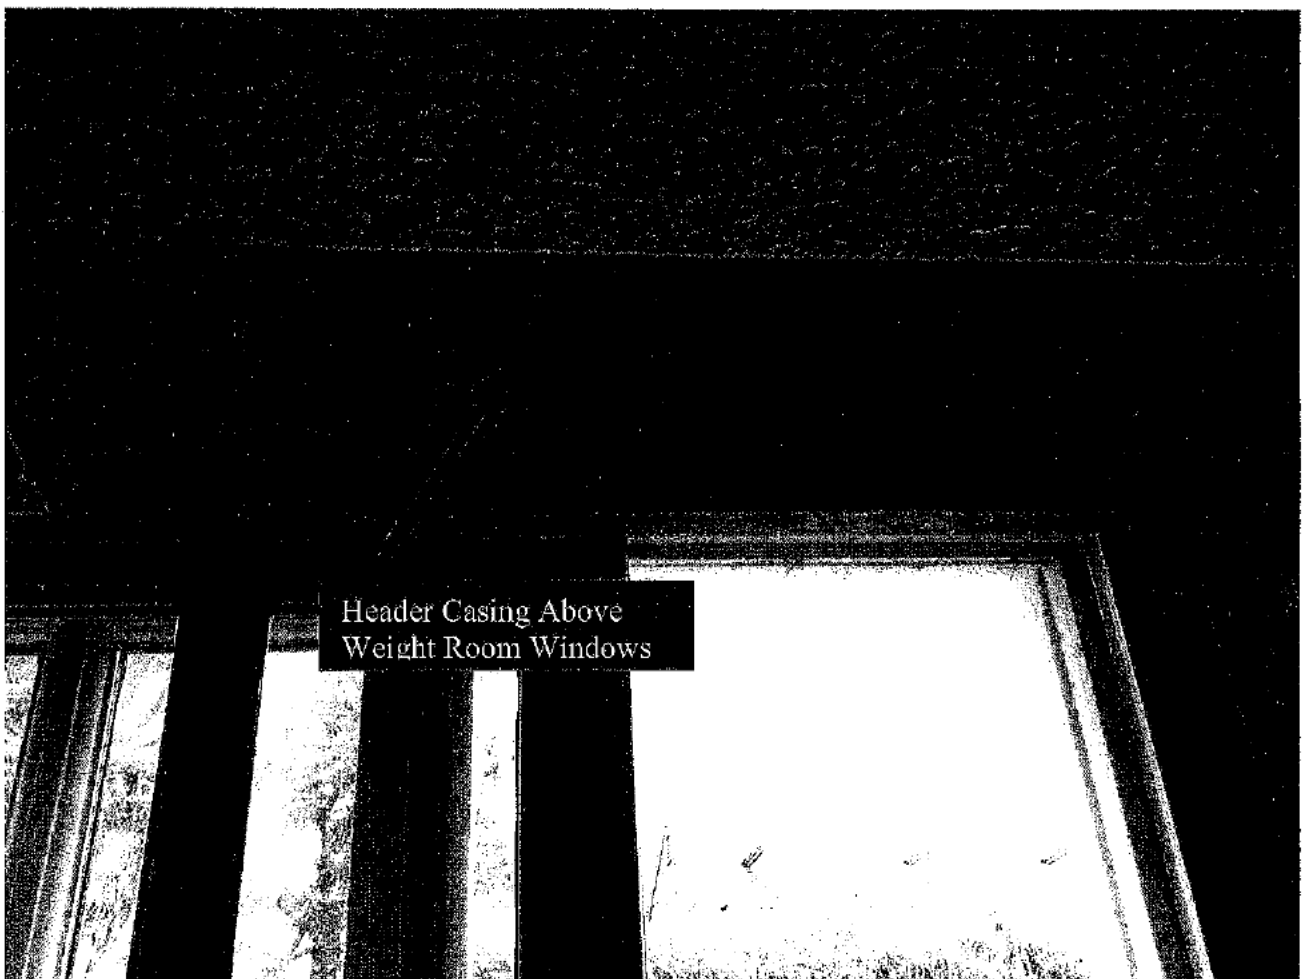

Header Casing Above
Weight Room Windows



Rake Board Below Soffit



Exterior Window Sill



Storm Window Frame



Exterior Window Well



Interior Window Sill

Lead Inspection / Risk Assessment Report

Page 1 of 27

MEL BLACKMAN

MASTER LEAD INSPECTOR

P.O. BOX 358 - STONEHAM, MA. 02180

PHONE / FAX 781- 665 - 3806

St.#	Street Name	Street Type	Unit
920	MAIN	ST	
City		Zip Code	
VINEYARD HAVEN		02568	

Owner Name: U.S. Government

Owner Address: 917 Main St., Vineyard Haven, MA 02568

Contact Information: Tel #

Email:

Client Name (if different from owner): H&S Environmental Inc. (508-366-7442)

Client Address: 160 E. Main St., Westborough, MA 01581

Number of Rooms in Unit 9

Property Type:

Single Family ☒

Multi Family ☐ # Units ☐

Condominium ☐ # Units ☐

Day Care ☐ Other: ☐

Key:	Lead Column	Key:	Delayed IC Method Column
COV	Covered	CAP	Capped
VB	Vinyl Baseboard	COV	Covered
MET	Metal	ENC	Encapsulated
VR	Vinyl Rep. Window	MI	Made Intact
MR	Metal Rep. Window	PRE	Prepared for Enc
NA	Not Accessible	VR/MR	Vinyl/Metal Rep Window
NC	No Coating	SFR	Storm Frame Removed
Tie	Tie (testing suggested)		Component Does not Exist
GC	Dropped Gelling		

Laundry in Basement? Yes or No ☒ No
Finished Space in Basement? Yes or No ☒ No


Testing Method Used:
Na₂S Exp. Date _____
X-Ray Fluorescence
Model XLp303A Serial # 24687

Comments / Notes BASEMENT INCLUDED AT OWNER'S REQUEST.

Floor# 1 (this is the level within building of unit being inspected)

Floor# 2

Property Diagram/ Unit Labels

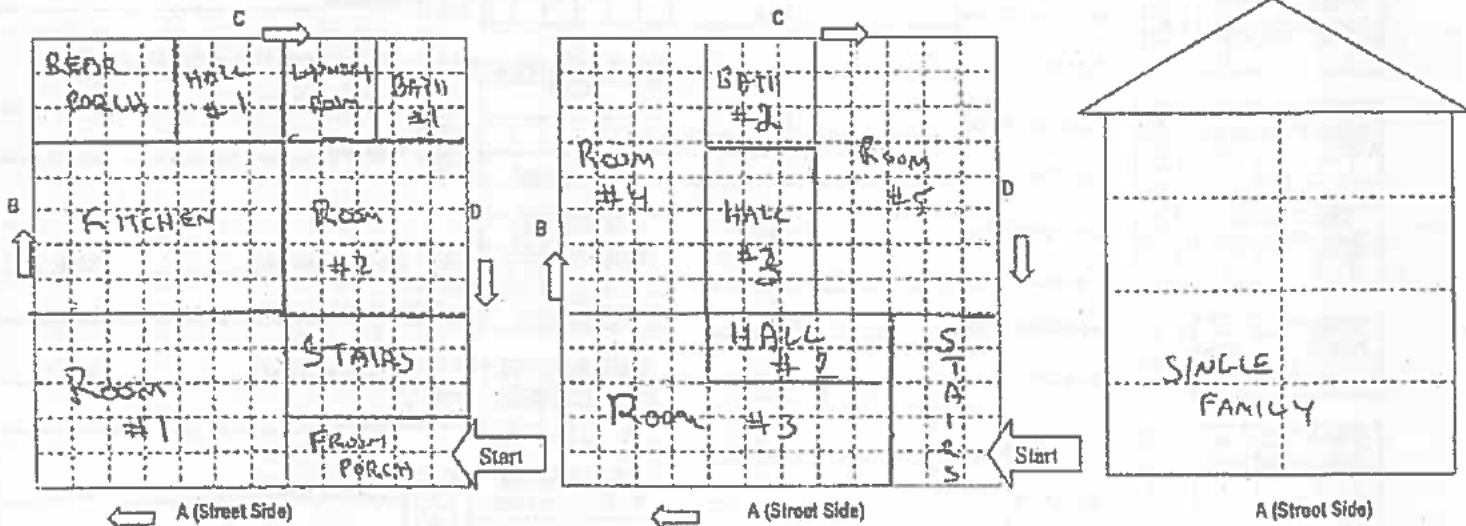

Pb (lead) equal to or greater than 1.0 mg/cm² with x-ray fluorescence or positive with Na₂S is Dangerous.

XRF Calibration Recorded in Log Book

Address verified through USPS

Research on Lead-Related History for Address

www.melblackman.com (b) (6)



✓ -Check off when complete

✓ -Check off when complete

✓ -Check off when complete

Inspector Name _____

LERA
Rev 3/11

68
Page 2 of 27

INTERIM CONTROL

R.A. Name: _____, Lic# _____
Signature: _____

RA Name: _____ Lic# _____
Signature _____

RA Name: _____ Lic# _____
Signature _____

R.A. Name: _____ Lic# _____
 Signature _____

RA Name: _____, Lic# _____
Signature _____

RA Name: _____ List _____
Signature _____

RA Name: _____ Lic# _____
Signature _____

RA Name: _____ Lic# _____
Signature _____

POST COMPLIANCE ASSESSMENT DETERMINATIONS

Instructor Name: _____, Lic# _____
Signature _____

Inspector Name: _____ Lic# _____Inspector Name: _____, Lic# _____
Signature: _____Inspector Name: _____, Lic# _____Inspector Name: _____ Lic# _____

Signature _____

920 Main St.

Vineyard Haven, MA 02568

ADDRESS:

Apt#

City

Page 3 of 27

REOCCUPANCY CERTIFICATE HISTORY

Certificate of Reoccupancy				
Only after High Mod Risk (= rooms rule)				

Inspector Name: _____, Lic# _____

Signature _____

Certificate of Reoccupancy				
Only after High Mod Risk (= rooms rule)				

Inspector Name: _____, Lic# _____

Signature _____

Certificate of Reoccupancy				
Only after High Mod Risk (= rooms rule)				

Inspector Name: _____, Lic# _____

Signature _____

COMPLIANCE HISTORY

Letter of Full Initial Compliance				
No prior history/No signs of UD				

Inspector Name: _____, Lic# _____

Signature _____

Letter of Interim Control				
No prior Comp. Expires in 1 yr				

Inspector Name: _____, Lic# _____

Signature _____

Recommendation of Interim Control				
Expires 1 yr from original Interim Control				

Inspector Name: _____, Lic# _____

Signature _____

Letter of Full Dealing Compliance				
Dust wipes if No Reocc.				

Inspector Name: _____, Lic# _____

Signature _____

Certificate of Maintained Compliance				
No Work=No Dust Work = 7 Dust				

Inspector Name: _____, Lic# _____

Signature _____

Certificate of Restored Compliance				
Dust wipes and arch people				

Inspector Name: _____, Lic# _____

Signature _____

COMPLIANCE HISTORY (CONT.)

Certificate of Maintained Compliance				
No Work=No Dust Work = 7 Dust				

Inspector Name: _____, Lic# _____

Signature _____

Certificate of Restored Compliance				
Dust wipes and arch people				

Inspector Name: _____, Lic# _____

Signature _____

Certificate of Maintained Compliance				
No Work=No Dust Work = 7 Dust				

Inspector Name: _____, Lic# _____

Signature _____

Certificate of Restored Compliance				
Dust wipes and arch people				

Inspector Name: _____, Lic# _____

Signature _____

OTHER HISTORY: WAIVERS/UD/EPA RRP

Approved CLPPP Waiver				
Attach to Comp Docs				

CLPPP Insp. Name: _____, Lic# _____

Signature _____

Approved CLPPP Waiver				
Attach to Comp Docs				

CLPPP Insp. Name: _____, Lic# _____

Signature _____

UD / DES Visual Reinspection				
No LOC Issued				

Inspector Name: _____, Lic# _____

P
F

Signature _____

UD / DES Visual Reinspection				
No LOC Issued				

Inspector Name: _____, Lic# _____

P
F

Signature _____

UD / DES Dust Taken				
No LOC Issued				

Inspector Name: _____, Lic# _____

P
F

Signature _____

UD / DES Dust Taken				
No LOC Issued				

Inspector Name: _____, Lic# _____

P
F

Signature _____

EXPLANATION OF LEAD INSPECTION / RISK ASSESSMENT REPORT FORM COLUMNS

This page provides general information needed to understand the lead inspection/risk assessment report. However, you should speak with the inspector/risk assessor before you start to do any work on your home.

SIDE	Refers to A, B, C, or D side of the building or room. See the diagram on the cover sheet. The "A" side of the building or room is the side facing the street that gives the property its address (usually, it is the front of the building). Keeping your back to this street, from the "A" side move clockwise to the "B" side on your left, the "C" side opposite you, and the "D" side to the right. Numbering is from left to right.
LOCATION/ SURFACE	Refers to the building component(s) being tested. Some surfaces may be made up of more than one part. For example, "Baseboard" may refer to four separate pieces of wood (one on each wall), but is still considered one surface.
LEAD	<p>The actual lead result. Each surface tested must have a result recorded in the "Lead" column.</p> <ul style="list-style-type: none"> A number shows that the surface was tested with an XRF analyzer. A number (or average number) equal to or greater than 1.0 mg/cm² is a dangerous level of lead. A "pos" or "neg" shows that the surface was tested with sodium sulfide. "Pos" means that there is a dangerous level of lead. "N/A" means that the inspector was not able to test the surface. Unless the owner can get a sample to test, the inspector must assume the surface contains lead and require it to be deleaded, if necessary. "MET" or "MR" means that a metal surface was not tested and only needs to be intact, even if it is a leaded surface. However, metal handrails, metal window sills, and metal railing caps, need to be deleaded if they test equal to or greater than 1.0 mg/cm², or is marked "N/A." For key to abbreviations like "COV", "VB", "VR" or "MR", "NC", "Tile", "DC", see the cover page. When a component box is slashed and there are test results above and below the diagonal line, the result on the "bottom" represents results below 5 ft. and the "top" result indicates the test result above 5 ft.
TYPE OF HAZARD	<p>Not all lead paint must be deleaded. This column tells you IF and WHY a surface needs deleading. The deleading standards below may not apply for Interim Controls. Speak to your risk assessor for more information.</p> <ul style="list-style-type: none"> "M/I" circled means that the surface is a moveable/impacted surface and must be deleaded in its entirety. "SF" circled indicates that there is a storm frame present which requires the blind stop and exterior sill be deleaded as interior moveable / impacted surfaces. "A/M" circled means that the surface is "accessible mouthable" and must be deleaded to a minimum of five feet high, four inches in from the edge or corner. "L" circled means that the surface is loose and must, at minimum, be made intact. If more than one choice is circled, the rules for deleading may change depending upon what method of deleading you choose. Speak to the inspector for more information. "N/A" means the inspector was unable to determine if the surface was a lead hazard. The person doing the deleading must check this surface and follow all the rules for deleading. Speak to the inspector for more information. If nothing is circled in the column, then it is likely the surface does not need deleading. Speak to the inspector for more information. Remember, this does not mean the entire surface is lead free, it just does not require deleading in its current condition.
URG HAZ?	This column is only completed during a risk assessment. A risk assessment is an evaluation of a home's suitability for Interim Control. Only a licensed risk assessor can do a risk assessment, not all inspectors are risk assessors. If "Y" is circled, then this surface is considered an "Urgent Lead Hazard" and some type of deleading work is required to qualify for Interim Control.
IC DATE	The date the licensed risk assessor determines the surface meets the standards for Interim Control.
IC METH	The deleading method or structural repair done to qualify the surface for Interim Control. Refer to the deleading codes key on the cover page.
DELEAD DATE	The date that the lead inspector reinspects the surface and finds that it has been successfully brought back into compliance.
DELEAD METH	The method used to bring a surface into full compliance. Refer to codes in the Key on the cover page of the PCAD
EXCLUDED SURFACES	The amount of loose paint on a surface as measured by the lead inspector. "N/A" means that the inspector was not able to measure the loose paint, but has determined it is more than the cut-off for moderate risk making intact.

(b) (6)

09-20-2012

Page 5 of 27

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 920 Main St.

Apt #: AAAAAA

City: Vineyard Haven, MA 02568

ROOM # 1 (PAGE 1 of 2)

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A B	Up Walls	0.01	A/M L N/A	Y				
A B	Low Walls	✓	A/M L N/A	Y				
A B	Baseboards	0.8	A/M L N/A	Y				
A B	Chair Rail	✓	A/M L N/A	Y				
A B	Radiator	0.22	A/M L N/A	Y				
A B	Floor	0.00	A/M L N/A	Y				
A B	Ceiling	0.00	A/M L N/A	Y				
A B	Door	✓	A/M L N/A	Y				
C D	Door Casing	1.5	A/M L N/A	Y				
1 2	Door Jamb	4.1	A/M L N/A	Y				
3 4	Threshold	0.00	A/M L N/A	Y				
A B	Door	✓	A/M L N/A	Y				
C D	Door Casing	1.4	A/M L N/A	Y				
1 2	Door Jamb	0.5	A/M L N/A	Y				
3 4	Threshold	0.00	A/M L N/A	Y				
A B	Door	✓	A/M L N/A	Y				
C D	Door Casing	✓	A/M L N/A	Y				
1 2	Door Jamb	✓	A/M L N/A	Y				
3 4	Threshold	✓	A/M L N/A	Y				
A B	Door	✓	A/M L N/A	Y				
C D	Door Casing	✓	A/M L N/A	Y				
1 2	Door Jamb	✓	A/M L N/A	Y				
3 4	Threshold	✓	A/M L N/A	Y				
A	Closet Door	✓	A/M L N/A	Y				
B	Closet Casing	✓	A/M L N/A	Y				
C	Closet Jamb	✓	A/M L N/A	Y				
D	Closet Walls	✓	A/M L N/A	Y				
	Closet Baseboard	✓	A/M L N/A	Y				
1	Closet Pole	✓	A/M L N/A	Y				
2	Closet Shelf	✓	A/M L N/A	Y				
3	Closet Supports	✓	A/M L N/A	Y				
4	Closet Floor	✓	A/M L N/A	Y				
	Closet Ceiling	✓	A/M L N/A	Y				

COMMENTS / STRUCTURAL DEFECTS:

1) OLDER LIP NEXT TO NEW STOPS
IS LEAD.

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A	Window Sill	0.24	A/M L N/A	Y				
B	Win Apron	2.1	A/M L N/A	Y				
C	Win Casing	0.5	A/M L N/A	Y				
D	Header Stop	0.22	A/M L N/A	Y				
	Int Stops (1)	0.22	A/M L N/A	Y				
1	Win Int Sash	0.00	A/M L N/A	Y				
2	Exterior Sill	1.1	A/M L N/A	Y				
3	Part Bead	0.00	A/M L N/A	Y				
4	Blind Stop	1.1	A/M L N/A	Y				
	Win Ext Sash	0.00	A/M L N/A	Y				
A	Window Sill	0.24	A/M L N/A	Y				
B	Win Apron	2.1	A/M L N/A	Y				
C	Win Casing	0.5	A/M L N/A	Y				
D	Header Stop	0.22	A/M L N/A	Y				
	Int Stops (1)	0.22	A/M L N/A	Y				
1	Win Int Sash	0.00	A/M L N/A	Y				
2	Exterior Sill	1.6	A/M L N/A	Y				
3	Part Bead	0.00	A/M L N/A	Y				
4	Blind Stop	1.6	A/M L N/A	Y				
	Win Ext Sash	0.00	A/M L N/A	Y				
A	Window Sill	0.6	A/M L N/A	Y				
B	Win Apron	0.16	A/M L N/A	Y				
C	Win Casing	0.01	A/M L N/A	Y				
D	Header Stop	0.22	A/M L N/A	Y				
	Int Stops (1)	0.22	A/M L N/A	Y				
1	Win Int Sash	0.00	A/M L N/A	Y				
2	Exterior Sill	0.21	A/M L N/A	Y				
3	Part Bead	0.00	A/M L N/A	Y				
4	Blind Stop	0.21	A/M L N/A	Y				
	Win Ext Sash	0.00	A/M L N/A	Y				
A B	Fireplace	✓	A/M L N/A	Y				
C D	Mantle	✓	A/M L N/A	Y				
A B	Win Above 5'	✓	A/M L N/A	Y				
C B	Ceiling Molding	✓	A/M L N/A	Y				
		✓	A/M L N/A	Y				
		✓	A/M L N/A	Y				
		✓	A/M L N/A	Y				

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

(b) (6)

09-20-2012

Page 60 of 27

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 920 Main St.

Apt #: AAAAA

City: Vineyard Haven, MA 02568

ROOM # 1 CONTINUED (PAGE 2 of 2)

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A B	Up Walls	/	A/M L N/A	Y				
A B	Low Walls	/	A/M L N/A	Y				
A B	Baseboards	/	A/M L N/A	Y				
A B	Chair Rail	/	A/M L N/A	Y				
A B	Radiator	/	A/M L N/A	Y				
A B	Floor	/	A/M L N/A	Y				
A B	Ceiling	/	A/M L N/A	Y				
A B	Door	/	A/M L N/A	Y				
C D	Door Casing	/	A/M L N/A	Y				
1 2	Door Jamb	/	A/M L N/A	Y				
3 4	Threshold	/	A/M L N/A	Y				
A B	Door	/	A/M L N/A	Y				
C D	Door Casing	/	A/M L N/A	Y				
1 2	Door Jamb	/	A/M L N/A	Y				
3 4	Threshold	/	A/M L N/A	Y				
A B	Door	/	A/M L N/A	Y				
C D	Door Casing	/	A/M L N/A	Y				
1 2	Door Jamb	/	A/M L N/A	Y				
3 4	Threshold	/	A/M L N/A	Y				
A B	Door	/	A/M L N/A	Y				
C D	Door Casing	/	A/M L N/A	Y				
1 2	Door Jamb	/	A/M L N/A	Y				
3 4	Threshold	/	A/M L N/A	Y				
A	Closet Door	/	A/M L N/A	Y				
B	Cl Casing	/	A/M L N/A	Y				
C	Closet Jamb	/	A/M L N/A	Y				
D	Closet Walls	/	A/M L N/A	Y				
	Cl Baseboard	/	A/M L N/A	Y				
1	Closet Pole	/	A/M L N/A	Y				
2	Closet Shelf	/	A/M L N/A	Y				
3	Cl Supports	/	A/M L N/A	Y				
4	Closet Floor	/	A/M L N/A	Y				
	Closet Ceiling	/	A/M L N/A	Y				

COMMENTS / STRUCTURAL DEFECTS:

(1) INNER EDGE LIP OF STOPS NEXT TO
NEWER STOP IS LEAD

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A	Window Sill	0.00	M/M A/M L N/A	Y				
B	Win Apron	0.04	A/M L N/A	Y				
C	Win Casing	0.01	A/M L N/A	Y				
D	Header Stop	0.01	M/M A/M L N/A	Y				
	Int Stops	0.01	M/M A/M L N/A	Y				
1	Win Int Sash	0.00	M/M A/M L N/A	Y				
2	Exterior Sill	0.04	M/M SF L N/A	Y				
3	Part Bead	0.00	M/M L N/A	Y				
4	Blind Stop	0.04	M/M SF L N/A	Y				
	Win Ext Sash	0.01	M/M L N/A	Y				
A	Window Sill	/	M/M A/M L N/A	Y				
B	Win Apron	/	A/M L N/A	Y				
C	Win Casing	/	A/M L N/A	Y				
D	Header Stop	/	M/M A/M L N/A	Y				
	Int Stops	/	M/M A/M L N/A	Y				
1	Win Int Sash	/	M/M A/M L N/A	Y				
2	Exterior Sill	/	M/M SF L N/A	Y				
3	Part Bead	/	M/M L N/A	Y				
4	Blind Stop	/	M/M SF L N/A	Y				
	Win Ext Sash	/	M/M L N/A	Y				
A	Window Sill	/	M/M A/M L N/A	Y				
B	Win Apron	/	A/M L N/A	Y				
C	Win Casing	/	A/M L N/A	Y				
D	Header Stop	/	M/M A/M L N/A	Y				
	Int Stops	/	M/M A/M L N/A	Y				
1	Win Int Sash	/	M/M A/M L N/A	Y				
2	Exterior Sill	/	M/M SF L N/A	Y				
3	Part Bead	/	M/M L N/A	Y				
4	Blind Stop	/	M/M SF L N/A	Y				
	Win Ext Sash	/	M/M L N/A	Y				
A B	Fireplace	/	A/M L N/A	Y				
C D	Mantle	/	A/M L N/A	Y				
A B	Win Above S	/	A/M L N/A	Y				
C D	Ceiling Molding	/	A/M L N/A	Y				
		/	A/M L N/A	Y				
		/	A/M L N/A	Y				
		/	A/M L N/A	Y				

(b) (6)

09-20-2012

Page 7 of 27

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 920 Main St.

Apt #: AAAAAA

City: Vineyard Haven, MA 02568

ROOM # 2

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A B	Up Walls (1)	0.00	A/M L N/A	Y				
A S	Low Walls		A/M L N/A	Y				
A B	Baseboards (2)	0.0	A/M L N/A	Y				
A B	Chair Rail		A/M L N/A	Y				
A B	Radiator	0.01	A/M L N/A	Y				
	Floor	0.00	A/M L N/A	Y				
	Ceiling	0.01	A/M L N/A	Y				
A B	Door	0.00	A/M L N/A	Y				
C D	Door Casing	0.00	A/M L N/A	Y				
1 2	Door Jamb	0.00	A/M L N/A	Y				
3 4	Threshold	0.01	A/M L N/A	Y				
A B	Door	0.00	A/M L N/A	Y				
C D	Door Casing	2.6	A/M L N/A	Y				
1 2	Door Jamb	0.0	A/M L N/A	Y				
3 4	Threshold	0.00	A/M L N/A	Y				
A B	Door	0.00	A/M L N/A	Y				
C D	Door Casing	0.00	A/M L N/A	Y				
1 2	Door Jamb	0.0	A/M L N/A	Y				
3 4	Threshold		A/M L N/A	Y				
A B	Door		A/M L N/A	Y				
C D	Door Casing		A/M L N/A	Y				
1 2	Door Jamb		A/M L N/A	Y				
3 4	Threshold		A/M L N/A	Y				
A B	Door		A/M L N/A	Y				
C D	Door Casing		A/M L N/A	Y				
1 2	Door Jamb		A/M L N/A	Y				
3 4	Threshold		A/M L N/A	Y				
A	Closet Door	1.5	A/M L N/A	Y				
B	Closet Casing		A/M L N/A	Y				
C	Closet Jamb	4.4	A/M L N/A	Y				
D	Closet Walls	15.1	A/M L N/A	Y				
	Closet Baseboard	21.2	A/M L N/A	Y				
1	Closet Pole		A/M L N/A	Y				
2	Closet Shelf	5.1	A/M L N/A	Y				
3	Closet Supports	0.21	A/M L N/A	Y				
4	Closet Floor	0.00	A/M L N/A	Y				
	Closet Ceiling	4.3	A/M L N/A	Y				

COMMENTS / STRUCTURAL DEFECTS:

(1) Plaster walls behind sheetrock = 2.7
 (2) TOP EDGE (3) upper/lower doors

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A	Window Sill	0.6	A/M L N/A	Y				
B	Win Apron	0.34	A/M L N/A	Y				
C	Win Casing	0.01	A/M L N/A	Y				
	Header Stop	0.00	A/M L N/A	Y				
	Int Stops	0.00	A/M L N/A	Y				
1	Win Int Sash	0.00	A/M L N/A	Y				
2	Exterior Sill	1.1	A/M L N/A	Y				
3	Part Bead	0.00	A/M L N/A	Y				
4	Blind Stop	1.2	A/M L N/A	Y				
	Win Ext Sash	0.00	A/M L N/A	Y				
A	Window Sill		A/M L N/A	Y				
B	Win Apron		A/M L N/A	Y				
C	Win Casing		A/M L N/A	Y				
D	Header Stop		A/M L N/A	Y				
	Int Stops		A/M L N/A	Y				
1	Win Int Sash		A/M L N/A	Y				
2	Exterior Sill		A/M L N/A	Y				
3	Part Bead		A/M L N/A	Y				
4	Blind Stop		A/M L N/A	Y				
	Win Ext Sash		A/M L N/A	Y				
A	Window Sill		A/M L N/A	Y				
B	Win Apron		A/M L N/A	Y				
C	Win Casing		A/M L N/A	Y				
D	Header Stop		A/M L N/A	Y				
	Int Stops		A/M L N/A	Y				
1	Win Int Sash		A/M L N/A	Y				
2	Exterior Sill		A/M L N/A	Y				
3	Part Bead		A/M L N/A	Y				
4	Blind Stop		A/M L N/A	Y				
	Win Ext Sash		A/M L N/A	Y				
A B	Fireplace		A/M L N/A	Y				
C D	Mantle		A/M L N/A	Y				
A B	Win Above 5'		A/M L N/A	Y				
	Ceiling Molding		A/M L N/A	Y				
B	PIPES	0.14	A/M L N/A	Y				
			A/M L N/A	Y				
			A/M L N/A	Y				

(3) INNER LIP/EDGE NEXT TO NEWER STOPS IS LEAD

(b) (6)

09-20-2012

Page 2 of 27

Inspector (print) _____ Lic # _____ Signature _____

Date _____

(b) (6)

Risk Assessor (print) _____ Lic # _____ Signature _____

Date _____

Address of Property: 920 Main St.

Apt #: AAAAAA

City: Vineyard Haven, MA 02568

ROOM # 3

SIDE	LOCATION/SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A B C D	Up Walls (1)	13.1	(AM) L N/A	Y				
A B C D	Low Walls		AM L N/A	Y				
A B C D	Baseboards (2)	13.2	(AM) L N/A	Y				
A B C D	Chair Rail		AM L N/A	Y				
A B C D	Radiator	0.01	AM L N/A	Y				
A B C D	Floor	0.00	AM L N/A	Y				
A B C D	Ceiling	11.1	(AM) L N/A	Y				
A B	Door	0.00	AM L N/A	Y				
C D	Door Casing	0.6	AM L N/A	Y				
1 2	Door Jamb	1.5	(AM) L N/A	Y				
3 4	Threshold		AM L N/A	Y				
A B	Door	0.8	AM L N/A	Y				
C D	Door Casing	1.5	(AM) L N/A	Y				
1 2	Door Jamb	6.4	AM L N/A	Y				
3 4	Threshold		AM L N/A	Y				
A B	Door		AM L N/A	Y				
C D	Door Casing		AM L N/A	Y				
1 2	Door Jamb		AM L N/A	Y				
3 4	Threshold		AM L N/A	Y				
A B	Door		AM L N/A	Y				
C D	Door Casing		AM L N/A	Y				
1 2	Door Jamb		AM L N/A	Y				
3 4	Threshold		AM L N/A	Y				
A	Closet Door	0.02	AM L N/A	Y				
B	Cl Casing	3.1	(AM) L N/A	Y				
C	Closet Jamb	0.14	AM L N/A	Y				
D	Closet Walls	15.5	AM L N/A	Y				
	Cl Baseboard	16.3	AM L N/A	Y				
1	Closet Pole	0.00	AM L N/A	Y				
2	Closet Shelf	0.00	AM L N/A	Y				
3	Cl Supports	2.6	(AM) L N/A	Y				
4	Closet Floor	0.00	AM L N/A	Y				
	Closet Ceiling	11.4	AM L N/A	Y				

COMMENTS / STRUCTURAL DEFECTS:

(1) C WALL o/c

(2) INNER LIP NEXT TO NEWER STOPS IS LEAD

SIDE	LOCATION/SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A	Window Sill	2.6	(AM) L N/A	Y				
B	Win Apron	2.4	(AM) L N/A	Y				
C	Win Casing	2.4	(AM) L N/A	Y				
D	Header Stop (2)	1.8	AM L N/A	Y				
	Int Stops (1)	1.8	(AM) L N/A	Y				
1	Win Int Sash	0.00	AM L N/A	Y				
2	Exterior Sill	2.1	(AM) SF L N/A	Y				
3	Part Bead	0.00	AM L N/A	Y				
4	Blind Stop	2.5	(AM) SF L N/A	Y				
	Win Ext Sash	0.02	AM L N/A	Y				
A	Window Sill	2.6	(AM) L N/A	Y				
B	Win Apron	2.4	(AM) L N/A	Y				
C	Win Casing	2.4	(AM) L N/A	Y				
D	Header Stop (2)	1.2	AM L N/A	Y				
	Int Stops (2)	1.4	(AM) L N/A	Y				
1	Win Int Sash	0.02	AM L N/A	Y				
2	Exterior Sill	2.1	(AM) SF L N/A	Y				
3	Part Bead	0.00	AM L N/A	Y				
4	Blind Stop	2.5	(AM) SF L N/A	Y				
	Win Ext Sash	0.02	AM L N/A	Y				
A	Window Sill		AM L N/A	Y				
B	Win Apron		AM L N/A	Y				
C	Win Casing		AM L N/A	Y				
D	Header Stop		AM L N/A	Y				
	Int Stops		AM L N/A	Y				
1	Win Int Sash		AM L N/A	Y				
2	Exterior Sill		AM SF L N/A	Y				
3	Part Bead		AM L N/A	Y				
4	Blind Stop		AM SF L N/A	Y				
	Win Ext Sash		AM L N/A	Y				
A B	Fireplace		AM L N/A	Y				
C D	Mantle		AM L N/A	Y				
A B C D	Win Above 5'		AM L N/A	Y				
	Ceiling Molding		AM L N/A	Y				
C	CLIF	13.2	(AM) L N/A	Y				
C	Support	0.4	AM L N/A	Y				
			AM L N/A	Y				

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

(b) (6)

09-20-2012

Page 9 of 27

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 920 Main St.

Apt #: AAAAAA

City: Vineyard Haven, MA 02568

ROOM # 4

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
AB	Up Walls	10.4	AM L N/A	Y				
AB	Low Walls		AM L N/A	Y				
AB	Baseboards	17.1	AM L N/A	Y				
AB	Chair Rail		AM L N/A	Y				
AB	Radiator	5.29	AM L N/A	Y				
AB	Floor	0.31	AM L N/A	Y				
AB	Ceiling	9.4	AM L N/A	Y				
AB	Door	0.33	AM L N/A	Y				
CD	Door Casing	4.2	AM L N/A	Y				
12	Door Jamb	1.6	AM L N/A	Y				
34	Threshold		AM L N/A	Y				
AB	Door	0.33	AM L N/A	Y				
CD	Door Casing	4.2	AM L N/A	Y				
12	Door Jamb	1.9	AM L N/A	Y				
34	Threshold		AM L N/A	Y				
AB	Door		AM L N/A	Y				
CD	Door Casing		AM L N/A	Y				
12	Door Jamb		AM L N/A	Y				
34	Threshold		AM L N/A	Y				
AB	Door		AM L N/A	Y				
CD	Door Casing		AM L N/A	Y				
12	Door Jamb		AM L N/A	Y				
34	Threshold		AM L N/A	Y				
AB	Closet Door	0.03	AM L N/A	Y				
B	Cl Casing	0.5	AM L N/A	Y				
C	Closet Jamb	3.2	AM L N/A	Y				
D	Closet Walls	2.0	AM L N/A	Y				
	Cl Baseboard	14.3	AM L N/A	Y				
1	Closet Pole	0.00	AM L N/A	Y				
2	Closet Shelf	0.30	AM L N/A	Y				
3	Cl Supports	3.0	AM L N/A	Y				
4	Closet Floor	10.0	AM L N/A	Y				
	Closet Ceiling	0.02	AM L N/A	Y				

COMMENTS / STRUCTURAL DEFECTS:
(1) INNER LIP NEXT TO NEWER STOPS
IS LEAD

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

(b) (6)

9-20-2012

Page 10 of 27

Inspector (print)

Lic #

Signature

Date

(b) (6)

SA Assessor (print)

Lic #

Signature

Date

Address of Property: 920 MAIN ST. Apt #:

City: VINEYARD HAVEN, MA 02658

Room # 5

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A B C D	Up Walls	2.7	AM L N/A	Y				
A B C D	Low Walls	/	AM L N/A	Y				
A B C D	Baseboards	13.7	AM L N/A	Y				
A B C D	Chair Rail	/	AM L N/A	Y				
A B C D	Radiator	0.16	AM L N/A	Y				
A B C D	Floor	0.31	AM L N/A	Y				
A B C D	Ceiling	6.9	AM L N/A	Y				
A B	Door	0.20	AM L N/A	Y				
C D	Door Casing	0.31	AM L N/A	Y				
1 2	Door Jamb	NC	AM L N/A	Y				
3 4	Threshold	/	AM L N/A	Y				
A B	Door	1.9	AM L N/A	Y				
C D	Door Casing	2.2	AM L N/A	Y				
1 2	Door Jamb	7.1	AM L N/A	Y				
3 4	Threshold	/	AM L N/A	Y				
A B	Door	0.31	AM L N/A	Y				
C D	Door Casing	7.9	AM L N/A	Y				
1 2	Door Jamb	0.6	AM L N/A	Y				
3 4	Threshold	/	AM L N/A	Y				
A B	Door (2)	NC	AM L N/A	Y				
C D	Door Casing	/	AM L N/A	Y				
1 2	Door Jamb	NC	AM L N/A	Y				
3 4	Threshold	/	AM L N/A	Y				
A	Closet Door	0.31	AM L N/A	Y				
B	Cl Casing	/	AM L N/A	Y				
C	Closet Jamb	4.6	AM L N/A	Y				
D	Closet Walls	NC	AM L N/A	Y				
	Cl Baseboard	/	AM L N/A	Y				
1	Closet Pole	/	AM L N/A	Y				
2	Closet Shelf	/	AM L N/A	Y				
3	Cl Supports	/	AM L N/A	Y				
4	Closet Floor	NC	AM L N/A	Y				
	Closet Ceiling	NC	AM L N/A	Y				

COMMENTS / STRUCTURAL DEFECTS:

- (1) Attic crawl space
(2) other side of door for pipe access

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A	Window Sill	0.20	AM L N/A	Y				
B	Win Apron	0.4	AM L N/A	Y				
C	Win Casing	2.9	AM L N/A	Y				
D	Header Stop	0.20	AM L N/A	Y				
	Int Stops	0.20	AM L N/A	Y				
1	Win Int Sash	0.20	AM L N/A	Y				
2	Exterior Sill	0.05	AM SF L N/A	Y				
3	Part Bead	0.05	AM L N/A	Y				
4	Blind Stop	0.01	AM SF L N/A	Y				
	Win Ext Sash	0.02	AM L N/A	Y				
A	Window Sill	/	AM L N/A	Y				
B	Win Apron	/	AM L N/A	Y				
C	Win Casing	/	AM L N/A	Y				
D	Header Stop	/	AM L N/A	Y				
	Int Stops	/	AM L N/A	Y				
1	Win Int Sash	/	AM L N/A	Y				
2	Exterior Sill	/	AM SF L N/A	Y				
3	Part Bead	/	AM L N/A	Y				
4	Blind Stop	/	AM SF L N/A	Y				
	Win Ext Sash	/	AM L N/A	Y				
A B	Fireplace	/	AM L N/A	Y				
C D	Mantle	/	AM L N/A	Y				
A B C D	Win Above S'	/	AM L N/A	Y				
	Ceiling Molding	/	AM L N/A	Y				
D	Appl. w/nc	/	AM L N/A	Y				
A	Shelf	8.3	AM L N/A	Y				
A	Support	6.1	AM L N/A	Y				

(b) (6)

09-20-2012

Page 11 of 27

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 920 Main St.

Apt #: AAAAAA

City: Vineyard Haven, MA 02568

KITCHEN

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A B	Up Walls	0.00	AM L N/A	Y				
A B	Low Walls	/	AM L N/A	Y				
A B	Baseboards	0.00	AM L N/A	Y				
A B	Chair Rail	/	AM L N/A	Y				
A B	Radiator	0.06	AM L N/A	Y				
	Floor	0.00	AM L N/A	Y				
	Ceiling	0.00	AM L N/A	Y				
A B	Door	/	AM L N/A	Y				
C D	Door Casing	0.01	AM L N/A	Y				
12	Door Jamb	0.07	AM L N/A	Y				
34	Threshold	0.00	AM L N/A	Y				
A B	Door	0.00	AM L N/A	Y				
C D	Door Casing	0.00	AM L N/A	Y				
12	Door Jamb	1.2	AM L N/A	Y				
34	Threshold	/	AM L N/A	Y				
A B	Door	/	AM L N/A	Y				
C D	Door Casing	0.00	AM L N/A	Y				
12	Door Jamb	1.3	AM L N/A	Y				
34	Threshold	0.00	AM L N/A	Y				
A B	Door	/	AM L N/A	Y				
C D	Door Casing	/	AM L N/A	Y				
12	Door Jamb	/	AM L N/A	Y				
34	Threshold	/	AM L N/A	Y				
A	Closet Door	0.00	AM L N/A	Y				
B	Closet Casing	4.4	AM L N/A	Y				
C	Closet Jamb	1.2	AM L N/A	Y				
D	Closet Walls	19.6	AM L N/A	Y				
	Closet Baseboard	15.5	AM L N/A	Y				
1	Closet Pole	/	AM L N/A	Y				
2	Closet Shelf	1.3	AM L N/A	Y				
3	Closet Supports	2.0	AM L N/A	Y				
4	Closet Floor	0.00	AM L N/A	Y				
	Closet Ceiling	11.3	AM L N/A	Y				

COMMENTS / STRUCTURAL DEFECTS:

U1 PLASTER BEHIND SHEETROCK = 3.6

SIDE	LOCATION/ SURFACE	LEAD	TYPE OF HAZARD	URG HAZ?	IC DATE	IC METH	DELEAD DATE	DELEAD METH
A	Window Sill	0.00	AM L N/A	Y				
B	Win Apron	0.00	AM L N/A	Y				
C	Win Casing	0.02	AM L N/A	Y				
D	Header Stop	0.00	AM L N/A	Y				
	Int Stops	0.01	AM L N/A	Y				
1	Win Int Sash	0.00	AM L N/A	Y				
2	Exterior Sill	1.5	AM L N/A	Y				
3	Part Bead	0.00	AM L N/A	Y				
4	Blind Stop	2.6	AM L N/A	Y				
	Win Ext Sash	0.00	AM L N/A	Y				
A	Window Sill	0.01	AM L N/A	Y				
B	Win Apron	0.00	AM L N/A	Y				
C	Win Casing	0.02	AM L N/A	Y				
D	Header Stop	0.03	AM L N/A	Y				
	Int Stops	0.00	AM L N/A	Y				
1	Win Int Sash	0.02	AM L N/A	Y				
2	Exterior Sill	1.6	AM L N/A	Y				
3	Part Bead	0.00	AM L N/A	Y				
4	Blind Stop	2.7	AM L N/A	Y				
	Win Ext Sash	0.00	AM L N/A	Y				
A B	Up Cab Frame	0.00	AM L N/A	Y				
C D	Up Cab Door	0.01	AM L N/A	Y				
	Up Cab Walls	0.00	AM L N/A	Y				
12	Up Cab Shlvs	0.00	AM L N/A	Y				
34	Supports	/	AM L N/A	Y				
	Low Cab Frame	0.00	AM L N/A	Y				
A B	Low Cab Door	0.01	AM L N/A	Y				
C D	Low Cab Walls	0.00	AM L N/A	Y				
	Low Cab Shlvs	0.00	AM L N/A	Y				
12	Supports	/	AM L N/A	Y				
34	Drawers	0.00	AM L N/A	Y				
A B	Win Above S	/	AM L N/A	Y				
	Win Below S	1.4	AM L N/A	Y				
		/	AM L N/A	Y				
		/	AM L N/A	Y				
		/	AM L N/A	Y				

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

SIDE	LOCATION	MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.)	IC DATE	IC METHOD

(b) (6)

Date _____

Page

Lic #

Signature _____

(b) (6)

पुनः

Signature

Date _____

920 Main St.

Appl #

~~~~~

City: Vineyard Haven, MA 02568

BATHROOM #

| SIDE       | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A B<br>C D | Up Walls (1)         | 0.01 | A/M L N/A         | Y           |            |            |                |                |
| A B<br>C D | Low Walls            |      | A/M L N/A         | Y           |            |            |                |                |
| A B<br>C D | Baseboards           | 19.2 | A/M L N/A         | Y           |            |            |                |                |
| A B<br>C D | Chair Rail           |      | A/M L N/A         | Y           |            |            |                |                |
| A B<br>C D | Radiator             | 0.00 | A/M L N/A         | Y           |            |            |                |                |
|            | Floor                | 0.00 | A/M L N/A         | Y           |            |            |                |                |
|            | Ceiling              | 0.01 | A/M L N/A         | Y           |            |            |                |                |
| A B        | Door                 | 0.01 | A/M L N/A         | Y           |            |            |                |                |
| C D        | Door Casing          | 0.02 | A/M L N/A         | Y           |            |            |                |                |
| 1 2        | Door Jamb            | 1.7  | A/M L N/A         | Y           |            |            |                |                |
| 3 4        | Threshold            | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A B        | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C D        | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2        | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4        | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A          | Closet Door          |      | A/M L N/A         | Y           |            |            |                |                |
| B          | CI Casing            |      | A/M L N/A         | Y           |            |            |                |                |
| C          | Closet Jamb          |      | A/M L N/A         | Y           |            |            |                |                |
| D          | Closet Walls         |      | A/M L N/A         | Y           |            |            |                |                |
|            | CI Baseboard         |      | A/M L N/A         | Y           |            |            |                |                |
| 1          | Closet Pole          |      | A/M L N/A         | Y           |            |            |                |                |
| 2          | Closet Shelf         |      | A/M L N/A         | Y           |            |            |                |                |
| 3          | CI Supports          |      | A/M L N/A         | Y           |            |            |                |                |
| 4          | Closet Floor         |      | A/M L N/A         | Y           |            |            |                |                |
|            | Closet Ceiling       |      | A/M L N/A         | Y           |            |            |                |                |
| A B        | Up Cab Frame         |      | A/M L N/A         | Y           |            |            |                |                |
| C D        | Up Cab Door          |      | A/M L N/A         | Y           |            |            |                |                |
|            | Up Cab Walls         |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2        | Up Cab Shvs          |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4        | Supports             |      | A/M L N/A         | Y           |            |            |                |                |
|            |                      |      | MR A/M L N/A      | Y           |            |            |                |                |
|            |                      |      | MI A/M L N/A      | Y           |            |            |                |                |
|            |                      |      | MI A/M L N/A      | Y           |            |            |                |                |

(2) INNER LIP/EDGE NEXT TO STOPS IS LEAD.

[illegible]

(1) PLASTER WALLS BEHND SHEET PILE = 2.2

**EXCLUDED SURFACES:** Surfaces listed in these boxes can be made intact only by a licensed dealer.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. FT.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |



(b) (6)

09-20-2012

Page 13 of 27

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic#

Signature

Date

Address of Property: 920 Main St.

Apt #: AAAAAA

City: Vineyard Haven, MA 02568

BATHROOM # 2

| SIDE       | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A B<br>C D | Up Walls             | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A B<br>C D | Low Walls            | Tile | A/M L N/A         | Y           |            |            |                |                |
| A B<br>C D | Baseboards           | 0.41 | A/M L N/A         | Y           |            |            |                |                |
| A B<br>C D | Chair Rail           |      | A/M L N/A         | Y           |            |            |                |                |
| A B<br>C D | Radiator             | 0.41 | A/M L N/A         | Y           |            |            |                |                |
|            | Floor                | 0.00 | A/M L N/A         | Y           |            |            |                |                |
|            | Ceiling              | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A B        | Door                 | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| C D        | Door Casing          | 5.11 | A/M L N/A         | Y           |            |            |                |                |
| 1 2        | Door Jamb            | 0.7  | A/M L N/A         | Y           |            |            |                |                |
| 3 4        | Threshold            | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A B        | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C D        | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2        | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4        | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A          | Closet Door          |      | A/M L N/A         | Y           |            |            |                |                |
| B          | Cl Casing            |      | A/M L N/A         | Y           |            |            |                |                |
| C          | Closet Jamb          |      | A/M L N/A         | Y           |            |            |                |                |
| D          | Closet Walls         |      | A/M L N/A         | Y           |            |            |                |                |
|            | Cl Baseboard         |      | A/M L N/A         | Y           |            |            |                |                |
| 1          | Closet Pole          |      | A/M L N/A         | Y           |            |            |                |                |
| 2          | Closet Shelf         |      | A/M L N/A         | Y           |            |            |                |                |
| 3          | Cl Supports          |      | A/M L N/A         | Y           |            |            |                |                |
| 4          | Closet Floor         |      | A/M L N/A         | Y           |            |            |                |                |
|            | Closet Ceiling       |      | A/M L N/A         | Y           |            |            |                |                |
| A B        | Up Cab Frame         |      | A/M L N/A         | Y           |            |            |                |                |
| C D        | Up Cab Door          |      | A/M L N/A         | Y           |            |            |                |                |
|            | Up Cab Walls         |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2        | Up Cab Shlvs         |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4        | Supports             |      | A/M L N/A         | Y           |            |            |                |                |
|            |                      |      | M/I A/M L N/A     | Y           |            |            |                |                |
|            |                      |      | M/I A/M L N/A     | Y           |            |            |                |                |
|            |                      |      | M/I A/M L N/A     | Y           |            |            |                |                |

COMMENTS / STRUCTURAL DEFECTS:

(1) INNER LIP NEXT TO NEWER STOPS IS LEAD

| SIDE       | LOCATION/<br>SURFACE | LEAD            | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------------|----------------------|-----------------|-------------------|-------------|------------|------------|----------------|----------------|
|            | Low Cab Frame        | 0.00            | A/M L N/A         | Y           |            |            |                |                |
| A B        | Low Cab Door         | 0.00            | A/M L N/A         | Y           |            |            |                |                |
| C D        | Low Cab Walls        | 0.00            | A/M L N/A         | Y           |            |            |                |                |
|            | Low Cab Shlvs        | 0.00            | A/M L N/A         | Y           |            |            |                |                |
| 1 2        | Supports             |                 | A/M L N/A         | Y           |            |            |                |                |
| 3 4        | Drawers              |                 | A/M L N/A         | Y           |            |            |                |                |
| A          | Window Sill          | 2.9 (M/I) (A/M) | L N/A             | Y           |            |            |                |                |
| B          | Win Apron            | 0.00            | A/M L N/A         | Y           |            |            |                |                |
| C          | Win Casing           | 0.3             | A/M L N/A         | Y           |            |            |                |                |
| D          | Header Stop          | 0.6 M/I         | A/M L N/A         | Y           |            |            |                |                |
|            | Int Stops (1)        | 2.80 M/I (A/M)  | L N/A             | Y           |            |            |                |                |
| 1          | Win Int Sash         | 0.00 M/I        | A/M L N/A         | Y           |            |            |                |                |
| 2          | Exterior Sill        | 2.1 M/I         | SF L N/A          | Y           |            |            |                |                |
| 3          | Part Bead            | 0.00 M/I        | L N/A             | Y           |            |            |                |                |
| 4          | Blind Stop           | 0.01 M/I        | SF L N/A          | Y           |            |            |                |                |
|            | Win Ext Sash         | 0.00 M/I        | L N/A             | Y           |            |            |                |                |
| A B<br>C D | Win Above 5'         |                 | M/I A/M L N/A     | Y           |            |            |                |                |
| A B<br>C D | Ceiling Molding      |                 | M/I A/M L N/A     | Y           |            |            |                |                |
| A B<br>C D | Medicine Cab         | 0.00 M/I        | A/M L N/A         | Y           |            |            |                |                |
| A B<br>C D | Wall O/C             |                 | M/I A/M L N/A     | Y           |            |            |                |                |
| D          | Shelves              | 3.7 M/I (A/M)   | L N/A             | Y           |            |            |                |                |
|            | Supports             | 0.2 M/I (A/M)   | L N/A             | Y           |            |            |                |                |
|            |                      |                 | M/I A/M L N/A     | Y           |            |            |                |                |
|            |                      |                 | M/I A/M L N/A     | Y           |            |            |                |                |
|            |                      |                 | M/I A/M L N/A     | Y           |            |            |                |                |
|            |                      |                 | M/I A/M L N/A     | Y           |            |            |                |                |
|            |                      |                 | M/I A/M L N/A     | Y           |            |            |                |                |
|            |                      |                 | M/I A/M L N/A     | Y           |            |            |                |                |
|            |                      |                 | M/I A/M L N/A     | Y           |            |            |                |                |
|            |                      |                 | M/I A/M L N/A     | Y           |            |            |                |                |

COMMENTS / STRUCTURAL DEFECTS:

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |

(b) (6)

09-20-2012

Page 14 of 27

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 920 Main St.

Apt #: 55555

City: Vineyard Haven, MA 02568

HALLWAY #1

| SIDE    | LOCATION/SURFACE | LEAD | TYPE OF HAZARD | URG HAZ? | IC DATE | IC METH | DELEAD DATE | DELEAD METH |
|---------|------------------|------|----------------|----------|---------|---------|-------------|-------------|
| A B C D | Up Walls (1)     | 0.24 | AM L N/A       | Y        |         |         |             |             |
| A B C D | Low Walls        |      | AM L N/A       | Y        |         |         |             |             |
| A B C D | Baseboards       | 2.3  | AM L N/A       | Y        |         |         |             |             |
| A B C D | Chair Rail       |      | AM L N/A       | Y        |         |         |             |             |
| A B C D | Radiator         |      | AM L N/A       | Y        |         |         |             |             |
|         | Floor            | 0.0  | AM L N/A       | Y        |         |         |             |             |
|         | Ceiling          | 0.0  | AM L N/A       | Y        |         |         |             |             |
| A B     | Door             |      | AM L N/A       | Y        |         |         |             |             |
| C D     | Door Casing      | 0.7  | AM L N/A       | Y        |         |         |             |             |
| 1 2     | Door Jamb        | 0.9  | AM L N/A       | Y        |         |         |             |             |
| 3 4     | Threshold        | 0.0  | AM L N/A       | Y        |         |         |             |             |
| A B     | Door             | 0.0  | AM L N/A       | Y        |         |         |             |             |
| C D     | Door Casing      | 0.0  | AM L N/A       | Y        |         |         |             |             |
| 1 2     | Door Jamb        | 1.2  | AM L N/A       | Y        |         |         |             |             |
| 3 4     | Threshold        | 0.5  | AM L N/A       | Y        |         |         |             |             |
| A B     | Door             | 0.0  | AM L N/A       | Y        |         |         |             |             |
| C D     | Door Casing      | 0.0  | AM L N/A       | Y        |         |         |             |             |
| 1 2     | Door Jamb        | 0.0  | AM L N/A       | Y        |         |         |             |             |
| 3 4     | Threshold        | 0.0  | AM L N/A       | Y        |         |         |             |             |
| A B     | Door             |      | AM L N/A       | Y        |         |         |             |             |
| C D     | Door Casing      |      | AM L N/A       | Y        |         |         |             |             |
| 1 2     | Door Jamb        |      | AM L N/A       | Y        |         |         |             |             |
| 3 4     | Threshold        |      | AM L N/A       | Y        |         |         |             |             |
| A       | Closet Door      |      | AM L N/A       | Y        |         |         |             |             |
| B       | Ci Casing        |      | AM L N/A       | Y        |         |         |             |             |
| C       | Closet Jamb      |      | AM L N/A       | Y        |         |         |             |             |
| D       | Closet Walls     |      | AM L N/A       | Y        |         |         |             |             |
|         | Ci Baseboard     |      | AM L N/A       | Y        |         |         |             |             |
| 1       | Closet Pole      |      | AM L N/A       | Y        |         |         |             |             |
| 2       | Closet Shelf     |      | AM L N/A       | Y        |         |         |             |             |
| 3       | Ci Supports      |      | AM L N/A       | Y        |         |         |             |             |
| 4       | Closet Floor     |      | AM L N/A       | Y        |         |         |             |             |
|         | Closet Ceiling   |      | AM L N/A       | Y        |         |         |             |             |
| A       | Window Sill      |      | AM L N/A       | Y        |         |         |             |             |
| B       | Win Apron        |      | AM L N/A       | Y        |         |         |             |             |
| C       | Win Casing       |      | AM L N/A       | Y        |         |         |             |             |
| D       | Header Stop      |      | MM L N/A       | Y        |         |         |             |             |
|         | Int Stops        |      | MM L N/A       | Y        |         |         |             |             |
| 1       | Win Int Sash     |      | MM L N/A       | Y        |         |         |             |             |
| 2       | Exterior Sill    |      | MM SF L N/A    | Y        |         |         |             |             |
| 3       | Part Bead        |      | MM L N/A       | Y        |         |         |             |             |
| 4       | Blind Stop       |      | MM SF L N/A    | Y        |         |         |             |             |
|         | Win Ext Sash     |      | MM L N/A       | Y        |         |         |             |             |
| A       | Window Sill      |      | MM L N/A       | Y        |         |         |             |             |
| B       | Win Apron        |      | AM L N/A       | Y        |         |         |             |             |
| C       | Win Casing       |      | AM L N/A       | Y        |         |         |             |             |
| D       | Header Stop      |      | MM L N/A       | Y        |         |         |             |             |
|         | Int Stops        |      | MM L N/A       | Y        |         |         |             |             |
| 1       | Win Int Sash     |      | MM L N/A       | Y        |         |         |             |             |
| 2       | Exterior Sill    |      | MM SF L N/A    | Y        |         |         |             |             |
| 3       | Part Bead        |      | MM L N/A       | Y        |         |         |             |             |
| 4       | Blind Stop       |      | MM SF L N/A    | Y        |         |         |             |             |
|         | Win Ext Sash     |      | MM L N/A       | Y        |         |         |             |             |
| A B C D | Pipe Chase       | 0.0  | MM L N/A       | Y        |         |         |             |             |
| A B C D | Ceiling Molding  |      | MM L N/A       | Y        |         |         |             |             |
| D       | Supports         | 0.0  | MM L N/A       | Y        |         |         |             |             |

COMMENTS / STRUCTURAL DEFECTS:

C1 plaster beneath sheet rock is 2.2

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.) | IC DATE | IC METHOD |
|------|----------|----------------------------------------------|---------|-----------|
|      |          |                                              |         |           |
|      |          |                                              |         |           |

| SIDE | LOCATION | MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.) | IC DATE | IC METHOD |
|------|----------|----------------------------------------------|---------|-----------|
|      |          |                                              |         |           |
|      |          |                                              |         |           |



(b) (6)

09-20-2012

Page 15 of 27

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 920 Main St.

Apt #: AAAAA

City: Vineyard Haven, MA 02568

HALLWAY # 2

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH | SIDE                           | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|--------------------------------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A B  | Up Walls             | 17.2 | (AM) L N/A        | Y           |            |            |                |                | A                              | Closet Door          | 3.0  | AM L N/A          | Y           |            |            |                |                |
| A B  | Low Walls            | /    | AM L N/A          | Y           |            |            |                |                | B                              | Ci Casing            | 3.5  | (AM) L N/A        | Y           |            |            |                |                |
| A B  | Baseboards           | 13.1 | (AM) L N/A        | Y           |            |            |                |                | C                              | Closet Jamb          | 0.6  | L N/A             | Y           |            |            |                |                |
| A B  | Chair Rail           | /    | AM L N/A          | Y           |            |            |                |                | D                              | Closet Walls         | 19.6 | AM L N/A          | Y           |            |            |                |                |
| A B  | Radiator             | /    | AM L N/A          | Y           |            |            |                |                |                                | Ci Baseboard         | 12.1 | AM L N/A          | Y           |            |            |                |                |
|      | Floor                | 0.05 | AM L N/A          | Y           |            |            |                |                | 1                              | Closet Pole          | 0.00 | AM L N/A          | Y           |            |            |                |                |
|      | Ceiling              | 0.5  | AM L N/A          | Y           |            |            |                |                | 2                              | Closet Shelf         | 0.31 | AM L N/A          | Y           |            |            |                |                |
| A B  | Door 2.              | 0.01 | AM L N/A          | Y           |            |            |                |                | 3                              | Ci Supports          | 14.9 | (AM) L N/A        | Y           |            |            |                |                |
| C D  | Door Casing          | 3.7  | (AM) L N/A        | Y           |            |            |                |                | 4                              | Closet Floor         | 0.01 | AM L N/A          | Y           |            |            |                |                |
| 12   | Door Jamb            | 1.2  | (AM) L N/A        | Y           |            |            |                |                |                                | Closet Ceiling       | 10.1 | AM L N/A          | Y           |            |            |                |                |
| 34   | Threshold            | /    | AM L N/A          | Y           |            |            |                |                | A                              | Window Sill          | /    | MM AM L N/A       | Y           |            |            |                |                |
| A B  | Door                 | 0.00 | AM L N/A          | Y           |            |            |                |                | B                              | Win Apron            | /    | AM L N/A          | Y           |            |            |                |                |
| C D  | Door Casing          | 3.7  | (AM) L N/A        | Y           |            |            |                |                | C                              | Win Casing           | /    | AM L N/A          | Y           |            |            |                |                |
| 12   | Door Jamb            | 0.3  | AM L N/A          | Y           |            |            |                |                | D                              | Header Stop          | /    | MM AM L N/A       | Y           |            |            |                |                |
| 34   | Threshold            | /    | AM L N/A          | Y           |            |            |                |                |                                | Int Stops            | /    | MM AM L N/A       | Y           |            |            |                |                |
| A B  | Door                 | 1.6  | (AM) L N/A        | Y           |            |            |                |                | 1                              | Win Int Sash         | /    | MM AM L N/A       | Y           |            |            |                |                |
| C D  | Door Casing          | 3.0  | (AM) L N/A        | Y           |            |            |                |                | 2                              | Exterior Sill        | /    | MM SF L N/A       | Y           |            |            |                |                |
| 12   | Door Jamb            | 1.7  | AM L N/A          | Y           |            |            |                |                | 3                              | Part Bead            | /    | MM L N/A          | Y           |            |            |                |                |
| 34   | Threshold            | /    | AM L N/A          | Y           |            |            |                |                | 4                              | Blind Stop           | /    | MM SF L N/A       | Y           |            |            |                |                |
| A B  | Door                 | /    | AM L N/A          | Y           |            |            |                |                |                                | Win Ext Sash         | /    | MM L N/A          | Y           |            |            |                |                |
| C D  | Door Casing          | /    | AM L N/A          | Y           |            |            |                |                | A                              | Window Sill          | /    | MM AM L N/A       | Y           |            |            |                |                |
| 12   | Door Jamb            | /    | AM L N/A          | Y           |            |            |                |                | B                              | Win Apron            | /    | AM L N/A          | Y           |            |            |                |                |
| 34   | Threshold            | /    | AM L N/A          | Y           |            |            |                |                | C                              | Win Casing           | /    | AM L N/A          | Y           |            |            |                |                |
| A B  | Door                 | /    | AM L N/A          | Y           |            |            |                |                | D                              | Header Stop          | /    | MM AM L N/A       | Y           |            |            |                |                |
| C D  | Door Casing          | /    | AM L N/A          | Y           |            |            |                |                |                                | Int Stops            | /    | MM AM L N/A       | Y           |            |            |                |                |
| #    | Door Jamb            | /    | AM L N/A          | Y           |            |            |                |                | 1                              | Win Int Sash         | /    | MM AM L N/A       | Y           |            |            |                |                |
|      | Threshold            | /    | AM L N/A          | Y           |            |            |                |                | 2                              | Exterior Sill        | /    | MM SF L N/A       | Y           |            |            |                |                |
| A    | Closet Door          | 2.4  | (AM) L N/A        | Y           |            |            |                |                | 3                              | Part Bead            | /    | MM L N/A          | Y           |            |            |                |                |
| B    | Ci Casing            | /    | AM L N/A          | Y           |            |            |                |                | 4                              | Blind Stop           | /    | MM SF L N/A       | Y           |            |            |                |                |
| C    | Closet Jamb          | 1.8  | (AM) L N/A        | Y           |            |            |                |                |                                | Win Ext Sash         | /    | MM L N/A          | Y           |            |            |                |                |
| D    | Closet Walls         | 11.9 | AM L N/A          | Y           |            |            |                |                | A B                            | Win Above 5'         | /    | MM AM L N/A       | Y           |            |            |                |                |
|      | Ci Baseboard         | 13.0 | AM L N/A          | Y           |            |            |                |                | A B                            | Ceiling Molding      | /    | MM AM L N/A       | Y           |            |            |                |                |
| 1    | Closet Pole          | /    | AM L N/A          | Y           |            |            |                |                |                                |                      | /    | MM AM L N/A       | Y           |            |            |                |                |
| 2    | Closet Shelf         | 0.09 | AM L N/A          | Y           |            |            |                |                | COMMENTS / STRUCTURAL DEFECTS: |                      |      |                   |             |            |            |                |                |
| 3    | Ci Supports          | 3.9  | (AM) L N/A        | Y           |            |            |                |                |                                |                      |      |                   |             |            |            |                |                |
| 4    | Closet Floor         | 0.01 | AM L N/A          | Y           |            |            |                |                |                                |                      |      |                   |             |            |            |                |                |
|      | Closet Ceiling       | 1.3  | AM L N/A          | Y           |            |            |                |                |                                |                      |      |                   |             |            |            |                |                |

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD | SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |      |          |                                                 |            |              |
|      |          |                                                 |            |              |      |          |                                                 |            |              |

(b) (6)

09-20-2012

Page 16 of 27

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 920 Main St.

Apt #: AAAAAA

City: Vineyard Haven, MA 02568

HALLWAY #1

| SIDE       | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A B<br>C D | Up Walls             | 15.6 | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Low Walls            |      | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Baseboards           | 12.6 | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Chair Rail           |      | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Radiator             |      | AM L N/A          | Y           |            |            |                |                |
|            | Floor                | 0.00 | AM L N/A          | Y           |            |            |                |                |
|            | Ceiling              | 0.01 | AM L N/A          | Y           |            |            |                |                |
| A B        | Door                 | 0.01 | AM L N/A          | Y           |            |            |                |                |
| C D        | Door Casing          | 4.2  | AM L N/A          | Y           |            |            |                |                |
| 1 2        | Door Jamb            | 0.01 | AM L N/A          | Y           |            |            |                |                |
| 3 4        | Threshold            |      | AM L N/A          | Y           |            |            |                |                |
| A B        | Door                 | 0.00 | AM L N/A          | Y           |            |            |                |                |
| C D        | Door Casing          | 0.8  | AM L N/A          | Y           |            |            |                |                |
| 1 2        | Door Jamb            | 3.4  | AM L N/A          | Y           |            |            |                |                |
| 3 4        | Threshold            | 0.20 | AM L N/A          | Y           |            |            |                |                |
| A B        | Door                 | 0.00 | AM L N/A          | Y           |            |            |                |                |
| C D        | Door Casing          | 3.6  | AM L N/A          | Y           |            |            |                |                |
| 1 2        | Door Jamb            | 0.24 | AM L N/A          | Y           |            |            |                |                |
| 3 4        | Threshold            |      | AM L N/A          | Y           |            |            |                |                |
| A B        | Door                 |      | AM L N/A          | Y           |            |            |                |                |
| C D        | Door Casing          |      | AM L N/A          | Y           |            |            |                |                |
| 1 2        | Door Jamb            |      | AM L N/A          | Y           |            |            |                |                |
| 3 4        | Threshold            |      | AM L N/A          | Y           |            |            |                |                |
| A          | Closet Door          |      | AM L N/A          | Y           |            |            |                |                |
| B          | Cl Casing            |      | AM L N/A          | Y           |            |            |                |                |
| C          | Closet Jamb          |      | AM L N/A          | Y           |            |            |                |                |
| D          | Closet Walls         |      | AM L N/A          | Y           |            |            |                |                |
|            | Cl Baseboard         |      | AM L N/A          | Y           |            |            |                |                |
| 1          | Closet Pole          |      | AM L N/A          | Y           |            |            |                |                |
| 2          | Closet Shelf         |      | AM L N/A          | Y           |            |            |                |                |
| 3          | Cl Supports          |      | AM L N/A          | Y           |            |            |                |                |
| 4          | Closet Floor         |      | AM L N/A          | Y           |            |            |                |                |
|            | Closet Ceiling       |      | AM L N/A          | Y           |            |            |                |                |

| SIDE       | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A          | Closet Door          |      | AM L N/A          | Y           |            |            |                |                |
| B          | Cl Casing            |      | AM L N/A          | Y           |            |            |                |                |
| C          | Closet Jamb          |      | AM L N/A          | Y           |            |            |                |                |
| D          | Closet Walls         |      | AM L N/A          | Y           |            |            |                |                |
|            | Cl Baseboard         |      | AM L N/A          | Y           |            |            |                |                |
| 1          | Closet Pole          |      | AM L N/A          | Y           |            |            |                |                |
| 2          | Closet Shelf         |      | AM L N/A          | Y           |            |            |                |                |
| 3          | Cl Supports          |      | AM L N/A          | Y           |            |            |                |                |
| 4          | Closet Floor         |      | AM L N/A          | Y           |            |            |                |                |
|            | Closet Ceiling       |      | AM L N/A          | Y           |            |            |                |                |
| A          | Window Sill          |      | AM L N/A          | Y           |            |            |                |                |
| B          | Win Apron            |      | AM L N/A          | Y           |            |            |                |                |
| C          | Win Casing           |      | AM L N/A          | Y           |            |            |                |                |
| D          | Header Stop          |      | AM L N/A          | Y           |            |            |                |                |
|            | Int Stops            |      | AM L N/A          | Y           |            |            |                |                |
| 1          | Win Int Sash         |      | AM L N/A          | Y           |            |            |                |                |
| 2          | Exterior Sill        |      | AM SF L N/A       | Y           |            |            |                |                |
| 3          | Part Bead            |      | AM L N/A          | Y           |            |            |                |                |
| 4          | Blind Stop           |      | MR SF L N/A       | Y           |            |            |                |                |
|            | Win Ext Sash         |      | MR L N/A          | Y           |            |            |                |                |
| A          | Window Sill          |      | AM L N/A          | Y           |            |            |                |                |
| B          | Win Apron            |      | AM L N/A          | Y           |            |            |                |                |
| C          | Win Casing           |      | AM L N/A          | Y           |            |            |                |                |
| D          | Header Stop          |      | MR L N/A          | Y           |            |            |                |                |
|            | Int Stops            |      | MR L N/A          | Y           |            |            |                |                |
| 1          | Win Int Sash         |      | MR L N/A          | Y           |            |            |                |                |
| 2          | Exterior Sill        |      | MR SF L N/A       | Y           |            |            |                |                |
| 3          | Part Bead            |      | MR L N/A          | Y           |            |            |                |                |
| 4          | Blind Stop           |      | MR SF L N/A       | Y           |            |            |                |                |
|            | Win Ext Sash         |      | MR L N/A          | Y           |            |            |                |                |
| A B<br>C D | Win Above 5'         |      | MR AM L N/A       | Y           |            |            |                |                |
| A B<br>C D | Ceiling Molding      |      | MR AM L N/A       | Y           |            |            |                |                |
| A          | HEADER               | 4.4  | MR AM L N/A       | Y           |            |            |                |                |

COMMENTS / STRUCTURAL DEFECTS:

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |



(b) (6)

09-20-2012

Page 17 of 27

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 920 Main St.

Apt #: AAAAAA

City: Vineyard Haven, MA 02568

STAIRCASE 1ST TO 2ND

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A B  | Up Walls             | 1.2  | AM L N/A          | Y           |            |            |                |                |
| A B  | Low Walls            |      | AM L N/A          | Y           |            |            |                |                |
| A B  | Baseboards           | 1.1  | AM L N/A          | Y           |            |            |                |                |
| A B  | Chair Rail           |      | AM L N/A          | Y           |            |            |                |                |
| A B  | Radiator             | 2.2  | AM L N/A          | Y           |            |            |                |                |
|      | Floor                | 0.00 | AM L N/A          | Y           |            |            |                |                |
|      | Ceiling              | 0.05 | AM L N/A          | Y           |            |            |                |                |
| A B  | Door 1st             | 0.2  | AM L N/A          | Y           |            |            |                |                |
| C D  | Door Casing          | 2.1  | AM L N/A          | Y           |            |            |                |                |
| 12   | Door Jamb            | 1.1  | AM L N/A          | Y           |            |            |                |                |
| 34   | Threshold            | 0.14 | AM L N/A          | Y           |            |            |                |                |
| A B  | Door 1st             |      | AM L N/A          | Y           |            |            |                |                |
| C D  | Door Casing          | 3.2  | AM L N/A          | Y           |            |            |                |                |
| 12   | Door Jamb            | 1.7  | AM L N/A          | Y           |            |            |                |                |
| 34   | Threshold            | 0.00 | AM L N/A          | Y           |            |            |                |                |
| A B  | Door 1st             | 0.00 | AM L N/A          | Y           |            |            |                |                |
| C D  | Door Casing          | 2.3  | AM L N/A          | Y           |            |            |                |                |
| 12   | Door Jamb            | 1.3  | AM L N/A          | Y           |            |            |                |                |
| 34   | Threshold            | 0.01 | AM L N/A          | Y           |            |            |                |                |
| A B  | Door                 |      | AM L N/A          | Y           |            |            |                |                |
| C D  | Door Casing          |      | AM L N/A          | Y           |            |            |                |                |
| #    | Door Jamb            |      | AM L N/A          | Y           |            |            |                |                |
|      | Threshold            |      | AM L N/A          | Y           |            |            |                |                |
| A    | Closet Door          |      | AM L N/A          | Y           |            |            |                |                |
| B    | Closet Casing        |      | AM L N/A          | Y           |            |            |                |                |
| C    | Closet Jamb          |      | AM L N/A          | Y           |            |            |                |                |
| D    | Closet Walls         |      | AM L N/A          | Y           |            |            |                |                |
|      | Closet Baseboard     |      | AM L N/A          | Y           |            |            |                |                |
| 1    | Closet Pole          |      | AM L N/A          | Y           |            |            |                |                |
| 2    | Closet Shelf         |      | AM L N/A          | Y           |            |            |                |                |
| 3    | Closet Supports      |      | AM L N/A          | Y           |            |            |                |                |
| 4    | Closet Floor         |      | AM L N/A          | Y           |            |            |                |                |
|      | Closet Ceiling       |      | AM L N/A          | Y           |            |            |                |                |

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A    | Window Sill          | 4.7  | AM L N/A          | Y           |            |            |                |                |
| B    | Win Apron            | 0.00 | AM L N/A          | Y           |            |            |                |                |
| C    | Win Casing           | 7.1  | AM L N/A          | Y           |            |            |                |                |
| D    | Header Stop          | 4.1  | AM L N/A          | Y           |            |            |                |                |
|      | Int Stops            | 4.3  | AM L N/A          | Y           |            |            |                |                |
| 1    | Win Int Sash         | 0.00 | AM L N/A          | Y           |            |            |                |                |
| 2    | Exterior Sill        | 1.0  | AM L N/A          | Y           |            |            |                |                |
| 3    | Part Bead            | 0.00 | AM L N/A          | Y           |            |            |                |                |
| 4    | Blind Stop           | 1.0  | AM L N/A          | Y           |            |            |                |                |
|      | Win Ext Sash         | 0.00 | AM L N/A          | Y           |            |            |                |                |
| A    | Window Sill          |      | AM L N/A          | Y           |            |            |                |                |
| B    | Win Apron            |      | AM L N/A          | Y           |            |            |                |                |
| C    | Win Casing           |      | AM L N/A          | Y           |            |            |                |                |
| D    | Header Stop          |      | AM L N/A          | Y           |            |            |                |                |
|      | Int Stops            |      | AM L N/A          | Y           |            |            |                |                |
| 1    | Win Int Sash         |      | AM L N/A          | Y           |            |            |                |                |
| 2    | Exterior Sill        |      | AM L N/A          | Y           |            |            |                |                |
| 3    | Part Bead            |      | AM L N/A          | Y           |            |            |                |                |
| 4    | Blind Stop           |      | AM L N/A          | Y           |            |            |                |                |
|      | Win Ext Sash         |      | AM L N/A          | Y           |            |            |                |                |
|      | Newel Post           | 0.16 | AM L N/A          | Y           |            |            |                |                |
|      | Railing Cap          | 0.24 | AM L N/A          | Y           |            |            |                |                |
|      | Handrail             |      | AM L N/A          | Y           |            |            |                |                |
|      | Balusters            | 0.00 | AM L N/A          | Y           |            |            |                |                |
|      | Lower rail           |      | AM L N/A          | Y           |            |            |                |                |
|      | Treads               | 0.12 | AM L N/A          | Y           |            |            |                |                |
|      | Risers               | 3.4  | AM L N/A          | Y           |            |            |                |                |
|      | Stringer             | 4.4  | AM L N/A          | Y           |            |            |                |                |
|      | Floor Edge           | 1.8  | AM L N/A          | Y           |            |            |                |                |
|      | Floor Casing         | 11.2 | AM L N/A          | Y           |            |            |                |                |
| A    | Win Apron            | 17.2 | AM L N/A          | Y           |            |            |                |                |

COMMENTS / STRUCTURAL DEFECTS:

(1) INNER LIP NEXT TO STOPS IS LEAD

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 285 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 285 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

(b) (6)

2012

Page 18 of 27

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property:

Apt #:

City:

STAIRCASE 1ST To 3rd

| SIDE    | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|---------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A B C D | Up Walls             | 0.52 | A/M L N/A         | Y           |            |            |                |                |
| A B C D | Low Walls            | 8.2  | (A/M) L N/A       | Y           |            |            |                |                |
| A B C D | Baseboards           |      | A/M L N/A         | Y           |            |            |                |                |
| A B C D | Chair Rail           |      | A/M L N/A         | Y           |            |            |                |                |
| A B C D | Radiator             |      | A/M L N/A         | Y           |            |            |                |                |
|         | Floor                | 1.2  | (A/M) L N/A       | Y           |            |            |                |                |
|         | Ceiling              | 0.5  | A/M L N/A         | Y           |            |            |                |                |
| A B     | Door 1st             | 0.51 | A/M L N/A         | Y           |            |            |                |                |
| C D     | Door Casing          | 4.2  | (A/M) L N/A       | Y           |            |            |                |                |
| 1 2     | Door Jamb            | 4.5  | (A/M) L N/A       | Y           |            |            |                |                |
| 3 4     | Threshold            | 0.05 | A/M L N/A         | Y           |            |            |                |                |
| A B     | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C D     | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2     | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4     | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A B     | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C D     | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2     | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4     | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A B     | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C D     | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| #       | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
|         | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A       | Closest Door         |      | A/M L N/A         | Y           |            |            |                |                |
| B       | Cl Casing            |      | A/M L N/A         | Y           |            |            |                |                |
| C       | Closest Jamb         |      | A/M L N/A         | Y           |            |            |                |                |
| D       | Closest Walls        |      | A/M L N/A         | Y           |            |            |                |                |
|         | Cl Baseboard         |      | A/M L N/A         | Y           |            |            |                |                |
| 1       | Closest Pole         |      | A/M L N/A         | Y           |            |            |                |                |
| 2       | Closest Shelf        |      | A/M L N/A         | Y           |            |            |                |                |
| 3       | Cl Supports          |      | A/M L N/A         | Y           |            |            |                |                |
| 4       | Closest Floor        |      | A/M L N/A         | Y           |            |            |                |                |
|         | Closest Ceiling      |      | A/M L N/A         | Y           |            |            |                |                |

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A    | Window Sill          | NC   | M/L A/M L N/A     | Y           |            |            |                |                |
| B    | Win Apron            |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Win Casing           | NC   | A/M L N/A         | Y           |            |            |                |                |
| D    | Header Stop          |      | M/L A/M L N/A     | Y           |            |            |                |                |
|      | Int Stops            |      | M/L A/M L N/A     | Y           |            |            |                |                |
| 1    | Win Int Sash         | VA   | M/L A/M L N/A     | Y           |            |            |                |                |
| 2    | Exterior Sill        | VA   | M/L SF L N/A      | Y           |            |            |                |                |
| 3    | Part Bead            | VA   | M/L L N/A         | Y           |            |            |                |                |
| 4    | Blind Stop           |      | M/L SF L N/A      | Y           |            |            |                |                |
|      | Win Ext Sash         | VA   | M/L L N/A         | Y           |            |            |                |                |
| A    | Window Sill          |      | M/L A/M L N/A     | Y           |            |            |                |                |
| B    | Win Apron            |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| D    | Header Stop          |      | M/L A/M L N/A     | Y           |            |            |                |                |
|      | Int Stops            |      | M/L A/M L N/A     | Y           |            |            |                |                |
| 1    | Win Int Sash         |      | M/L A/M L N/A     | Y           |            |            |                |                |
| 2    | Exterior Sill        |      | M/L SF L N/A      | Y           |            |            |                |                |
| 3    | Part Bead            |      | M/L L N/A         | Y           |            |            |                |                |
| 4    | Blind Stop           |      | M/L SF L N/A      | Y           |            |            |                |                |
|      | Win Ext Sash         |      | M/L L N/A         | Y           |            |            |                |                |
|      | Newel Post           | NC   | A/M L N/A         | Y           |            |            |                |                |
|      | Railing Cap          |      | A/M L N/A         | Y           |            |            |                |                |
|      | Handrail             | 0.00 | A/M L N/A         | Y           |            |            |                |                |
|      | Balusters            |      | A/M L N/A         | Y           |            |            |                |                |
|      | Lower rail           |      | A/M L N/A         | Y           |            |            |                |                |
|      | Treads               | 4.1  | (A/M) L N/A       | Y           |            |            |                |                |
|      | Risers               | 10.0 | (A/M) L N/A       | Y           |            |            |                |                |
|      | Stringer             | 2.6  | (A/M) L N/A       | Y           |            |            |                |                |
|      | Floor Edge           | 21.1 | (A/M) L N/A       | Y           |            |            |                |                |
|      | Floor Casing         | 21.1 | (A/M) L N/A       | Y           |            |            |                |                |
|      | 5485 cas             | 10.9 | M/L (A/M) L N/A   | Y           |            |            |                |                |

COMMENTS / STRUCTURAL DEFECTS:

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 289 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 289 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |



(b) (6)

09-20-2012

Page 19 of 27

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 920 Main St.

Apt #: 000000

City: Vineyard Haven, MA 02568

## BASEMENT/LAUNDRY AREA

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| AB   | Walls                | N/C  | A/M L N/A         | Y           |            |            |                |                |
| AB   | Walls (2)            | 3.6  | A/M L N/A         | Y           |            |            |                |                |
| AB   | Walls                | /    | A/M L N/A         | Y           |            |            |                |                |
| AB   | Walls                | /    | A/M L N/A         | Y           |            |            |                |                |
| AB   | Baseboards           | /    | A/M L N/A         | Y           |            |            |                |                |
| AB   | Chair rails          | /    | A/M L N/A         | Y           |            |            |                |                |
| AB   | Floor                | N/C  | A/M L N/A         | Y           |            |            |                |                |
| AB   | Ceiling              | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| AB   | Chimney              | /    | A/M L N/A         | Y           |            |            |                |                |
| AB   | Support Column       | /    | A/M L N/A         | Y           |            |            |                |                |
| AB   | Door (1)             | 1.4  | A/M L N/A         | Y           |            |            |                |                |
| CD   | Door Casing          | 10.5 | A/M L N/A         | Y           |            |            |                |                |
| 12   | Door Jamb            | N/C  | A/M L N/A         | Y           |            |            |                |                |
| 34   | Threshold            | /    | A/M L N/A         | Y           |            |            |                |                |
| AB   | Door                 | 0.01 | A/M L N/A         | Y           |            |            |                |                |
| CD   | Door Casing          | /    | A/M L N/A         | Y           |            |            |                |                |
| 12   | Door Jamb            | /    | A/M L N/A         | Y           |            |            |                |                |
| 34   | Threshold            | /    | A/M L N/A         | Y           |            |            |                |                |
| AB   | Door                 | /    | A/M L N/A         | Y           |            |            |                |                |
| CD   | Door Casing          | /    | A/M L N/A         | Y           |            |            |                |                |
| 12   | Door Jamb            | /    | A/M L N/A         | Y           |            |            |                |                |
| 34   | Threshold            | /    | A/M L N/A         | Y           |            |            |                |                |
| AB   | Cabinets             | /    | A/M L N/A         | Y           |            |            |                |                |
| AB   | Benches              | /    | A/M L N/A         | Y           |            |            |                |                |
| CD   | Supports             | /    | A/M L N/A         | Y           |            |            |                |                |
| A    | Closet Door          | 0.11 | A/M L N/A         | Y           |            |            |                |                |
| B    | Closet Casing        | /    | A/M L N/A         | Y           |            |            |                |                |
| C    | Closet Jamb          | /    | A/M L N/A         | Y           |            |            |                |                |
| 2    | Closet Walls         | 5.6  | A/M L N/A         | Y           |            |            |                |                |
| 1    | Closet Baseboard     | /    | A/M L N/A         | Y           |            |            |                |                |
| 1    | Closet Pole          | /    | A/M L N/A         | Y           |            |            |                |                |
| 2    | Closet Shelf         | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| 3    | Closet Supports      | 0.01 | A/M L N/A         | Y           |            |            |                |                |
| 4    | Closet Floor         | N/C  | A/M L N/A         | Y           |            |            |                |                |
|      | Closet Ceiling       | 0.40 | A/M L N/A         | Y           |            |            |                |                |

Comments/Structural Defects  
(1) BOTH SIDES  
(2) Around DL "CLOSET"

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |

(b) (6)

09-20-2012

Page 20 of 27

Inspector (Print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (Print)

Lic #

Signature

Date

Address of Property: 920 Main St.

Apt #: N/A

City: Vineyard Haven, MA 02568

ROOM # LAUNDRY Room

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A B  | Up Walls             | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Low Walls            |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Baseboards           | 0.01 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Chair Rail           |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Radiator             |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Floor                | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Ceiling              |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            | 0.01 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A    | Closet Door          |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Closet Casing        |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Closet Jamb          |      | A/M L N/A         | Y           |            |            |                |                |
| D    | Closet Walls         |      | A/M L N/A         | Y           |            |            |                |                |
|      | Closet Baseboard     |      | A/M L N/A         | Y           |            |            |                |                |
| 1    | Closet Pole          |      | A/M L N/A         | Y           |            |            |                |                |
| 2    | Closet Shelf         |      | A/M L N/A         | Y           |            |            |                |                |
| 3    | Closet Supports      |      | A/M L N/A         | Y           |            |            |                |                |
| 4    | Closet Floor         |      | A/M L N/A         | Y           |            |            |                |                |
|      | Closet Ceiling       |      | A/M L N/A         | Y           |            |            |                |                |

## COMMENTS / STRUCTURAL DEFECTS:

(1) INNER LIP/EDGE NEAR NEWER STOPS  
IS LEAD

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A    | Window Sill          | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| B    | Win Apron            | 0.02 | A/M L N/A         | Y           |            |            |                |                |
| C    | Win Casing           | 0.05 | A/M L N/A         | Y           |            |            |                |                |
| D    | Header Stop          | 0.01 | A/M L N/A         | Y           |            |            |                |                |
|      | Int Stops            | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| 1    | Win Int Sash         | 0.01 | A/M L N/A         | Y           |            |            |                |                |
| 2    | Exterior Sill        | 0.00 | A/M SF L N/A      | Y           |            |            |                |                |
| 3    | Part Bead            | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| 4    | Blind Stop           | 0.01 | A/M SF L N/A      | Y           |            |            |                |                |
|      | Win Ext Sash         | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A    | Window Sill          |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Win Apron            |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| D    | Header Stop          |      | A/M L N/A         | Y           |            |            |                |                |
|      | Int Stops            |      | A/M L N/A         | Y           |            |            |                |                |
| 1    | Win Int Sash         |      | A/M L N/A         | Y           |            |            |                |                |
| 2    | Exterior Sill        |      | A/M SF L N/A      | Y           |            |            |                |                |
| 3    | Part Bead            |      | A/M L N/A         | Y           |            |            |                |                |
| 4    | Blind Stop           |      | A/M SF L N/A      | Y           |            |            |                |                |
|      | Win Ext Sash         |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Fireplace            |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Mantle               |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Win Above 5'         |      | A/M L N/A         | Y           |            |            |                |                |
|      | Ceiling Molding      |      | A/M L N/A         | Y           |            |            |                |                |
| A    | Shelves              | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A    | Supports             | 0.01 | A/M L N/A         | Y           |            |            |                |                |
|      |                      |      | A/M L N/A         | Y           |            |            |                |                |

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |



Page 21 of 27

Date \_\_\_\_\_

Dale

Dale

City: Vineyard Haven, MA 02568

[illegible]

COMMENTS / STRUCTURAL DEFECTS:

**EXCLUDED SURFACES:** Surfaces listed in these boxes can be made intact only by a licensed dealer.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

Date \_\_\_\_\_

City: Vineyard Haven, MA 02568

PORCH A (B) C D (circle one) (sl N) 2nd fl 3rd fl 4th fl (circle one)

| SIDE  | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|-------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A B   | Siding               | 2-1  | L N/A             | Y           |            |            |                |                |
| C D   | Corner Boards        | 1.5  | (L) N/A           | Y           |            |            |                |                |
|       | Upper Trim           | N/A  | L N/A             | Y           |            |            |                |                |
|       | Ceiling              | N/A  | L N/A             | Y           |            |            |                |                |
|       | Joists               | N/A  | L N/A             | Y           |            |            |                |                |
| A     | Door                 | 2.1  | (A/N) L N/A       | Y           |            |            |                |                |
| (B)   | Storm Door           | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| C     | Door Casing          | 3.16 | (A/N) L N/A       | Y           |            |            |                |                |
| D     | Door Jamb            | 0.51 | A/M L N/A         | Y           |            |            |                |                |
| 12    | Threshold            | 1.4  | (A/N) L N/A       | Y           |            |            |                |                |
| 34    | Kickplate            | 31.2 | A/M L N/A         | Y           |            |            |                |                |
| A     | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| B     | Storm Door           |      | A/M L N/A         | Y           |            |            |                |                |
| C     | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| D     | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
| 12    | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| 34    | Kickplate            |      | A/M L N/A         | Y           |            |            |                |                |
| A B   | Window Sill          |      | A/M L N/A         | Y           |            |            |                |                |
| D     | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| 12    | Window Sash          |      | A/M L N/A         | Y           |            |            |                |                |
| 34    | Mullions             |      | A/M L N/A         | Y           |            |            |                |                |
| A B   | Window Sill          | 1.6  | (A/M) L N/A       | Y           |            |            |                |                |
| (C) D | Win Casing           | 1.4  | (A/M) L N/A       | Y           |            |            |                |                |
| 12    | Window Sash          | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| 34    | Mullions             |      | A/M L N/A         | Y           |            |            |                |                |
| A B   | Window Sill          |      | A/M L N/A         | Y           |            |            |                |                |
| C D   | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| 12    | Window Sash          |      | A/M L N/A         | Y           |            |            |                |                |
| 34    | Mullions             |      | A/M L N/A         | Y           |            |            |                |                |
| A B   | Window Sill          |      | A/M L N/A         | Y           |            |            |                |                |
| C D   | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| 12    | Window Sash          |      | A/M L N/A         | Y           |            |            |                |                |
| 34    | Mullions             |      | A/M L N/A         | Y           |            |            |                |                |

COMMENTS / STRUCTURAL DEFECTS:

[illegible]

COMMENTS / STRUCTURAL DEFECTS:

**EXCLUDED SURFACES:** Surfaces listed in these boxes can be made intact only by a licensed dealer.

| SIDE | LOCATION | MEASURE LOOSE PAINT<br>(MORE THAN 1440 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |



(b) (6)

09-20-2012

Page 23 of 27

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic#

Signature

Date

Address of Property:

920 Main St.

Apt #:

A A A A A A

City: Vineyard Haven, MA 02568

## EXTERIOR A Side

| SIDE | LOCATION/ SURFACE | LEAD | TYPE OF HAZARD | URG HAZ? | IC DATE | IC METH | DELEAD DATE | DELEAD METH |
|------|-------------------|------|----------------|----------|---------|---------|-------------|-------------|
| A    | Siding            | 0.03 | L N/A          | Y        |         |         |             |             |
| A    | Corner Boards     | 0.6  | L N/A          | Y        |         |         |             |             |
| A    | Lower Trim        | 0.03 | L N/A          | Y        |         |         |             |             |
| A    | Upper Trim        | 0.03 | L N/A          | Y        |         |         |             |             |
| A    | Win Above 5'      | NA   | L N/A          | Y        |         |         |             |             |
| A    | Porch Above 5'    |      | L N/A          | Y        |         |         |             |             |
| A    | Storm Door        |      | A/M L N/A      | Y        |         |         |             |             |
| A    | Door              |      | A/M L N/A      | Y        |         |         |             |             |
| A    | Door Casing       |      | A/M L N/A      | Y        |         |         |             |             |
| 1 2  | Door Jamb         |      | A/M L N/A      | Y        |         |         |             |             |
| 3 4  | Threshold         |      | A/M L N/A      | Y        |         |         |             |             |
|      | Kickplate         |      | A/M L N/A      | Y        |         |         |             |             |
| A    | Storm Door        |      | A/M L N/A      | Y        |         |         |             |             |
| A    | Door              |      | A/M L N/A      | Y        |         |         |             |             |
| A    | Door Casing       |      | A/M L N/A      | Y        |         |         |             |             |
| 1 2  | Door Jamb         |      | A/M L N/A      | Y        |         |         |             |             |
| 3 4  | Threshold         |      | A/M L N/A      | Y        |         |         |             |             |
|      | Kickplate         |      | A/M L N/A      | Y        |         |         |             |             |
| A    | Door              |      | A/M L N/A      | Y        |         |         |             |             |
| A    | Door Casing       |      | A/M L N/A      | Y        |         |         |             |             |
| 1 2  | Door Jamb         |      | A/M L N/A      | Y        |         |         |             |             |
| 3 4  | Threshold         |      | A/M L N/A      | Y        |         |         |             |             |
| A    | Window Sill       | 1.3  | A/M L N/A      | Y        |         |         |             |             |
| A    | Win Casing        | 1.2  | A/M L N/A      | Y        |         |         |             |             |
| A    | Window Sash       | 0.03 | A/M L N/A      | Y        |         |         |             |             |
| A    | Window Sill       |      | A/M L N/A      | Y        |         |         |             |             |
| A    | Win Casing        |      | A/M L N/A      | Y        |         |         |             |             |
| A    | Window Sash       |      | A/M L N/A      | Y        |         |         |             |             |
| A    | Window Sill       |      | A/M L N/A      | Y        |         |         |             |             |
| A    | Win Casing        |      | A/M L N/A      | Y        |         |         |             |             |
| A    | Window Sash       |      | A/M L N/A      | Y        |         |         |             |             |
| A    | Lamp Post         |      | L N/A          | Y        |         |         |             |             |

COMMENTS / STRUCTURAL DEFECTS:

| SIDE | LOCATION/ SURFACE | LEAD | TYPE OF HAZARD | URG HAZ? | IC DATE | IC METH | DELEAD DATE | DELEAD METH |
|------|-------------------|------|----------------|----------|---------|---------|-------------|-------------|
| A    | Window Sill       |      | A/M L N/A      | Y        |         |         |             |             |
| A    | Win Casing        |      | A/M L N/A      | Y        |         |         |             |             |
| A    | Window Sash       |      | A/M L N/A      | Y        |         |         |             |             |
| A    | Cellar Win Sill   | 0.03 | A/M L N/A      | Y        |         |         |             |             |
| A    | Cell Win Sash     | VR   | A/M L N/A      | Y        |         |         |             |             |
| A    | Cell Win Frame    | 0.03 | A/M L N/A      | Y        |         |         |             |             |
| A    | Screen Frame      |      | A/M L N/A      | Y        |         |         |             |             |
| A    | Cellar Win Sill   |      | A/M L N/A      | Y        |         |         |             |             |
| A    | Cell Win Sash     |      | A/M L N/A      | Y        |         |         |             |             |
| A    | Cell Win Frame    |      | A/M L N/A      | Y        |         |         |             |             |
| A    | Screen Frame      |      | A/M L N/A      | Y        |         |         |             |             |
| A    | Cellar Win Sill   |      | A/M L N/A      | Y        |         |         |             |             |
| A    | Cell Win Sash     |      | A/M L N/A      | Y        |         |         |             |             |
| A    | Cell Win Frame    |      | A/M L N/A      | Y        |         |         |             |             |
| A    | Screen Frame      |      | A/M L N/A      | Y        |         |         |             |             |
| A    | Foundation        | 0.10 | L N/A          | Y        |         |         |             |             |
| A    | Butthead          |      | A/M L N/A      | Y        |         |         |             |             |
| A    | Fences            | 0.03 | A/M L N/A      | Y        |         |         |             |             |
| A    | Shutters          |      | A/M L N/A      | Y        |         |         |             |             |
| A    | Newel post        |      | A/M L N/A      | Y        |         |         |             |             |
| A    | Railing Cap       |      | A/M L N/A      | Y        |         |         |             |             |
| A    | Handrail          |      | A/M L N/A      | Y        |         |         |             |             |
| A    | Balustrade        |      | A/M L N/A      | Y        |         |         |             |             |
| A    | Lower Rail        |      | A/M L N/A      | Y        |         |         |             |             |
| A    | Treads            |      | A/M L N/A      | Y        |         |         |             |             |
| A    | Risers            |      | A/M L N/A      | Y        |         |         |             |             |
| A    | Slinger           |      | A/M L N/A      | Y        |         |         |             |             |
| A    | Lattice           |      | A/M L N/A      | Y        |         |         |             |             |
| A    | FLAT ROOF         | 0.03 | L N/A          | Y        |         |         |             |             |
| A    | Elec Conduit      |      | L N/A          | Y        |         |         |             |             |
| A    | Oil Fill Pipe     |      | L N/A          | Y        |         |         |             |             |
| A    | Overhang Trim     |      | A/M L N/A      | Y        |         |         |             |             |

Excluded Surfaces: Surfaces listed in this box can be made intact only by a licensed deleader

| SIDE | LOCATION | MEASURE: LOOSE PAINT (MORE THAN 1440 SQ. IN.) | IC DATE | IC METH |
|------|----------|-----------------------------------------------|---------|---------|
| A    |          |                                               |         |         |
| A    |          |                                               |         |         |
| A    |          |                                               |         |         |
| A    |          |                                               |         |         |

## Soil Test Results

(Must be less than 400 ppm for play area / 1200 ppm for bare soil)

| LOCATION  | AREA MEASUREMENT ( Square Feet ) | RESULT (PPM) | REMED DATE | REMED METH |
|-----------|----------------------------------|--------------|------------|------------|
| Play Area |                                  |              |            |            |
| Bare Soil |                                  |              |            |            |
| Comments: |                                  |              |            |            |

|                      |       |           |
|----------------------|-------|-----------|
| (b) (6)              |       |           |
| Inspector (print)    | Lic # | Signature |
| (b) (6)              |       |           |
| Lic Recorser (print) | Lic # | Signature |

Date \_\_\_\_\_

Page 41 Of 44

(b) (6)

|                       |              |           |
|-----------------------|--------------|-----------|
| Risk Assessor (print) | Lic#         | Signature |
| Address of Property:  | 920 Main St. | Apt #:    |

Date  
Vineyard Haven, MA 02568

City: Vineyard Haven, MA 02568

EXTERIOR B Side

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| B    | Siding               | 404  | L N/A             | Y           |            |            |                |                |
| B    | Corner Boards        | 200  | L N/A             | Y           |            |            |                |                |
| B    | Lower Trim           | 201  | L N/A             | Y           |            |            |                |                |
| B    | Upper Trim           | N/A  | L N/A             | Y           |            |            |                |                |
| B    | Win Above 5'         | N/A  | L N/A             | Y           |            |            |                |                |
| B    | Porch Above 5'       |      | L N/A             | Y           |            |            |                |                |
| B    | Storm Door           |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
|      | Kickplate            |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Storm Door           |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
|      | Kickplate            |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Window Sill          | 0.41 | A/M L N/A         | Y           |            |            |                |                |
| B    | Win Casing           | 1.7  | A/M L N/A         | Y           |            |            |                |                |
| #1   | Window Sash          | 0.03 | A/M L N/A         | Y           |            |            |                |                |
| B    | Window Sill          | 0.02 | A/M L N/A         | Y           |            |            |                |                |
| B    | Win Casing           | 0.42 | A/M L N/A         | Y           |            |            |                |                |
| #1   | Window Sash          | 0.01 | A/M L N/A         | Y           |            |            |                |                |
| B    | Window Sill          |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| #    | Window Sash          |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Lamp Post            |      | L N/A             | Y           |            |            |                |                |

| NO. | DATE       | DESCRIPTION                    |
|-----|------------|--------------------------------|
| 1   | 10/10/2010 | COMMENTS / STRUCTURAL DEFECTS: |

**Excluded Surfaces:** Surfaces listed in this box can be made intact only by a licensed delealer

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 1440 SQ. IN.) | IC<br>DATE | IC<br>METH |
|------|----------|--------------------------------------------------|------------|------------|
| B    |          |                                                  |            |            |
| B    |          |                                                  |            |            |
| B    |          |                                                  |            |            |
| B    |          |                                                  |            |            |

| SIDE<br>B | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|-----------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| #         | Window Sill          | /    | A/M L N/A         | Y           |            |            |                |                |
|           | Win Casing           | /    | A/M L N/A         | Y           |            |            |                |                |
|           | Window Sash          | /    | A/M L N/A         | Y           |            |            |                |                |
| #         | Cellar Win Sill      | /    | A/M L N/A         | Y           |            |            |                |                |
|           | Cell Win Sash        | /    | A/M L N/A         | Y           |            |            |                |                |
|           | Cell Win Frame       | /    | A/M L N/A         | Y           |            |            |                |                |
| #         | Screen Frame         | /    | A/M L N/A         | Y           |            |            |                |                |
|           | Cellar Win Sill      | /    | A/M L N/A         | Y           |            |            |                |                |
|           | Cell Win Sash        | /    | A/M L N/A         | Y           |            |            |                |                |
| #         | Cell Win Frame       | /    | A/M L N/A         | Y           |            |            |                |                |
|           | Screen Frame         | /    | A/M L N/A         | Y           |            |            |                |                |
|           | Cellar Win Sill      | /    | A/M L N/A         | Y           |            |            |                |                |
| #         | Cell Win Sash        | /    | A/M L N/A         | Y           |            |            |                |                |
|           | Cell Win Frame       | /    | A/M L N/A         | Y           |            |            |                |                |
|           | Screen Frame         | /    | A/M L N/A         | Y           |            |            |                |                |
| #         | Cellar Win Sill      | /    | A/M L N/A         | Y           |            |            |                |                |
|           | Cell Win Sash        | /    | A/M L N/A         | Y           |            |            |                |                |
|           | Cell Win Frame       | /    | A/M L N/A         | Y           |            |            |                |                |
| #         | Screen Frame         | /    | A/M L N/A         | Y           |            |            |                |                |
|           | Foundation           | 2.03 | L N/A             | Y           |            |            |                |                |
|           | Bulkhead             | /    | A/M L N/A         | Y           |            |            |                |                |
| #         | Fences               | /    | A/M L N/A         | Y           |            |            |                |                |
|           | Shutters             | /    | A/M L N/A         | Y           |            |            |                |                |
|           | Nowel post           | /    | A/M L N/A         | Y           |            |            |                |                |
| #         | Railing Cap          | /    | A/M L N/A         | Y           |            |            |                |                |
|           | Handrail             | /    | A/M L N/A         | Y           |            |            |                |                |
|           | Balusters            | /    | A/M L N/A         | Y           |            |            |                |                |
|           | Lower Rail           | /    | A/M L N/A         | Y           |            |            |                |                |
|           | Treads               | /    | A/M L N/A         | Y           |            |            |                |                |
|           | Risers               | /    | A/M L N/A         | Y           |            |            |                |                |
|           | Stringer             | /    | A/M L N/A         | Y           |            |            |                |                |
|           | Lattice              | /    | A/M L N/A         | Y           |            |            |                |                |
| #         |                      | /    | L N/A             | Y           |            |            |                |                |
|           | Elec Conduit         | /    | L N/A             | Y           |            |            |                |                |
|           | Oil Fill Pipe        | /    | L N/A             | Y           |            |            |                |                |
|           | Overhang Trim        | /    | A/M L N/A         | Y           |            |            |                |                |

### Soil Test Results

(Must be less than 400 ppm for play area / 1200 ppm for bare soil)

| LOCATION  | AREA MEASUREMENT<br>( Square Feet ) | RESULT<br>(PPM) | REMED<br>DATE | REMED<br>METH |
|-----------|-------------------------------------|-----------------|---------------|---------------|
| Play Area |                                     |                 |               |               |
| Bara Soil |                                     |                 |               |               |
| Comments: |                                     |                 |               |               |



(b) (6)

09-20-2012

Page 25 Of 27

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 920 Main St.

Apt #: AAAAAA

City: Vineyard Haven, MA 02568

## EXTERIOR C Side

| SIDE                           | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|--------------------------------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| C                              | Siding               | 0.00 | L N/A             | Y           |            |            |                |                |
| C                              | Corner Boards        |      | L N/A             | Y           |            |            |                |                |
| C                              | Lower Trim           | 0.01 | L N/A             | Y           |            |            |                |                |
| C                              | Upper Trim           | 0.02 | L N/A             | Y           |            |            |                |                |
| C                              | Win Above 5'         | 0.03 | L N/A             | Y           |            |            |                |                |
| C                              | Porch Above 5'       |      | L N/A             | Y           |            |            |                |                |
| C                              | Storm Door           |      | A/M L N/A         | Y           |            |            |                |                |
| C                              | Door                 | 0.1  | A/M L N/A         | Y           |            |            |                |                |
| C                              | Door Casing          | 0.4  | A/M L N/A         | Y           |            |            |                |                |
| 1 2                            | Door Jamb            | 0.5  | A/M L N/A         | Y           |            |            |                |                |
| 3 4                            | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| C                              | Kickplate            |      | A/M L N/A         | Y           |            |            |                |                |
| C                              | Storm Door           |      | A/M L N/A         | Y           |            |            |                |                |
| C                              | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C                              | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2                            | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4                            | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| C                              | Kickplate            |      | A/M L N/A         | Y           |            |            |                |                |
| C                              | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C                              | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2                            | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4                            | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| C                              | Window Sill          |      | A/M L N/A         | Y           |            |            |                |                |
| C                              | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| #                              | Window Sash          |      | A/M L N/A         | Y           |            |            |                |                |
| C                              | Window Sill          |      | A/M L N/A         | Y           |            |            |                |                |
| C                              | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| #                              | Window Sash          |      | A/M L N/A         | Y           |            |            |                |                |
| C                              | Window Sill          |      | A/M L N/A         | Y           |            |            |                |                |
| C                              | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| #                              | Window Sash          |      | A/M L N/A         | Y           |            |            |                |                |
| C                              | Lamp Post            |      | L N/A             | Y           |            |            |                |                |
| COMMENTS / STRUCTURAL DEFECTS: |                      |      |                   |             |            |            |                |                |

Excluded Surfaces: Surfaces listed in this box can be made  
Intact only by a licensed deleader

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 1440 SQ. IN.) | IC<br>DATE | IC<br>METH |
|------|----------|--------------------------------------------------|------------|------------|
| C    |          |                                                  |            |            |
| C    |          |                                                  |            |            |
| C    |          |                                                  |            |            |
| C    |          |                                                  |            |            |

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| C    | Window Sill          |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| #    | Window Sash          |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Ceiling Win Sill     |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Ceiling Win Sash     |      | A/M L N/A         | Y           |            |            |                |                |
| #    | Ceiling Win Frame    |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Screen Frame         |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Ceiling Win Sill     |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Ceiling Win Sash     |      | A/M L N/A         | Y           |            |            |                |                |
| #    | Ceiling Win Frame    |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Screen Frame         |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Ceiling Win Sill     |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Ceiling Win Sash     |      | A/M L N/A         | Y           |            |            |                |                |
| #    | Ceiling Win Frame    |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Screen Frame         |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Foundation           | 0.00 | L N/A             | Y           |            |            |                |                |
| C    | Bulkhead             |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Fences               |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Shutters             |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Newel post           |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Railing Cap          |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Handrail             |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Balusters            |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Lower Rail           |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Treads               |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Risers               |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Stringer             |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Lattice              |      | A/M L N/A         | Y           |            |            |                |                |
| C    |                      |      | L N/A             | Y           |            |            |                |                |
| C    | Elec Conduit         |      | L N/A             | Y           |            |            |                |                |
| C    | Oil Fill Pipe        |      | L N/A             | Y           |            |            |                |                |
| C    | Overhang Trim        |      | A/M L N/A         | Y           |            |            |                |                |

## Soil Test Results

(Must be less than 400 ppm for play area / 1200 ppm for bare soil)

| LOCATION  | AREA MEASUREMENT<br>(Square Feet) | RESULT<br>(PPM) | REMED<br>DATE | REMED<br>METH |
|-----------|-----------------------------------|-----------------|---------------|---------------|
| Play Area |                                   |                 |               |               |
| Bare Soil |                                   |                 |               |               |
| Comments: |                                   |                 |               |               |

(b) (6)

09-20-2012

Page 26 of 27

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 920 Main St.

Apt #: AAAAAA

City: Vineyard Haven, MA 02568

EXTERIOR D Side

| SIDE | LOCATION/SURFACE | LEAD | TYPE OF HAZARD | URG HAZ? | IC DATE | IC METH | DELEAD DATE | DELEAD METH |
|------|------------------|------|----------------|----------|---------|---------|-------------|-------------|
| D    | Siding           | 0.00 | L N/A          | Y        |         |         |             |             |
|      | Corner Boards    | 0.00 | L N/A          | Y        |         |         |             |             |
|      | Lower Trim       | 0.00 | L N/A          | Y        |         |         |             |             |
|      | Upper Trim       | 0.00 | L N/A          | Y        |         |         |             |             |
|      | Win Above 5'     | 0.00 | L N/A          | Y        |         |         |             |             |
|      | Porch Above 5'   | 0.00 | L N/A          | Y        |         |         |             |             |
| D    | Storm Door       | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Door             | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Door Casing      | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Door Jamb        | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Threshold        | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Kickplate        | /    | A/M L N/A      | Y        |         |         |             |             |
| D    | Storm Door       | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Door             | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Door Casing      | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Door Jamb        | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Threshold        | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Kickplate        | /    | A/M L N/A      | Y        |         |         |             |             |
| D    | Door             | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Door Casing      | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Door Jamb        | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Threshold        | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Window Sill      | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Win Casing       | /    | A/M L N/A      | Y        |         |         |             |             |
| D    | Window Sash      | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Window Sill      | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Win Casing       | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Window Sash      | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Window Sill      | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Win Casing       | /    | A/M L N/A      | Y        |         |         |             |             |
| D    | Window Sash      | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Lamp Post        | /    | L N/A          | Y        |         |         |             |             |

COMMENTS / STRUCTURAL DEFECTS:

| SIDE | LOCATION/SURFACE | LEAD | TYPE OF HAZARD | URG HAZ? | IC DATE | IC METH | DELEAD DATE | DELEAD METH |
|------|------------------|------|----------------|----------|---------|---------|-------------|-------------|
| D    | Window Sill      | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Win Casing       | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Window Sash      | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Cellar Win Sill  | 0.00 | A/M L N/A      | Y        |         |         |             |             |
|      | Cell Win Sash    | 0.00 | A/M L N/A      | Y        |         |         |             |             |
|      | Cell Win Frame   | 0.00 | A/M L N/A      | Y        |         |         |             |             |
| D    | Screen Frame     | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Cellar Win Sill  | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Cell Win Sash    | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Cell Win Frame   | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Screen Frame     | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Cellar Win Sill  | /    | A/M L N/A      | Y        |         |         |             |             |
| D    | Cell Win Sash    | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Cell Win Frame   | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Screen Frame     | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Cellar Win Sill  | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Cell Win Sash    | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Cell Win Frame   | /    | A/M L N/A      | Y        |         |         |             |             |
| D    | Screen Frame     | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Foundation       | 0.00 | L N/A          | Y        |         |         |             |             |
|      | Bulkhead         | 0.00 | A/M L N/A      | Y        |         |         |             |             |
|      | Fences           | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Shutters         | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Newel post       | /    | A/M L N/A      | Y        |         |         |             |             |
| D    | Railing Cap      | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Handrail         | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Balusters        | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Lower Rail       | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Treads           | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Risers           | /    | A/M L N/A      | Y        |         |         |             |             |
| D    | Stringer         | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Lattice          | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Elec Conduit     | /    | L N/A          | Y        |         |         |             |             |
|      | Oil Fill Pipe    | 0.00 | L N/A          | Y        |         |         |             |             |
|      | Overhang Trim    | /    | A/M L N/A      | Y        |         |         |             |             |

Excluded Surfaces: Surfaces listed in this box can be made  
intact only by a licensed deleader

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 1440 SQ. IN.) | IC DATE | IC METH |
|------|----------|--------------------------------------------------|---------|---------|
| D    |          |                                                  |         |         |
| D    |          |                                                  |         |         |
| D    |          |                                                  |         |         |
| D    |          |                                                  |         |         |

Soil Test Results

(Must be less than 400 ppm for play area / 1200 ppm for bare soil)

| LOCATION  | AREA MEASUREMENT<br>(Square Feet) | RESULT<br>(PPM) | REMED<br>DATE | REMED<br>METH |
|-----------|-----------------------------------|-----------------|---------------|---------------|
| Play Area |                                   |                 |               |               |
| Bare Soil |                                   |                 |               |               |
| Comments: |                                   |                 |               |               |



(b) (6)

09-20-2012

Page 27 of 27

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 930 Main St

Apt #: AAAAAA

City: Vineyard Haven, MA 02568

GARAGE/ SHEO OTHER

| SIDE | LOCATION/ SURFACE | LEAD | TYPE OF HAZARD | URG HAZ? | IC DATE | IC METH | DELEAD DATE | DELEAD METH |
|------|-------------------|------|----------------|----------|---------|---------|-------------|-------------|
| A    | Siding            | 0.5  | L N/A          | Y        |         |         |             |             |
| A    | Corner Board      | 0.00 | L N/A          | Y        |         |         |             |             |
|      | Lower Trim        | /    | L N/A          | Y        |         |         |             |             |
|      | Upper Trim        | N/A  | L N/A          | Y        |         |         |             |             |
| A    | Door              | 0.00 | A/M L N/A      | Y        |         |         |             |             |
|      | Door Casing       | 0.00 | A/M L N/A      | Y        |         |         |             |             |
|      | Door Jamb         | 1.2  | A/M L N/A      | Y        |         |         |             |             |
|      | Threshold         | N/A  | A/M L N/A      | Y        |         |         |             |             |
| A    | Window Sill       | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Win Casing        | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Win Sash          | /    | A/M L N/A      | Y        |         |         |             |             |
| A    | Foundation        | /    | L N/A          | Y        |         |         |             |             |

COMMENTS / STRUCTURAL DEFECTS:

| SIDE | LOCATION/ SURFACE | LEAD | TYPE OF HAZARD | URG HAZ? | IC DATE | IC METH | DELEAD DATE | DELEAD METH |
|------|-------------------|------|----------------|----------|---------|---------|-------------|-------------|
| C    | Siding            | 2.1  | L N/A          | Y        |         |         |             |             |
| C    | Corner Boards     | 0.00 | L N/A          | Y        |         |         |             |             |
|      | Lower Trim        | /    | L N/A          | Y        |         |         |             |             |
|      | Upper Trim        | N/A  | L N/A          | Y        |         |         |             |             |
| C    | Door              | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Door Casing       | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Door Jamb         | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Threshold         | /    | A/M L N/A      | Y        |         |         |             |             |
| C    | Window Sill       | 0.10 | A/M L N/A      | Y        |         |         |             |             |
|      | Win Casing        | 0.00 | A/M L N/A      | Y        |         |         |             |             |
|      | Win Sash          | 0.04 | A/M L N/A      | Y        |         |         |             |             |
| C    | Foundation        | 1.3  | L N/A          | Y        |         |         |             |             |

COMMENTS / STRUCTURAL DEFECTS:

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT (MORE THAN 1440 SQ. IN.) | IC DATE | IC METHOD |
|------|----------|-----------------------------------------------|---------|-----------|
| A    |          |                                               |         |           |
| A    |          |                                               |         |           |
| A    |          |                                               |         |           |
| A    |          |                                               |         |           |

| SIDE | LOCATION | MEASURE: LOOSE PAINT (MORE THAN 1440 SQ. IN.) | IC DATE | IC METHOD |
|------|----------|-----------------------------------------------|---------|-----------|
| C    |          |                                               |         |           |
| C    |          |                                               |         |           |
| C    |          |                                               |         |           |
| C    |          |                                               |         |           |

| SIDE | LOCATION/ SURFACE | LEAD | TYPE OF HAZARD | URG HAZ? | IC DATE | IC METH | DELEAD DATE | DELEAD METH |
|------|-------------------|------|----------------|----------|---------|---------|-------------|-------------|
| B    | Siding            | 2.1  | L N/A          | Y        |         |         |             |             |
| B    | Corner Boards     | 0.00 | L N/A          | Y        |         |         |             |             |
|      | Lower Trim        | /    | L N/A          | Y        |         |         |             |             |
|      | Upper Trim        | N/A  | L N/A          | Y        |         |         |             |             |
| B    | Door              | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Door Casing       | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Door Jamb         | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Threshold         | /    | A/M L N/A      | Y        |         |         |             |             |
| B    | Window Sill       | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Win Casing        | /    | A/M L N/A      | Y        |         |         |             |             |
|      | Win Sash          | /    | A/M L N/A      | Y        |         |         |             |             |
| B    | Foundation        | 3.1  | L N/A          | Y        |         |         |             |             |

COMMENTS / STRUCTURAL DEFECTS:

| SIDE | LOCATION/ SURFACE | LEAD | TYPE OF HAZARD | URG HAZ? | IC DATE | IC METH | DELEAD DATE | DELEAD METH |
|------|-------------------|------|----------------|----------|---------|---------|-------------|-------------|
| D    | Siding            | 5.1  | L N/A          | Y        |         |         |             |             |
| D    | Corner Boards     | 0.00 | L N/A          | Y        |         |         |             |             |
|      | Lower Trim        | /    | L N/A          | Y        |         |         |             |             |
|      | Upper Trim        | N/A  | L N/A          | Y        |         |         |             |             |
| D    | Door              | 0.00 | A/M L N/A      | Y        |         |         |             |             |
|      | Door Casing       | 0.01 | A/M L N/A      | Y        |         |         |             |             |
|      | Door Jamb         | 0.01 | A/M L N/A      | Y        |         |         |             |             |
|      | Threshold         | 0.01 | A/M L N/A      | Y        |         |         |             |             |
| D    | Window Sill       | 0.12 | A/M L N/A      | Y        |         |         |             |             |
|      | Win Casing        | 0.10 | A/M L N/A      | Y        |         |         |             |             |
|      | Win Sash          | 0.06 | A/M L N/A      | Y        |         |         |             |             |
| D    | Foundation        | 3.2  | L N/A          | Y        |         |         |             |             |

COMMENTS / STRUCTURAL DEFECTS:

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT (MORE THAN 1440 SQ. IN.) | IC DATE | IC METHOD |
|------|----------|-----------------------------------------------|---------|-----------|
| B    |          |                                               |         |           |
| B    |          |                                               |         |           |
| B    |          |                                               |         |           |
| B    |          |                                               |         |           |

| SIDE | LOCATION | MEASURE: LOOSE PAINT (MORE THAN 1440 SQ. IN.) | IC DATE | IC METHOD |
|------|----------|-----------------------------------------------|---------|-----------|
| D    |          |                                               |         |           |
| D    |          |                                               |         |           |
| D    |          |                                               |         |           |
| D    |          |                                               |         |           |

# Lead Inspection / Risk Assessment Report

Page 1 of 25

**MEL BLACKMAN**

**MASTER LEAD INSPECTOR**

P.O. BOX 358 - STONEHAM, MA 02180  
PHONE / FAX 781- 665 - 3806

|                |             |             |      |
|----------------|-------------|-------------|------|
| St.#           | Street Name | Street Type | Unit |
| 917            | MAIN        | ST          |      |
| City           |             | Zip Code    |      |
| VINEYARD HAVEN |             | 02568       |      |

Owner Name: U.S. Government

Owner Address: 917 Main St., Vineyard Haven, MA 02568

Contact Information: Tel #

Email:

Client Name (If different from owner): H&S Environmental Inc. (508-366-7442)

Client Address: 160 E. Main St., Westborough, MA 01581

Number of Rooms in Unit 4

Property Type:

Single Family ☒

Multi Family ☐ # Units

Condominium ☐ # Units

Day Care ☐ Other:

| Key: | Lead Column              | Key: | Delead/IC Method Column  |
|------|--------------------------|------|--------------------------|
| COV  | Covered                  | CAP  | Capped                   |
| VB   | Vinyl Baseboard          | COV  | Covered                  |
| MET  | Metal                    | ENC  | Encapsulated             |
| VR   | Vinyl Rep. Window        | MI   | Made Intact              |
| MR   | Metal Rep. Window        | PRE  | Prepared for Enc.        |
| NA   | Not Accessible           | VRMR | Vinyl/Metal Rep Window   |
| NC   | No Coating               | SFR  | Storm Frame Removed      |
| Tile | Tile (testing suggested) |      | Component Does not Exist |
| DC   | Dropped Ceiling          |      |                          |

Laundry in Basement? Yes or No ☒  
Finished Space in Basement? Yes or No ☒




Testing Method Used:  
Na<sub>2</sub>S Exp. Date \_\_\_\_\_  
X-Ray Fluorescence  
Model XLp303A Serial # 24687

Comments / Notes BASEMENT TESTED AT OWNER'S REQUEST.

Floor# 1 (this is the level within building of unit being inspected)

Floor# 2

Property Diagram/ Unit Labels

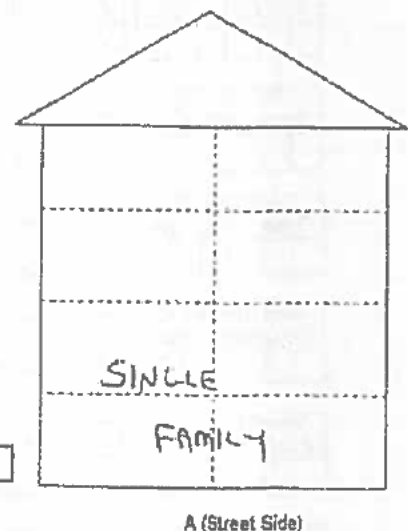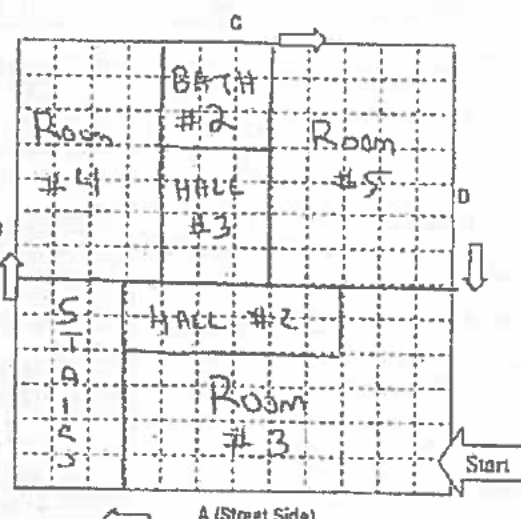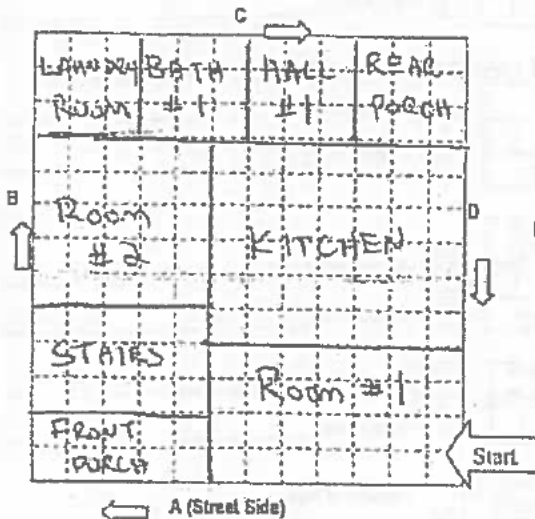

Pb (lead) equal to or greater than 1.0 mg/cm<sup>2</sup> with x-ray fluorescence or positive with Na<sub>2</sub>S is Dangerous.

XRF Calibration Recorded in Log Book  
Address verified through USPS  
Research on Lead-Related History for Address  
[www.epa.gov/lead](http://www.epa.gov/lead) or 800-532-9571



- ✓ -Check off when complete
- ✓ -Check off when complete
- ✓ -Check off when complete

(b) (6)

Inspector Name (b) (6)

Lic # (b) (6)

Signature

Date 09-20-2012

LIRA  
Rev 8/11





ADDRESS: 917 Main St.

Apt# \_\_\_\_\_ City Vineyard Haven, MA 02568

Page 3 of 25

## REOCCUPANCY CERTIFICATE HISTORY

|                                         |                          |
|-----------------------------------------|--------------------------|
| Certificate of Reoccupancy              |                          |
| <input type="checkbox"/>                | <input type="checkbox"/> |
| Only after High/Med Risk (= rooms rule) |                          |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

|                                         |                          |
|-----------------------------------------|--------------------------|
| Certificate of Reoccupancy              |                          |
| <input type="checkbox"/>                | <input type="checkbox"/> |
| Only after High/Med Risk (= rooms rule) |                          |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

|                                         |                          |
|-----------------------------------------|--------------------------|
| Certificate of Reoccupancy              |                          |
| <input type="checkbox"/>                | <input type="checkbox"/> |
| Only after High/Med Risk (= rooms rule) |                          |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

## COMPLIANCE HISTORY

|                                   |                          |
|-----------------------------------|--------------------------|
| Letter of Full Initial Compliance |                          |
| <input type="checkbox"/>          | <input type="checkbox"/> |
| No prior history No signs of UD   |                          |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

|                                |                          |
|--------------------------------|--------------------------|
| Letter of Interim Control      |                          |
| <input type="checkbox"/>       | <input type="checkbox"/> |
| No prior Comp. Expires in 1 yr |                          |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

|                                             |                          |
|---------------------------------------------|--------------------------|
| Recertification of Interim Control          |                          |
| <input type="checkbox"/>                    | <input type="checkbox"/> |
| Expires 2 yrs from original Interim Control |                          |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

|                                    |                          |
|------------------------------------|--------------------------|
| Letter of Full Delaying Compliance |                          |
| <input type="checkbox"/>           | <input type="checkbox"/> |
| Dust wipes if No Reocc.            |                          |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

|                                      |                          |
|--------------------------------------|--------------------------|
| Certificate of Maintained Compliance |                          |
| <input type="checkbox"/>             | <input type="checkbox"/> |
| No Work=No Dust Work = ? Dust        |                          |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

|                                    |                          |
|------------------------------------|--------------------------|
| Certificate of Restored Compliance |                          |
| <input type="checkbox"/>           | <input type="checkbox"/> |
| Dust wipes and air people          |                          |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

## COMPLIANCE HISTORY (CONT.)

|                                      |                          |
|--------------------------------------|--------------------------|
| Certificate of Maintained Compliance |                          |
| <input type="checkbox"/>             | <input type="checkbox"/> |
| No Work=No Dust Work = ? Dust        |                          |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

|                                    |                          |
|------------------------------------|--------------------------|
| Certificate of Restored Compliance |                          |
| <input type="checkbox"/>           | <input type="checkbox"/> |
| Dust wipes and air people          |                          |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

|                                      |                          |
|--------------------------------------|--------------------------|
| Certificate of Maintained Compliance |                          |
| <input type="checkbox"/>             | <input type="checkbox"/> |
| No Work=No Dust Work = ? Dust        |                          |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

|                                    |                          |
|------------------------------------|--------------------------|
| Certificate of Restored Compliance |                          |
| <input type="checkbox"/>           | <input type="checkbox"/> |
| Dust wipes and air people          |                          |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

## OTHER HISTORY: WAIVERS/UD/EPA RRP

|                          |                          |
|--------------------------|--------------------------|
| Approved CLPPP Waiver    |                          |
| <input type="checkbox"/> | <input type="checkbox"/> |
| Attach to Comp Docs      |                          |

CLPPP Insp. Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

|                          |                          |
|--------------------------|--------------------------|
| Approved CLPPP Waiver    |                          |
| <input type="checkbox"/> | <input type="checkbox"/> |
| Attach to Comp Docs      |                          |

CLPPP Insp. Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

|                              |                          |
|------------------------------|--------------------------|
| UD / DES Visual Reinspection |                          |
| <input type="checkbox"/>     | <input type="checkbox"/> |
| No LOC Issued                |                          |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

|                              |                          |
|------------------------------|--------------------------|
| UD / DES Visual Reinspection |                          |
| <input type="checkbox"/>     | <input type="checkbox"/> |
| No LOC Issued                |                          |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

|                          |                          |
|--------------------------|--------------------------|
| UD / DES Dust Taken      |                          |
| <input type="checkbox"/> | <input type="checkbox"/> |
| No LOC Issued            |                          |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

|                          |                          |
|--------------------------|--------------------------|
| UD / DES Dust Taken      |                          |
| <input type="checkbox"/> | <input type="checkbox"/> |
| No LOC Issued            |                          |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_



**EXPLANATION OF LEAD INSPECTION / RISK ASSESSMENT REPORT FORM COLUMNS**

This page provides general information needed to understand the lead inspection/risk assessment report. However, you should speak with the inspector/risk assessor before you start to do any work on your home.

|                              |                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                 |
|------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| <b>SIDE</b>                  | Refers to A, B, C, or D side of the building or room. See the diagram on the cover sheet. The "A" side of the building or room is the side facing the street that gives the property its address (usually, it is the front of the building). Keeping your back to this street, from the "A" side move clockwise to the "B" side on your left, the "C" side opposite you, and the "D" side to the right. Numbering is from left to right.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                        |
| <b>LOCATION/<br/>SURFACE</b> | Refers to the building component(s) being tested. Some surfaces may be made up of more than one part. For example, "Baseboard" may refer to four separate pieces of wood (one on each wall), but is still considered one surface.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                               |
| <b>LEAD</b>                  | <p>The actual lead result. Each surface tested must have a result recorded in the "Lead" column.</p> <ul style="list-style-type: none"> <li>A number shows that the surface was tested with an XRF analyzer. A number (or average number) equal to or greater than 1.0 mg/cm<sup>2</sup> is a dangerous level of lead.</li> <li>A "pos" or "neg" shows that the surface was tested with sodium sulfide. "Pos" means that there is a dangerous level of lead.</li> <li>"N/A" means that the inspector was not able to test the surface. Unless the owner can get a sample to test, the inspector must assume the surface contains lead and require it to be delead, if necessary.</li> <li>"MET" or "MK" means that a metal surface was not tested and only needs to be intact, even if it is a leaded surface. However, metal handrails, metal window sills, and metal railing caps, need to be delead if they test equal to or greater than 1.0 mg/cm<sup>2</sup>, or is marked "N/A."</li> <li>For key to abbreviations like "COV", "VB", "VR" or "MR", "NC", "Tile", "DC", see the cover page.</li> <li>When a component box is slashed and there are test results above and below the diagonal line, the result on the "bottom" represents results below 5 ft. and the "top" result indicates the test result above 5 ft.</li> </ul>                                                                                                                                                                                        |
| <b>TYPE OF<br/>HAZARD</b>    | <p>Not all lead paint must be delead. This column tells you IF and WHY a surface needs deleading. The deleading standards below may not apply for Interim Controls. Speak to your risk assessor for more information.</p> <ul style="list-style-type: none"> <li>"M/" circled means that the surface is a moveable/impacted surface and must be delead in its entirety.</li> <li>"SF" circled indicates that there is a storm frame present which requires the blind stop and exterior sill be delead as interior moveable / impacted surfaces.</li> <li>"A/M" circled means that the surface is "accessible mouthable" and must be delead to a minimum of five feet high, four inches in from the edge or corner.</li> <li>"L" circled means that the surface is loose and must, at minimum, be made intact.</li> <li>If more than one choice is circled, the rules for deleading may change depending upon what method of deleading you choose. Speak to the inspector for more information.</li> <li>"N/A" means the inspector was unable to determine if the surface was a lead hazard. The person doing the deleading must check this surface and follow all the rules for deleading. Speak to the inspector for more information.</li> <li>If nothing is circled in the column, then it is likely the surface does not need deleading. Speak to the inspector for more information. Remember, this does not mean the entire surface is lead free, it just does not require deleading in its current condition.</li> </ul> |
| <b>URG HAZ?</b>              | This column is only completed during a risk assessment. A risk assessment is an evaluation of a home's suitability for Interim Control. Only a licensed risk assessor can do a risk assessment, not all inspectors are risk assessors. If "Y" is circled, then this surface is considered an "Urgent Lead Hazard" and some type of deleading work is required to qualify for Interim Control.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                   |
| <b>IC DATE</b>               | The date the licensed risk assessor determines the surface meets the standards for Interim Control.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                             |
| <b>IC METH</b>               | The deleading method or structural repair done to qualify the surface for Interim Control. Refer to the deleading codes key on the cover page.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                  |
| <b>DELEAD<br/>DATE</b>       | The date that the lead inspector reinspects the surface and finds that it has been successfully brought back into compliance.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                   |
| <b>DELEAD<br/>METH</b>       | The method used to bring a surface into full compliance. Refer to codes in the Key on the cover page of the PCAD                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                |
| <b>EXCLUDED<br/>SURFACES</b> | The amount of loose paint on a surface as measured by the lead inspector. "N/A" means that the inspector was not able to measure the loose paint, but has determined it is more than the cut-off for moderate risk making intact.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                               |

(b) (6)

09-20-2012

Page 5 of 25

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 917 Main St.

Apt #: 4444

City: Vineyard Haven, MA 02568

ROOM # 1

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A B  | Up Walls             | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Low Walls            |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Baseboards           | 2.6  | A/M L N/A         | Y           |            |            |                |                |
| A B  | Chair Rail           |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Radiator             | 0.00 | A/M L N/A         | Y           |            |            |                |                |
|      | Floor                | 0.00 | A/M L N/A         | Y           |            |            |                |                |
|      | Ceiling              | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          | 2.6  | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            | 0.01 | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            | 0.01 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A    | Closet Door          |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Ci Casing            |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Closet Jamb          |      | A/M L N/A         | Y           |            |            |                |                |
| D    | Closet Walls         |      | A/M L N/A         | Y           |            |            |                |                |
|      | Ci Baseboard         |      | A/M L N/A         | Y           |            |            |                |                |
| 1    | Closet Pole          |      | A/M L N/A         | Y           |            |            |                |                |
| 2    | Closet Shelf         |      | A/M L N/A         | Y           |            |            |                |                |
| 3    | Ci Supports          |      | A/M L N/A         | Y           |            |            |                |                |
| 4    | Closet Floor         |      | A/M L N/A         | Y           |            |            |                |                |
|      | Closet Ceiling       |      | A/M L N/A         | Y           |            |            |                |                |

COMMENTS / STRUCTURAL DEFECTS:

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |



(b) (6)

09-20-2012

Page 6 of 25

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 917 Main St.

Apt #: AAAAAA

City: Vineyard Haven, MA 02568

ROOM # 2

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A B  | Up Walls             | 0.05 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Low Walls            |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Baseboards           | 31.5 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Chair Rail           |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Radiator             | 0.75 | A/M L N/A         | Y           |            |            |                |                |
|      | Floor                | 0.00 | A/M L N/A         | Y           |            |            |                |                |
|      | Ceiling              | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          | 4.6  | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            | 7.1  | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            | 0.02 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 | 0.02 | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          | 2.1  | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            | 4.1  | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            | 0.11 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A    | Closet Door          | 0.05 | A/M L N/A         | Y           |            |            |                |                |
| B    | Cl Casing            | 7.1  | A/M L N/A         | Y           |            |            |                |                |
| C    | Closet Jamb          | 7.0  | A/M L N/A         | Y           |            |            |                |                |
| D    | Closet Walls         | 10.1 | A/M L N/A         | Y           |            |            |                |                |
|      | Cl Baseboard         | 17.7 | A/M L N/A         | Y           |            |            |                |                |
|      | Closet Pipes         | 6.11 | A/M L N/A         | Y           |            |            |                |                |
| 2    | Closet Shelf         | 4.2  | A/M L N/A         | Y           |            |            |                |                |
| 3    | Cl Supports          | 12.6 | A/M L N/A         | Y           |            |            |                |                |
| 4    | Closet Floor         | 0.20 | A/M L N/A         | Y           |            |            |                |                |
|      | Closet Ceiling       | NA   | A/M L N/A         | Y           |            |            |                |                |

COMMENTS / STRUCTURAL DEFECTS:

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A    | Window Sill          | 4.1  | A/M L N/A         | Y           |            |            |                |                |
| B    | Win Apron            | 0.02 | A/M L N/A         | Y           |            |            |                |                |
| C    | Win Casing           | 4.1  | A/M L N/A         | Y           |            |            |                |                |
| D    | Header Stop          | 0.00 | A/M L N/A         | Y           |            |            |                |                |
|      | Int Stops            | 0.02 | A/M L N/A         | Y           |            |            |                |                |
| 1    | Win Int Sash         | 0.01 | A/M L N/A         | Y           |            |            |                |                |
| 2    | Exterior Sill        | 1.6  | A/M SF L N/A      | Y           |            |            |                |                |
| 3    | Part Bead            | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| 4    | Blind Stop           | 0.5  | A/M SF L N/A      | Y           |            |            |                |                |
|      | Win Ext Sash         | 0.01 | A/M L N/A         | Y           |            |            |                |                |
| A    | Window Sill          | 4.2  | A/M L N/A         | Y           |            |            |                |                |
| B    | Win Apron            | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| C    | Win Casing           | 4.0  | A/M L N/A         | Y           |            |            |                |                |
| D    | Header Stop          | 0.01 | A/M L N/A         | Y           |            |            |                |                |
|      | Int Stops            | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| 1    | Win Int Sash         | 0.02 | A/M L N/A         | Y           |            |            |                |                |
| 2    | Exterior Sill        | 1.7  | A/M SF L N/A      | Y           |            |            |                |                |
| 3    | Part Bead            | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| 4    | Blind Stop           | 0.5  | A/M SF L N/A      | Y           |            |            |                |                |
|      | Win Ext Sash         | 0.02 | A/M L N/A         | Y           |            |            |                |                |
| A    | Window Sill          |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Win Apron            |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| D    | Header Stop          |      | A/M L N/A         | Y           |            |            |                |                |
|      | Int Stops            |      | A/M L N/A         | Y           |            |            |                |                |
| 1    | Win Int Sash         |      | A/M L N/A         | Y           |            |            |                |                |
| 2    | Exterior Sill        |      | A/M SF L N/A      | Y           |            |            |                |                |
| 3    | Part Bead            |      | A/M L N/A         | Y           |            |            |                |                |
| 4    | Blind Stop           |      | A/M SF L N/A      | Y           |            |            |                |                |
|      | Win Ext Sash         |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Fireplace            |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Mantle               |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Win Above 5'         |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Ceiling Molding      |      | A/M L N/A         | Y           |            |            |                |                |
| A    | Pipes                | 0.25 | A/M L N/A         | Y           |            |            |                |                |
|      |                      |      | A/M L N/A         | Y           |            |            |                |                |
|      |                      |      | A/M L N/A         | Y           |            |            |                |                |

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

(b) (6)

09-20-2012

Page 7 of 25

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 917 Main St.

Apt #:

A A A A A

City: Vineyard Haven, MA 02568

ROOM # 3

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A B  | Up Walls             | 10.4 | (A/M) L N/A       | Y           |            |            |                |                |
| A B  | Low Walls            |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Baseboards           | 18.6 | (A/M) L N/A       | Y           |            |            |                |                |
| A B  | Chair Rail           |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Radiator             | 0.02 | A/M L N/A         | Y           |            |            |                |                |
|      | Floor                | 0.05 | A/M L N/A         | Y           |            |            |                |                |
|      | Ceiling              | 11.3 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          | 6.1  | (A/M) L N/A       | Y           |            |            |                |                |
| 1 2  | Door Jamb            | 8.3  | (A/M) L N/A       | Y           |            |            |                |                |
| 3 4  | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 | 0.04 | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          | 6.1  | (A/M) L N/A       | Y           |            |            |                |                |
| 1 2  | Door Jamb            | 6.3  | (A/M) L N/A       | Y           |            |            |                |                |
| 3 4  | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A    | Closet Door          | 0.04 | A/M L N/A         | Y           |            |            |                |                |
| B    | Ct Casing            | 4.1  | (A/M) L N/A       | Y           |            |            |                |                |
| C    | Closet Jamb          | 6.2  | (A/M) L N/A       | Y           |            |            |                |                |
| D    | Closet Walls         | 16.1 | A/M L N/A         | Y           |            |            |                |                |
|      | Ct Baseboard         | 7.9  | A/M L N/A         | Y           |            |            |                |                |
| 1    | Closet Pole          | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| 2    | Closet Shelf         | 2.5  | A/M L N/A         | Y           |            |            |                |                |
| 3    | Ct Supports          | 2.1  | A/M L N/A         | Y           |            |            |                |                |
| 4    | Closet Floor         | 0.02 | A/M L N/A         | Y           |            |            |                |                |
|      | Closet Ceiling       | 9.6  | (A/M) L N/A       | Y           |            |            |                |                |

COMMENTS / STRUCTURAL DEFECTS:

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 286 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 286 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |



(b) (6)

09-20-2012

Page 8 of 25

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 917 Main St

Apt #: 44444

City: Vineyard Haven, MA 02568

ROOM # 4

| SIDE    | LOCATION/SURFACE | LEAD | TYPE OF HAZARD | URG HAZ? | IC DATE | IC METH | DELEAD DATE | DELEAD METH |
|---------|------------------|------|----------------|----------|---------|---------|-------------|-------------|
| A B C D | Up Walls         | 7.1  | AM L N/A       | Y        |         |         |             |             |
| A B C D | Low Walls        |      | AM L N/A       | Y        |         |         |             |             |
| A B C D | Baseboards       | 13.0 | AM L N/A       | Y        |         |         |             |             |
| A B C D | Chair Rail       |      | AM L N/A       | Y        |         |         |             |             |
| A B C D | Radiator         | 204  | AM L N/A       | Y        |         |         |             |             |
| A B C D | Floor            | 0.01 | AM L N/A       | Y        |         |         |             |             |
| A B C D | Ceiling          | 7.0  | AM L N/A       | Y        |         |         |             |             |
| A B     | Door             | 1.2  | AM L N/A       | Y        |         |         |             |             |
| C D     | Door Casing      | 4.1  | AM L N/A       | Y        |         |         |             |             |
| 1/2     | Door Jamb        | 2.6  | AM L N/A       | Y        |         |         |             |             |
| 3/4     | Threshold        |      | AM L N/A       | Y        |         |         |             |             |
| A B     | Door             | 1.2  | AM L N/A       | Y        |         |         |             |             |
| C D     | Door Casing      | 1.9  | AM L N/A       | Y        |         |         |             |             |
| 1/2     | Door Jamb        | 2.6  | AM L N/A       | Y        |         |         |             |             |
| 3/4     | Threshold        | 0.00 | AM L N/A       | Y        |         |         |             |             |
| A B     | Door             | 0.04 | AM L N/A       | Y        |         |         |             |             |
| C D     | Door Casing      | 7.1  | AM L N/A       | Y        |         |         |             |             |
| 1/2     | Door Jamb        | 7.1  | AM L N/A       | Y        |         |         |             |             |
| 3/4     | Threshold        | 0.00 | AM L N/A       | Y        |         |         |             |             |
| A B     | Door (+)         | 1.2  | AM L N/A       | Y        |         |         |             |             |
| C D     | Door Casing      |      | AM L N/A       | Y        |         |         |             |             |
| 1/2     | Door Jamb        | 7.9  | AM L N/A       | Y        |         |         |             |             |
| 3/4     | Threshold        | 0.00 | AM L N/A       | Y        |         |         |             |             |
| A       | Closet Door      | 15.2 | AM L N/A       | Y        |         |         |             |             |
| B       | Closet Casing    | 3.2  | AM L N/A       | Y        |         |         |             |             |
| C       | Closet Jamb      | 3.0  | AM L N/A       | Y        |         |         |             |             |
| D       | Closet Walls     | 10.1 | AM L N/A       | Y        |         |         |             |             |
|         | Closet Baseboard | 6.3  | AM L N/A       | Y        |         |         |             |             |
| 1       | Closet Pole      | 0.04 | AM L N/A       | Y        |         |         |             |             |
| 2       | Closet Shelf     |      | AM L N/A       | Y        |         |         |             |             |
| 3       | Closet Supports  | 0.03 | AM L N/A       | Y        |         |         |             |             |
| 4       | Closet Floor     | 0.00 | AM L N/A       | Y        |         |         |             |             |
|         | Closet Ceiling   | 7.1  | AM L N/A       | Y        |         |         |             |             |

## COMMENTS / STRUCTURAL DEFECTS:

(1) other side of EZ door in  
CRAWL SPACE

| SIDE    | LOCATION/SURFACE | LEAD | TYPE OF HAZARD | URG HAZ? | IC DATE | IC METH | DELEAD DATE | DELEAD METH |
|---------|------------------|------|----------------|----------|---------|---------|-------------|-------------|
| A       | Window Sill      | 2.6  | AM L N/A       | Y        |         |         |             |             |
| B       | Win Apron        | 5.7  | AM L N/A       | Y        |         |         |             |             |
| C       | Win Casing       | 2.9  | AM L N/A       | Y        |         |         |             |             |
| D       | Header Stop      | 0.00 | AM L N/A       | Y        |         |         |             |             |
|         | Int Stops        | 0.00 | AM L N/A       | Y        |         |         |             |             |
| 1       | Win Int Sash     | 0.00 | AM L N/A       | Y        |         |         |             |             |
| 2       | Exterior Sill    | 1.3  | AM SF L N/A    | Y        |         |         |             |             |
| 3       | Part Bead        | 0.00 | AM L N/A       | Y        |         |         |             |             |
| 4       | Blind Stop       | 1.6  | AM SF L N/A    | Y        |         |         |             |             |
|         | Win Ext Sash     | 0.00 | AM L N/A       | Y        |         |         |             |             |
| A       | Window Sill      |      | AM L N/A       | Y        |         |         |             |             |
| B       | Win Apron        |      | AM L N/A       | Y        |         |         |             |             |
| C       | Win Casing       |      | AM L N/A       | Y        |         |         |             |             |
| D       | Header Stop      |      | AM L N/A       | Y        |         |         |             |             |
|         | Int Stops        |      | AM L N/A       | Y        |         |         |             |             |
| 1       | Win Int Sash     |      | AM L N/A       | Y        |         |         |             |             |
| 2       | Exterior Sill    |      | AM SF L N/A    | Y        |         |         |             |             |
| 3       | Part Bead        |      | AM L N/A       | Y        |         |         |             |             |
| 4       | Blind Stop       |      | AM SF L N/A    | Y        |         |         |             |             |
|         | Win Ext Sash     |      | AM L N/A       | Y        |         |         |             |             |
| A       | Window Sill      |      | AM L N/A       | Y        |         |         |             |             |
| B       | Win Apron        |      | AM L N/A       | Y        |         |         |             |             |
| C       | Win Casing       |      | AM L N/A       | Y        |         |         |             |             |
| D       | Header Stop      |      | AM L N/A       | Y        |         |         |             |             |
|         | Int Stops        |      | AM L N/A       | Y        |         |         |             |             |
| 1       | Win Int Sash     |      | AM L N/A       | Y        |         |         |             |             |
| 2       | Exterior Sill    |      | AM SF L N/A    | Y        |         |         |             |             |
| 3       | Part Bead        |      | AM L N/A       | Y        |         |         |             |             |
| 4       | Blind Stop       |      | AM SF L N/A    | Y        |         |         |             |             |
|         | Win Ext Sash     |      | AM L N/A       | Y        |         |         |             |             |
| A B     | Fireplace        |      | AM L N/A       | Y        |         |         |             |             |
| C D     | Mantle           |      | AM L N/A       | Y        |         |         |             |             |
| A B C D | Win Above 5'     |      | AM L N/A       | Y        |         |         |             |             |
|         | Ceiling Molding  |      | AM L N/A       | Y        |         |         |             |             |
|         | C2 CL Ceiling    | 0.01 | AM L N/A       | Y        |         |         |             |             |
|         | C2 CL Wall       | 0.00 | AM L N/A       | Y        |         |         |             |             |
|         |                  |      | AM L N/A       | Y        |         |         |             |             |

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC DATE | IC METHOD |
|------|----------|-------------------------------------------------|---------|-----------|
|      |          |                                                 |         |           |
|      |          |                                                 |         |           |

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC DATE | IC METHOD |
|------|----------|-------------------------------------------------|---------|-----------|
|      |          |                                                 |         |           |
|      |          |                                                 |         |           |

(b) (6)

09-20-2012

Page 9 of 25

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property:

917 Main St.

Apt #:

AAAAA

City: Vineyard Haven, MA 02568

ROOM # 5

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A B  | Up Walls             | 15.0 | AM L N/A          | Y           |            |            |                |                |
| A B  | Low Walls            | /    | AM L N/A          | Y           |            |            |                |                |
| A B  | Baseboards           | 12.1 | AM L N/A          | Y           |            |            |                |                |
| A B  | Chair Rail           | /    | AM L N/A          | Y           |            |            |                |                |
| A B  | Radiator             | 0.00 | AM L N/A          | Y           |            |            |                |                |
| A B  | Floor                | 0.00 | AM L N/A          | Y           |            |            |                |                |
| A B  | Ceiling              | 3.1  | AM L N/A          | Y           |            |            |                |                |
| A B  | Door                 | 0.00 | AM L N/A          | Y           |            |            |                |                |
| C D  | Door Casing          | 3.1  | AM L N/A          | Y           |            |            |                |                |
| 1 2  | Door Jamb            | 3.0  | AM L N/A          | Y           |            |            |                |                |
| 3 4  | Threshold            | /    | AM L N/A          | Y           |            |            |                |                |
| A B  | Door                 | 0.00 | AM L N/A          | Y           |            |            |                |                |
| C D  | Door Casing          | 4.4  | AM L N/A          | Y           |            |            |                |                |
| 1 2  | Door Jamb            | 3.8  | AM L N/A          | Y           |            |            |                |                |
| 3 4  | Threshold            | 0.00 | AM L N/A          | Y           |            |            |                |                |
| A B  | Door                 | 0.02 | AM L N/A          | Y           |            |            |                |                |
| C D  | Door Casing          | 0.00 | AM L N/A          | Y           |            |            |                |                |
| 1 2  | Door Jamb            | 0.00 | AM L N/A          | Y           |            |            |                |                |
| 3 4  | Threshold            | /    | AM L N/A          | Y           |            |            |                |                |
| A B  | Door                 | /    | AM L N/A          | Y           |            |            |                |                |
| C D  | Door Casing          | /    | AM L N/A          | Y           |            |            |                |                |
| 1 2  | Door Jamb            | /    | AM L N/A          | Y           |            |            |                |                |
| 3 4  | Threshold            | /    | AM L N/A          | Y           |            |            |                |                |
| A    | Closet Door          | 0.01 | AM L N/A          | Y           |            |            |                |                |
| B    | Ct Casing            | 3.6  | AM L N/A          | Y           |            |            |                |                |
| C    | Closet Jamb          | 3.1  | AM L N/A          | Y           |            |            |                |                |
| D    | Closet Walls         | 11.3 | AM L N/A          | Y           |            |            |                |                |
|      | Ct Baseboard         | 29.6 | AM L N/A          | Y           |            |            |                |                |
| 1    | Closet Pole          | 0.00 | AM L N/A          | Y           |            |            |                |                |
| 2    | Closet Shelf         | 0.00 | AM L N/A          | Y           |            |            |                |                |
| 3    | Ct Supports          | 12.6 | AM L N/A          | Y           |            |            |                |                |
| 4    | Closet Floor         | 0.00 | AM L N/A          | Y           |            |            |                |                |
|      | Closet Ceiling       | NA   | AM L N/A          | Y           |            |            |                |                |

COMMENTS / STRUCTURAL DEFECTS:

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |



(b) (6)

09- 20- 2012

Page 10 of 25

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 917 Main St.

Apt #: AAAAA

City: Vineyard Haven, MA 02568

## KITCHEN

| SIDE       | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A B<br>C D | Up Walls             | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A B<br>C D | Low Walls            | /    | A/M L N/A         | Y           |            |            |                |                |
| A B<br>C D | Baseboards           | 15.7 | A/M L N/A         | Y           |            |            |                |                |
| A B<br>C D | Chair Rail           | /    | A/M L N/A         | Y           |            |            |                |                |
| A B<br>C D | Radiator             | 0.11 | A/M L N/A         | Y           |            |            |                |                |
| A B<br>C D | Floor                | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A B<br>C D | Ceiling              | NA   | A/M L N/A         | Y           |            |            |                |                |
| A B        | Door                 | /    | A/M L N/A         | Y           |            |            |                |                |
| C D        | Door Casing          | 2.1  | A/M L N/A         | Y           |            |            |                |                |
| 1 2        | Door Jamb            | 4.5  | A/M L N/A         | Y           |            |            |                |                |
| 3 4        | Threshold            | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A B        | Door                 | 0.03 | A/M L N/A         | Y           |            |            |                |                |
| C D        | Door Casing          | 1.6  | A/M L N/A         | Y           |            |            |                |                |
| 1 2        | Door Jamb            | 2.4  | A/M L N/A         | Y           |            |            |                |                |
| 3 4        | Threshold            | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A B        | Door                 | 0.03 | A/M L N/A         | Y           |            |            |                |                |
| C D        | Door Casing          | 3.3  | A/M L N/A         | Y           |            |            |                |                |
| 1 2        | Door Jamb            | 3.2  | A/M L N/A         | Y           |            |            |                |                |
| 3 4        | Threshold            | 0.01 | A/M L N/A         | Y           |            |            |                |                |
| A B        | Door                 | /    | A/M L N/A         | Y           |            |            |                |                |
| C D        | Door Casing          | 1.6  | A/M L N/A         | Y           |            |            |                |                |
| 1 2        | Door Jamb            | 1.9  | A/M L N/A         | Y           |            |            |                |                |
| 3 4        | Threshold            | 0.04 | A/M L N/A         | Y           |            |            |                |                |
| A          | Closet Door          | /    | A/M L N/A         | Y           |            |            |                |                |
| B          | Ct Casing            | /    | A/M L N/A         | Y           |            |            |                |                |
| C          | Closet Jamb          | /    | A/M L N/A         | Y           |            |            |                |                |
| D          | Closet Walls         | /    | A/M L N/A         | Y           |            |            |                |                |
|            | Ct Baseboard         | /    | A/M L N/A         | Y           |            |            |                |                |
| 1          | Closet Pole          | /    | A/M L N/A         | Y           |            |            |                |                |
| 2          | Closet Shelf         | /    | A/M L N/A         | Y           |            |            |                |                |
| 3          | Ct Supports          | /    | A/M L N/A         | Y           |            |            |                |                |
| 4          | Closet Floor         | /    | A/M L N/A         | Y           |            |            |                |                |
|            | Closet Ceiling       | /    | A/M L N/A         | Y           |            |            |                |                |

COMMENTS / STRUCTURAL DEFECTS:

| SIDE       | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A          | Window Sill          | 0.00 | M/L A/M L N/A     | Y           |            |            |                |                |
| B          | Win Apron            | 0.01 | A/M L N/A         | Y           |            |            |                |                |
| C          | Win Casing           | 0.02 | A/M L N/A         | Y           |            |            |                |                |
| D          | Header Slop          | 0.00 | M/L A/M L N/A     | Y           |            |            |                |                |
|            | Int Slops            | 0.01 | M/L A/M L N/A     | Y           |            |            |                |                |
| 1          | Win Int Sash         | 0.02 | M/L A/M L N/A     | Y           |            |            |                |                |
| 2          | Exterior Sill        | 4.0  | M/L SF L N/A      | Y           |            |            |                |                |
| 3          | Part Bead            | 0.00 | M/L L N/A         | Y           |            |            |                |                |
| 4          | Blind Slop           | 1.1  | M/L SF L N/A      | Y           |            |            |                |                |
|            | Win Ext Sash         | 0.00 | M/L L N/A         | Y           |            |            |                |                |
| A          | Window Sill          | 0.00 | M/L A/M L N/A     | Y           |            |            |                |                |
| B          | Win Apron            | /    | A/M L N/A         | Y           |            |            |                |                |
| C          | Win Casing           | 0.01 | A/M L N/A         | Y           |            |            |                |                |
| D          | Header Slop          | 0.00 | M/L A/M L N/A     | Y           |            |            |                |                |
|            | Int Slops            | 0.00 | M/L A/M L N/A     | Y           |            |            |                |                |
| 1          | Win Int Sash         | 0.00 | M/L A/M L N/A     | Y           |            |            |                |                |
| 2          | Exterior Sill        | 0.05 | M/L SF L N/A      | Y           |            |            |                |                |
| 3          | Part Bead            | 0.00 | M/L L N/A         | Y           |            |            |                |                |
| 4          | Blind Slop           | 0.00 | M/L SF L N/A      | Y           |            |            |                |                |
|            | Win Ext Sash         | 0.00 | M/L L N/A         | Y           |            |            |                |                |
| A B        | Up Cab Frame         | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| C D        | Up Cab Door          | 0.00 | A/M L N/A         | Y           |            |            |                |                |
|            | Up Cab Walls         | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| 1 2        | Up Cab Shivs         | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| 3 4        | Supports             | /    | A/M L N/A         | Y           |            |            |                |                |
|            | Low Cab Frame        | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A B        | Low Cab Door         | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| C D        | Low Cab Walls        | 0.00 | A/M L N/A         | Y           |            |            |                |                |
|            | Low Cab Shivs        | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| 1 2        | Supports             | /    | A/M L N/A         | Y           |            |            |                |                |
| 3 4        | Drawers              | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A B<br>C D | Win Above 5'         | /    | M/L A/M L N/A     | Y           |            |            |                |                |
|            |                      | /    | M/L A/M L N/A     | Y           |            |            |                |                |
|            |                      | /    | M/L A/M L N/A     | Y           |            |            |                |                |
|            |                      | /    | M/L A/M L N/A     | Y           |            |            |                |                |
|            |                      | /    | M/L A/M L N/A     | Y           |            |            |                |                |

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

Page 11 of 25

Date \_\_\_\_\_

Date \_\_\_\_\_

Date \_\_\_\_\_

City: Vineyard Haven, MA 02568

Adi #:

[illegible]

COMMENTS / STRUCTURAL DEFECTS:

**EXCLUDED SURFACES:** Surfaces listed in these boxes can be made intact only by a licensed dealer.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 280 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |





(b) (6)

09-20-2012

Page 13 of 25

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 917 Main St.

Apt #: AAAAAA

City: Vineyard Haven, MA 02568

HALLWAY #1

| SIDE       | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH | SIDE       | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|------------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A B<br>C D | Up Walls             | 0.01 | A/M L N/A         | Y           |            |            |                |                | A          | Closet Door          |      | A/M L N/A         | Y           |            |            |                |                |
| A B<br>C D | Low Walls            |      | A/M L N/A         | Y           |            |            |                |                | B          | CI Casing            |      | A/M L N/A         | Y           |            |            |                |                |
| A B<br>C D | Baseboards           | 16.4 | A/M L N/A         | Y           |            |            |                |                | C          | Closet Jamb          |      | A/M L N/A         | Y           |            |            |                |                |
| A B<br>C D | Chair Rail           |      | A/M L N/A         | Y           |            |            |                |                | D          | Closet Walls         |      | A/M L N/A         | Y           |            |            |                |                |
| A B<br>C D | Radiator             |      | A/M L N/A         | Y           |            |            |                |                |            | CI Baseboard         |      | A/M L N/A         | Y           |            |            |                |                |
|            | Floor                | Tile | A/M L N/A         | Y           |            |            |                |                | 1          | Closet Pole          |      | A/M L N/A         | Y           |            |            |                |                |
|            | Ceiling              | 0.00 | A/M L N/A         | Y           |            |            |                |                | 2          | Closet Shelf         |      | A/M L N/A         | Y           |            |            |                |                |
| A B        | Door                 |      | A/M L N/A         | Y           |            |            |                |                | 3          | CI Supports          |      | A/M L N/A         | Y           |            |            |                |                |
| C D        | Door Casing          | 2.3  | A/M L N/A         | Y           |            |            |                |                | 4          | Closet Floor         |      | A/M L N/A         | Y           |            |            |                |                |
| 12         | Door Jamb            | 2.4  | A/M L N/A         | Y           |            |            |                |                |            | Closet Ceiling       |      | A/M L N/A         | Y           |            |            |                |                |
| 34         | Threshold            | 0.01 | A/M L N/A         | Y           |            |            |                |                | A          | Window Sill          |      | M/I A/M L N/A     | Y           |            |            |                |                |
| A B        | Door                 | 0.00 | A/M L N/A         | Y           |            |            |                |                | B          | Win Apron            |      | A/M L N/A         | Y           |            |            |                |                |
| C D        | Door Casing          | 0.01 | A/M L N/A         | Y           |            |            |                |                | C          | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| 12         | Door Jamb            | 2.9  | A/M L N/A         | Y           |            |            |                |                | D          | Header Stop          |      | M/I A/M L N/A     | Y           |            |            |                |                |
| 34         | Threshold            | 0.20 | A/M L N/A         | Y           |            |            |                |                |            | Int Stops            |      | M/I A/M L N/A     | Y           |            |            |                |                |
| A B        | Door                 |      | A/M L N/A         | Y           |            |            |                |                | 1          | Win Int Sash         |      | M/I A/M L N/A     | Y           |            |            |                |                |
| C D        | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                | 2          | Exterior Sill        |      | M/I SF L N/A      | Y           |            |            |                |                |
| 12         | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                | 3          | Part Bead            |      | M/I L N/A         | Y           |            |            |                |                |
| 34         | Threshold            |      | A/M L N/A         | Y           |            |            |                |                | 4          | Blind Stop           |      | M/I SF L N/A      | Y           |            |            |                |                |
| A B        | Door                 |      | A/M L N/A         | Y           |            |            |                |                |            | Win Ext Sash         |      | M/I L N/A         | Y           |            |            |                |                |
| C D        | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                | A          | Window Sill          |      | M/I A/M L N/A     | Y           |            |            |                |                |
| 12         | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                | B          | Win Apron            |      | A/M L N/A         | Y           |            |            |                |                |
| 34         | Threshold            |      | A/M L N/A         | Y           |            |            |                |                | C          | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| A B        | Door                 |      | A/M L N/A         | Y           |            |            |                |                | D          | Header Stop          |      | M/I A/M L N/A     | Y           |            |            |                |                |
| C D        | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |            | Int Stops            |      | M/I A/M L N/A     | Y           |            |            |                |                |
| #          | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                | 1          | Win Int Sash         |      | M/I A/M L N/A     | Y           |            |            |                |                |
|            | Threshold            |      | A/M L N/A         | Y           |            |            |                |                | 2          | Exterior Sill        |      | M/I SF L N/A      | Y           |            |            |                |                |
| A          | Closet Door          |      | A/M L N/A         | Y           |            |            |                |                | 3          | Part Bead            |      | M/I L N/A         | Y           |            |            |                |                |
| B          | CI Casing            |      | A/M L N/A         | Y           |            |            |                |                | 4          | Blind Stop           |      | M/I SF L N/A      | Y           |            |            |                |                |
| C          | Closet Jamb          |      | A/M L N/A         | Y           |            |            |                |                |            | Win Ext Sash         |      | M/I L N/A         | Y           |            |            |                |                |
| D          | Closet Walls         |      | A/M L N/A         | Y           |            |            |                |                | A B<br>C D | Win Above 5'         |      | M/I A/M L N/A     | Y           |            |            |                |                |
|            | CI Baseboard         |      | A/M L N/A         | Y           |            |            |                |                | A B<br>C D | Ceiling Molding      |      | M/I A/M L N/A     | Y           |            |            |                |                |
| 1          | Closet Pole          |      | A/M L N/A         | Y           |            |            |                |                | E          | Support              | 0.00 | M/I A/M L N/A     | Y           |            |            |                |                |
| 2          | Closet Shelf         |      | A/M L N/A         | Y           |            |            |                |                |            |                      |      |                   |             |            |            |                |                |
| 3          | CI Supports          |      | A/M L N/A         | Y           |            |            |                |                |            |                      |      |                   |             |            |            |                |                |
| 4          | Closet Floor         |      | A/M L N/A         | Y           |            |            |                |                |            |                      |      |                   |             |            |            |                |                |
|            | Closet Ceiling       |      | A/M L N/A         | Y           |            |            |                |                |            |                      |      |                   |             |            |            |                |                |

COMMENTS / STRUCTURAL DEFECTS:

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD | SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |      |          |                                                 |            |              |
|      |          |                                                 |            |              |      |          |                                                 |            |              |



(b) (6)

09-20-2012

Page 14 of 25

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 917 Main St.

Apt #: AAAAAA

City: Vineyard Haven, MA 02568

HALLWAY # 2

| SIDE       | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A B<br>C D | Up Walls             | 9.1  | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Low Walls            |      | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Baseboards           | 7.8  | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Chair Rail           |      | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Radiator             |      | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Floor                | 6.0  | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Ceiling              | 14.5 | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Door                 | 0.4  | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Door Casing          | 5.2  | AM L N/A          | Y           |            |            |                |                |
| 1 2<br>3 4 | Door Jamb            | 5.1  | AM L N/A          | Y           |            |            |                |                |
| 3 4        | Threshold            | 0.4  | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Door                 | 0.2  | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Door Casing          | 3.6  | AM L N/A          | Y           |            |            |                |                |
| 1 2<br>3 4 | Door Jamb            | 3.3  | AM L N/A          | Y           |            |            |                |                |
| 3 4        | Threshold            |      | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Door                 |      | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Door Casing          |      | AM L N/A          | Y           |            |            |                |                |
| 1 2<br>3 4 | Door Jamb            |      | AM L N/A          | Y           |            |            |                |                |
| 3 4        | Threshold            |      | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Door                 |      | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Door Casing          |      | AM L N/A          | Y           |            |            |                |                |
| #          | Door Jamb            |      | AM L N/A          | Y           |            |            |                |                |
|            | Threshold            |      | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Closet Door          | 0.10 | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | CI Casing            | 2.4  | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Closet Jamb          | 4.0  | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Closet Walls         | 11.1 | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | CI Baseboard         | 14.1 | AM L N/A          | Y           |            |            |                |                |
| 1          | Closet Pole          |      | AM L N/A          | Y           |            |            |                |                |
| 2          | Closet Shelf         | 1.1  | AM L N/A          | Y           |            |            |                |                |
| 3          | CI Supports          | 9.6  | AM L N/A          | Y           |            |            |                |                |
| 4          | Closet Floor         | 0.5  | AM L N/A          | Y           |            |            |                |                |
|            | Closet Ceiling       | 11.3 | AM L N/A          | Y           |            |            |                |                |

| SIDE       | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A          | Closet Door          |      | AM L N/A          | Y           |            |            |                |                |
| B          | CI Casing            |      | AM L N/A          | Y           |            |            |                |                |
| C          | Closet Jamb          |      | AM L N/A          | Y           |            |            |                |                |
| D          | Closet Walls         |      | AM L N/A          | Y           |            |            |                |                |
|            | CI Baseboard         |      | AM L N/A          | Y           |            |            |                |                |
| 1          | Closet Pole          |      | AM L N/A          | Y           |            |            |                |                |
| 2          | Closet Shelf         |      | AM L N/A          | Y           |            |            |                |                |
| 3          | CI Supports          |      | AM L N/A          | Y           |            |            |                |                |
| 4          | Closet Floor         |      | AM L N/A          | Y           |            |            |                |                |
|            | Closet Ceiling       |      | AM L N/A          | Y           |            |            |                |                |
| A          | Window Sill          |      | AM L N/A          | Y           |            |            |                |                |
| B          | Win Apron            |      | AM L N/A          | Y           |            |            |                |                |
| C          | Win Casing           |      | AM L N/A          | Y           |            |            |                |                |
| D          | Header Stop          |      | AM L N/A          | Y           |            |            |                |                |
|            | Int Stops            |      | AM L N/A          | Y           |            |            |                |                |
| 1          | Win Int Sash         |      | AM L N/A          | Y           |            |            |                |                |
| 2          | Exterior Sill        |      | AM L N/A          | Y           |            |            |                |                |
| 3          | Part Board           |      | AM L N/A          | Y           |            |            |                |                |
| 4          | Blind Stop           |      | AM L N/A          | Y           |            |            |                |                |
|            | Win Ext Sash         |      | AM L N/A          | Y           |            |            |                |                |
| A          | Window Sill          |      | AM L N/A          | Y           |            |            |                |                |
| B          | Win Apron            |      | AM L N/A          | Y           |            |            |                |                |
| C          | Win Casing           |      | AM L N/A          | Y           |            |            |                |                |
| D          | Header Stop          |      | AM L N/A          | Y           |            |            |                |                |
|            | Int Stops            |      | AM L N/A          | Y           |            |            |                |                |
| 1          | Win Int Sash         |      | AM L N/A          | Y           |            |            |                |                |
| 2          | Exterior Sill        |      | AM L N/A          | Y           |            |            |                |                |
| 3          | Part Board           |      | AM L N/A          | Y           |            |            |                |                |
| 4          | Blind Stop           |      | AM L N/A          | Y           |            |            |                |                |
|            | Win Ext Sash         |      | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Win Above 5'         |      | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Ceiling Molding      |      | AM L N/A          | Y           |            |            |                |                |
|            |                      |      | AM L N/A          | Y           |            |            |                |                |

COMMENTS / STRUCTURAL DEFECTS:

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

(b) (6)

09-20-2012

Page 15 of 25

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 917 Main St

Apt #: AAAAAA

City: Vineyard Haven, MA 02558

HALLOWAY 3

| SIDE    | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|---------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A B C D | Up Walls             | 13.6 | A/M L N/A         | Y           |            |            |                |                |
| A B C D | Low Walls            |      | A/M L N/A         | Y           |            |            |                |                |
| A B C D | Baseboards           | 6.0  | A/M L N/A         | Y           |            |            |                |                |
| A B C D | Chair Rail           |      | A/M L N/A         | Y           |            |            |                |                |
| J C D   | Radiator             |      | A/M L N/A         | Y           |            |            |                |                |
|         | Floor                | 0.0  | A/M L N/A         | Y           |            |            |                |                |
|         | Ceiling              | 9.3  | A/M L N/A         | Y           |            |            |                |                |
| A B     | Door                 | 0.0  | A/M L N/A         | Y           |            |            |                |                |
| C D     | Door Casing          | 2.4  | A/M L N/A         | Y           |            |            |                |                |
| 1 2     | Door Jamb            | 3.0  | A/M L N/A         | Y           |            |            |                |                |
| 3 4     | Threshold            | 0.0  | A/M L N/A         | Y           |            |            |                |                |
| A B     | Door                 | 0.0  | A/M L N/A         | Y           |            |            |                |                |
| C D     | Door Casing          | 0.0  | A/M L N/A         | Y           |            |            |                |                |
| 1 2     | Door Jamb            | 0.0  | A/M L N/A         | Y           |            |            |                |                |
| 3 4     | Threshold            | 0.0  | A/M L N/A         | Y           |            |            |                |                |
| A B     | Door                 | 0.0  | A/M L N/A         | Y           |            |            |                |                |
| C D     | Door Casing          | 2.6  | A/M L N/A         | Y           |            |            |                |                |
| 1 2     | Door Jamb            | 2.8  | A/M L N/A         | Y           |            |            |                |                |
| 3 4     | Threshold            | 0.0  | A/M L N/A         | Y           |            |            |                |                |
| A B     | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C D     | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2     | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4     | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A       | Closet Door          |      | A/M L N/A         | Y           |            |            |                |                |
| B       | Closet Casing        |      | A/M L N/A         | Y           |            |            |                |                |
| C       | Closet Jamb          |      | A/M L N/A         | Y           |            |            |                |                |
| D       | Closet Walls         |      | A/M L N/A         | Y           |            |            |                |                |
|         | Closet Baseboard     |      | A/M L N/A         | Y           |            |            |                |                |
| 1       | Closet Pole          |      | A/M L N/A         | Y           |            |            |                |                |
| 2       | Closet Shelf         |      | A/M L N/A         | Y           |            |            |                |                |
| 3       | Closet Supports      |      | A/M L N/A         | Y           |            |            |                |                |
| 4       | Closet Floor         |      | A/M L N/A         | Y           |            |            |                |                |
|         | Closet Ceiling       |      | A/M L N/A         | Y           |            |            |                |                |

COMMENTS / STRUCTURAL DEFECTS:

| SIDE    | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|---------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A       | Window Sill          |      | M/I A/M L N/A     | Y           |            |            |                |                |
| B       | Win Apron            |      | A/M L N/A         | Y           |            |            |                |                |
| C       | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| D       | Header Stop          |      | M/I A/M L N/A     | Y           |            |            |                |                |
|         | Int Stops            |      | M/I A/M L N/A     | Y           |            |            |                |                |
| 1       | Win Int Sash         |      | M/I A/M L N/A     | Y           |            |            |                |                |
| 2       | Exterior Sill        |      | M/I SF L N/A      | Y           |            |            |                |                |
| 3       | Part Bead            |      | M/I L N/A         | Y           |            |            |                |                |
| 4       | Blind Stop           |      | M/I SF L N/A      | Y           |            |            |                |                |
|         | Win Ext Sash         |      | M/I L N/A         | Y           |            |            |                |                |
| A       | Window Sill          |      | M/I A/M L N/A     | Y           |            |            |                |                |
| B       | Win Apron            |      | A/M L N/A         | Y           |            |            |                |                |
| C       | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| D       | Header Stop          |      | M/I A/M L N/A     | Y           |            |            |                |                |
|         | Int Stops            |      | M/I A/M L N/A     | Y           |            |            |                |                |
| 1       | Win Int Sash         |      | M/I A/M L N/A     | Y           |            |            |                |                |
| 2       | Exterior Sill        |      | M/I SF L N/A      | Y           |            |            |                |                |
| 3       | Part Bead            |      | M/I L N/A         | Y           |            |            |                |                |
| 4       | Blind Stop           |      | M/I SF L N/A      | Y           |            |            |                |                |
|         | Win Ext Sash         |      | M/I L N/A         | Y           |            |            |                |                |
| A B     | Fireplace            |      | A/M L N/A         | Y           |            |            |                |                |
| C D     | Mantle               |      | A/M L N/A         | Y           |            |            |                |                |
| A B C D | Win Above 5'         |      | A/M L N/A         | Y           |            |            |                |                |
|         | Ceiling Molding      |      | A/M L N/A         | Y           |            |            |                |                |
| A       | Huber Sill           |      | A/M L N/A         | Y           |            |            |                |                |
|         |                      |      | A/M L N/A         | Y           |            |            |                |                |
|         |                      |      | A/M L N/A         | Y           |            |            |                |                |

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |



(b) (6)

09-20-2012

Page 16 of 25

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 917 Main St

Apt #

\*\*\*\*\*

City: Vineyard Haven, MA 02568

STAIRCASE 1st to 2nd

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A B  | Up Walls             | 0.8  | A/M L N/A         | Y           |            |            |                |                |
| A B  | Low Walls            |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Baseboards           | 1.7  | A/M L N/A         | Y           |            |            |                |                |
| A B  | Chair Rail           |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Radiator             | 1.1  | A/M L N/A         | Y           |            |            |                |                |
|      | Floor                | 0.6  | A/M L N/A         | Y           |            |            |                |                |
|      | Ceiling              | 0.12 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door 1st             | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          | 4.2  | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            | 1.9  | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            | 0.3  | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door 1st             | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          | 1.9  | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            | 7.1  | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            | 0.02 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          | 3.1  | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            | 0.6  | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            | 0.01 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          | 2.6  | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            | 2.8  | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            | 0.01 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
|      | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
|      | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A    | Closet Door          |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Cl Casing            |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Closet Jamb          |      | A/M L N/A         | Y           |            |            |                |                |
| D    | Closet Walls         |      | A/M L N/A         | Y           |            |            |                |                |
|      | Cl Baseboard         |      | A/M L N/A         | Y           |            |            |                |                |
| 1    | Closet Pole          |      | A/M L N/A         | Y           |            |            |                |                |
| 2    | Closet Shelf         |      | A/M L N/A         | Y           |            |            |                |                |
| 3    | Cl Supports          |      | A/M L N/A         | Y           |            |            |                |                |
| 4    | Closet Floor         |      | A/M L N/A         | Y           |            |            |                |                |
|      | Closet Ceiling       |      | A/M L N/A         | Y           |            |            |                |                |

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A    | Window Sill          | 3.1  | A/M L N/A         | Y           |            |            |                |                |
| B    | Win Apron            | 3.0  | A/M L N/A         | Y           |            |            |                |                |
| C    | Win Casing           | 3.6  | A/M L N/A         | Y           |            |            |                |                |
| D    | Header Stop          | 0.01 | A/M L N/A         | Y           |            |            |                |                |
|      | Int Stops            | 0.01 | A/M L N/A         | Y           |            |            |                |                |
| 1    | Win Int Sash         | 0.01 | A/M L N/A         | Y           |            |            |                |                |
| 2    | Exterior Sill        | 4.5  | A/M L N/A         | Y           |            |            |                |                |
| 3    | Part Bead            | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| 4    | Blind Stop           | 4.6  | A/M L N/A         | Y           |            |            |                |                |
|      | Win Ext Sash         | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A    | Window Sill          |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Win Apron            |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| D    | Header Stop          |      | A/M L N/A         | Y           |            |            |                |                |
|      | Int Stops            |      | A/M L N/A         | Y           |            |            |                |                |
| 1    | Win Int Sash         |      | A/M L N/A         | Y           |            |            |                |                |
| 2    | Exterior Sill        |      | A/M SF L N/A      | Y           |            |            |                |                |
| 3    | Part Bead            |      | A/M L N/A         | Y           |            |            |                |                |
| 4    | Blind Stop           |      | A/M SF L N/A      | Y           |            |            |                |                |
|      | Win Ext Sash         |      | A/M L N/A         | Y           |            |            |                |                |
|      | Mevel Post           | 0.00 | A/M L N/A         | Y           |            |            |                |                |
|      | Railing Cap          | 0.01 | A/M L N/A         | Y           |            |            |                |                |
|      | Handrail             |      | A/M L N/A         | Y           |            |            |                |                |
|      | Balusters            | 0.01 | A/M L N/A         | Y           |            |            |                |                |
|      | Lower rail           |      | A/M L N/A         | Y           |            |            |                |                |
|      | Treads               | 0.6  | A/M L N/A         | Y           |            |            |                |                |
|      | Risers               | 22.4 | A/M L N/A         | Y           |            |            |                |                |
|      | Slinger              | 22.4 | A/M L N/A         | Y           |            |            |                |                |
|      | Floor Edge           | 24.1 | A/M L N/A         | Y           |            |            |                |                |
|      | Floor Casing         | 22.4 | A/M L N/A         | Y           |            |            |                |                |
| A    | Win Apron            | 16.2 | A/M L N/A         | Y           |            |            |                |                |

COMMENTS / STRUCTURAL DEFECTS:

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

(b) (6)

09-20-2012

Page 17 of 25

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property:

917 Main St

Apt #: AAAAAA

City: Vineyard Haven, MA 02588

STAIRCASE 137 TO B3m1

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH | SIDE                           | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|--------------------------------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A B  | Up Walls             | 0.3  | A/M L N/A         | Y           |            |            |                |                | A                              | Window Sill          | NL   | M/A A/M L N/A     | Y           |            |            |                |                |
| A B  | Low Walls            | 17.6 | A/M L N/A         | Y           |            |            |                |                | B                              | Win Apron            |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Baseboards           |      | A/M L N/A         | Y           |            |            |                |                | C                              | Win Casing           | NL   | A/M L N/A         | Y           |            |            |                |                |
| A B  | SCREEN Window        | 4.6  | A/M L N/A         | Y           |            |            |                |                | D                              | Header Stop          |      | M/A A/M L N/A     | Y           |            |            |                |                |
| A B  | Radiator             |      | A/M L N/A         | Y           |            |            |                |                |                                | Int Stops            |      | M/A A/M L N/A     | Y           |            |            |                |                |
|      | Floor                | 4.3  | A/M L N/A         | Y           |            |            |                |                | 1                              | Win Int Sash         | NL   | M/A A/M L N/A     | Y           |            |            |                |                |
|      | Ceiling              | 0.0  | A/M L N/A         | Y           |            |            |                |                | 2                              | Exterior Sill        | VR   | M/A SF L N/A      | Y           |            |            |                |                |
| A B  | Door (5-1)           | 0.01 | A/M L N/A         | Y           |            |            |                |                | 3                              | Part Bead            | VR   | M/A L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          | 3.6  | A/M L N/A         | Y           |            |            |                |                | 4                              | Blind Stop           |      | M/A SF L N/A      | Y           |            |            |                |                |
| 1 2  | Door Jamb            | 7.6  | A/M L N/A         | Y           |            |            |                |                |                                | Win Ext Sash         | VR   | M/A L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            |      | A/M L N/A         | Y           |            |            |                |                | A                              | Window Sill          |      | M/A A/M L N/A     | Y           |            |            |                |                |
| A B  | Door                 |      | A/M L N/A         | Y           |            |            |                |                | B                              | Win Apron            |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                | C                              | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                | D                              | Header Stop          |      | M/A A/M L N/A     | Y           |            |            |                |                |
| 3 4  | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |                                | Int Stops            |      | M/A A/M L N/A     | Y           |            |            |                |                |
| A B  | Door                 |      | A/M L N/A         | Y           |            |            |                |                | 1                              | Win Int Sash         |      | M/A A/M L N/A     | Y           |            |            |                |                |
| C D  | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                | 2                              | Exterior Sill        |      | M/A SF L N/A      | Y           |            |            |                |                |
| 1 2  | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                | 3                              | Part Bead            |      | M/A L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            |      | A/M L N/A         | Y           |            |            |                |                | 4                              | Blind Stop           |      | M/A SF L N/A      | Y           |            |            |                |                |
| A B  | Door                 |      | A/M L N/A         | Y           |            |            |                |                |                                | Win Ext Sash         |      | M/A L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |                                | Newel Post           |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |                                | CORNER               | 17.6 | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |                                | Handrail             | 0.01 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 |      | A/M L N/A         | Y           |            |            |                |                |                                | Balusters            |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |                                | Lower rail           |      | A/M L N/A         | Y           |            |            |                |                |
| #    | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |                                | Treads               | 13.1 | A/M L N/A         | Y           |            |            |                |                |
|      | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |                                | Risers               | 18.6 | A/M L N/A         | Y           |            |            |                |                |
| A    | Closet Door          |      | A/M L N/A         | Y           |            |            |                |                |                                | Stringer             | 12.6 | A/M L N/A         | Y           |            |            |                |                |
| B    | Cl Casing            |      | A/M L N/A         | Y           |            |            |                |                |                                | Floor Edge           | 2.6  | A/M L N/A         | Y           |            |            |                |                |
| C    | Closet Jamb          |      | A/M L N/A         | Y           |            |            |                |                |                                | Floor Casing         | 0.01 | A/M L N/A         | Y           |            |            |                |                |
| D    | Closet Walls         |      | A/M L N/A         | Y           |            |            |                |                | 20                             | WOOD SLATS           | 14.0 | M/A A/M L N/A     | Y           |            |            |                |                |
|      | Cl Baseboard         |      | A/M L N/A         | Y           |            |            |                |                | COMMENTS / STRUCTURAL DEFECTS: |                      |      |                   |             |            |            |                |                |
| 1    | Closet Pole          |      | A/M L N/A         | Y           |            |            |                |                | (1) FOUNDATION SILL AND JOINT  |                      |      |                   |             |            |            |                |                |
| 2    | Closet Shelf         |      | A/M L N/A         | Y           |            |            |                |                |                                |                      |      |                   |             |            |            |                |                |
| 3    | Cl Supports          |      | A/M L N/A         | Y           |            |            |                |                |                                |                      |      |                   |             |            |            |                |                |
| 4    | Closet Floor         |      | A/M L N/A         | Y           |            |            |                |                |                                |                      |      |                   |             |            |            |                |                |
|      | Closet Ceiling       |      | A/M L N/A         | Y           |            |            |                |                |                                |                      |      |                   |             |            |            |                |                |



(b) (6)

09-20-2012

Page 18 of 25

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 917 Main St.

Apt #: AAAAAA

City: Vineyard Haven, MA 02568

## BASEMENT/LAUNDRY AREA

| SIDE                                                                               | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------------------------------------------------------------------------------------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| AB                                                                                 | Walls                | NC   | A/M L N/A         | Y           |            |            |                |                |
| AB                                                                                 | Walls                | NC   | A/M L N/A         | Y           |            |            |                |                |
| AB                                                                                 | Walls (2)            | 2.4  | (A/M) L N/A       | Y           |            |            |                |                |
| AB                                                                                 | Walls                | /    | A/M L N/A         | Y           |            |            |                |                |
| AB                                                                                 | Baseboards           | /    | A/M L N/A         | Y           |            |            |                |                |
| AB                                                                                 | Chair rails          | /    | A/M L N/A         | Y           |            |            |                |                |
| AB                                                                                 | Floor                | NC   | A/M L N/A         | Y           |            |            |                |                |
| AB                                                                                 | Ceiling              |      | A/M L N/A         | Y           |            |            |                |                |
| AB                                                                                 | Chimney              | NC   | A/M L N/A         | Y           |            |            |                |                |
| AB                                                                                 | Support Column       | NC   | A/M L N/A         | Y           |            |            |                |                |
| AB                                                                                 | Door                 | 18.6 | (A/M) L N/A       | Y           |            |            |                |                |
| CD                                                                                 | Door Casing          | 19.0 | (A/M) L N/A       | Y           |            |            |                |                |
| 12                                                                                 | Door Jamb            | 19.1 | (A/M) L N/A       | Y           |            |            |                |                |
| 34                                                                                 | Threshold            | /    | A/M L N/A         | Y           |            |            |                |                |
| AB                                                                                 | Door (1)             | 13.6 | (A/M) L N/A       | Y           |            |            |                |                |
| CD                                                                                 | Door Casing          | /    | A/M L N/A         | Y           |            |            |                |                |
| 2                                                                                  | Door Jamb            | 15.6 | (A/M) L N/A       | Y           |            |            |                |                |
| 34                                                                                 | Threshold            | /    | A/M L N/A         | Y           |            |            |                |                |
| AB                                                                                 | Door                 | /    | A/M L N/A         | Y           |            |            |                |                |
| CD                                                                                 | Door Casing          | /    | A/M L N/A         | Y           |            |            |                |                |
| 12                                                                                 | Door Jamb            | /    | A/M L N/A         | Y           |            |            |                |                |
| 34                                                                                 | Threshold            | /    | A/M L N/A         | Y           |            |            |                |                |
| AB                                                                                 | Cabinets             | 19.6 | (A/M) L N/A       | Y           |            |            |                |                |
| AB                                                                                 | Benches              | /    | A/M L N/A         | Y           |            |            |                |                |
| CD                                                                                 | Supports             | /    | A/M L N/A         | Y           |            |            |                |                |
| A                                                                                  | Closet Door          | /    | A/M L N/A         | Y           |            |            |                |                |
| B                                                                                  | Cl Casing            | /    | A/M L N/A         | Y           |            |            |                |                |
| C                                                                                  | Closet Jamb          | /    | A/M L N/A         | Y           |            |            |                |                |
| D                                                                                  | Closet Walls         | /    | A/M L N/A         | Y           |            |            |                |                |
|                                                                                    | Cl Baseboard         | /    | A/M L N/A         | Y           |            |            |                |                |
| 1                                                                                  | Closet Pole          | /    | A/M L N/A         | Y           |            |            |                |                |
| 2                                                                                  | Closet Shelf         | /    | A/M L N/A         | Y           |            |            |                |                |
| 3                                                                                  | Cl Supports          | /    | A/M L N/A         | Y           |            |            |                |                |
| 4                                                                                  | Closet Floor         | /    | A/M L N/A         | Y           |            |            |                |                |
|                                                                                    | Closet Ceiling       | /    | A/M L N/A         | Y           |            |            |                |                |
| Comments/Structural Defects:<br>(1) outside of D door<br>(2) Bottom side of stairs |                      |      |                   |             |            |            |                |                |

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| AB   | Pipes                | /    | A/M L N/A         | Y           |            |            |                |                |
| AB   | Sink                 | /    | A/M L N/A         | Y           |            |            |                |                |
| AB   | Drainpipe            | /    | A/M L N/A         | Y           |            |            |                |                |
| AB   | Serviceboard         | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| AB   | Shelves              | /    | A/M L N/A         | Y           |            |            |                |                |
| CD   | Supports             | /    | A/M L N/A         | Y           |            |            |                |                |
| AB   | Shelves              | /    | A/M L N/A         | Y           |            |            |                |                |
| CD   | Supports             | /    | A/M L N/A         | Y           |            |            |                |                |
| AB   | Shelves              | /    | A/M L N/A         | Y           |            |            |                |                |
| CD   | Supports             | /    | A/M L N/A         | Y           |            |            |                |                |
|      | Window frame         | NC   | M/A A/M L N/A     | Y           |            |            |                |                |
| AB   | Window Sash          | VR   | M/A A/M L N/A     | Y           |            |            |                |                |
| CD   | Exterior Sill        | VR   | M/A A/M L N/A     | Y           |            |            |                |                |
| 12   | Part Bead            | /    | M/A A/M L N/A     | Y           |            |            |                |                |
| 34   | Win Ext Sash         | VR   | M/A A/M L N/A     | Y           |            |            |                |                |
|      | Window frame         | NC   | M/A A/M L N/A     | Y           |            |            |                |                |
| AB   | Window Sash          | VR   | M/A A/M L N/A     | Y           |            |            |                |                |
| CD   | Exterior Sill        | VR   | M/A A/M L N/A     | Y           |            |            |                |                |
| 12   | Part Bead            | /    | M/A A/M L N/A     | Y           |            |            |                |                |
| 34   | Win Ext Sash         | VR   | M/A A/M L N/A     | Y           |            |            |                |                |
|      | Window frame         | NC   | M/A A/M L N/A     | Y           |            |            |                |                |
| AB   | Window Sash          | VR   | M/A A/M L N/A     | Y           |            |            |                |                |
| CD   | Exterior Sill        | VR   | M/A A/M L N/A     | Y           |            |            |                |                |
| 12   | Part Bead            | /    | M/A A/M L N/A     | Y           |            |            |                |                |
| 34   | Win Ext Sash         | VR   | M/A A/M L N/A     | Y           |            |            |                |                |
|      | Window frame         | /    | M/A A/M L N/A     | Y           |            |            |                |                |
| AB   | Window Sash          | /    | M/A A/M L N/A     | Y           |            |            |                |                |
| CD   | Exterior Sill        | VR   | M/A A/M L N/A     | Y           |            |            |                |                |
| 12   | Part Bead            | /    | M/A A/M L N/A     | Y           |            |            |                |                |
| 34   | Win Ext Sash         | VR   | M/A A/M L N/A     | Y           |            |            |                |                |
|      | Window frame         | /    | M/A A/M L N/A     | Y           |            |            |                |                |
| AB   | Window Sash          | /    | M/A A/M L N/A     | Y           |            |            |                |                |
| CD   | Exterior Sill        | /    | M/A A/M L N/A     | Y           |            |            |                |                |
| 12   | Part Bead            | /    | M/A A/M L N/A     | Y           |            |            |                |                |
| 34   | Win Ext Sash         | /    | M/A A/M L N/A     | Y           |            |            |                |                |
|      | Newel Posts          | /    | A/M L N/A         | Y           |            |            |                |                |
| AB   | Handrail             | /    | A/M L N/A         | Y           |            |            |                |                |
| CD   | Balusters            | /    | A/M L N/A         | Y           |            |            |                |                |
| 12   | Board Rail           | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| 34   | Treads               | 0.01 | A/M L N/A         | Y           |            |            |                |                |
|      | Risers               | 0.00 | A/M L N/A         | Y           |            |            |                |                |
|      | Stringer             | 0.02 | A/M L N/A         | Y           |            |            |                |                |
| AB   | Oil Tank             | 0.00 | L N/A             | Y           |            |            |                |                |

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURED LOOSE PAINT<br>(MORE THAN 289 SQ. IN.) | IC<br>DATE | IC<br>METHOD | SIDE | LOCATION | MEASURED LOOSE PAINT<br>(MORE THAN 289 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|------|----------|-------------------------------------------------|------------|--------------|
|------|----------|-------------------------------------------------|------------|--------------|------|----------|-------------------------------------------------|------------|--------------|

(b) (6)

9-20-2012

Page 19 of 25

Inspector (print)

Lic #

Signature

Date

(b) (6)

Asst Assessor (print)

Lic #

Signature

Date

Address of Property:

917

Main St

Apt #:

City:

VINEYARD

HAUEN, MA 02568

Avenue Room

| SIDE                           | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH | SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|--------------------------------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A B                            | Up Walls             | 2.62 | A/M L N/A         | Y           |            |            |                |                | A    | Window Sill          | 2.8  | M/L L N/A         | Y           |            |            |                |                |
| A B                            | Low Walls            |      | A/M L N/A         | Y           |            |            |                |                | B    | Win Apron            | 0.15 | A/M L N/A         | Y           |            |            |                |                |
| A B                            | Baseboards           | 1.61 | A/M L N/A         | Y           |            |            |                |                | C    | Win Casing           | 4.6  | M/L L N/A         | Y           |            |            |                |                |
| A B                            | Chair Rail           |      | A/M L N/A         | Y           |            |            |                |                | D    | Header Slop          | 0.00 | M/L A/M L N/A     | Y           |            |            |                |                |
| A B                            | Radiator             |      | A/M L N/A         | Y           |            |            |                |                |      | Int Stops            | 0.01 | M/L A/M L N/A     | Y           |            |            |                |                |
| A B                            | Floor                | 1.05 | A/M L N/A         | Y           |            |            |                |                | 1    | Win Int Sash         | 0.00 | M/L A/M L N/A     | Y           |            |            |                |                |
| A B                            | Ceiling              | N/A  | A/M L N/A         | Y           |            |            |                |                | 2    | Exterior Sill        | 1.4  | M/L SF L N/A      | Y           |            |            |                |                |
| A B                            | Door                 |      | A/M L N/A         | Y           |            |            |                |                | 3    | Part Bead            | 0.00 | M/L L N/A         | Y           |            |            |                |                |
| C D                            | Door Casing          | 0.15 | A/M L N/A         | Y           |            |            |                |                | 4    | Blind Slop           | 1.3  | M/L SF L N/A      | Y           |            |            |                |                |
| 1 2                            | Door Jamb            | 0.22 | A/M L N/A         | Y           |            |            |                |                |      | Win Ext Sash         | 0.02 | M/L L N/A         | Y           |            |            |                |                |
| 3 4                            | Threshold            | 0.15 | A/M L N/A         | Y           |            |            |                |                | A    | Window Sill          |      | M/L A/M L N/A     | Y           |            |            |                |                |
| A B                            | Door                 |      | A/M L N/A         | Y           |            |            |                |                | B    | Win Apron            |      | A/M L N/A         | Y           |            |            |                |                |
| C D                            | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                | C    | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2                            | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                | D    | Header Slop          |      | M/L A/M L N/A     | Y           |            |            |                |                |
| 3 4                            | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |      | Int Stops            |      | M/L A/M L N/A     | Y           |            |            |                |                |
| A B                            | Door                 |      | A/M L N/A         | Y           |            |            |                |                | 1    | Win Int Sash         |      | M/L A/M L N/A     | Y           |            |            |                |                |
| C D                            | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                | 2    | Exterior Sill        |      | M/L SF L N/A      | Y           |            |            |                |                |
| 1 2                            | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                | 3    | Part Bead            |      | M/L L N/A         | Y           |            |            |                |                |
| 3 4                            | Threshold            |      | A/M L N/A         | Y           |            |            |                |                | 4    | Blind Slop           |      | M/L SF L N/A      | Y           |            |            |                |                |
| A B                            | Door                 |      | A/M L N/A         | Y           |            |            |                |                |      | Win Ext Sash         |      | M/L L N/A         | Y           |            |            |                |                |
| C D                            | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                | A    | Window Sill          |      | M/L A/M L N/A     | Y           |            |            |                |                |
| 1 2                            | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                | B    | Win Apron            |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4                            | Threshold            |      | A/M L N/A         | Y           |            |            |                |                | C    | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| A                              | Closet Door          |      | A/M L N/A         | Y           |            |            |                |                | D    | Header Slop          |      | M/L A/M L N/A     | Y           |            |            |                |                |
| B                              | Ci Casing            |      | A/M L N/A         | Y           |            |            |                |                |      | Int Stops            |      | M/L A/M L N/A     | Y           |            |            |                |                |
| C                              | Closet Jamb          |      | A/M L N/A         | Y           |            |            |                |                | 1    | Win Int Sash         |      | M/L A/M L N/A     | Y           |            |            |                |                |
| D                              | Closet Walls         |      | A/M L N/A         | Y           |            |            |                |                | 2    | Exterior Sill        |      | M/L SF L N/A      | Y           |            |            |                |                |
|                                | Ci Baseboard         |      | A/M L N/A         | Y           |            |            |                |                | 3    | Part Bead            |      | M/L L N/A         | Y           |            |            |                |                |
| 1                              | Closet Pole          |      | A/M L N/A         | Y           |            |            |                |                | 4    | Blind Slop           |      | M/L SF L N/A      | Y           |            |            |                |                |
| 2                              | Closet Shelf         |      | A/M L N/A         | Y           |            |            |                |                |      | Win Ext Sash         |      | M/L L N/A         | Y           |            |            |                |                |
| 3                              | Ci Supports          |      | A/M L N/A         | Y           |            |            |                |                | A B  | Fireplace            |      | A/M L N/A         | Y           |            |            |                |                |
| 4                              | Closet Floor         |      | A/M L N/A         | Y           |            |            |                |                | C D  | Mantle               |      | A/M L N/A         | Y           |            |            |                |                |
|                                | Closet Ceiling       |      | A/M L N/A         | Y           |            |            |                |                | A B  | Win Above 5'         |      | A/M L N/A         | Y           |            |            |                |                |
| COMMENTS / STRUCTURAL DEFECTS: |                      |      |                   |             |            |            |                |                |      | Ceiling Molding      |      | A/M L N/A         | Y           |            |            |                |                |
|                                |                      |      |                   |             |            |            |                |                |      |                      |      | A/M L N/A         | Y           |            |            |                |                |
|                                |                      |      |                   |             |            |            |                |                |      |                      |      | A/M L N/A         | Y           |            |            |                |                |
|                                |                      |      |                   |             |            |            |                |                |      |                      |      | A/M L N/A         | Y           |            |            |                |                |

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD | SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |      |          |                                                 |            |              |
|      |          |                                                 |            |              |      |          |                                                 |            |              |



(b) (6)

Date \_\_\_\_\_

Page 20 of 25

Lic #

Date \_\_\_\_\_

(b) (6)

Lic #

Date \_\_\_\_\_

City: VINEYARD HAVEN MA 02568

PORCH (A) B C D (circle one) (1st fl) 2nd fl 3rd fl 4th fl (circle one)

| SIDE | LOCATION/<br>SURFACE | LEAD      | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |  |
|------|----------------------|-----------|-------------------|-------------|------------|------------|----------------|----------------|--|
| A B  | Siding               | 0.00      | L N/A             | Y           |            |            |                |                |  |
| C D  | Corner Boards        | 0.21      | L N/A             | Y           |            |            |                |                |  |
| E F  | Upper Trim           | N/A       | L N/A             | Y           |            |            |                |                |  |
|      | Ceiling              | N/A       | L N/A             | Y           |            |            |                |                |  |
|      | Joists               | N/A       | L N/A             | Y           |            |            |                |                |  |
| A    | Door                 | 0.30      | A/M L N/A         | Y           |            |            |                |                |  |
| B    | Storm Door           | 0.30      | A/M L N/A         | Y           |            |            |                |                |  |
| C    | Door Casing          | 0.40      | A/M L N/A         | Y           |            |            |                |                |  |
| D    | Door Jamb            | 2.6       | A/M L N/A         | Y           |            |            |                |                |  |
| 12   | Threshold            | 1.6       | A/M L N/A         | Y           |            |            |                |                |  |
| 34   | Kickplate            | 1.4       | A/M L N/A         | Y           |            |            |                |                |  |
| A    | Door                 | /         | A/M L N/A         | Y           |            |            |                |                |  |
| B    | Storm Door           |           | A/M L N/A         | Y           |            |            |                |                |  |
| C    | Door Casing          |           | A/M L N/A         | Y           |            |            |                |                |  |
| D    | Door Jamb            |           | A/M L N/A         | Y           |            |            |                |                |  |
| 12   | Threshold            |           | A/M L N/A         | Y           |            |            |                |                |  |
| 34   | Kickplate            |           | A/M L N/A         | Y           |            |            |                |                |  |
| A B  | Window Sill          | /         | A/M L N/A         | Y           |            |            |                |                |  |
| C D  | Win Casing           |           | A/M L N/A         | Y           |            |            |                |                |  |
| 12   | Window Sash          |           | A/M L N/A         | Y           |            |            |                |                |  |
| 34   | Mullions             |           | A/M L N/A         | Y           |            |            |                |                |  |
| A B  | Window Sill          |           | /                 | A/M L N/A   | Y          |            |                |                |  |
| C D  | Win Casing           |           |                   | A/M L N/A   | Y          |            |                |                |  |
| 12   | Window Sash          | A/M L N/A |                   | Y           |            |            |                |                |  |
| 34   | Mullions             | A/M L N/A |                   | Y           |            |            |                |                |  |
| A B  | Window Sill          | /         | A/M L N/A         | Y           |            |            |                |                |  |
| C D  | Win Casing           |           | A/M L N/A         | Y           |            |            |                |                |  |
| 12   | Window Sash          |           | A/M L N/A         | Y           |            |            |                |                |  |
| 34   | Mullions             |           | A/M L N/A         | Y           |            |            |                |                |  |
| A B  | Window Sill          | /         | A/M L N/A         | Y           |            |            |                |                |  |
| C D  | Win Casing           |           | A/M L N/A         | Y           |            |            |                |                |  |
| 12   | Window Sash          |           | A/M L N/A         | Y           |            |            |                |                |  |
| 34   | Mullions             |           | A/M L N/A         | Y           |            |            |                |                |  |

COMMENTS / STRUCTURAL DEFECTS:

[illegible]

COMMENTS / STRUCTURAL DEFECTS:

**EXCLUDED SURFACES:** Surfaces listed in these boxes can be made intact only by a licensed dealer.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 1440 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|--------------------------------------------------|------------|--------------|
|      |          |                                                  |            |              |
|      |          |                                                  |            |              |
|      |          |                                                  |            |              |

| SIDE | LOCATION | MEASURE; LOOSE PAINT<br>(MORE THAN 285 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

(b) (6)

09-20-2012

Page 21 of 25

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 917 Main St.

Apt #: AAAAAA

City: Vineyard Haven, MA 02568

PORCH A B C D (circle one) (1st) 2nd fl 3rd fl 4th fl (circle one)

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A B  | Siding               | 0.1  | L N/A             | Y           |            |            |                |                |
| C D  | Corner Boards        | 1.4  | L N/A             | Y           |            |            |                |                |
|      | Upper Trim           | N/A  | L N/A             | Y           |            |            |                |                |
|      | Ceiling              | N/A  | L N/A             | Y           |            |            |                |                |
|      | Joists               | N/A  | L N/A             | Y           |            |            |                |                |
| A    | Door                 | 2.3  | A/M L N/A         | Y           |            |            |                |                |
| B    | Storm Door           |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Door Casing          | 1.2  | A/M L N/A         | Y           |            |            |                |                |
| D    | Door Jamb            | 1.2  | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Threshold            | 1.2  | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Kickplate            | 1.3  | A/M L N/A         | Y           |            |            |                |                |
| A    | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Storm Door           |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| D    | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Kickplate            |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Window Sill          |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Window Sash          |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Mullions             |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Window Sill          | 1.5  | A/M L N/A         | Y           |            |            |                |                |
| C D  | Win Casing           | 1.4  | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Window Sash          | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Mullions             |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Window Sill          |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Window Sash          |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Mullions             |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Window Sill          |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Window Sash          |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Mullions             |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Window Sill          |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Window Sash          |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Mullions             |      | A/M L N/A         | Y           |            |            |                |                |

COMMENTS / STRUCTURAL DEFECTS:

COMMENTS / STRUCTURAL DEFECTS:

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 1440 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|--------------------------------------------------|------------|--------------|
|      |          |                                                  |            |              |
|      |          |                                                  |            |              |
|      |          |                                                  |            |              |

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |



(b) (6)

09-20-2012

Page 22 of 25

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 917 Main St.

Apt #: AAAAAA

City: Vineyard Haven, MA 02568

## EXTERIOR A Side

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A    | Siding               | 0.5  | L N/A             | Y           |            |            |                |                |
|      | Corner Boards        | 1.0  | L N/A             | Y           |            |            |                |                |
|      | Lower Trim           |      | L N/A             | Y           |            |            |                |                |
|      | Upper Trim           | 0.5  | L N/A             | Y           |            |            |                |                |
|      | Win Above 5'         | NA   | L N/A             | Y           |            |            |                |                |
|      | Porch Above 5'       |      | L N/A             | Y           |            |            |                |                |
| A    | Storm Door           |      | A/M L N/A         | Y           |            |            |                |                |
|      | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
|      | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
|      | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
|      | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
|      | Kickplate            |      | A/M L N/A         | Y           |            |            |                |                |
| A    | Storm Door           |      | A/M L N/A         | Y           |            |            |                |                |
|      | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
|      | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
|      | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
|      | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
|      | Kickplate            |      | A/M L N/A         | Y           |            |            |                |                |
| A    | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
|      | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
|      | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
|      | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
|      | Kickplate            |      | A/M L N/A         | Y           |            |            |                |                |
|      | Window Sill          | 1.5  | A/M L N/A         | Y           |            |            |                |                |
| A    | Win Casing           | 1.6  | A/M L N/A         | Y           |            |            |                |                |
|      | Window Sash          | 0.01 | A/M L N/A         | Y           |            |            |                |                |
|      | Window Sill          |      | A/M L N/A         | Y           |            |            |                |                |
|      | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
|      | Window Sash          |      | A/M L N/A         | Y           |            |            |                |                |
|      | Window Sill          |      | A/M L N/A         | Y           |            |            |                |                |
| A    | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
|      | Window Sash          |      | A/M L N/A         | Y           |            |            |                |                |
|      | Window Sill          |      | A/M L N/A         | Y           |            |            |                |                |
|      | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
|      | Window Sash          |      | A/M L N/A         | Y           |            |            |                |                |
|      | Lamp Post            |      | L N/A             | Y           |            |            |                |                |

COMMENTS / STRUCTURAL DEFECTS:

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A    | Window Sill          |      | A/M L N/A         | Y           |            |            |                |                |
|      | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
|      | Window Sash          |      | A/M L N/A         | Y           |            |            |                |                |
|      | Collar Win Sill      | 0.00 | A/M L N/A         | Y           |            |            |                |                |
|      | Cel Win Sash         | 0.02 | A/M L N/A         | Y           |            |            |                |                |
|      | Cel Win Frame        | 0.03 | A/M L N/A         | Y           |            |            |                |                |
| A    | Screen Frame         |      | A/M L N/A         | Y           |            |            |                |                |
|      | Collar Win Sill      |      | A/M L N/A         | Y           |            |            |                |                |
|      | Cel Win Sash         |      | A/M L N/A         | Y           |            |            |                |                |
|      | Cel Win Frame        |      | A/M L N/A         | Y           |            |            |                |                |
|      | Screen Frame         |      | A/M L N/A         | Y           |            |            |                |                |
|      | Collar Win Sill      |      | A/M L N/A         | Y           |            |            |                |                |
| A    | Cel Win Sash         |      | A/M L N/A         | Y           |            |            |                |                |
|      | Cel Win Frame        |      | A/M L N/A         | Y           |            |            |                |                |
|      | Screen Frame         |      | A/M L N/A         | Y           |            |            |                |                |
|      | Collar Win Sill      |      | A/M L N/A         | Y           |            |            |                |                |
|      | Cel Win Sash         |      | A/M L N/A         | Y           |            |            |                |                |
|      | Cel Win Frame        |      | A/M L N/A         | Y           |            |            |                |                |
| A    | Screen Frame         |      | A/M L N/A         | Y           |            |            |                |                |
|      | Foundation           | 0.05 | L N/A             | Y           |            |            |                |                |
|      | Bulkhead             |      | A/M L N/A         | Y           |            |            |                |                |
|      | Fences               | 0.03 | A/M L N/A         | Y           |            |            |                |                |
|      | Shutters             |      | A/M L N/A         | Y           |            |            |                |                |
|      | Lower post           |      | A/M L N/A         | Y           |            |            |                |                |
| A    | Railing Cap          |      | A/M L N/A         | Y           |            |            |                |                |
|      | Handrail             |      | A/M L N/A         | Y           |            |            |                |                |
|      | Balusters            |      | A/M L N/A         | Y           |            |            |                |                |
|      | Lower Rail           |      | A/M L N/A         | Y           |            |            |                |                |
|      | Treads               |      | A/M L N/A         | Y           |            |            |                |                |
|      | Risers               |      | A/M L N/A         | Y           |            |            |                |                |
| A    | Stringer             |      | A/M L N/A         | Y           |            |            |                |                |
|      | Lattice              |      | A/M L N/A         | Y           |            |            |                |                |
|      | FLA- POLE            | 0.03 | L N/A             | Y           |            |            |                |                |
|      | Elec Conduit         |      | L N/A             | Y           |            |            |                |                |
|      | Oil Fill Pipe        | 0.03 | L N/A             | Y           |            |            |                |                |
|      | Overhang Trim        |      | A/M L N/A         | Y           |            |            |                |                |

Excluded Surfaces: Surfaces listed in this box can be made  
Intact only by a licensed deleader

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 1440 SQ. IN.) | IC<br>DATE | IC<br>METH |
|------|----------|--------------------------------------------------|------------|------------|
| A    |          |                                                  |            |            |
| A    |          |                                                  |            |            |
| A    |          |                                                  |            |            |
| A    |          |                                                  |            |            |

## Soil Test Results

(Must be less than 400 ppm for play area / 1200 ppm for bare soil)

| LOCATION  | AREA MEASUREMENT<br>(Square Feet) | RESULT<br>(PPM) | REMED<br>DATE | REMED<br>METH |
|-----------|-----------------------------------|-----------------|---------------|---------------|
| Play Area |                                   |                 |               |               |
| Bare Soil |                                   |                 |               |               |
| Comments: |                                   |                 |               |               |

(b) (6)

09-20-2012

Page 23 Of 25

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 917 Main St.

Apt #: AAAAAA

City: Vineyard Haven, MA 02568

EXTERIOR B Side

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| B    | Siding               | 0.1  | L N/A             | Y           |            |            |                |                |
| B    | Corner Boards        | 1.2  | L N/A             | Y           |            |            |                |                |
| B    | Lower Trim           | 0.5  | L N/A             | Y           |            |            |                |                |
| B    | Upper Trim           | 0.5  | L N/A             | Y           |            |            |                |                |
| B    | Win Above 5'         | N/A  | L N/A             | Y           |            |            |                |                |
| B    | Porch Above 5'       |      | L N/A             | Y           |            |            |                |                |
| B    | Storm Door           |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Door                 | 3.3  | A/M L N/A         | Y           |            |            |                |                |
| B    | Door Casing          | 3.4  | A/M L N/A         | Y           |            |            |                |                |
| B    | Door Jamb            | N/A  | A/M L N/A         | Y           |            |            |                |                |
| B    | Threshold            | 0.6  | A/M L N/A         | Y           |            |            |                |                |
| B    | Kickplate            |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Storm Door           |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Kickplate            |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Window Sill          |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Window Sash          |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Window Sill          |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Window Sash          |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Window Sill          |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Window Sash          |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Lamp Post            |      | L N/A             | Y           |            |            |                |                |

COMMENTS / STRUCTURAL DEFECTS:

Excluded Surfaces: Surfaces listed in this box can be made  
intact only by a licensed deleader

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 1440 SQ. IN.) | IC<br>DATE | IC<br>METH |
|------|----------|--------------------------------------------------|------------|------------|
| B    |          |                                                  |            |            |
| B    |          |                                                  |            |            |
| B    |          |                                                  |            |            |
| B    |          |                                                  |            |            |

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| B    | Window Sill          |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Window Sash          |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Cellar Win Sill      | 0.2  | A/M L N/A         | Y           |            |            |                |                |
| B    | Cell Win Sash        | 0.2  | A/M L N/A         | Y           |            |            |                |                |
| B    | Cell Win Frame       | 0.2  | A/M L N/A         | Y           |            |            |                |                |
| B    | Screen Frame         |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Cellar Win Sill      |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Cell Win Sash        |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Cell Win Frame       |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Screen Frame         |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Cellar Win Sill      |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Cell Win Sash        |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Cell Win Frame       |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Screen Frame         |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Cellar Win Sill      |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Cell Win Sash        |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Cell Win Frame       |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Screen Frame         |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Foundation           | 0.3  | L N/A             | Y           |            |            |                |                |
| B    | Bulkhead             |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Fences               |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Shutters             |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Newel post           |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Railing Cap          |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Handrail             |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Balusters            |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Lower Rail           |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Treads               |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Risers               |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Stringer             |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Lattice              |      | A/M L N/A         | Y           |            |            |                |                |
| B    |                      |      | L N/A             | Y           |            |            |                |                |
| B    | Elec Conduit         |      | L N/A             | Y           |            |            |                |                |
| B    | Oil Fill Pipe        |      | L N/A             | Y           |            |            |                |                |
| B    | Overhang Trim        |      | A/M L N/A         | Y           |            |            |                |                |

Soil Test Results

(Must be less than 400 ppm for play area / 1200 ppm for bare soil)

| LOCATION  | AREA MEASUREMENT<br>(Square Feet) | RESULT<br>(PPM) | REMED<br>DATE | REMED<br>METH |
|-----------|-----------------------------------|-----------------|---------------|---------------|
| Play Area |                                   |                 |               |               |
| Bare Soil |                                   |                 |               |               |
| Comments: |                                   |                 |               |               |



(b) (6)

Inspector (print)

Lic #

Signature

09-20-2012

Page 24 of 25

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 917 Main St.

Apt #: 000000

City: Vineyard Haven, MA 02568

## EXTERIOR C Side

| SIDE | LOCATION/<br>SURFACE           | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|--------------------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| C    | Siding                         | 0.25 | L N/A             | Y           |            |            |                |                |
|      | Corner Boards                  | 0.25 | L N/A             | Y           |            |            |                |                |
|      | Lower Trim                     | 0.25 | L N/A             | Y           |            |            |                |                |
|      | Upper Trim                     | 0.25 | L N/A             | Y           |            |            |                |                |
|      | Win Above 5'                   | 0.25 | L N/A             | Y           |            |            |                |                |
|      | Porch Above 5'                 | 0.25 | L N/A             | Y           |            |            |                |                |
| C    | Storm Door                     |      | A/M L N/A         | Y           |            |            |                |                |
|      | Door                           |      | A/M L N/A         | Y           |            |            |                |                |
|      | Door Casing                    |      | A/M L N/A         | Y           |            |            |                |                |
|      | Door Jamb                      |      | A/M L N/A         | Y           |            |            |                |                |
|      | Threshold                      |      | A/M L N/A         | Y           |            |            |                |                |
|      | Kickplate                      |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Storm Door                     |      | A/M L N/A         | Y           |            |            |                |                |
|      | Door                           |      | A/M L N/A         | Y           |            |            |                |                |
|      | Door Casing                    |      | A/M L N/A         | Y           |            |            |                |                |
|      | Door Jamb                      |      | A/M L N/A         | Y           |            |            |                |                |
|      | Threshold                      |      | A/M L N/A         | Y           |            |            |                |                |
|      | Kickplate                      |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Storm Door                     |      | A/M L N/A         | Y           |            |            |                |                |
|      | Door                           |      | A/M L N/A         | Y           |            |            |                |                |
|      | Door Casing                    |      | A/M L N/A         | Y           |            |            |                |                |
|      | Door Jamb                      |      | A/M L N/A         | Y           |            |            |                |                |
|      | Threshold                      |      | A/M L N/A         | Y           |            |            |                |                |
|      | Kickplate                      |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Window Sill                    |      | A/M L N/A         | Y           |            |            |                |                |
|      | Win Casing                     |      | A/M L N/A         | Y           |            |            |                |                |
|      | Window Sash                    |      | A/M L N/A         | Y           |            |            |                |                |
|      | Window Sill                    |      | A/M L N/A         | Y           |            |            |                |                |
|      | Win Casing                     |      | A/M L N/A         | Y           |            |            |                |                |
|      | Window Sash                    |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Window Sill                    |      | A/M L N/A         | Y           |            |            |                |                |
|      | Win Casing                     |      | A/M L N/A         | Y           |            |            |                |                |
|      | Window Sash                    |      | A/M L N/A         | Y           |            |            |                |                |
|      | Window Sill                    |      | A/M L N/A         | Y           |            |            |                |                |
|      | Win Casing                     |      | A/M L N/A         | Y           |            |            |                |                |
|      | Window Sash                    |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Lamp Post                      |      | L N/A             | Y           |            |            |                |                |
|      | Foundation                     | 0.25 | L N/A             | Y           |            |            |                |                |
|      | Bulkhead                       |      | A/M L N/A         | Y           |            |            |                |                |
|      | Fences                         |      | A/M L N/A         | Y           |            |            |                |                |
|      | Shutters                       |      | A/M L N/A         | Y           |            |            |                |                |
|      | Newel post                     |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Railing Cap                    |      | A/M L N/A         | Y           |            |            |                |                |
|      | Handrail                       |      | A/M L N/A         | Y           |            |            |                |                |
|      | Balusters                      |      | A/M L N/A         | Y           |            |            |                |                |
|      | Lower Rail                     |      | A/M L N/A         | Y           |            |            |                |                |
|      | Treads                         |      | A/M L N/A         | Y           |            |            |                |                |
|      | Risers                         |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Stringer                       |      | A/M L N/A         | Y           |            |            |                |                |
|      | Lattice                        |      | A/M L N/A         | Y           |            |            |                |                |
|      | Elec Conduit                   |      | L N/A             | Y           |            |            |                |                |
|      | Oil Fill Pipe                  |      | L N/A             | Y           |            |            |                |                |
|      | Overhang Trim                  |      | A/M L N/A         | Y           |            |            |                |                |
|      | Comments / STRUCTURAL DEFECTS: |      |                   |             |            |            |                |                |

Excluded Surfaces: Surfaces listed in this box can be made intact only by a licensed deleader

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 1440 SQ. IN.) | IC<br>DATE | IC<br>METH |
|------|----------|--------------------------------------------------|------------|------------|
| C    |          |                                                  |            |            |
| C    |          |                                                  |            |            |
| C    |          |                                                  |            |            |
| C    |          |                                                  |            |            |

## Soil Test Results

(Must be less than 400 ppm for play area / 1200 ppm for bare soil)

| LOCATION  | AREA MEASUREMENT<br>(Square Feet) | RESULT<br>(PPM) | REMED<br>DATE | REMED<br>METH |
|-----------|-----------------------------------|-----------------|---------------|---------------|
| Play Area |                                   |                 |               |               |
| Bare Soil |                                   |                 |               |               |
| Comments: |                                   |                 |               |               |

(b) (6)

09-20-2012

Page 25 of 25

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic#

Signature

Date

Address of Property: 917 Main St.

Apt #: AAAAAA

City: Vineyard Haven, MA 02568

## EXTERIOR D Side

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| D    | Siding               | 0.02 | L N/A             | Y           |            |            |                |                |
|      | Cement Boards        | 0.0  | L N/A             | Y           |            |            |                |                |
|      | Lower Trim           | 0.01 | L N/A             | Y           |            |            |                |                |
|      | Upper Trim           | N/A  | L N/A             | Y           |            |            |                |                |
|      | Win Above 5'         | N/A  | L N/A             | Y           |            |            |                |                |
|      | Porch Above 5'       |      | L N/A             | Y           |            |            |                |                |
| D    | Storm Door           |      | A/M L N/A         | Y           |            |            |                |                |
|      | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
|      | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
|      | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
|      | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
|      | Kickplate            |      | A/M L N/A         | Y           |            |            |                |                |
| D    | Storm Door           |      | A/M L N/A         | Y           |            |            |                |                |
|      | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
|      | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
|      | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
|      | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
|      | Kickplate            |      | A/M L N/A         | Y           |            |            |                |                |
| D    | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
|      | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
|      | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
|      | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
|      | Window Sill          |      | A/M L N/A         | Y           |            |            |                |                |
|      | Window Casing        |      | A/M L N/A         | Y           |            |            |                |                |
| D    | Window Sash          |      | A/M L N/A         | Y           |            |            |                |                |
|      | Window Sill          |      | A/M L N/A         | Y           |            |            |                |                |
|      | Window Casing        |      | A/M L N/A         | Y           |            |            |                |                |
|      | Window Sash          |      | A/M L N/A         | Y           |            |            |                |                |
|      | Window Sill          |      | A/M L N/A         | Y           |            |            |                |                |
|      | Window Casing        |      | A/M L N/A         | Y           |            |            |                |                |
| D    | Window Sash          |      | A/M L N/A         | Y           |            |            |                |                |
|      | Lamp Post            |      | L N/A             | Y           |            |            |                |                |

COMMENTS / STRUCTURAL DEFECTS:

Excluded Surfaces: Surfaces listed in this box can be made intact only by a licensed deleader

| SIDE | LOCATION | MEASURE LOOSE PAINT<br>(MORE THAN 1440 SQ. IN.) | IC<br>DATE | IC<br>METH |
|------|----------|-------------------------------------------------|------------|------------|
| D    |          |                                                 |            |            |
| D    |          |                                                 |            |            |
| D    |          |                                                 |            |            |
| D    |          |                                                 |            |            |

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| D    | Window Sill          |      | A/M L N/A         | Y           |            |            |                |                |
|      | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
|      | Window Sash          |      | A/M L N/A         | Y           |            |            |                |                |
| D    | Cellar Win Sill      | 0.02 | A/M L N/A         | Y           |            |            |                |                |
|      | Cell Win Sash        | 0.02 | A/M L N/A         | Y           |            |            |                |                |
|      | Cell Win Frame       | 0.02 | A/M L N/A         | Y           |            |            |                |                |
|      | Screen Frame         |      | A/M L N/A         | Y           |            |            |                |                |
| D    | Cellar Win Sill      |      | A/M L N/A         | Y           |            |            |                |                |
|      | Cell Win Sash        |      | A/M L N/A         | Y           |            |            |                |                |
|      | Cell Win Frame       |      | A/M L N/A         | Y           |            |            |                |                |
|      | Screen Frame         |      | A/M L N/A         | Y           |            |            |                |                |
| D    | Cellar Win Sill      |      | A/M L N/A         | Y           |            |            |                |                |
|      | Cell Win Sash        |      | A/M L N/A         | Y           |            |            |                |                |
|      | Cell Win Frame       |      | A/M L N/A         | Y           |            |            |                |                |
|      | Screen Frame         |      | A/M L N/A         | Y           |            |            |                |                |
| D    | Foundation           | 0.03 | L N/A             | Y           |            |            |                |                |
|      | Bulkhead             | 0.01 | A/M L N/A         | Y           |            |            |                |                |
|      | Fences               |      | A/M L N/A         | Y           |            |            |                |                |
|      | Shutters             |      | A/M L N/A         | Y           |            |            |                |                |
| D    | Newel post           |      | A/M L N/A         | Y           |            |            |                |                |
|      | Railing Cap          |      | A/M L N/A         | Y           |            |            |                |                |
|      | Handrail             |      | A/M L N/A         | Y           |            |            |                |                |
|      | Balusters            |      | A/M L N/A         | Y           |            |            |                |                |
|      | Lower Rail           |      | A/M L N/A         | Y           |            |            |                |                |
|      | Treads               |      | A/M L N/A         | Y           |            |            |                |                |
|      | Risers               |      | A/M L N/A         | Y           |            |            |                |                |
|      | Stringer             |      | A/M L N/A         | Y           |            |            |                |                |
|      | Lattice              |      | A/M L N/A         | Y           |            |            |                |                |
|      |                      |      | L N/A             | Y           |            |            |                |                |
| D    | Elec Condu't         |      | L N/A             | Y           |            |            |                |                |
|      | Oil Fill Pipe        |      | L N/A             | Y           |            |            |                |                |
|      | Overhang Trim        |      | A/M L N/A         | Y           |            |            |                |                |

## Soil Test Results

(Must be less than 400 ppm for play area / 1200 ppm for bare soil)

| LOCATION  | AREA MEASUREMENT<br>(Square Feet) | RESULT<br>(PPM) | REMED<br>DATE | REMED<br>METH |
|-----------|-----------------------------------|-----------------|---------------|---------------|
| Play Area |                                   |                 |               |               |
| Bare Soil |                                   |                 |               |               |

Comments:



**Hazardous Building Material  
Inspection Report  
For  
West Chop 1&2  
917 & 921 East Main Street  
Vineyard Haven, MA**



**United States Coast Guard  
CEU Providence  
300 Metro Center Blvd  
Warwick, RI 02886**

*Prepared by:*



**H&S Environmental, Inc.  
160 East Main Street, Suite 2F  
Westborough, Massachusetts 01581**

**October 2012**

## TABLE OF CONTENTS

|                                                                                        |           |
|----------------------------------------------------------------------------------------|-----------|
| <b>TABLE OF CONTENTS .....</b>                                                         | <b>i</b>  |
| <b>CERTIFICATION OF RESULTS .....</b>                                                  | <b>ii</b> |
| <b>1.0 PURPOSE AND SCOPE OF WORK .....</b>                                             | <b>1</b>  |
| <b>2.0 SITE DESCRIPTION .....</b>                                                      | <b>1</b>  |
| <b>3.0 HAZARDOUS BUILDING MATERIAL INSPECTIONS, FINDINGS AND RECOMMENDATIONS .....</b> | <b>1</b>  |
| 3.1 Inspection Personnel and Process .....                                             | 1         |
| 3.1.1 Inspection Personnel.....                                                        | 1         |
| 3.1.2 Inspection Process .....                                                         | 1         |
| 3.2 Asbestos Containing Material Inspection.....                                       | 2         |
| 3.2.1 ACM Introduction .....                                                           | 2         |
| 3.2.2 ACM Inspection.....                                                              | 2         |
| 3.2.3 Definitions of ACM Inspection Terms.....                                         | 3         |
| 3.2.4 ACM Bulk Sample Analysis .....                                                   | 4         |
| 3.2.5 ACM Analytical QC Program .....                                                  | 4         |
| 3.2.6 ACM Inspection Findings and Recommendations .....                                | 5         |
| 3.3 Lead Containing Paint Inspection .....                                             | 8         |
| 3.3.1 LCP Introduction .....                                                           | 8         |
| 3.3.2 LCP Inspection.....                                                              | 8         |
| 3.3.3 LCP Inspection Findings and Recommendations .....                                | 9         |
| 3.4 Radon .....                                                                        | 11        |
| 3.4.1 Radon Introduction .....                                                         | 11        |
| 3.4.2 Radon Sampling .....                                                             | 11        |
| 3.4.3 Radon Findings and Recommendations .....                                         | 12        |

## APPENDICES

|            |                                                    |
|------------|----------------------------------------------------|
| Appendix A | Asbestos Bulk Sample Laboratory Analysis Results   |
| Appendix B | Lead Based Paint Executive Summary and Field Notes |
| Appendix C | Radon Sample Laboratory Analysis Results           |



## **CERTIFICATION OF RESULTS**

This Hazardous Building Material Inspection Report has been prepared for the exclusive use of the Client, the United States Coast Guard. Photocopying of this document by parties other than those designated by the Client or its affiliates or use of this document for purposes other than it is intended, is prohibited.

Respectfully submitted this 17<sup>th</sup> day of October 2012.

Report Prepared by:

(b) (6)



Building Inspector

Report reviewed by:

(b) (6)



(b) (6)



Project Manager

## 1.0 PURPOSE AND SCOPE OF WORK

H&S Environmental, Inc. (H&S) performed a Hazardous Building Materials (HBM's) Inspection of the West Chop 1 & 2 properties located at 917 and 921 East Main Street (the Site) in Vineyard Haven, Massachusetts. The purpose of the inspection was to identify and confirm the presence and/or absence of Asbestos-Containing Materials (ACMs), Lead-Containing Paints (LCPs), and Radon Gases in preparation for possible Site activities including renovations and/or demolition to the West Chop 1 & 2 properties.

The HBM inspection was conducted on September 17, 2012 and September 20, 2012 in all accessible areas at the Site. H&S used experienced and accredited inspectors and laboratories to perform the HBM inspection and analysis of samples. Specific inspection methods, procedures, inspection findings and recommendations can be found in Section 3.0.

## 2.0 SITE DESCRIPTION

The Site is comprised of two wood framed houses and a garage. Each house is two floors with full basement and is approximately 1,800 square foot. Basements are a combination of field stone and brick. The roofs are pitched wood framed structures and covered with three-tab asphalt roof shingles. Interior walls and ceilings are combination plaster and drywall. The wood subfloors are covered with combination of hardwood and resilient floor sheeting and vinyl-composite floor tiles. Windows are wood-cased, double hung units. Heat is provided by oil fired furnaces in the basements and delivered to the individual spaces by room radiators. The house at 921 Main Street is presently occupied and the house at 917 Main Street is vacant.

The two car garage is free standing; wood framed, slab-on-grade, single story structure, with a pitched roof that is covered with the same shingles as the two houses. The only interior finishes were Masonite wall panels over the wall stringers. The front door is a bay door typically seen on garages. Two wood-cased, double hung window units were also noted.

## 3.0 HAZARDOUS BUILDING MATERIAL INSPECTIONS, FINDINGS AND RECOMMENDATIONS

### 3.1 Inspection Personnel and Process

#### 3.1.1 Inspection Personnel

The investigative survey was conducted on September 17, 2012 and September 20, 2012 by trained and certified Massachusetts licensed Asbestos Inspector, (b) (6)

(b) (6)

– All experienced HBM inspectors.

#### 3.1.2 Inspection Process

The inspection for hazardous building materials was conducted in a systematic manner using H&S's standard safety procedures and inspection protocol including:



1. Interviews with individuals knowledgeable about the building and existing written documentation / information regarding the presence and/or absence of hazardous building materials.
2. A visual inspection of accessible areas of the Site to locate, quantify, and assess the condition of materials/areas suspected to contain ACM, LCP, and Radon Gases.
3. Collection and analysis of materials as described herein to determine composition.

### **3.2 Asbestos Containing Material Inspection**

#### *3.2.1 ACM Introduction*

Asbestos is a mineral fiber that has been used commonly in a variety of building construction materials for insulation and as a fire-retardant. Because of its fiber strength and heat resistant properties, asbestos has been used for a wide range of manufactured goods, mostly in building materials (roofing shingles, ceiling and floor tiles, paper products, and asbestos cement products), friction products (automobile clutch, brake, and transmission parts), heat-resistant fabrics, packaging, gaskets, and coatings.

When asbestos-containing materials are damaged or disturbed by repair, remodeling or demolition activities, microscopic fibers become airborne and can be inhaled into the lungs, where they can cause significant health problems.

Most Common Sources of Asbestos Exposure:

- Workplace exposure to people that work in industries that mine, make or use asbestos products and those living near these industries, including:
  - the construction industry (particularly building demolition and renovation activities),
  - the manufacture of asbestos products (such as textiles, friction products, insulation, and other building materials),
  - and during automotive brake and clutch repair work
- Deteriorating, damaged, or disturbed asbestos-containing products such as insulation, fireproofing, acoustical materials, and floor tiles.

#### *3.2.2 ACM Inspection*

The inspection for suspect ACMs included:

1. Conduct a visual inspection of accessible areas of the Site to locate, quantify, and assess the condition of materials suspected to contain ACM.
2. Collection of representative bulk samples of each homogeneous area or application of suspect material in sufficient numbers to comply with the Environmental

Protection Agency (EPA) / Asbestos Hazard Emergency Response Act (AHERA) minimum criteria (see Chart A below).

3. To prevent release of any airborne asbestos fibers, samples were collected by first carefully wetting the suspect material and then removing a small full-thickness sample and placing it in a sealed plastic bag labeled with a unique sample identification number.
4. Chain-of-custody documentation was used to ensure sample integrity.
5. Analysis of the bulk samples at an accredited laboratory using the EPA approved Polarized Light Microscopy (PLM) method.
6. A review of the inspection findings and lab results to ensure proper and consistent identification and characterization of all assumed and confirmed ACMs.

| <b>Chart A</b>                                 |                                                                                    |
|------------------------------------------------|------------------------------------------------------------------------------------|
| <b>Minimum Asbestos Bulk Sampling Criteria</b> |                                                                                    |
| Type of Suspect Material                       | Minimum Sampling Criteria                                                          |
| Surfacing Materials                            | EPA/AHERA mandated statistically random criteria (Min. 3 Samples / Max. 7 Samples) |
| Miscellaneous Materials                        | Minimum of 2 samples of each homogeneous application (unless otherwise noted)      |
| Thermal System Insulation Materials            | Minimum of 3 samples of each homogeneous application (unless otherwise noted)      |

### 3.2.3 Definitions of ACM Inspection Terms

Given the specific purposes and objectives of this inspection, the following definitions were used for the terms: suspect materials, homogeneous applications or areas of suspect materials, friable materials, inaccessible building areas, and confirmed ACMs:

1. Suspect Materials: Building materials that may contain asbestos. The following materials are considered non-suspect and were not sampled or assessed if observed:
  - Plastic, Glass, Wood, or Wood Composite Materials
  - Brick, Granite, Marble, or Other Stonework
  - Fiberglass Insulation (Pink/Yellow) on Piping/Mechanical Components
  - Clay or Ceramic Tiles
  - Rubber or Synthetic Foam
  - Paint (unless textured)
  - Concrete or Mortar (except Gyp-Crete)



- Carpeting, Curtains, Wallpaper, or Other Paper/Natural Fabric/Synthetics
2. Homogeneous Applications or Areas: Suspect materials which serve the same function or purpose (e.g., floor or ceiling tiles), have similar color and texture and were likely installed at or near the same time. Homogeneity is a determining factor in calculating the number of bulk samples collected for a particular material.
  3. Friable Materials: Suspect materials that may be easily reduced to a powder by applying hand pressure, (e.g., sprayed-on fireproofing as opposed to a non-friable material such as vinyl floor tile).
  4. Inaccessible Building Areas: Building areas, systems, structural components, or surfaces which could not be observed because it was unsafe or impractical to demolish, disassemble, or remove systems or coverings, or because a human being cannot physically enter or observe the area or component. Inaccessible areas could include areas such as below grade building foundations, pipe trenches and utility vaults/corridors, electrical equipment/wire, pipe gaskets, in-filled window openings, fire doors and enclosed wall and ceiling cavities.
  5. Asbestos Containing Material (ACM): Suspect materials where at least one (1) of the collected bulk samples contained an asbestos concentration of 1% or more. According to EPA's AHERA criteria, all bulk samples of a homogeneous area of suspect ACM must be found to contain less than 1% asbestos to conclude that the material is not regulated as an ACM by OSHA or EPA under the National Emissions Standard for Hazardous Air Pollutants regulation (NESHAPs).

#### 3.2.4 ACM Bulk Sample Analysis

Bulk samples collected during the inspection were submitted to EMSL Analytical Services, Inc. (EMSL) located in Woburn, Massachusetts and International Asbestos Testing Laboratories (IATL) in Cherry Hill, New Jersey for analysis. EMSL and IATL are fully accredited for bulk sample analysis under the National Voluntary Laboratory Accreditation Program (NVLAP) administered by the National Institute of Standards and Technology (NIST). Bulk samples were analyzed for asbestos content using EPA Method 600/R-93/116. The Laboratory Analytical Results can be found in *Appendix A*.

#### 3.2.5 ACM Analytical QC Program

The EMSL and IATL quality assurance and control programs were developed in strict compliance with NIST/NVLAP requirements.

### 3.2.6 ACM Inspection Findings and Recommendations

A total of two (2) building materials from the HBM inspection of the Site were confirmed for the presence of Asbestos. The materials **confirmed** to contain asbestos in the inspected areas and are summarized as follows:

#### **Confirmed Asbestos Containing Material, 921 Main Street, Vineyard Haven, MA**

| Sample Number | Material Location                                   | Quantity | Analysis Results |
|---------------|-----------------------------------------------------|----------|------------------|
| 092012-09-09A | Red Brick Patter Flooring Closet in Child's Bedroom | 20 SF    | 2% Chrysotile    |

#### **Confirmed Asbestos Containing Material, 917 Main Street, Vineyard Haven, MA**

| Sample Number | Material Location                                           | Quantity | Analysis Results |
|---------------|-------------------------------------------------------------|----------|------------------|
| 092012-09-15A | Joint Compound Second Floor Middle Bedroom at Utility Hatch | 200 SF   | 2% Chrysotile    |

The following building materials were identified and sampled and have been classified as **Non ACMs** in the inspected areas and are summarized as follows:

#### **Confirmed Non-Asbestos Containing Material, 917 E. Main Street, Vineyard Haven, MA**

| LOCATION                             | MATERIAL               |
|--------------------------------------|------------------------|
| Wall Coating on Fieldstone Wall      | Basement Walls         |
| Wall Coating on Fieldstone Wall      | Basement Walls         |
| Wall Coating on Fieldstone Wall      | Basement Walls         |
| Wall and Ceiling Plaster             | Basement Stairwell     |
| Wall and Ceiling Plaster             | Basement Stairwell     |
| Wall and Ceiling Plaster             | Basement Stairwell     |
| Wall and Ceiling Plaster             | Crawl Space in Bedroom |
| Wall and Ceiling Plaster             | Crawl Space in Bedroom |
| Mastic Paper on White Floor Sheeting | Kitchen                |
| Mastic Paper on White Floor Sheeting | Entryway At Radiator   |

| LOCATION                                         | MATERIAL                         |
|--------------------------------------------------|----------------------------------|
| White Floor Sheeting                             | Kitchen                          |
| Mastic Paper of White Floor Sheeting             | Entryway At Radiator             |
| Mastic Paper on Beige Peel and Stick Floor Tiles | Bathroom                         |
| Mastic Paper on Beige Peel and Stick Floor Tiles | Bathroom                         |
| Beige Peel and Stick Floor Tiles                 | Bathroom                         |
| Beige Peel and Stick Floor Tiles                 | Bathroom                         |
| Loose Fill Insulation                            | Attic Spaces                     |
| Loose Fill Insulation                            | Attic Spaces                     |
| Loose Fill Insulation                            | Attic Spaces                     |
| Mastic on Red Brick Pattern Floor Sheeting       | Closet In Childs Bedroom         |
| Mastic on Red Brick Pattern Floor Sheeting       | Closet In Childs Bedroom         |
| Exterior Window Glazing                          | Six Over Nine Double Hung Units  |
| Exterior Window Glazing                          | Six Over Nine Double Hung Units  |
| Exterior Window Glazing                          | Four over Nine Double Hung Units |

**Confirmed Non-Asbestos Containing Materials, 921 E. Main Street, Vineyard Haven, MA**

| LOCATION                             | MATERIAL                              |
|--------------------------------------|---------------------------------------|
| Mastic on 12" x 12" Brown Floor Tile | First Floor Bathroom                  |
| Mastic on 12" x 12" Brown Floor Tile | First Floor                           |
| 12" x 12" Brown Floor Tile           | First Floor Bathroom                  |
| 12" x 12" Brown Floor Tile           | First Floor                           |
| White Sink Undercoating              | Kitchen Sink                          |
| White Sink Undercoating              | Kitchen Sink                          |
| Gypsum Board                         | Laundry Area                          |
| Gypsum Board                         | Second Floor Middle Bedroom           |
| Joint Compound w/Sample #14A         | Laundry Area                          |
| Wall and Ceiling Plaster             | Chase in Second Floor Middle Bedroom  |
| Wall and Ceiling Plaster             | Basement                              |
| Wall and Ceiling Plaster             | Basement                              |
| Wall and Ceiling Plaster             | Attic                                 |
| Wall and Ceiling Plaster             | Attic                                 |
| Mastic on Beige Floor Tiles          | Second Floor Bath                     |
| Mastic on Beige Floor Tiles          | Second Floor Bath                     |
| Beige Floor Tiles                    | Second Floor Bath                     |
| Beige Floor Tiles                    | Second Floor Bath                     |
| Loose Fill Insulation                | Attic Floor                           |
| Loose Fill Insulation                | Attic Floor                           |
| Loose Fill Insulation                | Attic Floor                           |
| Exterior Window Glazing Compound     | Six Over Four Double Hung Units       |
| Exterior Window Glazing Compound     | Four Over Four Double Hung Units      |
| Exterior Window Glazing Compound     | Six Over Nine Double Hung Units       |
| Exterior Window Glazing Compound     | Garage Six Over Six Double Hung Units |
| Exterior Window Glazing Compound     | Garage Six Over Six Double Hung Units |



The mere presence of asbestos in a building does not mean that the health of building occupants is necessarily at risk. As long as the ACMs remain in good condition and are not disturbed, exposure is unlikely. However, when building maintenance, repair, renovation, demolition or other activities disturb ACMs, or if ACMs are damaged, asbestos fibers can be released creating a potential hazard to building occupants. Contractors and employees performing demolition, construction or renovation activities must be informed of the presence of ACMs if the activities may impact these materials.

It is H&S's understanding that the Site is to be renovated in the near future. H&S recommends that the above Confirmed ACMs be removed (asbestos abatement) prior to the demolition/renovation work by a Massachusetts Licensed Asbestos Contractor prior to demolition or renovation of the Site.

Until all Confirmed ACMs are removed, they should be managed according to governing regulations. All ACMs in each of the buildings should be included in a site-specific asbestos operations and maintenance (O&M) program designed at a minimum to comply with 29 CFR 1910.1001 and 1926.1101, incorporating the basic components outlined in the EPA's *Guide to Managing Asbestos in Buildings*.

### 3.3 Lead Containing Paint Inspection

#### 3.3.1 LCP Introduction

Lead is a toxic metal that was used for many years in paint and other products found in and around our homes. Lead also can be emitted into the air from industrial sources and leaded aviation gasoline, and lead can enter drinking water from plumbing materials. Lead may cause a range of health effects, from behavioral problems and learning disabilities, to seizures and death. Children six years old and under are most at risk.

Most Common Sources of Lead Poisoning:

- Deteriorating lead-based paint
- Lead contaminated dust
- Lead contaminated residential soil

Historically, lead was added to paint because its color stability properties made it a desirable pigment and because it enhances durability. Lead-containing paint becomes harmful when inhaled as dust or fumes or when ingested. Once lead pigment was proven to be a health hazard, it was officially banned in 1978 from paint applied in residences.

In an occupational or industrial setting, if lead-containing painted surfaces are to be impacted by renovation or demolition activities, contractor personnel exposure (per OSHA compliance) and waste disposal (per EPA compliance) issues must be addressed and factored into the cost of the project. Specifically, contractors are required to comply with all applicable OSHA regulations including 29 CFR 1926.62 *Lead Exposure on Contractors Interim Final Rule* and 29 CFR 1926.59 *Hazard Communication for the Construction Industry*. These regulations are applicable for all construction workers that are involved in activities that impact lead containing paint and/or generate airborne lead.

#### 3.3.2 LCP Inspection

The XRF testing was performed to evaluate the lead content on painted surfaces for interior and exterior surfaces in housing, and determine the presence of lead hazards as defined by the Massachusetts Lead Law (105 CMR 460.000 – Lead Poisoning Prevention and Control). Surfaces tested included: walls, ceilings, floors, shelving, closet features, window systems, door systems, exterior siding, exterior trim, porch trim and features, garage exterior components, and any other component with a surface coating that was visible and reachable during the inspection.

The inspection for suspect LCP included:

1. Conduct a visual inspection of accessible areas of the Site to identify, quantify, and assess the condition of materials suspected to contain LCP.

2. Analysis of painted surfaces using a Niton Xli 300 Series X-Ray Fluorescence (XRF) Gun. The XRF Gun is a direct read instrument that can detect the presence and/or absence of LCP.
3. If analysis of LCP is inconclusive with the XRF Gun, Then collect bulk paint chip samples for laboratory analysis.
4. Analysis of bulk paint chip samples at an Accredited Laboratory using Atomic Absorption methodology.
5. A review of the inspection findings to ensure proper and consistent identification and characterization of all confirmed LCP.

### 3.3.3 LCP Inspection Findings and Recommendations

Most of the materials throughout the Site were painted surfaces. All of the surfaces were analyzed with the XRF Gun and either identified as LBP or Paint not containing lead. Therefore, no bulk paint samples were collected or analyzed for lead content.

Lead paint content of components was not consistent or representative from one area to another; this is likely due to previous work that has been performed to the property from over the years of maintenance and updates. The following building components were commonly found to contain dangerous levels of lead (see individual reports for exact results):

- Plaster walls and ceilings
- Baseboards
- Doors, door casings, and door jambs
- Window sills, casings, interior stop edges, aprons, exterior sills, blind stops, and exterior casings.
- Stair risers, treads, stringers, floor edges, and floor casings
- Shelves and shelf supports
- Garage exterior components

Less commonly found to contain lead, but still having at least some locations which are considered to have dangerous amounts of lead are:

- Door thresholds and kickplates
- Exterior Cornerboards
- Porch columns

In addition to these components containing dangerous levels of lead, many of these components present one or more lead hazards as defined by 105 CMR 460.000. These hazards are either: accessible/mouthable surfaces, moveable/impact surfaces, and/or loose/chipping/peeling/deteriorated paint.



Anyone who performs work to correct lead hazards must be authorized and licensed according to 105 CMR 460.00 – Lead Poisoning Prevention and Control and 454 CMR 22.00 – Deleading and Lead Safe Renovation Regulations.

Additionally, the employer of workers who disturb or remove lead paint must comply with OSHA Standard 29 CFR 1926.62 - Lead. This applies to all construction work, alteration, or repair, including painting, where an employee may be occupationally exposed to lead.

Many of the painted surfaces did test positive for LBP and some of those surfaces are loose, therefore, further action is required regarding the LCP Inspection and Findings. An Executive Summary (*see Attachment B*) has been prepared to provide the field documentation and recommendations regarding the LBP.

Although the HUD<sup>(1)</sup> lead paint standard classifies lead-based paint ( LBP) as that having  $\geq 0.5\%$  of lead by weight as analyzed by Atomic Absorption. For the purposes of renovation and/or demolition work, OSHA defines lead-containing paint (LCP) as any paint containing detectable amounts of lead.

The current interpretation of the EPA's Resource Conservation and Recovery Act (RCRA) requires that waste generated during projects where LCPs are present and will be disposed of is tested for the toxicity characteristic of lead in the waste stream. Toxicity Characteristic Leachate Procedure (TCLP) testing is performed to determine whether the waste (construction debris) must be classified as hazardous because of its lead content or if it can be disposed in a conventional construction and demolition (C&D) landfill. The regulatory limit for lead toxicity is 5.0 milligrams per liter (mg/L) using the EPA reference Method SW846-7420 for Atomic Absorption Spectroscopy (AAS).

---

<sup>(1)</sup> U.S Department of Housing and Urban Development

## 3.4 Radon

### 3.4.1 Radon Introduction

The EPA estimates that about 20,000 lung cancer deaths each year in the U.S. are radon-related. Exposure to radon is the second leading cause of lung cancer after smoking. Radon is an odorless, tasteless and invisible gas produced by the decay of naturally occurring uranium in soil and water. Radon is a form of ionizing radiation and a proven carcinogen. Lung cancer is the only known effect on human health from exposure to radon in air. Thus far, there is no evidence that children are at greater risk of lung cancer than are adults.

Radon in air is ubiquitous. Radon is found in outdoor air and in the indoor air of buildings of all kinds. EPA recommends homes be fixed if the radon level is 4 pCi/L (picocuries per liter) or more. Because there is no known safe level of exposure to radon, EPA also recommends that Americans consider fixing their home for radon levels between 2 pCi/L and 4 pCi/L. The average radon concentration in the indoor air of America's homes is about 1.3 pCi/L. It is upon this level that EPA based its estimate of 20,000 radon-related lung cancers a year upon. It is for this simple reason that EPA recommends that Americans consider fixing their homes when the radon level is between 2 pCi/L and 4 pCi/L. The average concentration of radon in outdoor air is .4 pCi/L or 1/10<sup>th</sup> of EPA's 4 pCi/L action level.

For smokers the risk of lung cancer is significant due to the synergistic effects of radon and smoking. For this population about 62 people in a 1,000 will die of lung-cancer, compared to 7.3 people in a 1,000 for never smokers. Put another way, a person who never smoked (never smoker) who is exposed to 1.3 pCi/L has a 2 in 1,000 chance of lung cancer; while a smoker has a 20 in 1,000 chance of dying from lung cancer. Figure A compares the risks between smokers and never smokers; smokers are at a much higher risk than never smokers, e.g., at 8 pCi/L the risk to smokers is six times the risk to never smokers.

The radon health risk is underscored by the fact that in 1988 Congress added Title III on Indoor Radon Abatement to the Toxic Substances Control Act. It codified and funded EPA's then fledgling radon program. Also that year, the Office of the U.S. Surgeon General issued a warning about radon urging Americans to test their homes and to reduce the radon level when necessary (U.S. Surgeon General).

Unfortunately, many Americans presume that because the action level is 4 pCi/L, a radon level of less than 4 pCi/L is "safe". This perception is altogether too common in the residential real estate market. In managing any risk, we should be concerned with the greatest risk. For most Americans, their greatest exposure to radon is in their homes; especially in rooms that are below grade (e.g., basements), rooms that are in contact with the ground and those rooms immediately above them.

### 3.4.2 Radon Sampling

Basement level locations were tested in both houses because radon enters through building foundations. The radon collection device used for this indoor air quality testing were charcoal canisters placed in the basement of both buildings for a period of approximately 48 hours. For quality control purposes trip blanks were also summited and analyzed.

### 3.4.3 Radon Findings and Recommendations

All radon samples were analyzed by AccuStar Labs located in Medway, MA. The canister measurement device used to conduct the radon air tests are listed on the Environmental Protection Agency's (EPA's) Radon Measurement Proficiency (PMP) program. The Radon samples locations, sample identification number and analysis results are listed in the table below.

#### Radon Sampling Test Results for USGC 917 and 921 Main Street, Vineyard Haven, MA

| <u>Sample Identification Number</u> | <u>Location</u>          | <u>PCi/L</u><br>(Picocuries of Radon<br>per Liter of air) |
|-------------------------------------|--------------------------|-----------------------------------------------------------|
| 2382769                             | Basement of 921 Main St. | 2.3                                                       |
| 238770                              | Basement of 921 Main St. | 2.1                                                       |
| 2262237                             | Basement of 917 Main St. | 1.6                                                       |
| 2262238                             | Basement of 917 Main St. | 1.5                                                       |
| 2382771                             | Field Blank              | <0.4                                                      |
| 2382772                             | Field Blank              | <0.4                                                      |

The indoor radon levels ranged from 1.5 pCi/L to 2.3 pCi/L of radon. The United States EPA currently recommends you take action to reduce indoor radon levels if radon test results are 4 pCi/L or higher; therefore no action is required (*See Appendix C – Radon Laboratory Analysis Results*).



**APPENDIX A**  
**Asbestos Bulk Sample Laboratory**  
**Analysis Results**

**EMSL Analytical, Inc.**

7 Constitution Way, Suite 107, Woburn, MA 01801

Phone/Fax: (781) 933-8411 / (781) 933-8412

(b) (6)

EMSL Order: 131204616

CustomerID: AXIO80

CustomerPO:

ProjectID:

Attn: (b) (6)

**Axiom Partners, Inc.****979 Main Street****Wakefield, MA 01880**

Phone: (781) 213-9198

Fax: (781) 213-6992

Received: 09/19/12 11:55 AM

Analysis Date: 9/26/2012

Collected: 9/17/2012

Project: 01006.025 / USGC; Martha's Vineyard; 921 Main Street; Vineyard Haven, MA

**Test Report: Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 and/or EPA 600/M4-82-020 Method(s) using Polarized Light Microscopy**

| Sample                          | Description                                             | Appearance                                 | <u>Non-Asbestos</u> |                          | <u>Asbestos</u> |
|---------------------------------|---------------------------------------------------------|--------------------------------------------|---------------------|--------------------------|-----------------|
|                                 |                                                         |                                            | % Fibrous           | % Non-Fibrous            | % Type          |
| 091712-09-01A<br>131204616-0001 | Basement Walls -<br>Wall Coating on<br>Fieldstone Wall  | Gray/White<br>Non-Fibrous<br>Heterogeneous |                     | 100% Non-fibrous (other) | None Detected   |
| 091712-09-01B<br>131204616-0002 | Basement Walls -<br>Wall Coating on<br>Fieldstone Wall  | Gray/White<br>Non-Fibrous<br>Heterogeneous |                     | 100% Non-fibrous (other) | None Detected   |
| 091712-09-01C<br>131204616-0003 | Basement Walls -<br>Wall Coating on<br>Fieldstone Wall  | Gray/White<br>Non-Fibrous<br>Heterogeneous |                     | 100% Non-fibrous (other) | None Detected   |
| 091712-09-02A<br>131204616-0004 | Basement<br>Stairwell - Wall<br>and Ceiling Plaster     | Gray/White<br>Fibrous<br>Heterogeneous     | 2% Hair             | 98% Non-fibrous (other)  | None Detected   |
| 091712-09-02B<br>131204616-0005 | Basement<br>Stairwell - Wall<br>and Ceiling Plaster     | Gray/White<br>Non-Fibrous<br>Heterogeneous | <1% Hair            | 100% Non-fibrous (other) | None Detected   |
| 091712-09-02C<br>131204616-0006 | Basement<br>Stairwell - Wall<br>and Ceiling Plaster     | Gray/White<br>Fibrous<br>Heterogeneous     | 2% Hair             | 98% Non-fibrous (other)  | None Detected   |
| 091712-09-02D<br>131204616-0007 | Crawl Space in<br>Bedroom - Wall<br>and Ceiling Plaster | White<br>Fibrous<br>Homogeneous            | 5% Hair             | 95% Non-fibrous (other)  | None Detected   |
| 091712-09-02E<br>131204616-0008 | Crawl Space in<br>Bedroom - Wall<br>and Ceiling Plaster | White<br>Fibrous<br>Homogeneous            | 5% Hair             | 95% Non-fibrous (other)  | None Detected   |

Analyst(s)

(b) (6)

(b) (6)

(b) (6)

(b) (6)

or other approved signatory

EMSL maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. Interpretation and use of test results are the responsibility of the client. This report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST or any agency of the federal government. Non-friable organically bound materials present a problem matrix and therefore EMSL recommends gravimetric reduction prior to analysis. Samples received in good condition unless otherwise noted. Estimated accuracy, precision and uncertainty data available upon request. Unless requested by the client, building materials manufactured with multiple layers (i.e. linoleum, wallboard, etc.) are reported as a single sample. Reporting limit is 1%

Samples analyzed by EMSL Analytical, Inc. Woburn, MA NVLAP Lab Code 101147-0, CT PH-0315, MA AA000188, RI AAL-107T3 and VT AL357102

Initial report from 09/26/2012 14:43:51

**EMSL Analytical, Inc.**

7 Constitution Way, Suite 107, Woburn, MA 01801

Phone/Fax: (781) 933-8411 / (781) 933-8412

(b) (6)

EMSL Order: 131204616

CustomerID: AXIO80

CustomerPO:

ProjectID:

Attn: (b) (6)  
(b) (6)  
**Axiom Partners, Inc.**  
**979 Main Street**  
**Wakefield, MA 01880**

Phone: (781) 213-9198  
Fax: (781) 213-6992  
Received: 09/19/12 11:55 AM  
Analysis Date: 9/26/2012  
Collected: 9/17/2012

Project: 01006.025 / USGC; Martha's Vineyard; 921 Main Street; Vineyard Haven, MA

**Test Report: Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 and/or EPA 600/M4-82-020 Method(s) using Polarized Light Microscopy**

| Sample                          | Description                                                 | Appearance                           | <u>Non-Asbestos</u> |                          | <u>Asbestos</u> |
|---------------------------------|-------------------------------------------------------------|--------------------------------------|---------------------|--------------------------|-----------------|
|                                 |                                                             |                                      | % Fibrous           | % Non-Fibrous            | % Type          |
| 091712-09-03A<br>131204616-0009 | Kitchen - Mastic Paper on White Floor Sheeting              | Yellow<br>Non-Fibrous<br>Homogeneous |                     | 100% Non-fibrous (other) | None Detected   |
| 091712-09-03B<br>131204616-0010 | Entryway at Radiator - Mastic Paper on White Floor Sheeting | Yellow<br>Non-Fibrous<br>Homogeneous |                     | 100% Non-fibrous (other) | None Detected   |
| 091712-09-04A<br>131204616-0011 | Kitchen - White Floor Sheeting                              | White<br>Non-Fibrous<br>Homogeneous  |                     | 100% Non-fibrous (other) | None Detected   |
| 091712-09-04B<br>131204616-0012 | Entryway at Radiator - Mastic Paper of White Floor Sheeting | White<br>Non-Fibrous<br>Homogeneous  |                     | 100% Non-fibrous (other) | None Detected   |
| 091712-09-05A<br>131204616-0013 | Bathroom - Mastic Paper on Beige Peel & Stick Floor Tile    | Yellow<br>Non-Fibrous<br>Homogeneous |                     | 100% Non-fibrous (other) | None Detected   |
| 091712-09-05B<br>131204616-0014 | Bathroom - Mastic Paper on Beige Peel & Stick Floor Tile    | Yellow<br>Non-Fibrous<br>Homogeneous |                     | 100% Non-fibrous (other) | None Detected   |
| 091712-09-06A<br>131204616-0015 | Bathroom - Beige Peel & Stick Floor Tile                    | Tan<br>Non-Fibrous<br>Homogeneous    |                     | 100% Non-fibrous (other) | None Detected   |

Analyst(s)

(b) (6)  
(b) (6)

(b) (6)

(b) (6)

or other approved signatory

EMSL maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. Interpretation and use of test results are the responsibility of the client. This report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST or any agency of the federal government. Non-friable organically bound materials present a problem matrix and therefore EMSL recommends gravimetric reduction prior to analysis. Samples received in good condition unless otherwise noted. Estimated accuracy, precision and uncertainty data available upon request. Unless requested by the client, building materials manufactured with multiple layers (i.e. linoleum, wallboard, etc.) are reported as a single sample. Reporting limit is 1%

Samples analyzed by EMSL Analytical, Inc. Woburn, MA NVLAP Lab Code 101147-0, CT PH-0315, MA AA000188, RI AAL-107T3 and VT AL357102

Initial report from 09/26/2012 14:43:51



**EMSL Analytical, Inc.**

7 Constitution Way, Suite 107, Woburn, MA 01801

Phone/Fax: (781) 933-8411 / (781) 933-8412

(b) (6)

EMSL Order: 131204616

CustomerID: AXIO80

CustomerPO:

ProjectID:

Attn: (b) (6)  
**Axiom Partners, Inc.**  
**979 Main Street**  
**Wakefield, MA 01880**

Phone: (781) 213-9198  
Fax: (781) 213-6992  
Received: 09/19/12 11:55 AM  
Analysis Date: 9/26/2012  
Collected: 9/17/2012

Project: 01006.025 / USGC; Martha's Vineyard; 921 Main Street; Vineyard Haven, MA

**Test Report: Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 and/or EPA 600/M4-82-020 Method(s) using Polarized Light Microscopy**

| Sample                          | Description                                                            | Appearance                     | <u>Non-Asbestos</u> |                          | <u>Asbestos</u> |
|---------------------------------|------------------------------------------------------------------------|--------------------------------|---------------------|--------------------------|-----------------|
|                                 |                                                                        |                                | % Fibrous           | % Non-Fibrous            | % Type          |
| 091712-09-06B<br>131204616-0016 | Bathroom - Beige Peel & Stick Floor Tile                               | Gray Non-Fibrous Homogeneous   |                     | 100% Non-fibrous (other) | None Detected   |
| 091712-09-07A<br>131204616-0017 | Attic Spaces - Loose Fill Insulation                                   | Tan Fibrous Homogeneous        | 90% Cellulose       | 10% Non-fibrous (other)  | None Detected   |
| 091712-09-07B<br>131204616-0018 | Attic Spaces - Loose Fill Insulation                                   | Tan Fibrous Homogeneous        | 90% Cellulose       | 10% Non-fibrous (other)  | None Detected   |
| 091712-09-07C<br>131204616-0019 | Attic Spaces - Loose Fill Insulation                                   | Brown Fibrous Homogeneous      | 90% Cellulose       | 10% Non-fibrous (other)  | None Detected   |
| 091712-09-08A<br>131204616-0020 | Closet in Child's Bedroom - Mastic on Red Brick Pattern Floor Sheeting | Yellow Non-Fibrous Homogeneous |                     | 100% Non-fibrous (other) | None Detected   |
| 091712-09-08B<br>131204616-0021 | Closet in Child's Bedroom - Mastic on Red Brick Pattern Floor Sheeting | Yellow Non-Fibrous Homogeneous |                     | 100% Non-fibrous (other) | None Detected   |
| 091712-09-09A<br>131204616-0022 | Closet in Child's Bedroom - Red Brick Pattern Floor Sheeting           | Red Non-Fibrous Homogeneous    |                     | 98% Non-fibrous (other)  | 2% Chrysotile   |

Analyst(s)

(b) (6)

(b) (6)

(b) (6)

(b) (6)

or other approved signatory

EMSL maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. Interpretation and use of test results are the responsibility of the client. This report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST or any agency of the federal government. Non-friable organically bound materials present a problem matrix and therefore EMSL recommends gravimetric reduction prior to analysis. Samples received in good condition unless otherwise noted. Estimated accuracy, precision and uncertainty data available upon request. Unless requested by the client, building materials manufactured with multiple layers (i.e. linoleum, wallboard, etc.) are reported as a single sample. Reporting limit is 1%

Samples analyzed by EMSL Analytical, Inc. Woburn, MA NVLAP Lab Code 101147-0, CT PH-0315, MA AA000188, RI AAL-107T3 and VT AL357102

Initial report from 09/26/2012 14:43:51

**EMSL Analytical, Inc.**

7 Constitution Way, Suite 107, Woburn, MA 01801

Phone/Fax: (781) 933-8411 / (781) 933-8412

(b) (6)

EMSL Order: 131204616

CustomerID: AXIO80

CustomerPO:

ProjectID:

Attn: (b) (6)

**Axiom Partners, Inc.****979 Main Street****Wakefield, MA 01880**

Phone: (781) 213-9198

Fax: (781) 213-6992

Received: 09/19/12 11:55 AM

Analysis Date: 9/26/2012

Collected: 9/17/2012

Project: 01006.025 / USGC; Martha's Vineyard; 921 Main Street; Vineyard Haven, MA

**Test Report: Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 and/or EPA 600/M4-82-020 Method(s) using Polarized Light Microscopy**

| Sample                          | Description                                                  | Appearance                        | <u>Non-Asbestos</u> |                          | <u>Asbestos</u>              |
|---------------------------------|--------------------------------------------------------------|-----------------------------------|---------------------|--------------------------|------------------------------|
|                                 |                                                              |                                   | % Fibrous           | % Non-Fibrous            | % Type                       |
| 091712-09-09B<br>131204616-0023 | Closet in Child's Bedroom - Red Brick Pattern Floor Sheeting |                                   |                     |                          | Stop Positive (Not Analyzed) |
| 091712-09-10A<br>131204616-0024 | 6 over 9 Double Hung Units - Exterior Window Glazing         | Tan<br>Non-Fibrous<br>Homogeneous |                     | 100% Non-fibrous (other) | None Detected                |
| 091712-09-10B<br>131204616-0025 | 6 over 9 Double Hung Units - Exterior Window Glazing         | Tan<br>Non-Fibrous<br>Homogeneous |                     | 100% Non-fibrous (other) | None Detected                |
| 091712-09-10C<br>131204616-0026 | 6 over 9 Double Hung Units - Exterior Window Glazing         | Tan<br>Non-Fibrous<br>Homogeneous |                     | 100% Non-fibrous (other) | None Detected                |

Analyst(s)

(b) (6)

(b) (6)

(b) (6)

(b) (6)

or other approved signatory

EMSL maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. Interpretation and use of test results are the responsibility of the client. This report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST or any agency of the federal government. Non-friable organically bound materials present a problem matrix and therefore EMSL recommends gravimetric reduction prior to analysis. Samples received in good condition unless otherwise noted. Estimated accuracy, precision and uncertainty data available upon request. Unless requested by the client, building materials manufactured with multiple layers (i.e. linoleum, wallboard, etc.) are reported as a single sample. Reporting limit is 1%

Samples analyzed by EMSL Analytical, Inc. Woburn, MA NVLAP Lab Code 101147-0, CT PH-0315, MA AA000188, RI AAL-107T3 and VT AL357102

Initial report from 09/26/2012 14:43:51

**EMSL Analytical, Inc.**

7 Constitution Way, Suite 107, Woburn, MA 01801

Phone/Fax: (781) 933-8411 / (781) 933-8412

(b) (6)

EMSL Order: 131204615

CustomerID: AXIO80

CustomerPO:

ProjectID:

Attn: (b) (6)

**Axiom Partners, Inc.****979 Main Street****Wakefield, MA 01880**

Phone: (781) 213-9198

Fax: (781) 213-6992

Received: 09/19/12 11:55 AM

Analysis Date: 9/26/2012

Collected: 9/17/2012

Project: 01006.024 / USGC; Martha's Vineyard; 917 Main Street; Vineyard Haven, MA

**Test Report: Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 and/or EPA 600/M4-82-020 Method(s) using Polarized Light Microscopy**

| Sample                          | Description                                                           | Appearance                           | Non-Asbestos  |                          | Asbestos      |
|---------------------------------|-----------------------------------------------------------------------|--------------------------------------|---------------|--------------------------|---------------|
|                                 |                                                                       |                                      | % Fibrous     | % Non-Fibrous            | % Type        |
| 091712-09-11A<br>131204615-0001 | FIRST FLOOR<br>BATHROOM -<br>MASTIC ON<br>12"x12" BROWN<br>FLOOR TILE | Clear<br>Non-Fibrous<br>Homogeneous  |               | 100% Non-fibrous (other) | None Detected |
| 091712-09-11B<br>131204615-0002 | FIRST FLOOR -<br>MASTIC ON<br>12"x12" BROWN<br>FLOOR TILE             | Yellow<br>Non-Fibrous<br>Homogeneous |               | 100% Non-fibrous (other) | None Detected |
| 091712-09-12A<br>131204615-0003 | FIRST FLOOR<br>BATHROOM -<br>12"x12" BROWN<br>FLOOR TILE              | Tan<br>Non-Fibrous<br>Homogeneous    |               | 100% Non-fibrous (other) | None Detected |
| 091712-09-12B<br>131204615-0004 | FIRST FLOOR -<br>12"x12" BROWN<br>FLOOR TILE                          | Gray<br>Non-Fibrous<br>Homogeneous   |               | 100% Non-fibrous (other) | None Detected |
| 091712-09-13A<br>131204615-0005 | KITCHEN SINK -<br>WHITE SINK<br>UNDERCOATING                          | White<br>Non-Fibrous<br>Homogeneous  | 15% Cellulose | 85% Non-fibrous (other)  | None Detected |
| 091712-09-13B<br>131204615-0006 | KITCHEN SINK -<br>WHITE SINK<br>UNDERCOATING                          | Tan<br>Non-Fibrous<br>Homogeneous    | 15% Cellulose | 85% Non-fibrous (other)  | None Detected |
| 091712-09-14A<br>131204615-0007 | LAUNDRY<br>AREA - GYPSUM<br>BOARD                                     | White<br>Non-Fibrous<br>Homogeneous  | 2% Cellulose  | 98% Non-fibrous (other)  | None Detected |

Analyst(s)

(b) (6)

(b) (6)

(b) (6)

(b) (6)

or other approved signatory

EMSL maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. Interpretation and use of test results are the responsibility of the client. This report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST or any agency of the federal government. Non-friable organically bound materials present a problem matrix and therefore EMSL recommends gravimetric reduction prior to analysis. Samples received in good condition unless otherwise noted. Estimated accuracy, precision and uncertainty data available upon request. Unless requested by the client, building materials manufactured with multiple layers (i.e. linoleum, wallboard, etc.) are reported as a single sample. Reporting limit is 1%

Samples analyzed by EMSL Analytical, Inc. Woburn, MA NVLAP Lab Code 101147-0, CT PH-0315, MA AA000188, RI AAL-107T3 and VT AL357102

Initial report from 09/26/2012 14:15:17



**EMSL Analytical, Inc.**

7 Constitution Way, Suite 107, Woburn, MA 01801

Phone/Fax: (781) 933-8411 / (781) 933-8412

(b) (6)

EMSL Order: 131204615

CustomerID: AXIO80

CustomerPO:

ProjectID:

Attn: (b) (6)

**Axiom Partners, Inc.****979 Main Street****Wakefield, MA 01880**

Phone: (781) 213-9198

Fax: (781) 213-6992

Received: 09/19/12 11:55 AM

Analysis Date: 9/26/2012

Collected: 9/17/2012

Project: 01006.024 / USGC; Martha's Vineyard; 917 Main Street; Vineyard Haven, MA

**Test Report: Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 and/or EPA 600/M4-82-020 Method(s) using Polarized Light Microscopy**

| Sample                          | Description                                                                       | Appearance                                 | <u>Non-Asbestos</u> |                          | <u>Asbestos</u> |  |
|---------------------------------|-----------------------------------------------------------------------------------|--------------------------------------------|---------------------|--------------------------|-----------------|--|
|                                 |                                                                                   |                                            | % Fibrous           | % Non-Fibrous            | % Type          |  |
| 091712-09-14B<br>131204615-0008 | SECOND FLOOR<br>MIDDLE<br>BEDROOM -<br>GYPSUM BOARD                               | White<br>Non-Fibrous<br>Homogeneous        | 2% Cellulose        | 98% Non-fibrous (other)  | None Detected   |  |
| 091712-09-15A<br>131204615-0009 | LAUNDRY<br>AREA - JOINT<br>COMPOUND<br>W/SAMPLE 14A                               | White<br>Non-Fibrous<br>Homogeneous        |                     | 100% Non-fibrous (other) | None Detected   |  |
| 091712-09-15B<br>131204615-0010 | SECOND FLOOR<br>MIDDLE<br>BEDROOM -<br>JOINT<br>COMPOUND<br>W/SAMPLE 14B          | Tan<br>Non-Fibrous<br>Homogeneous          |                     | 98% Non-fibrous (other)  | 2% Chrysotile   |  |
| 091712-09-16A<br>131204615-0011 | CHASE IN<br>SECOND FLOOR<br>MIDDLE<br>BEDROOM -<br>WALL AND<br>CEILING<br>PLASTER | Gray/White<br>Fibrous<br>Heterogeneous     | 2% Hair             | 98% Non-fibrous (other)  | None Detected   |  |
| 091712-09-16B<br>131204615-0012 | BASEMENT -<br>WALL AND<br>CEILING<br>PLASTER                                      | Gray/White<br>Non-Fibrous<br>Heterogeneous | <1% Hair            | 100% Non-fibrous (other) | None Detected   |  |
| 091712-09-16C<br>131204615-0013 | BASEMENT -<br>WALL AND<br>CEILING<br>PLASTER                                      | Gray/White<br>Non-Fibrous<br>Homogeneous   | 2% Hair             | 98% Non-fibrous (other)  | None Detected   |  |

Analyst(s)

(b) (6) (12)

(b) (6) (15)

(b) (6)

(b) (6)

or other approved signatory

EMSL maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. Interpretation and use of test results are the responsibility of the client. This report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST or any agency of the federal government. Non-friable organically bound materials present a problem matrix and therefore EMSL recommends gravimetric reduction prior to analysis. Samples received in good condition unless otherwise noted. Estimated accuracy, precision and uncertainty data available upon request. Unless requested by the client, building materials manufactured with multiple layers (i.e. linoleum, wallboard, etc.) are reported as a single sample. Reporting limit is 1%

Samples analyzed by EMSL Analytical, Inc. Woburn, MA NVLAP Lab Code 101147-0, CT PH-0315, MA AA000188, RI AAL-107T3 and VT AL357102

Initial report from 09/26/2012 14:15:17

**EMSL Analytical, Inc.**

7 Constitution Way, Suite 107, Woburn, MA 01801

Phone/Fax: (781) 933-8411 / (781) 933-8412

(b) (6)

EMSL Order: 131204615

CustomerID: AXIO80

CustomerPO:

ProjectID:

Attn: (b) (6)

**Axiom Partners, Inc.****979 Main Street****Wakefield, MA 01880**

Phone: (781) 213-9198

Fax: (781) 213-6992

Received: 09/19/12 11:55 AM

Analysis Date: 9/26/2012

Collected: 9/17/2012

Project: 01006.024 / USGC; Martha's Vineyard; 917 Main Street; Vineyard Haven, MA

**Test Report: Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 and/or EPA 600/M4-82-020 Method(s) using Polarized Light Microscopy**

| Sample                          | Description                                              | Appearance                             | <u>Non-Asbestos</u> |                          | <u>Asbestos</u> |
|---------------------------------|----------------------------------------------------------|----------------------------------------|---------------------|--------------------------|-----------------|
|                                 |                                                          |                                        | % Fibrous           | % Non-Fibrous            | % Type          |
| 091712-09-16D<br>131204615-0014 | ATTIC - WALL<br>AND CEILING<br>PLASTER                   | Gray/White<br>Fibrous<br>Heterogeneous | 2% Hair             | 98% Non-fibrous (other)  | None Detected   |
| 091712-09-16E<br>131204615-0015 | ATTIC - WALL<br>AND CEILING<br>PLASTER                   | Gray/White<br>Fibrous<br>Heterogeneous | 2% Hair             | 98% Non-fibrous (other)  | None Detected   |
| 091712-09-17A<br>131204615-0016 | SECOND FLOOR<br>BATH - MASTIC<br>ON BEIGE<br>FLOOR TILES | Yellow<br>Non-Fibrous<br>Homogeneous   |                     | 100% Non-fibrous (other) | None Detected   |
| 091712-09-17B<br>131204615-0017 | SECOND FLOOR<br>BATH - MASTIC<br>ON BEIGE<br>FLOOR TILES | Yellow<br>Non-Fibrous<br>Homogeneous   |                     | 100% Non-fibrous (other) | None Detected   |
| 091712-09-18A<br>131204615-0018 | SECOND FLOOR<br>BATH - BEIGE<br>FLOOR TILES              | Tan<br>Fibrous<br>Heterogeneous        | 20% Cellulose       | 80% Non-fibrous (other)  | None Detected   |
| 091712-09-18B<br>131204615-0019 | SECOND FLOOR<br>BATH - BEIGE<br>FLOOR TILES              | Tan<br>Fibrous<br>Heterogeneous        | 20% Cellulose       | 80% Non-fibrous (other)  | None Detected   |
| 091712-09-19A<br>131204615-0020 | ATTIC FLOOR -<br>LOOSE FILL<br>INSULATION                | Tan<br>Fibrous<br>Homogeneous          | 90% Cellulose       | 10% Non-fibrous (other)  | None Detected   |
| 091712-09-19B<br>131204615-0021 | ATTIC FLOOR -<br>LOOSE FILL<br>INSULATION                | Tan<br>Fibrous<br>Homogeneous          | 90% Cellulose       | 10% Non-fibrous (other)  | None Detected   |

Analyst(s)

(b) (6) (12)

(b) (6) (15)

(b) (6)

(b) (6)

or other approved signatory

EMSL maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. Interpretation and use of test results are the responsibility of the client. This report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST or any agency of the federal government. Non-friable organically bound materials present a problem matrix and therefore EMSL recommends gravimetric reduction prior to analysis. Samples received in good condition unless otherwise noted. Estimated accuracy, precision and uncertainty data available upon request. Unless requested by the client, building materials manufactured with multiple layers (i.e. linoleum, wallboard, etc.) are reported as a single sample. Reporting limit is 1%

Samples analyzed by EMSL Analytical, Inc. Woburn, MA NVLAP Lab Code 101147-0, CT PH-0315, MA AA000188, RI AAL-107T3 and VT AL357102

Initial report from 09/26/2012 14:15:17

**EMSL Analytical, Inc.**

7 Constitution Way, Suite 107, Woburn, MA 01801

Phone/Fax: (781) 933-8411 / (781) 933-8412

(b) (6)

EMSL Order: 131204615

CustomerID: AXIO80

CustomerPO:

ProjectID:

Attn: (b) (6)  
**Axiom Partners, Inc.**  
**979 Main Street**  
**Wakefield, MA 01880**

Phone: (781) 213-9198  
Fax: (781) 213-6992  
Received: 09/19/12 11:55 AM  
Analysis Date: 9/26/2012  
Collected: 9/17/2012

Project: 01006.024 / USGC; Martha's Vineyard; 917 Main Street; Vineyard Haven, MA

**Test Report: Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 and/or EPA 600/M4-82-020 Method(s) using Polarized Light Microscopy**

| Sample                          | Description                                                                           | Appearance                          | <u>Non-Asbestos</u> |                          | <u>Asbestos</u> |
|---------------------------------|---------------------------------------------------------------------------------------|-------------------------------------|---------------------|--------------------------|-----------------|
|                                 |                                                                                       |                                     | % Fibrous           | % Non-Fibrous            | % Type          |
| 091712-09-19C<br>131204615-0022 | ATTIC FLOOR -<br>LOOSE FILL<br>INSULATION                                             | Tan<br>Fibrous<br>Homogeneous       | 90% Cellulose       | 10% Non-fibrous (other)  | None Detected   |
| 091712-09-20A<br>131204615-0023 | SIX OVER FOUR<br>DOUBLE HUNG<br>UNITS -<br>EXTERIOR<br>WINDOW<br>GLAZING<br>COMPOUND  | White<br>Non-Fibrous<br>Homogeneous |                     | 100% Non-fibrous (other) | None Detected   |
| 091712-09-20B<br>131204615-0024 | FOUR OVER<br>FOUR DOUBLE<br>HUNG UNITS -<br>EXTERIOR<br>WINDOW<br>GLAZING<br>COMPOUND | White<br>Non-Fibrous<br>Homogeneous |                     | 100% Non-fibrous (other) | None Detected   |
| 091712-09-20C<br>131204615-0025 | SIX OVER NINE<br>DOUBLE HUNG<br>UNITS -<br>EXTERIOR<br>WINDOW<br>GLAZING<br>COMPOUND  | Tan<br>Non-Fibrous<br>Homogeneous   |                     | 100% Non-fibrous (other) | None Detected   |

Analyst(s)

(b) (6) (12)

(b) (6) (15)

(b) (6)

(b) (6)

or other approved signatory

EMSL maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. Interpretation and use of test results are the responsibility of the client. This report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST or any agency of the federal government. Non-friable organically bound materials present a problem matrix and therefore EMSL recommends gravimetric reduction prior to analysis. Samples received in good condition unless otherwise noted. Estimated accuracy, precision and uncertainty data available upon request. Unless requested by the client, building materials manufactured with multiple layers (i.e. linoleum, wallboard, etc.) are reported as a single sample. Reporting limit is 1%

Samples analyzed by EMSL Analytical, Inc. Woburn, MA NVLAP Lab Code 101147-0, CT PH-0315, MA AA000188, RI AAL-107T3 and VT AL357102

Initial report from 09/26/2012 14:15:17



**EMSL Analytical, Inc.**

7 Constitution Way, Suite 107, Woburn, MA 01801

Phone/Fax: (781) 933-8411 / (781) 933-8412

(b) (6)

EMSL Order: 131204615

CustomerID: AXIO80

CustomerPO:

ProjectID:

Attn: (b) (6)  
**Axiom Partners, Inc.**  
**979 Main Street**  
**Wakefield, MA 01880**

Phone: (781) 213-9198  
Fax: (781) 213-6992  
Received: 09/19/12 11:55 AM  
Analysis Date: 9/26/2012  
Collected: 9/17/2012

Project: 01006.024 / USGC; Martha's Vineyard; 917 Main Street; Vineyard Haven, MA

**Test Report: Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 and/or EPA 600/M4-82-020 Method(s) using Polarized Light Microscopy**

| Sample                          | Description                                                                                   | Appearance                          | <u>Non-Asbestos</u> |                          | <u>Asbestos</u> |
|---------------------------------|-----------------------------------------------------------------------------------------------|-------------------------------------|---------------------|--------------------------|-----------------|
|                                 |                                                                                               |                                     | % Fibrous           | % Non-Fibrous            | % Type          |
| 091712-09-21A<br>131204615-0026 | GARAGE SIX<br>OVER SIX<br>DOUBLE HUNG<br>UNITS -<br>EXTERIOR<br>WINDOW<br>GLAZING<br>COMPOUND | Gray<br>Non-Fibrous<br>Homogeneous  |                     | 100% Non-fibrous (other) | None Detected   |
| 091712-09-21B<br>131204615-0027 | GARAGE SIX<br>OVER SIX<br>DOUBLE HUNG<br>UNITS -<br>EXTERIOR<br>WINDOW<br>GLAZING<br>COMPOUND | White<br>Non-Fibrous<br>Homogeneous |                     | 100% Non-fibrous (other) | None Detected   |

Analyst(s)

(b) (6) (12)

(b) (6) (15)

(b) (6)

(b) (6)

or other approved signatory

EMSL maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. Interpretation and use of test results are the responsibility of the client. This report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST or any agency of the federal government. Non-friable organically bound materials present a problem matrix and therefore EMSL recommends gravimetric reduction prior to analysis. Samples received in good condition unless otherwise noted. Estimated accuracy, precision and uncertainty data available upon request. Unless requested by the client, building materials manufactured with multiple layers (i.e. linoleum, wallboard, etc.) are reported as a single sample. Reporting limit is 1%

Samples analyzed by EMSL Analytical, Inc. Woburn, MA NVLAP Lab Code 101147-0, CT PH-0315, MA AA000188, RI AAL-107T3 and VT AL357102

Initial report from 09/26/2012 14:15:17



AXIOM PARTNERS  
979 MAIN STREET  
WAKEFIELD, MA 01880  
PHONE: 781.213.9198  
FAX: 781.213.6992

EMSL LABORATORY ORDER #:

131204616

Sample(s) received in good condition? [Y] [N]

Discernable field blank submitted? [Y] [N]

### Asbestos Analysis - Chain of Custody Form

|                           |                                                               |                 |            |
|---------------------------|---------------------------------------------------------------|-----------------|------------|
| Sampled by:               | (b) (6)                                                       | Date Collected: | 09-17-2012 |
| Project Name:             | Asbestos-Containing Materials Survey                          |                 |            |
| Project Site:             | USGC, Martha's Vineyard, 921 Main Street, Vineyard Haven, MA  |                 |            |
| Project ID/Number:        | 01006.025                                                     |                 |            |
| Special Lab Instructions: | Positive Stop, Five Day Turnaround, E-Mail Results to (b) (6) |                 |            |

**TURNAROUND TIME** - If turn around time is not chosen standard turnaround time applies (6 + Days)

|                                  |                                  |                                   |                                   |                                   |                                   |                                 |                                            |                                    |
|----------------------------------|----------------------------------|-----------------------------------|-----------------------------------|-----------------------------------|-----------------------------------|---------------------------------|--------------------------------------------|------------------------------------|
| <input type="checkbox"/> 3 Hours | <input type="checkbox"/> 6 Hours | <input type="checkbox"/> 12 Hours | <input type="checkbox"/> 24 Hours | <input type="checkbox"/> 48 Hours | <input type="checkbox"/> 72 Hours | <input type="checkbox"/> 4 Days | <input checked="" type="checkbox"/> 5 Days | <input type="checkbox"/> 6-10 Days |
|----------------------------------|----------------------------------|-----------------------------------|-----------------------------------|-----------------------------------|-----------------------------------|---------------------------------|--------------------------------------------|------------------------------------|

#### TYPE OF ASBESTOS ANALYSIS

|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                    |                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                       |                                                                                                                                                                                                                                                                                                                                                                                                                                               |
|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| PCM - Air<br><input type="checkbox"/> NIOSH 7400 (A) Issue 2: August 1994<br><input type="checkbox"/> OSHA w/TWA<br>PLM - Bulk<br><input checked="" type="checkbox"/> EPA 600/R-93/116<br><input type="checkbox"/> California Air Resource Board (CARB) 435<br><input type="checkbox"/> NY Stratified Point Count<br><input type="checkbox"/> NIOSH 9002<br><input type="checkbox"/> PLM NOB (Gravimetric) NYS 198.1<br><input type="checkbox"/> EPA Point Count (400 Points)<br><input type="checkbox"/> EPA Point Count (1,000 Points)<br><input type="checkbox"/> Standard Addition Point Count | SOILS<br><input type="checkbox"/> EPA Protocol Qualitative<br><input type="checkbox"/> EPA Protocol Quantitative<br><input type="checkbox"/> EMSL MSD 9000 Method fibers/gram<br><input type="checkbox"/> Superfund EPA 540-R097-028 (dust generation)<br>TEM AIR<br><input type="checkbox"/> AHERA 40 CFR, Part 763 Subpart E<br><input type="checkbox"/> NIOSH 7402 Issue 2<br><input type="checkbox"/> EPA Level II<br>TEM WIPE<br><input type="checkbox"/> ASTM D-6480-99<br><input type="checkbox"/> Qualitative | TEM MICROVAC<br><input type="checkbox"/> ASTM D 5755-95 (Quantitative)<br>TEM BULK<br><input type="checkbox"/> Drop Mount (Qualitative)<br><input type="checkbox"/> Chatfield SOP-1988-02<br><input type="checkbox"/> TEM NOB (Gravimetric) NY 198.4<br>TEM WATER<br><input type="checkbox"/> EPA 100.1<br><input type="checkbox"/> EPA 100.2<br><input type="checkbox"/> NYS 198.2<br><input checked="" type="checkbox"/> Other: Page 1 of 2 |
|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|


|    | SAMPLE NUMBER | SAMPLE TYPE | SAMPLE                                           | COMMENTS               |
|----|---------------|-------------|--------------------------------------------------|------------------------|
| 1  | 091712-09-01A | Bulk        | Wall Coating on Fieldstone Wall                  | Basement Walls         |
| 2  | 091712-09-01B | Bulk        | Wall Coating on Fieldstone Wall                  | Basement Walls         |
| 3  | 091712-09-01C | Bulk        | Wall Coating on Fieldstone Wall                  | Basement Walls         |
| 4  | 091712-09-02A | Bulk        | Wall and Ceiling Plaster                         | Basement Stairwell     |
| 5  | 091712-09-02B | Bulk        | Wall and Ceiling Plaster                         | Basement Stairwell     |
| 6  | 091712-09-02C | Bulk        | Wall and Ceiling Plaster                         | Basement Stairwell     |
| 7  | 091712-09-02D | Bulk        | Wall and Ceiling Plaster                         | Crawl Space in Bedroom |
| 8  | 091712-09-02E | Bulk        | Wall and Ceiling Plaster                         | Crawl Space in Bedroom |
| 9  | 091712-09-03A | Bulk        | Mastic Paper on White Floor Sheeting             | Kitchen                |
| 10 | 091712-09-03B | Bulk        | Mastic Paper on White Floor Sheeting             | Entryway At Radiator   |
| 11 | 091712-09-04A | Bulk        | White Floor Sheeting                             | Kitchen                |
| 12 | 091712-09-04B | Bulk        | Mastic Paper of White Floor Sheeting             | Entryway At Radiator   |
| 13 | 091712-09-05A | Bulk        | Mastic Paper on Beige Peel and Stick Floor Tiles | Bathroom               |
| 14 | 091712-09-05B | Bulk        | Mastic Paper on Beige Peel and Stick Floor Tiles | Bathroom               |
| 15 | 091712-09-06A | Bulk        | Beige Peel and Stick Floor Tiles                 | Bathroom               |

Relinquished: (b) (6)

Received: \_\_\_\_\_

Date: \_\_\_\_\_

Date: \_\_\_\_\_

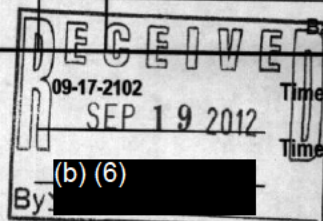





AXIOM PARTNERS  
979 MAIN STREET  
WAKEFIELD, MA 01880  
PHONE: 781.213.9198  
FAX: 781.213.6992

EMSL LABORATORY ORDER #:

131204616

Sample(s) received in good condition? [Y] [N]

Discernable field blank submitted? [Y] [N]

### Asbestos Analysis - Chain of Custody Form

|                           |                                                               |                 |            |
|---------------------------|---------------------------------------------------------------|-----------------|------------|
| Sampled by:               | (b) (6)                                                       | Date Collected: | 09-17-2012 |
| Project Name:             | Asbestos-Containing Materials Survey                          |                 |            |
| Project Site:             | USGC, Martha's Vineyard, 921 Main Street, Vineyard Haven, MA  |                 |            |
| Project ID/Number:        | 01006.025                                                     |                 |            |
| Special Lab Instructions: | Positive Stop, Five Day Turnaround, E-Mail Results to (b) (6) |                 |            |

**TURNAROUND TIME** – If turn around time is not chosen standard turnaround time applies (6 + Days)

|                                  |                                  |                                   |                                   |                                   |                                   |                                 |                                 |                                    |
|----------------------------------|----------------------------------|-----------------------------------|-----------------------------------|-----------------------------------|-----------------------------------|---------------------------------|---------------------------------|------------------------------------|
| <input type="checkbox"/> 3 Hours | <input type="checkbox"/> 6 Hours | <input type="checkbox"/> 12 Hours | <input type="checkbox"/> 24 Hours | <input type="checkbox"/> 48 Hours | <input type="checkbox"/> 72 Hours | <input type="checkbox"/> 4 Days | <input type="checkbox"/> 5 Days | <input type="checkbox"/> 6-10 Days |
|----------------------------------|----------------------------------|-----------------------------------|-----------------------------------|-----------------------------------|-----------------------------------|---------------------------------|---------------------------------|------------------------------------|

#### TYPE OF ASBESTOS ANALYSIS


|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                         |                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                       |                                                                                                                                                                                                                                                                                                                                                                                                                                    |
|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| PCM – Air<br><input type="checkbox"/> NIOSH 7400 (A) Issue 2: August 1994<br><input type="checkbox"/> OSHA w/TWA<br>PLM – Bulk<br><input type="checkbox"/> EPA 600/R-93/116<br><input type="checkbox"/> California Air Resource Board (CARB) 435<br><input type="checkbox"/> NY Stratified Point Count<br><input type="checkbox"/> NIOSH 9002<br><input type="checkbox"/> PLM NOB (Gravimetric) NYS 198.1<br><input type="checkbox"/> EPA Point Count (400 Points)<br><input type="checkbox"/> EPA Point Count (1,000 Points)<br><input type="checkbox"/> Standard Addition Point Count | SOILS<br><input type="checkbox"/> EPA Protocol Qualitative<br><input type="checkbox"/> EPA Protocol Quantitative<br><input type="checkbox"/> EMSL MSD 9000 Method fibers/gram<br><input type="checkbox"/> Superfund EPA 540-R097-028 (dust generation)<br>TEM AIR<br><input type="checkbox"/> AHERA 40 CFR, Part 763 Subpart E<br><input type="checkbox"/> NIOSH 7402 Issue 2<br><input type="checkbox"/> EPA Level II<br>TEM WIPE<br><input type="checkbox"/> ASTM D-6480-99<br><input type="checkbox"/> Qualitative | TEM MICROVAC<br><input type="checkbox"/> ASTM D 5755-95 (Quantitative)<br>TEM BULK<br><input type="checkbox"/> Drop Mount (Qualitative)<br><input type="checkbox"/> Chatfield SOP-1988-02<br><input type="checkbox"/> TEM NOB (Gravimetric) NY 198.4<br>TEM WATER<br><input type="checkbox"/> EPA 100.1<br><input type="checkbox"/> EPA 100.2<br><input type="checkbox"/> NYS 198.2<br><input type="checkbox"/> Other: Page 2 of 2 |
|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|

|    | SAMPLE NUMBER | SAMPLE TYPE | SAMPLE                                     | COMMENTS                         |
|----|---------------|-------------|--------------------------------------------|----------------------------------|
| 16 | 091712-09-06B | Bulk        | Beige Peel and Stick Floor Tiles           | Bathroom                         |
| 17 | 091712-09-07A | Bulk        | Loose Fill Insulation                      | Attic Spaces                     |
| 18 | 091712-09-07B | Bulk        | Loose Fill Insulation                      | Attic Spaces                     |
| 19 | 091712-09-07C | Bulk        | Loose Fill Insulation                      | Attic Spaces                     |
| 20 | 091712-09-08A | Bulk        | Mastic on Red Brick Pattern Floor Sheeting | Closet In Childs Bedroom         |
| 21 | 091712-09-08B | Bulk        | Mastic on Red Brick Pattern Floor Sheeting | Closet In Childs Bedroom         |
| 22 | 091712-09-09A | Bulk        | Red Brick Pattern Floor Sheeting           | Closet In Childs Bedroom         |
| 23 | 091712-09-09B | Bulk        | Red Brick Pattern Floor Sheeting           | Closet In Childs Bedroom         |
| 24 | 091712-09-10A | Bulk        | Exterior Window Glazing                    | Six Over Nine Double Hung Units  |
| 25 | 091712-09-10B | Bulk        | Exterior Window Glazing                    | Six Over Nine Double Hung Units  |
| 26 | 091712-09-10C | Bulk        | Exterior Window Glazing                    | Four over Nine Double Hung Units |
|    |               |             |                                            |                                  |
|    |               |             |                                            |                                  |
|    |               |             |                                            |                                  |
|    |               |             |                                            |                                  |

Relinquished:

(b) (6)

Received:

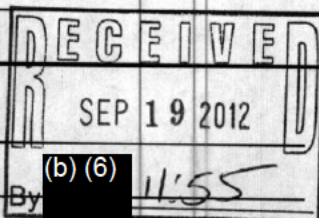

(b) (6)

Date:

09-17-2102

Time:

Date:

Time:





AXIOM PARTNERS  
979 MAIN STREET  
WAKEFIELD, MA 01880  
PHONE: 781.213.9198  
FAX: 781.213.6992

EMSL LABORATORY ORDER #:

**131204615**

Sample(s) received in good condition? [Y] [N]

Discernable field blank submitted? [Y] [N]

### Asbestos Analysis – Chain of Custody Form

|                           |                                                               |                 |            |
|---------------------------|---------------------------------------------------------------|-----------------|------------|
| Sampled by:               | (b) (6)                                                       | Date Collected: | 09-17-2012 |
| Project Name:             | Asbestos-Containing Materials Survey                          |                 |            |
| Project Site:             | USGC, Martha's Vineyard, 917 Main Street, Vineyard Haven, MA  |                 |            |
| Project ID/Number:        | 01006.024                                                     |                 |            |
| Special Lab Instructions: | Positive Stop, Five Day Turnaround, E-Mail Results to (b) (6) |                 |            |

**TURNAROUND TIME – If turn around time is not chosen standard turnaround time applies (6 + Days)**

|                                  |                                  |                                   |                                   |                                   |                                   |                                 |                                            |                                    |
|----------------------------------|----------------------------------|-----------------------------------|-----------------------------------|-----------------------------------|-----------------------------------|---------------------------------|--------------------------------------------|------------------------------------|
| <input type="checkbox"/> 3 Hours | <input type="checkbox"/> 6 Hours | <input type="checkbox"/> 12 Hours | <input type="checkbox"/> 24 Hours | <input type="checkbox"/> 48 Hours | <input type="checkbox"/> 72 Hours | <input type="checkbox"/> 4 Days | <input checked="" type="checkbox"/> 5 Days | <input type="checkbox"/> 6-10 Days |
|----------------------------------|----------------------------------|-----------------------------------|-----------------------------------|-----------------------------------|-----------------------------------|---------------------------------|--------------------------------------------|------------------------------------|

#### TYPE OF ASBESTOS ANALYSIS

|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                           |                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                       |                                                                                                                                                                                                                                                                                                                                                                                                                                                      |
|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| PCM – Air<br><input type="checkbox"/> NIOSH 7400 (A) Issue 2: August 1994<br><input type="checkbox"/> OSHA w/TWA<br>PLM – Bulk<br><input checked="" type="checkbox"/> <b>EPA 600/R-93/116</b><br><input type="checkbox"/> California Air Resource Board (CARB) 435<br><input type="checkbox"/> NY Stratified Point Count<br><input type="checkbox"/> NIOSH 9002<br><input type="checkbox"/> PLM NOB (Gravimetric) NYS 198.1<br><input type="checkbox"/> EPA Point Count (400 Points)<br><input type="checkbox"/> EPA Point Count (1,000 Points)<br><input type="checkbox"/> Standard Addition Point Count | SOILS<br><input type="checkbox"/> EPA Protocol Qualitative<br><input type="checkbox"/> EPA Protocol Quantitative<br><input type="checkbox"/> EMSL MSD 9000 Method fibers/gram<br><input type="checkbox"/> Superfund EPA 540-R097-028 (dust generation)<br>TEM AIR<br><input type="checkbox"/> AHERA 40 CFR, Part 763 Subpart E<br><input type="checkbox"/> NIOSH 7402 Issue 2<br><input type="checkbox"/> EPA Level II<br>TEM WIPE<br><input type="checkbox"/> ASTM D-6480-99<br><input type="checkbox"/> Qualitative | TEM MICROVAC<br><input type="checkbox"/> ASTM D 5755-95 (Quantitative)<br>TEM BULK<br><input type="checkbox"/> Drop Mount (Qualitative)<br><input type="checkbox"/> Chatfield SOP-1988-02<br><input type="checkbox"/> TEM NOB (Gravimetric) NY 198.4<br>TEM WATER<br><input type="checkbox"/> EPA 100.1<br><input type="checkbox"/> EPA 100.2<br><input type="checkbox"/> <b>NYS 198.2</b><br><input checked="" type="checkbox"/> Other: Page 1 of 2 |
|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|

|    | SAMPLE NUMBER | SAMPLE TYPE | SAMPLE                               | COMMENTS                             |
|----|---------------|-------------|--------------------------------------|--------------------------------------|
| 1  | 091712-09-11A | Bulk        | Mastic on 12" x 12" Brown Floor Tile | First Floor Bathroom                 |
| 2  | 091712-09-11A | Bulk        | Mastic on 12" x 12" Brown Floor Tile | First Floor                          |
| 3  | 091712-09-12A | Bulk        | 12" x 12" Brown Floor Tile           | First Floor Bathroom                 |
| 4  | 091712-09-12B | Bulk        | 12" x 12" Brown Floor Tile           | First Floor                          |
| 5  | 091712-09-13A | Bulk        | White Sink Undercoating              | Kitchen Sink                         |
| 6  | 091712-09-13B | Bulk        | White Sink Undercoating              | Kitchen Sink                         |
| 7  | 091712-09-14A | Bulk        | Gypsum Board                         | Laundry Area                         |
| 8  | 091712-09-14B | Bulk        | Gypsum Board                         | Second Floor Middle Bedroom          |
| 9  | 091712-09-15A | Bulk        | Joint Compound w/Sample #14A         | Laundry Area                         |
| 10 | 091712-09-15B | Bulk        | Joint Compound w/Sample #14B         | Second Floor Middle Bedroom          |
| 11 | 091712-09-16A | Bulk        | Wall and Ceiling Plaster             | Chase in Second Floor Middle Bedroom |
| 12 | 091712-09-16B | Bulk        | Wall and Ceiling Plaster             | Basement                             |
| 13 | 091712-09-16C | Bulk        | Wall and Ceiling Plaster             | Basement                             |
| 14 | 091712-09-16D | Bulk        | Wall and Ceiling Plaster             | Attic                                |
| 15 | 091712-09-16E | Bulk        | Wall and Ceiling Plaster             | Attic                                |

Relinquished:

(b) (6)

Received:

Date:

SEP 19 2012

Time:

Date:

(b) (6) 1155

Time:

By

walkin





AXIOM PARTNERS  
979 MAIN STREET  
WAKEFIELD, MA 01880  
PHONE: 781.213.9198  
FAX: 781.213.6992

EMSL LABORATORY ORDER #:

**131204615**

Sample(s) received in good condition? [Y] [N]

Discernable field blank submitted? [Y] [N]

### Asbestos Analysis - Chain of Custody Form

|                           |                                                               |                 |            |
|---------------------------|---------------------------------------------------------------|-----------------|------------|
| Sampled by:               | (b) (6)                                                       | Date Collected: | 09-17-2012 |
| Project Name:             | Asbestos-Containing Materials Survey                          |                 |            |
| Project Site:             | USGC, Martha's Vineyard, 917 Main Street, Vineyard Haven, MA  |                 |            |
| Project ID/Number:        | 01006.024                                                     |                 |            |
| Special Lab Instructions: | Positive Stop, Five Day Turnaround, E-Mail Results to (b) (6) |                 |            |

**TURNAROUND TIME** - If turn around time is not chosen standard turnaround time applies (6 + Days)

|                                  |                                  |                                   |                                   |                                   |                                   |                                 |                                 |                                    |
|----------------------------------|----------------------------------|-----------------------------------|-----------------------------------|-----------------------------------|-----------------------------------|---------------------------------|---------------------------------|------------------------------------|
| <input type="checkbox"/> 3 Hours | <input type="checkbox"/> 6 Hours | <input type="checkbox"/> 12 Hours | <input type="checkbox"/> 24 Hours | <input type="checkbox"/> 48 Hours | <input type="checkbox"/> 72 Hours | <input type="checkbox"/> 4 Days | <input type="checkbox"/> 5 Days | <input type="checkbox"/> 6-10 Days |
|----------------------------------|----------------------------------|-----------------------------------|-----------------------------------|-----------------------------------|-----------------------------------|---------------------------------|---------------------------------|------------------------------------|

#### TYPE OF ASBESTOS ANALYSIS


|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                         |                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                       |                                                                                                                                                                                                                                                                                                                                                                                                                                    |
|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| PCM - Air<br><input type="checkbox"/> NIOSH 7400 (A) Issue 2: August 1994<br><input type="checkbox"/> OSHA w/TWA<br>PLM - Bulk<br><input type="checkbox"/> EPA 600/R-93/116<br><input type="checkbox"/> California Air Resource Board (CARB) 435<br><input type="checkbox"/> NY Stratified Point Count<br><input type="checkbox"/> NIOSH 9002<br><input type="checkbox"/> PLM NOB (Gravimetric) NYS 198.1<br><input type="checkbox"/> EPA Point Count (400 Points)<br><input type="checkbox"/> EPA Point Count (1,000 Points)<br><input type="checkbox"/> Standard Addition Point Count | SOILS<br><input type="checkbox"/> EPA Protocol Qualitative<br><input type="checkbox"/> EPA Protocol Quantitative<br><input type="checkbox"/> EMSL MSD 9000 Method fibers/gram<br><input type="checkbox"/> Superfund EPA 540-R097-028 (dust generation)<br>TEM AIR<br><input type="checkbox"/> AHERA 40 CFR, Part 763 Subpart E<br><input type="checkbox"/> NIOSH 7402 Issue 2<br><input type="checkbox"/> EPA Level II<br>TEM WIPE<br><input type="checkbox"/> ASTM D-6480-99<br><input type="checkbox"/> Qualitative | TEM MICROVAC<br><input type="checkbox"/> ASTM D 5755-95 (Quantitative)<br>TEM BULK<br><input type="checkbox"/> Drop Mount (Qualitative)<br><input type="checkbox"/> Chatfield SOP-1988-02<br><input type="checkbox"/> TEM NOB (Gravimetric) NY 198.4<br>TEM WATER<br><input type="checkbox"/> EPA 100.1<br><input type="checkbox"/> EPA 100.2<br><input type="checkbox"/> NYS 198.2<br><input type="checkbox"/> Other: Page 2 of 2 |
|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|

|    | SAMPLE NUMBER | SAMPLE TYPE | SAMPLE                           | COMMENTS                              |
|----|---------------|-------------|----------------------------------|---------------------------------------|
| 16 | 091712-09-17A | Bulk        | Mastic on Beige Floor Tiles      | Second Floor Bath                     |
| 17 | 091712-09-17B | Bulk        | Mastic on Beige Floor Tiles      | Second Floor Bath                     |
| 18 | 091712-09-18A | Bulk        | Beige Floor Tiles                | Second Floor Bath                     |
| 19 | 091712-09-18B | Bulk        | Beige Floor Tiles                | Second Floor Bath                     |
| 20 | 091712-09-19A | Bulk        | Loose Fill Insulation            | Attic Floor                           |
| 21 | 091712-09-19B | Bulk        | Loose Fill Insulation            | Attic Floor                           |
| 22 | 091712-09-19C | Bulk        | Loose Fill Insulation            | Attic Floor                           |
| 23 | 091712-09-20A | Bulk        | Exterior Window Glazing Compound | Six Over Four Double Hung Units       |
| 24 | 091712-09-20B | Bulk        | Exterior Window Glazing Compound | Four Over Four Double Hung Units      |
| 25 | 091712-09-20C | Bulk        | Exterior Window Glazing Compound | Six Over Nine Double Hung Units       |
| 26 | 091712-09-21A | Bulk        | Exterior Window Glazing Compound | Garage Six Over Six Double Hung Units |
| 27 | 091712-09-21B | Bulk        | Exterior Window Glazing Compound | Garage Six Over Six Double Hung Units |
|    |               |             |                                  |                                       |
|    |               |             |                                  |                                       |
|    |               |             |                                  |                                       |

Relinquished:

(b) (6)

Received:

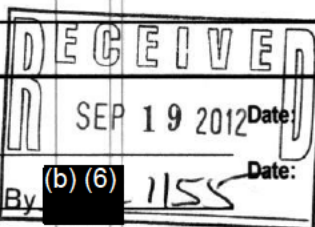

09-17-2102

Time:

Time:

**APPENDIX B**  
**LBP Executive Summary**  
**& Field Documentation**





October 17, 2012

Via E-Mail

United States Coast Guard  
CEU Providence  
300 Metro Center Boulevard  
Warwick, RI 02886-1747  
Attn: (b) (6)

Re: Executive Summary for Lead Based Paint, Martha's Vineyard Housing West Chop #1 & #2, Vineyard Haven, Massachusetts, Contract No. HSCGG1-08-D-3RX001 / 01010770714901

Dear (b) (6) ;

H&S Environmental, Inc. (H&S) conducted lead based paint inspections for the USCG at 917 & 920 East Main Street, Vineyard Haven, MA 02568 (also known as West Chop #1 and #2) on September 20, 2012. . An executive summary of the lead based paint inspections are below:

**Executive Summary for 917 East Main Street (West Chop #1)**

**Site Location and Description**

The Site (917 East Main Street) is comprised of a wood framed house and a garage. The house is two floors with a full basement and is approximately 1,800 square foot. The basement is a combination of field stone and brick. The roof is a pitched wood framed structure and covered with three-tab asphalt roof shingles. Interior walls and ceilings are combination plaster and drywall. The wood subfloors are covered with a combination of hardwood and resilient floor sheeting and vinyl-composite floor tiles. Windows are wood-cased, double hung units. Heat is provided by an oil fired furnace in the basement and is delivered to the individual spaces by room radiators. The house at 917 Main Street is vacant.

**Findings and Results**

This summary presents the results of testing for the presence of lead by X-Ray Fluorescence (XRF) analysis on interior and exterior painted surfaces at the Site. The lead testing was performed on September 20, 2012, by (b) (6) Commonwealth of Massachusetts Licensed Master Lead Inspector (License No. (b) (6)) is trained in the proper use and interpretation of results of the XRF Spectrum Analyzer.

The XRF testing was performed to evaluate the lead content on painted surfaces for interior and exterior surfaces in housing, and determine the presence of lead hazards as defined by the Massachusetts Lead Law (105 CMR 460.000 – Lead Poisoning Prevention and Control). Surfaces tested included: walls, ceilings, floors, shelving, closet features, window systems, door systems, exterior siding, exterior trim, porch trim and features, garage exterior components, and any other component with a surface coating that was visible and reachable during the inspection.

Lead paint content of components was not consistent or representative from one area to another; this is likely due to previous work that has been performed to the property from over the years of maintenance and updates. The following building components were found to contain dangerous levels of lead (see individual reports for exact results):

- Plaster walls and ceilings
- Baseboards
- Doors, door casings, and door jambs
- Window sills, casings, interior stop edges, aprons, exterior sills, blind stops, and exterior casings.
- Stair risers, treads, stringers, floor edges, and floor casings
- Shelves and shelf supports
- Garage exterior components

Less commonly found to contain lead, but still having at least some locations which are considered to have dangerous amounts of lead are:

- Door thresholds and kickplates
- Exterior Cornerboards
- Porch columns

In addition to these components containing dangerous levels of lead, many of these components present one or more lead hazards as defined by 105 CMR 460.000. These hazards are either:

- accessible/mouthable surfaces
- moveable/impact surfaces, and/or
- loose/chipping/peeling/deteriorated paint.

Anyone who performs work to correct lead hazards must be authorized and licensed according to 105 CMR 460.00 – Lead Poisoning Prevention and Control and 454 CMR 22.00 – Deleading and Lead Safe Renovation Regulations.

Additionally, the employer of workers who disturb or remove lead paint must comply with OSHA Standard 29 CFR 1926.62 - Lead. This applies to all construction work, alteration, or repair, including painting, where an employee may be occupationally exposed to lead.

Although the HUD<sup>1</sup> lead paint standard classifies Lead-Based Paint (LBP) as having  $\geq 0.5\%$  of lead by weight as analyzed by Atomic Absorption, for the purposes of renovation and/or demolition work, OSHA defines LCP's as any paint containing detectable amounts of lead. The condition of the lead containing paint listed in Appendix B ranges from good to damage.

The findings of this inspection are included in *Attachment A*.

### **Recommendations for Deleading In Massachusetts**

A comprehensive lead paint inspection was performed at the Site by a licensed lead paint inspector which included information regarding the lead paint content of every accessible surface by location for that property. In addition, if a dangerous level of lead is detected on a surface (equal to or greater than **1.0 milligrams per square centimeter**) then the inspector will also indicate if any lead hazards are associated with that surface.

The Massachusetts Lead Law requires that a property where a child under six years of age resides be free of any lead hazards. Lead hazards cannot exist inside the living space of the unit, on the exterior of any accessible building on the lot line, or in any common areas if there are any. This can only be determined after a comprehensive lead inspection is performed.

If no lead hazards are found at the time of the initial inspection, a Letter of Full Initial Lead Inspection Compliance may be issued for the property. If lead hazards are found, then all lead hazards must be delead in order to make the property lead-safe.

Lead Hazards fall into one of three categories in Massachusetts:

- Accessible/Mouthable (A/M) – A surface that is 5 feet or less from the floor, ground, or stair tread that protrudes more a ½ inch or more, or forms an outside corner. All metal surfaces are not considered A/M except for handrails, railing caps, and window sills.
- Moveable/Impact (M/I) – A frictional piece in a window system in which that window system has a sill located 5 feet or less from the floor, ground, or stair tread. Also storm window frames must be removed if there is lead paint on the exterior window sill or blind stop so lead chips will not build up inside.
- Loose (L) – A surface that is loose, chipping, peeling, flaking, damaged, or otherwise deteriorated.

Therefore a typical lead abatement job will require that all moveable/impact parts of windows be completely abated, all accessible/mouthable surfaces are abated to a minimum height of 5 feet, and all other remaining loose lead paint is stabilized and made intact. All work performed for these purposes MUST be performed by a licensed or authorized person.

---

<sup>1</sup> [U.S. Department of Housing and Urban Development](#)



Authorization of workers in Massachusetts is broken into three categories determined by the risk of the lead abatement task. Authorization comes from either the Childhood Lead Poisoning Prevention Program (CLPPP) or the Department of Labor Standards (DLS). These are described in *Table 1*.

**Table 1**  
**Massachusetts Deleading Authorization Levels**

| <b>Low Risk</b>                                                                                                                                                                     | <b>Moderate Risk</b>                                                                                                                                                                                                                                                                                                                                                                                                                                                          | <b>High Risk</b>                                                                                                                                                                                                                                                                                              |
|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| Reserved for owners and their agents.<br><br>Low risk deleading requires the person to read two informational pamphlets and submit two quizzes (located in the pamphlets) to CLPPP. | Two ways of authorization.<br><br>For owners and their agents, they may take a one day approved by CLPPP called Moderate Risk Owner/Agent. CLPPP mails a person who completes the course a quiz, which is mailed back to CLPPP upon completion.<br><br>Contractors may take the one day RRP course followed by a 4-hour Moderate Risk Option for Lead-Safe Renovators course which is approved by DLS. Upon course completion DLS/CLPPP will provide an authorization number. | Deleading Contractors, Deleading Supervisors, and Deleading Workers.<br><br>A 3-day course for workers, and a 4-day course for supervisors/contractors is required. Highly regulated by DLS through strict enforcement, including blood monitoring of employees.<br><br>Requires an annual one day refresher. |

An appropriately authorized person may then perform some or all of the lead abatement necessary for the property to gain a Letter of Full Deleading Compliance. Each of the previously described lead hazards has multiple ways of being remediated. *Table 2* describes how each lead be hazard may be deleading.

**Table 2**  
**Deleading Methods**

| <b>Type of Lead Hazard</b>  | <b>Deleading Method</b>                                                                                                                                                                                                                                                                                                                                                                                                                     |
|-----------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| <b>Accessible/Mouthable</b> | <b>Coating Removal (High Risk)</b> – Surface is wet scrapped or stripped to bare substrate to a minimum height of 5 feet. If it is an outside corner, then it is scraped to a minimum of 5 feet high and 4 inches back from all edges.<br><br><b>Replacement (Moderate Risk)</b> – Component is removed in a piece-by-piece manner and replaced with a new component which is appropriately installed. Replacement of walls and ceilings is |

|                        |                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                            |
|------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|                        | <p>considered High Risk Deleading.</p> <p><b>Encapsulating Paint (Low Risk)</b> – Surface is painted with a specialized paint called an encapsulant. Encapsulants are designed specifically to cover A/M lead painted surfaces. The surface must be in good condition. If marked loose on the inspection report, a Moderate or High Risk Deleader must make the surface intact first. Good for historical preservation.</p> <p><b>Covering (Low Risk)</b> – Some surfaces may be covered to block access to a surface that is considered A/M. Typically these surfaces are on the outside corners of walls or ceiling/walls, or may be in an uncommon location. Covering may also be used for other reasons as well.</p> <p><b>Dipping (Various)</b> – A component is removed and taken to an off-site dipping facility to remove all coatings, and then reinstalled by the appropriately authorized person. This is usually done for doors, but can be used for other components if desired.</p>                                                                                                                                          |
| <b>Moveable/Impact</b> | <p><b>Window Replacement (Moderate Risk)</b> - Window system is removed and replaced with a new self-contained system that does not rub on any part of the existing window trim. This is usually done with a vinyl replacement window.</p> <p><b>Covering (Low Risk)</b> – In some cases where windows have been previously partially modernized, covering of specific surfaces may be enough to remove any lead hazards from the window. In this situation, only the exterior sill and/or blind stop have lead paint on them. Aluminum sheet metal may be used to cover the exterior sill and blind stop, but must be done so that all edges are caulked and wrap into the storm window frame if there is one.</p> <p><b>Coating Removal (High Risk)</b> – This method is chosen for historical preservation applications. The window sash is typically wet scrapped or dipped off-site if it has lead paint. All putty must be scrapped out of the sash as well. The rest of the window parts should be wet scrapped or stripped to bare substrate. Partial replacement may be used with replica components if necessary or desired.</p> |
| <b>Loose</b>           | <p><b>Make Intact (High Risk)</b> - Loose paint is flaked and spot-primed in order to stabilize it. Surface cracks and imperfections are repaired using spackle, wood putty, or other appropriate materials. Severely damaged or rotted components may need partial or full replacement.</p> <p><b>Moderate Risk Make Intact (Moderate Risk)</b> – Loose paint is flaked and spot-primed in order to stabilize it. Surface cracks and</p>                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                  |

|  |                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                |
|--|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|  | <p>imperfections are repaired using spackle, wood putty, or other appropriate materials. Severely damaged or rotted components may need partial or full replacement. Moderate Risk Make Intact is limited to 2 sq. ft. per interior room or 10 sq. ft. for the entire exterior. Exceeding this limit becomes High Risk.</p> <p><b>Covering (Low Risk)</b> - Surface is covered with an appropriate material for the application. The component should be completely covered, and the covering be mechanically fastened to the surface by screws, nails, or construction adhesive. All edges and seams should be caulked so no loose paint chips or dust can be released. The surface below does not need to be made intact before being covered. Covering may also be used for other reasons as well.</p> <p><b>Replacement (Moderate Risk)</b> - Component is removed in a piece-by-piece manner and replaced with a new component which is appropriately installed. Replacement of walls and ceilings is considered High Risk Deleading.</p> |
|--|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|

H&S Recommends the following actions for 917 East Main Street:

- 1) All Accessible/Mouthable Surfaces be either be replaced (Moderate Risk) or covered using an encapsulating paint (Low Risk)
- 2) All Moveable/Impactable Surfaces (i.e. windows) be replaced (Moderate Risk) or the coating removed (High Risk)
- 3) All Loose Surfaces be made intact (Moderate Risk) or be replaced (Moderate Risk)

### *Rough Order of Magnitude (ROM) Cost Estimate*

The Rough Order of Magnitude Costs for the deleading of the property (including all labor, material, and equipment) associated with this ROM Cost Estimate is as follows:

917 East Main Street (Including Garage)

\$30-\$45/per square foot



## **Executive Summary for 920 East Main Street (West Chop #2)**

### **Site Location and Description**

The Site (920 East Main Street) is comprised of a wood framed house and a garage. The house is two floors with a full basement and is approximately 1,800 square foot. The basement is a combination of field stone and brick. The roof is a pitched wood framed structure and covered with three-tab asphalt roof shingles. Interior walls and ceilings are combination plaster and drywall. The wood subfloors are covered with a combination of hardwood and resilient floor sheeting and vinyl-composite floor tiles. Windows are wood-cased, double hung units. Heat is provided by an oil fired furnace in the basement and is delivered to the individual spaces by room radiators. The house at 920 Main Street is currently occupied and has two (2) children under the age of 6.

### **Findings and Results**

This summary presents the results of testing for the presence of lead by X-Ray Fluorescence (XRF) analysis on interior and exterior painted surfaces at the Site. The lead testing was performed on September 20, 2012, by (b) (6) Commonwealth of Massachusetts Licensed Master Lead Inspector (License (b) (6)). (b) (6) is trained in the proper use and interpretation of results of the XRF Spectrum Analyzer.

The XRF testing was performed to evaluate the lead content on painted surfaces for interior and exterior surfaces in housing, and determine the presence of lead hazards as defined by the Massachusetts Lead Law (105 CMR 460.000 – Lead Poisoning Prevention and Control). Surfaces tested included: walls, ceilings, floors, shelving, closet features, window systems, door systems, exterior siding, exterior trim, porch trim and features, garage exterior components, and any other component with a surface coating that was visible and reachable during the inspection.

Lead paint content of components was not consistent or representative from one area to another; this is likely due to previous work that has been performed to the property from over the years of maintenance and updates. The following building components were found to contain dangerous levels of lead (see individual reports for exact results):

- Plaster walls and ceilings
- Baseboards
- Doors, door casings, and door jambs
- Window sills, casings, interior stop edges, aprons, exterior sills, blind stops, and exterior casings.
- Stair risers, treads, stringers, floor edges, and floor casings
- Shelves and shelf supports
- Garage exterior components

Less commonly found to contain lead, but still having at least some locations which are considered to have dangerous amounts of lead are:

- Door thresholds and kickplates
- Exterior Cornerboards
- Porch columns

In addition to these components containing dangerous levels of lead, many of these components present one or more lead hazards as defined by 105 CMR 460.000. These hazards are either:

- accessible/mouthable surfaces
- moveable/impact surfaces, and/or
- loose/chipping/peeling/deteriorated paint.

Anyone who performs work to correct lead hazards must be authorized and licensed according to 105 CMR 460.00 – Lead Poisoning Prevention and Control and 454 CMR 22.00 – Deleading and Lead Safe Renovation Regulations.

Additionally, the employer of workers who disturb or remove lead paint must comply with OSHA Standard 29 CFR 1926.62 - Lead. This applies to all construction work, alteration, or repair, including painting, where an employee may be occupationally exposed to lead.

Although the HUD<sup>2</sup> lead paint standard classifies Lead-Based Paint (LBP) as having  $\geq 0.5\%$  of lead by weight as analyzed by Atomic Absorption, for the purposes of renovation and/or demolition work, OSHA defines LCP's as any paint containing detectable amounts of lead. The condition of the lead containing paint listed in Appendix B ranges from good to damage.

The findings of this inspection are included in *Attachment B*.

### **Recommendations for Deleading In Massachusetts**

A comprehensive lead paint inspection was performed at the Site by a licensed lead paint inspector which included information regarding the lead paint content of every accessible surface by location for that property. In addition, if a dangerous level of lead is detected on a surface (equal to or greater than **1.0 milligrams per square centimeter**) then the inspector will also indicate if any lead hazards are associated with that surface.

The Massachusetts Lead Law requires that a property where a child under six years of age resides be free of any lead hazards. Lead hazards cannot exist inside the living space of the unit, on the exterior of any accessible building on the lot line, or in any common areas if there are any. This can only be determined after a comprehensive lead inspection is performed.

If no lead hazards are found at the time of the initial inspection, a Letter of Full Initial Lead Inspection Compliance may be issued for the property. If lead hazards are found, then all lead hazards must be deleading in order to make the property lead-safe.

<sup>2</sup> [U.S. Department of Housing and Urban Development](#)

Lead Hazards fall into one of three categories in Massachusetts:

- Accessible/Mouthable (A/M) – A surface that is 5 feet or less from the floor, ground, or stair tread that protrudes more a ½ inch or more, or forms an outside corner. All metal surfaces are not considered A/M except for handrails, railing caps, and window sills.
- Moveable/Impact (M/I) – A frictional piece in a window system in which that window system has a sill located 5 feet or less from the floor, ground, or stair tread. Also storm window frames must be removed if there is lead paint on the exterior window sill or blind stop so lead chips will not build up inside.
- Loose (L) – A surface that is loose, chipping, peeling, flaking, damaged, or otherwise deteriorated.

Therefore a typical lead abatement job will require that all moveable/impact parts of windows be completely abated, all accessible/mouthable surfaces are abated to a minimum height of 5 feet, and all other remaining loose lead paint is stabilized and made intact. All work performed for these purposes MUST be performed by a licensed or authorized person.

Authorization of workers in Massachusetts is broken into three categories determined by the risk of the lead abatement task. Authorization comes from either the Childhood Lead Poisoning Prevention Program (CLPPP) or the Department of Labor Standards (DLS). These are described in *Table 1*.

**Table 1**  
**Massachusetts Deleading Authorization Levels**

| <b>Low Risk</b>                                                                                                                                                                     | <b>Moderate Risk</b>                                                                                                                                                                                                                                                                                                                                                                                                                         | <b>High Risk</b>                                                                                                                                                                                                                                                                                              |
|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| Reserved for owners and their agents.<br><br>Low risk deleading requires the person to read two informational pamphlets and submit two quizzes (located in the pamphlets) to CLPPP. | Two ways of authorization.<br><br>For owners and their agents, they may take a one day approved by CLPPP called Moderate Risk Owner/Agent. CLPPP mails a person who completes the course a quiz, which is mailed back to CLPPP upon completion.<br><br>Contractors may take the one day RRP course followed by a 4-hour Moderate Risk Option for Lead-Safe Renovators course which is approved by DLS. Upon course completion DLS/CLPPP will | Deleading Contractors, Deleading Supervisors, and Deleading Workers.<br><br>A 3-day course for workers, and a 4-day course for supervisors/contractors is required. Highly regulated by DLS through strict enforcement, including blood monitoring of employees.<br><br>Requires an annual one day refresher. |



|  |                                  |  |
|--|----------------------------------|--|
|  | provide an authorization number. |  |
|--|----------------------------------|--|

An appropriately authorized person may then perform some or all of the lead abatement necessary for the property to gain a Letter of Full Deleading Compliance. Each of the previously described lead hazards has multiple ways of being remediated. **Table 2** describes how each lead hazard may be delead.

**Table 2**  
**Deleading Methods**

| <b>Type of Lead Hazard</b>  | <b>Deleading Method</b>                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                       |
|-----------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| <b>Accessible/Mouthable</b> | <p><b>Coating Removal (High Risk)</b> – Surface is wet scrapped or stripped to bare substrate to a minimum height of 5 feet. If it is an outside corner, then it is scraped to a minimum of 5 feet high and 4 inches back from all edges.</p> <p><b>Replacement (Moderate Risk)</b> – Component is removed in a piece-by-piece manner and replaced with a new component which is appropriately installed. Replacement of walls and ceilings is considered High Risk Deleading.</p> <p><b>Encapsulating Paint (Low Risk)</b> – Surface is painted with a specialized paint called an encapsulant. Encapsulants are designed specifically to cover A/M lead painted surfaces. The surface must be in good condition. If marked loose on the inspection report, a Moderate or High Risk Deleader must make the surface intact first. Good for historical preservation.</p> <p><b>Covering (Low Risk)</b> – Some surfaces may be covered to block access to a surface that is considered A/M. Typically these surfaces are on the outside corners of walls or ceiling/walls, or may be in an uncommon location. Covering may also be used for other reasons as well.</p> <p><b>Dipping (Various)</b> – A component is removed and taken to an off-site dipping facility to remove all coatings, and then reinstalled by the appropriately authorized person. This is usually done for doors, but can be used for other components if desired.</p> |
| <b>Moveable/Impact</b>      | <p><b>Window Replacement (Moderate Risk)</b> - Window system is removed and replaced with a new self-contained system that does not rub on any part of the existing window trim. This is usually done with a vinyl replacement window.</p> <p><b>Covering (Low Risk)</b> – In some cases where windows have been</p>                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                          |

|              |                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                   |
|--------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|              | <p>previously partially modernized, covering of specific surfaces may be enough to remove any lead hazards from the window. In this situation, only the exterior sill and/or blind stop have lead paint on them. Aluminum sheet metal may be used to cover the exterior sill and blind stop, but must be done so that all edges are caulked and wrap into the storm window frame if there is one.</p> <p><b>Coating Removal (High Risk)</b> – This method is chosen for historical preservation applications. The window sash is typically wet scrapped or dipped off-site if it has lead paint. All putty must be scrapped out of the sash as well. The rest of the window parts should be wet scrapped or stripped to bare substrate. Partial replacement may be used with replica components if necessary or desired.</p>                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                      |
| <b>Loose</b> | <p><b>Make Intact (High Risk)</b> - Loose paint is flaked and spot-primed in order to stabilize it. Surface cracks and imperfections are repaired using spackle, wood putty, or other appropriate materials. Severely damaged or rotted components may need partial or full replacement.</p> <p><b>Moderate Risk Make Intact (Moderate Risk)</b> – Loose paint is flaked and spot-primed in order to stabilize it. Surface cracks and imperfections are repaired using spackle, wood putty, or other appropriate materials. Severely damaged or rotted components may need partial or full replacement. Moderate Risk Make Intact is limited to 2 sq. ft. per interior room or 10 sq. ft. for the entire exterior. Exceeding this limit becomes High Risk.</p> <p><b>Covering (Low Risk)</b> - Surface is covered with an appropriate material for the application. The component should be completely covered, and the covering be mechanically fastened to the surface by screws, nails, or construction adhesive. All edges and seams should be caulked so no loose paint chips or dust can be released. The surface below does not need to be made intact before being covered. Covering may also be used for other reasons as well.</p> <p><b>Replacement (Moderate Risk)</b> - Component is removed in a piece-by-piece manner and replaced with a new component which is appropriately installed. Replacement of walls and ceilings is considered High Risk Deleading.</p> |

H&S Recommends the following actions for 920 East Main Street:

- 4) All Accessible/Mouthable Surfaces be either be replaced (Moderate Risk) or covered using an encapsulating paint (Low Risk)

- 5) All Moveable/Impactable Surfaces (i.e. windows) be replaced (Moderate Risk) or the coating removed (High Risk)
- 6) All Loose Surfaces be made intact (Moderate Risk) or be replaced (Moderate Risk)

**Rough Order of Magnitude (ROM) Cost Estimate**

The Rough Order of Magnitude Costs for the deleading of the property (including all labor, material, and equipment) associated with this ROM Cost Estimate is as follows:

920 East Main Street

\$45-\$55/per square foot

Please see the attached lead inspection reports/field notes for 917 E. Main Street (Attachment A), 920 East Main Street (Attachment B), Commonwealth of Massachusetts Residential Deleading Advisory (Attachment C), and Commonwealth of Massachusetts Tenant's Rights and Responsibilities (Attachment D) for more detailed information regarding the lead based paint inspections and for Commonwealth of Massachusetts requirements.

H&S appreciates the opportunity to provide our service to the USCG.. If you have any questions related to this executive summary, please feel free to contact me at (b) (6) or (b) (6).

Sincerely,  
***H&S Environmental Inc.***

(b) (6)

(b) (6) ®  
Project Manager



**Attachment A**

Lead Inspection Report/Field Notes  
917 East Main Street (Including Garage)

September 23, 2012

US Coast Guard Air Station Cape Cod  
Martha's Vineyard Housing  
West Chop #1 & #2  
(917 & 920 Main Street)  
Vineyard Haven, MA 02568

#### XRF Lead Paint Narrative

This report presents the results of testing for the presence of lead by X-Ray Fluorescence (XRF) analysis on interior and exterior painted surfaces at the above-referenced location. The lead testing was performed on September 20, 2012, by (b) (6) Commonwealth of Massachusetts Licensed Lead Inspector (License No. (b) (6)). (b) (6) is trained in the proper use and interpretation of results of the XRF Spectrum Analyzer.

The XRF testing was performed to evaluate the lead content on painted surfaces for interior and exterior surfaces in housing, and determine the presence of lead hazards as defined by the Massachusetts Lead Law (105 CMR 460.000 – Lead Poisoning Prevention and Control). Surfaces tested included: walls, ceilings, floors, shelving, closet features, window systems, door systems, exterior siding, exterior trim, porch trim and features, garage exterior components, and any other component with a surface coating that was visible and reachable during the inspection.

Lead paint content of components was not consistent or representative from one area to another; this is likely due to previous work that has been performed to the property from over the years of maintenance and updates. The following building components were commonly found to contain dangerous levels of lead (see individual reports for exact results):

- Plaster walls and ceilings
- Baseboards
- Doors, door casings, and door jambs
- Window sills, casings, interior stop edges, aprons, exterior sills, blind stops, and exterior casings.
- Stair risers, treads, stringers, floor edges, and floor casings
- Shelves and shelf supports
- Garage exterior components

Less commonly found to contain lead, but still having at least some locations which are considered to have dangerous amounts of lead are:

- Door thresholds and kickplates
- Exterior Cornerboards
- Porch columns

In addition to these components containing dangerous levels of lead, many of these components present one or more lead hazards as defined by 105 CMR 460.000. These

hazards are either: Accessible/mouthable surfaces, moveable/impact surfaces, and/or loose/chipping/peeling/deteriorated paint.

Anyone who performs work to correct lead hazards must be authorized and licensed according to 105 CMR 460.00 – Lead Poisoning Prevention and Control and 454 CMR 22.00 – Deleading and Lead Safe Renovation Regulations.

Additionally, the employer of workers who disturb or remove lead paint must comply with OSHA Standard 29 CFR 1926.62 - Lead. This applies to all construction work, alteration, or repair, including painting, where an employee may be occupationally exposed to lead.

### **Limitations**


Lead testing was limited to accessible interior and exterior painted surfaces located at 917 & 920 Main Street, Vineyard Haven, Massachusetts. Additional lead-containing building substrates and components may be present in inaccessible building areas or areas not tested.

Sincerely,

(b) (6)

Master Lead Inspector/Risk Assessor  
MA Lic (b) (6)



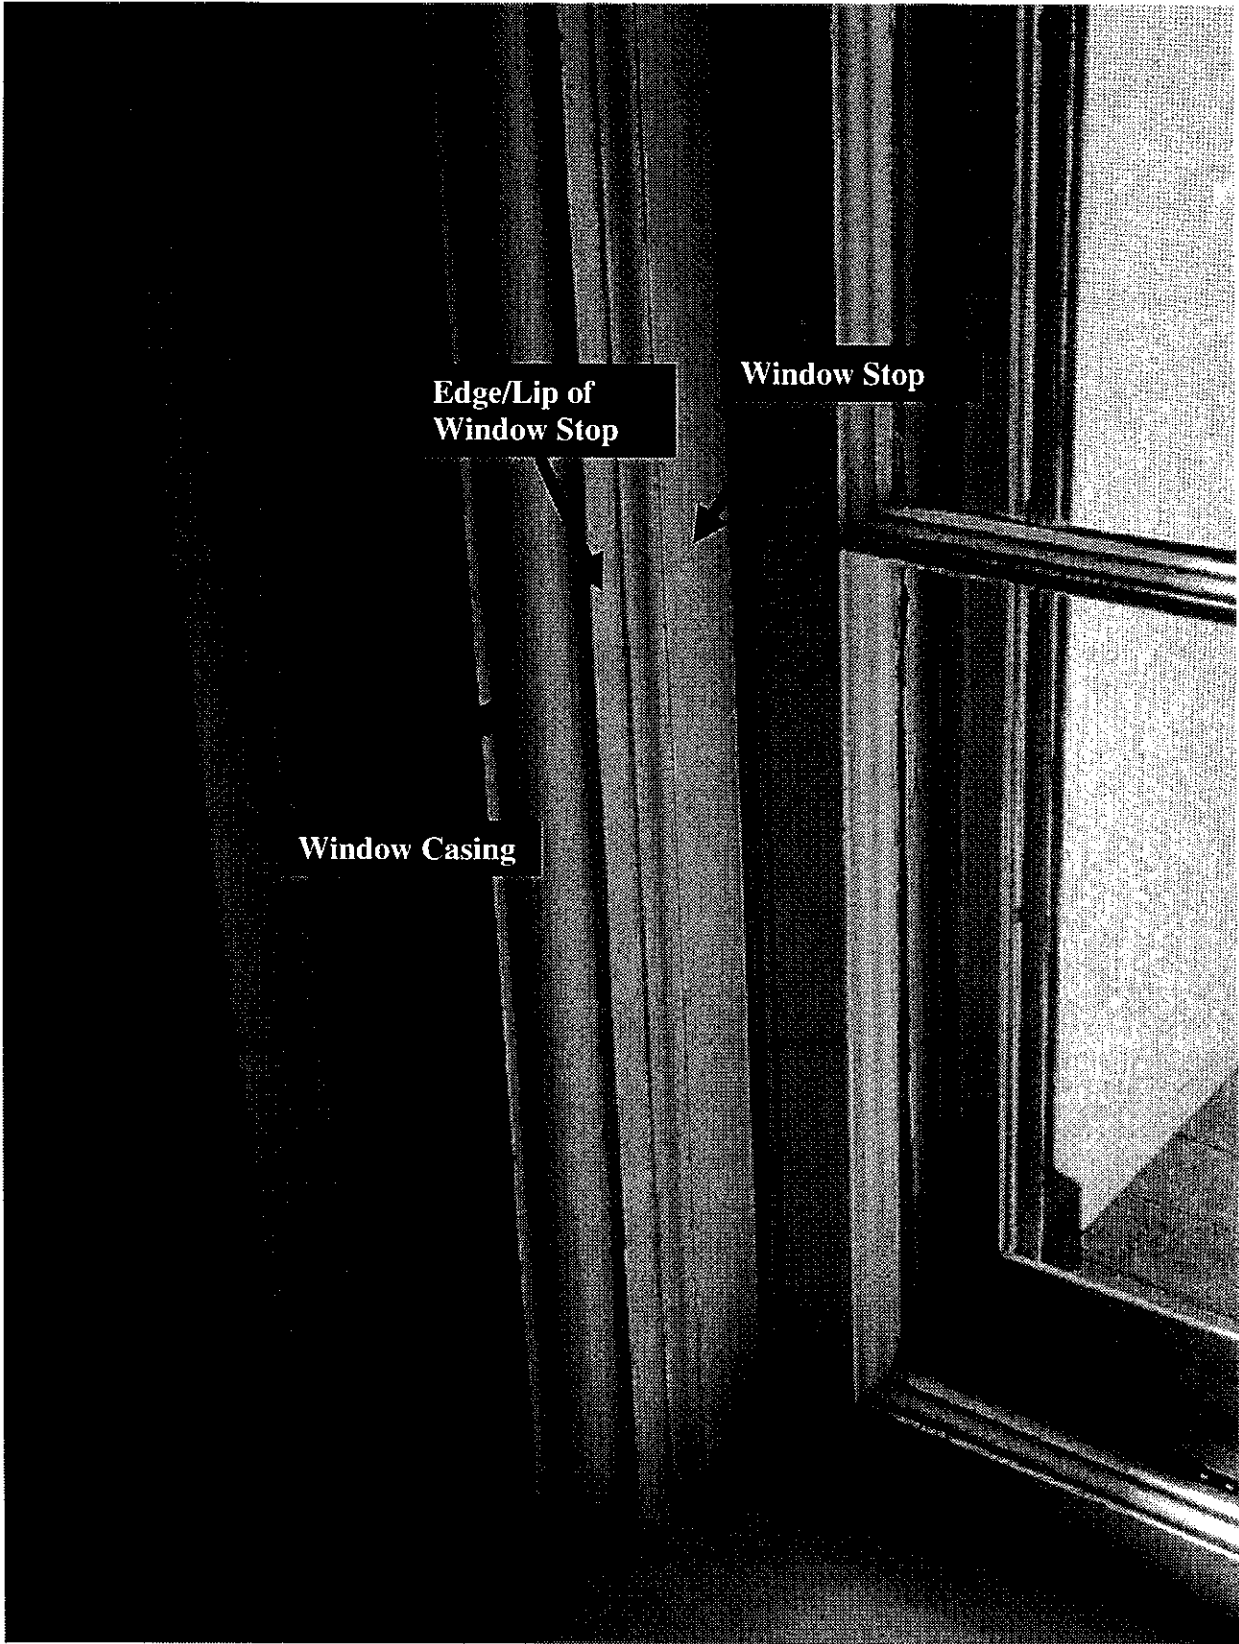

**Positive Lead Paint Results by XRF**  
**US Coast Guard Air Base Cape Cod**  
**Martha's Vineyard Housing**  
**917 Main St.**  
**Vineyard Haven, Massachusetts**  
**September 20, 2012**

| Location/Component      | Substrate | Results (mg/cm <sup>2</sup> ) |
|-------------------------|-----------|-------------------------------|
| <b>Room # 1</b>         |           |                               |
| Baseboards              | Wood      | 22.6                          |
| B Door Casing           | Wood      | 2.6                           |
| A1 Window Sill          | Wood      | 2.1                           |
| A1 Window Casing        | Wood      | 5.1                           |
| A1 Exterior Window Sill | Wood      | 2.2                           |
| A1 Blind Stop           | Wood      | 2.1                           |
| A2 Window Sill          | Wood      | 2.6                           |
| A2 Window Casing        | Wood      | 5.4                           |
| A2 Exterior Window Sill | Wood      | 2.6                           |
| A2 Blind Stop           | Wood      | 2.1                           |
| D Window Sill           | Wood      | 2.6                           |
| D Window Casing         | Wood      | 4.1                           |
| D Exterior Window Sill  | Wood      | 1.4                           |
| D Blind Stop            | Wood      | 1.6                           |
| <b>Room # 2</b>         |           |                               |
| Baseboards              | Wood      | 31.8                          |
| D1 Door Casing          | Wood      | 4.6                           |
| D1 Door Jamb            | Wood      | 7.1                           |
| D2 Door Casing          | Wood      | 2.1                           |
| D2 Door Jamb            | Wood      | 4.1                           |
| B1 Window Sill          | Wood      | 4.1                           |
| B1 Window Casing        | Wood      | 4.1                           |
| B1 Exterior Window Sill | Wood      | 1.6                           |
| B2 Window Sill          | Wood      | 4.2                           |
| B2 Window Casing        | Wood      | 4.0                           |
| B2 Exterior Window Sill | Wood      | 1.7                           |
| D1 Closet Door Casing   | Wood      | 7.1                           |
| D1 Closet Door Jamb     | Wood      | 7.0                           |

- Dangerous level of lead by XRF is equal to or greater than 1.0 mg/cm<sup>2</sup>
- mg/cm<sup>2</sup> = milligrams of lead per square centimeter of sampled surface area.
- NA = not able to test, assume positive

**Positive Lead Paint Results by XRF**  
**US Coast Guard Air Base Cape Cod**  
**Martha's Vineyard Housing**  
**917 Main St.**  
**Vineyard Haven, Massachusetts**  
**September 20, 2012**

| Location/Component       | Substrate | Results (mg/cm <sup>2</sup> ) |
|--------------------------|-----------|-------------------------------|
| D1 Closet Walls          | Plaster   | 10.1                          |
| D1 Closet Baseboard      | Wood      | 17.4                          |
| D1 Closet Shelf          | Wood      | 4.2                           |
| D1 Closet Shelf Supports | Wood      | 12.6                          |
| D1 Closet Ceiling        | Plaster   | NA                            |
| <b>Room # 3</b>          |           |                               |
| Walls                    | Plaster   | 10.4                          |
| Ceiling                  | Plaster   | 11.3                          |
| Baseboards               | Wood      | 18.6                          |
| C1 Door Casing           | Wood      | 6.1                           |
| C1 Door Jamb             | Wood      | 8.3                           |
| C2 Door Casing           | Wood      | 2.1                           |
| C2 Door Jamb             | Wood      | 6.3                           |
| A1 Window Sill           | Wood      | 4.1                           |
| A1 Window Casing         | Wood      | 3.6                           |
| A1 Exterior Window Sill  | Wood      | 3.9                           |
| A1 Blind Stop            | Wood      | 3.6                           |
| A2 Window Sill           | Wood      | 4.1                           |
| A2 Window Casing         | Wood      | 4.0                           |
| A2 Exterior Window Sill  | Wood      | 4.1                           |
| A2 Blind Stop            | Wood      | 4.0                           |
| B1 Closet Door Casing    | Wood      | 4.1                           |
| B1 Closet Door Jamb      | Wood      | 5.2                           |
| B1 Closet Walls          | Plaster   | 16.4                          |
| B1 Closet Baseboard      | Wood      | 7.9                           |
| B1 Closet Shelf          | Wood      | 8.5                           |
| B1 Closet Shelf Supports | Wood      | 8.1                           |
| B1 Closet Ceiling        | Plaster   | 9.6                           |
| <b>Room # 4</b>          |           |                               |

- Dangerous level of lead by XRF is equal to or greater than 1.0 mg/cm<sup>2</sup>
- mg/cm<sup>2</sup> = milligrams of lead per square centimeter of sampled surface area.
- NA = not able to test, assume positive



**Positive Lead Paint Results by XRF**  
**US Coast Guard Air Base Cape Cod**  
**Martha's Vineyard Housing**  
**917 Main St.**  
**Vineyard Haven, Massachusetts**  
**September 20, 2012**

| Location/Component        | Substrate | Results (mg/cm <sup>2</sup> ) |
|---------------------------|-----------|-------------------------------|
| Walls                     | Plaster   | 7.1                           |
| Ceiling                   | Plaster   | 7.0                           |
| Baseboards                | Wood      | 18.0                          |
| C1 Door                   | Wood      | 1.2                           |
| C1 Door Casing            | Wood      | 4.1                           |
| C1 Door Jamb              | Wood      | 2.6                           |
| C2 Door                   | Wood      | 1.2                           |
| C2 Door Casing            | Wood      | 1.9                           |
| C2 Door Jamb              | Wood      | 2.6                           |
| C2 Door (attic side)      | Wood      | 1.2                           |
| C2 Door Jamb (attic side) | Wood      | 1.9                           |
| D Door Casing             | Wood      | 7.1                           |
| D Door Jamb               | Wood      | 7.6                           |
| B Window Sill             | Wood      | 2.6                           |
| B Window Apron            | Wood      | 5.7                           |
| B Window Casing           | Wood      | 2.9                           |
| B Exterior Window Sill    | Wood      | 1.3                           |
| B Blind Stop              | Wood      | 1.6                           |
| C1 Closet Door            | Wood      | 18.2                          |
| C1 Closet Door Casing     | Wood      | 3.2                           |
| C1 Closet Door Jamb       | Wood      | 3.0                           |
| C1 Closet Walls           | Plaster   | 10.1                          |
| C1 Closet Baseboard       | Wood      | 6.8                           |
| C1 Closet Shelf Supports  | Wood      | 2.3                           |
| C1 Closet Ceiling         | Plaster   | 7.1                           |
| <b>Room # 5</b>           |           |                               |
| Walls                     | Plaster   | 15.0                          |
| Ceiling                   | Plaster   | 8.1                           |
| Baseboards                | Wood      | 18.1                          |

- Dangerous level of lead by XRF is equal to or greater than 1.0 mg/cm<sup>2</sup>
- mg/cm<sup>2</sup> = milligrams of lead per square centimeter of sampled surface area.
- NA = not able to test, assume positive

**Positive Lead Paint Results by XRF**  
**US Coast Guard Air Base Cape Cod**  
**Martha's Vineyard Housing**  
**917 Main St.**  
**Vineyard Haven, Massachusetts**  
**September 20, 2012**

| Location/Component      | Substrate | Results (mg/cm <sup>2</sup> ) |
|-------------------------|-----------|-------------------------------|
| A Door Casing           | Wood      | 3.1                           |
| A Door Jamb             | Wood      | 3.0                           |
| B Door Casing           | Wood      | 4.4                           |
| B Door Jamb             | Wood      | 3.8                           |
| D Window Sill           | Wood      | 3.0                           |
| D Window Apron          | Wood      | 3.1                           |
| D Window Casing         | Wood      | 5.1                           |
| D Exterior Window Sill  | Wood      | 1.8                           |
| D Blind Stop            | Wood      | 2.6                           |
| A Closet Door Casing    | Wood      | 3.6                           |
| A Closet Door Jamb      | Wood      | 3.1                           |
| A Closet Walls          | Plaster   | 11.3                          |
| A Closet Baseboard      | Wood      | 29.6                          |
| A Closet Shelf Supports | Wood      | 12.6                          |
| A Closet Ceiling        | Plaster   | NA                            |
| A Shelf (in room)       | Wood      | 4.2                           |
| <b>Kitchen</b>          |           |                               |
| Ceiling                 | Plaster   | NA                            |
| Baseboards              | Wood      | 15.7                          |
| B1 Door Casing          | Wood      | 2.1                           |
| B1 Door Jamb            | Wood      | 4.5                           |
| B2 Door Casing          | Wood      | 1.6                           |
| B2 Door Jamb            | Wood      | 2.4                           |
| C1 Door Casing          | Wood      | 3.8                           |
| C1 Door Jamb            | Wood      | 3.2                           |
| C2 Door Casing          | Wood      | 1.6                           |
| C2 Door Jamb            | Wood      | 1.9                           |
| C Exterior Window Sill  | Wood      | 4.0                           |
| C Blind Stop            | Wood      | 4.1                           |

- Dangerous level of lead by XRF is equal to or greater than 1.0 mg/cm<sup>2</sup>
- mg/cm<sup>2</sup> = milligrams of lead per square centimeter of sampled surface area.
- NA = not able to test, assume positive

**Positive Lead Paint Results by XRF**  
**US Coast Guard Air Base Cape Cod**  
**Martha's Vineyard Housing**  
**917 Main St.**  
**Vineyard Haven, Massachusetts**  
**September 20, 2012**

| Location/Component       | Substrate | Results (mg/cm <sup>2</sup> ) |
|--------------------------|-----------|-------------------------------|
| <b>Bathroom # 1</b>      |           |                               |
| Baseboards               | Wood      | 15.7                          |
| A Door Casing            | Wood      | 2.1                           |
| A Door Jamb              | Wood      | 2.0                           |
| B Door Casing            | Wood      | 4.0                           |
| B Door Jamb              | Wood      | 4.1                           |
| C Window Sill            | Wood      | 4.1                           |
| C Window Casing          | Wood      | 3.0                           |
| C Exterior Window Sill   | Wood      | 2.1                           |
| C Blind Stop             | Wood      | 2.3                           |
| <b>Hallway # 1</b>       |           |                               |
| Baseboards               | Wood      | 16.4                          |
| A Door Casing            | Wood      | 2.3                           |
| A Door Jamb              | Wood      | 2.4                           |
| D Door Jamb              | Wood      | 2.9                           |
| <b>Hallway # 2</b>       |           |                               |
| Walls                    | Plaster   | 9.1                           |
| Ceiling                  | Plaster   | NA                            |
| Baseboards               | Wood      | 7.8                           |
| A1 Door Casing           | Wood      | 5.2                           |
| A1 Door Jamb             | Wood      | 5.1                           |
| A2 Door Casing           | Wood      | 3.6                           |
| A2 Door Jamb             | Wood      | 3.8                           |
| A2 Closet Door Casing    | Wood      | 3.9                           |
| A2 Closet Door Jamb      | Wood      | 4.0                           |
| A2 Closet Walls          | Plaster   | 11.1                          |
| A2 Closet Baseboard      | Wood      | 14.1                          |
| A2 Closet Shelf          | Wood      | 1.1                           |
| A2 Closet Shelf Supports | Wood      | 9.6                           |

- Dangerous level of lead by XRF is equal to or greater than 1.0 mg/cm<sup>2</sup>
- mg/cm<sup>2</sup> = milligrams of lead per square centimeter of sampled surface area.
- NA = not able to test, assume positive



**Positive Lead Paint Results by XRF**  
**US Coast Guard Air Base Cape Cod**  
**Martha's Vineyard Housing**  
**917 Main St.**  
**Vineyard Haven, Massachusetts**  
**September 20, 2012**

| Location/Component                                | Substrate | Results (mg/cm <sup>2</sup> ) |
|---------------------------------------------------|-----------|-------------------------------|
| A2 Closet Ceiling                                 | Plaster   | 11.8                          |
| <b>Hallway # 3</b>                                |           |                               |
| Walls                                             | Plaster   | 13.0                          |
| Ceiling                                           | Plaster   | 9.3                           |
| Baseboards                                        | Wood      | 6.0                           |
| B Door Casing                                     | Wood      | 2.4                           |
| B Door Jamb                                       | Wood      | 3.0                           |
| D Door Casing                                     | Wood      | 2.6                           |
| D Door Jamb                                       | Wood      | 2.8                           |
| A Header                                          | Wood      | 5.7                           |
| <b>Staircase 1<sup>st</sup> to 2<sup>nd</sup></b> |           |                               |
| Walls                                             | Plaster   | 6.8                           |
| Radiator                                          | Metal     | 1.1                           |
| Baseboards                                        | Wood      | 19.7                          |
| A Door Casing                                     | Wood      | 4.2                           |
| A Door Jamb                                       | Wood      | 1.9                           |
| B Door Casing                                     | Wood      | 1.9                           |
| B Door Jamb                                       | Wood      | 7.1                           |
| D1 Door Casing                                    | Wood      | 3.1                           |
| D2 Door Casing                                    | Wood      | 2.6                           |
| D2 Door Jamb                                      | Wood      | 2.8                           |
| A Window Sill                                     | Wood      | 3.1                           |
| A Window Apron                                    | Wood      | 3.0                           |
| A Window Casing                                   | Wood      | 3.6                           |
| A Exterior Window Sill                            | Wood      | 4.5                           |
| A Blind Stop                                      | Wood      | 4.2                           |
| Stair Risers                                      | Wood      | 22.4                          |
| Stair Stringer                                    | Wood      | 22.4                          |
| Floor Edge                                        | Wood      | 24.1                          |

- Dangerous level of lead by XRF is equal to or greater than 1.0 mg/cm<sup>2</sup>
- mg/cm<sup>2</sup> = milligrams of lead per square centimeter of sampled surface area.
- NA = not able to test, assume positive

**Positive Lead Paint Results by XRF**  
**US Coast Guard Air Base Cape Cod**  
**Martha's Vineyard Housing**  
**917 Main St.**  
**Vineyard Haven, Massachusetts**  
**September 20, 2012**

| Location/Component                          | Substrate | Results (mg/cm <sup>2</sup> ) |
|---------------------------------------------|-----------|-------------------------------|
| Floor Casing                                | Wood      | 22.4                          |
| A Window Above 5'                           | Wood      | 16.2                          |
| <b>Staircase 1<sup>st</sup> to Basement</b> |           |                               |
| Lower Walls                                 | Wood      | 17.6                          |
| Wood Slats                                  | Wood      | 14.0                          |
| D Door Casing                               | Wood      | 3.6                           |
| D Door Jamb                                 | Wood      | 3.6                           |
| Screen Window                               | Wood      | 4.6                           |
| Columns                                     | Wood      | 17.6                          |
| Stair Treads                                | Wood      | 18.1                          |
| Stair Risers                                | Wood      | 18.6                          |
| Stair Stringer                              | Wood      | 18.6                          |
| Floor Edge                                  | Wood      | 2.6                           |
| <b>Basement Area</b>                        |           |                               |
| Walls                                       | Wood      | 2.4                           |
| D Door (Interior Side)                      | Wood      | 18.6                          |
| D Door Casing (Interior Side)               | Wood      | 19.0                          |
| D Door Jamb (Interior Side)                 | Wood      | 19.1                          |
| D Door (Exterior Side)                      | Wood      | 18.6                          |
| D Door Jamb (Exterior Side)                 | Wood      | 15.6                          |
| B Cabinet                                   | Wood      | 19.6                          |
| <b>Laundry Room</b>                         |           |                               |
| Baseboards                                  | Wood      | 16.1                          |
| C Window Sill                               | Wood      | 2.8                           |
| C Window Casing                             | Wood      | 4.6                           |
| C Exterior Window Sill                      | Wood      | 1.4                           |
| C Blind Stop                                | Wood      | 1.3                           |
| <b>Front Porch (A-Side Porch)</b>           |           |                               |
| Upper Trim                                  | Wood      | NA                            |

- Dangerous level of lead by XRF is equal to or greater than 1.0 mg/cm<sup>2</sup>
- mg/cm<sup>2</sup> = milligrams of lead per square centimeter of sampled surface area.
- NA = not able to test, assume positive

**Positive Lead Paint Results by XRF**  
**US Coast Guard Air Base Cape Cod**  
**Martha's Vineyard Housing**  
**917 Main St.**  
**Vineyard Haven, Massachusetts**  
**September 20, 2012**

| Location/Component               | Substrate | Results (mg/cm <sup>2</sup> ) |
|----------------------------------|-----------|-------------------------------|
| Ceiling                          | Wood      | NA                            |
| Joists                           | Wood      | NA                            |
| A Door Jamb                      | Wood      | 2.6                           |
| A Door Threshold                 | Wood      | 1.6                           |
| A Door Kickplate                 | Wood      | 1.9                           |
| <b>Rear Porch (C-Side Porch)</b> |           |                               |
| Upper Trim                       | Wood      | NA                            |
| Ceiling                          | Wood      | NA                            |
| Joists                           | Wood      | NA                            |
| D Door                           | Wood      | 2.5                           |
| D Door Casing                    | Wood      | 1.2                           |
| D Door Jamb                      | Wood      | 1.8                           |
| D Door Threshold                 | Wood      | 1.6                           |
| D Door Kickplate                 | Wood      | 1.3                           |
| C Exterior Window Sill           | Wood      | 1.5                           |
| C Exterior Window Casing         | Wood      | 1.4                           |
| Support Columns                  | Wood      | 3.3                           |
| <b>Exterior A-Side</b>           |           |                               |
| Corner Boards                    | Wood      | 1.6                           |
| Upper Trim                       | Wood      | NA                            |
| Windows Above 5'                 | Wood      | NA                            |
| A Exterior Window Sill (x3)      | Wood      | 1.5                           |
| A Exterior Window Casing (x3)    | Wood      | 1.6                           |
| <b>Exterior B-Side</b>           |           |                               |
| Corner Boards                    | Wood      | 1.2                           |
| Upper Trim                       | Wood      | NA                            |
| Windows Above 5'                 | Wood      | NA                            |
| B Door                           | Wood      | 3.8                           |
| B Door Casing                    | Wood      | 3.2                           |

- Dangerous level of lead by XRF is equal to or greater than 1.0 mg/cm<sup>2</sup>
- mg/cm<sup>2</sup> = milligrams of lead per square centimeter of sampled surface area.
- NA = not able to test, assume positive



**Positive Lead Paint Results by XRF**  
**US Coast Guard Air Base Cape Cod**  
**Martha's Vineyard Housing**  
**917 Main St.**  
**Vineyard Haven, Massachusetts**  
**September 20, 2012**

| Location/Component     | Substrate | Results (mg/cm <sup>2</sup> ) |
|------------------------|-----------|-------------------------------|
| B Door Jamb            | Wood      | NA                            |
| <b>Exterior C-Side</b> |           |                               |
| Upper Trim             | Wood      | NA                            |
| Windows Above 5'       | Wood      | NA                            |
| <b>Exterior D-Side</b> |           |                               |
| Upper Trim             | Wood      | NA                            |
| Windows Above 5'       | Wood      | NA                            |

- Dangerous level of lead by XRF is equal to or greater than 1.0 mg/cm<sup>2</sup>
- mg/cm<sup>2</sup> = milligrams of lead per square centimeter of sampled surface area.
- NA = not able to test, assume positive

# Lead Inspection / Risk Assessment Report

Page 1 of 25

## MEL BLACKMAN

### MASTER LEAD INSPECTOR

P.O. BOX 358 - STONEHAM, MA. 02180

PHONE / FAX 781- 665 - 3806

|                               |                            |                          |                 |
|-------------------------------|----------------------------|--------------------------|-----------------|
| St.#<br><b>917</b>            | Street Name<br><b>MAIN</b> | Street Type<br><b>ST</b> | Unit<br><b></b> |
| City<br><b>VINEYARD HAVEN</b> |                            | Zip Code<br><b>02568</b> |                 |

Owner Name: **U.S. Government**

Owner Address: **917 Main St., Vineyard Haven, MA 02568**

Contact Information: Tel #

Email:

Client Name (if different from owner): **H&S Environmental Inc. (508-366-7442)**

Client Address: **160 E. Main St., Westborough, MA 01581**

Number of Rooms in Unit **9**

Property Type:

Single Family ☒

Multi Family ☐ # Units

Condominium ☐ # Units

Day Care ☐ Other:

| Key: | Lead Column              | Key:  | Delead/IC Method Column  |
|------|--------------------------|-------|--------------------------|
| COV  | Covered                  | CAP   | Capped                   |
| VB   | Vinyl Baseboard          | COV   | Covered                  |
| MET  | Metal                    | ENC   | Encapsulated             |
| VR   | Vinyl Rep. Window        | MI    | Made Intact              |
| MR   | Metal Rep. Window        | PRE   | Prepared for Enc         |
| NA   | Not Accessible           | VR/MR | Vinyl/Metal Rep Window   |
| NC   | No Coating               | SFR   | Storm Frame Removed      |
| Tile | Tile (testing suggested) |       | Component Does not Exist |
| DC   | Dropped Ceiling          |       |                          |

Laundry in Basement? **Yes** or **No**  
Finished Space in Basement? **Yes** or **No**

Testing Method Used:




Na<sub>2</sub>S Exp. Date   
X-Ray Fluorescence  
Model **XLp303A** Serial # **24687**

Comments / Notes **BASEMENT TESTED AT OWNER'S REQUEST.**

Floor# **1** (this is the level within building of unit being inspected)

Floor# **2**

Property Diagram/ Unit Labels

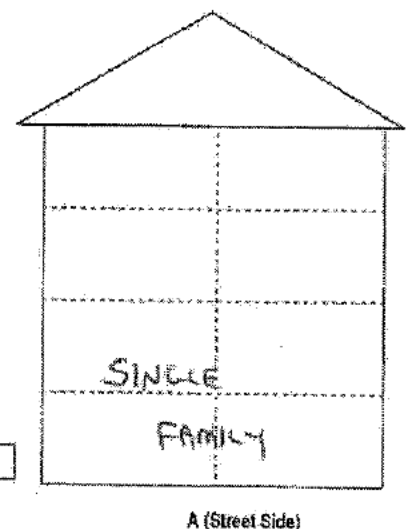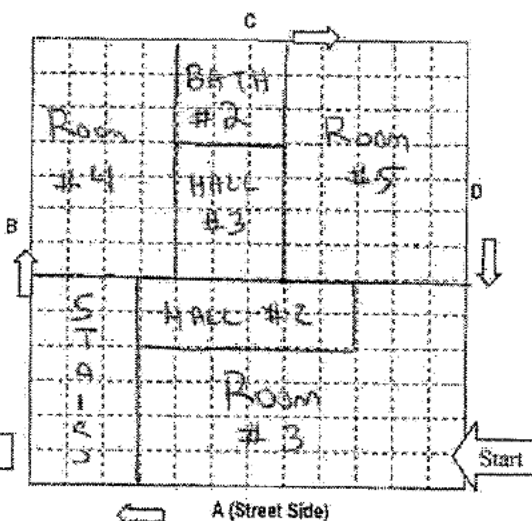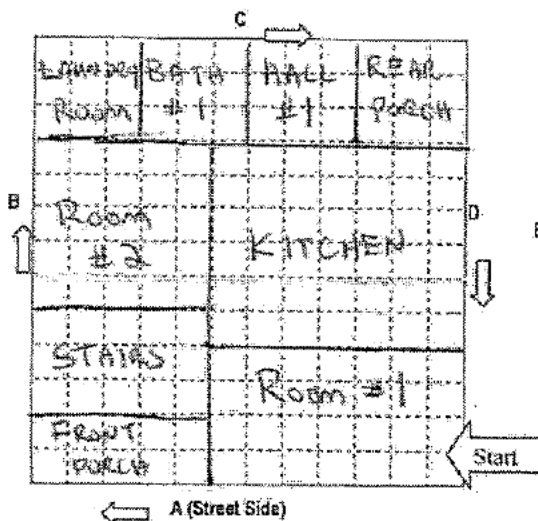

Pb (lead) equal to or greater than 1.0 mg/cm<sup>2</sup> with x-ray fluorescence or positive with Na<sub>2</sub>S is Dangerous.

XRF Calibration Recorded in Log Book

Address verified through USPS

Research on Lead-Related History for Address

[www.stoneham.us/dph/volapp](http://www.stoneham.us/dph/volapp) or 800-532-9571



✓ -Check off when complete.

✓ -Check off when complete

✓ -Check off when complete

(b) (6)

Inspector Name **(b) (6)**

Lic # **(b) (6)**

Signature **(b) (6)**

Date **09-20-2012**

68  
Page of 25

## INTERIM CONTROL

**Signature:** \_\_\_\_\_

Signature \_\_\_\_\_

Signature \_\_\_\_\_

Signature \_\_\_\_\_Signature \_\_\_\_\_

Signature \_\_\_\_\_

Signature \_\_\_\_\_

**Signature** \_\_\_\_\_

Signature \_\_\_\_\_Signature \_\_\_\_\_Signature \_\_\_\_\_

**Signature** \_\_\_\_\_

**Signature** \_\_\_\_\_

Signature \_\_\_\_\_



ADDRESS: 917 Main St.

Apt# \_\_\_\_\_ City Vineyard Haven, MA 02568

Page 3 of 25

## REOCCUPANCY CERTIFICATE HISTORY

|                                         |  |  |  |  |
|-----------------------------------------|--|--|--|--|
| Certificate of Reoccupancy              |  |  |  |  |
|                                         |  |  |  |  |
| Only after High/Med Risk (# rooms rule) |  |  |  |  |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

|                                         |  |  |  |  |
|-----------------------------------------|--|--|--|--|
| Certificate of Reoccupancy              |  |  |  |  |
|                                         |  |  |  |  |
| Only after High/Med Risk (# rooms rule) |  |  |  |  |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

|                                         |  |  |  |  |
|-----------------------------------------|--|--|--|--|
| Certificate of Reoccupancy              |  |  |  |  |
|                                         |  |  |  |  |
| Only after High/Med Risk (# rooms rule) |  |  |  |  |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

## COMPLIANCE HISTORY

|                                   |  |  |  |  |
|-----------------------------------|--|--|--|--|
| Letter of Full Initial Compliance |  |  |  |  |
|                                   |  |  |  |  |
| No prior history/ No signs of IUD |  |  |  |  |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

|                                 |  |  |  |  |
|---------------------------------|--|--|--|--|
| Letter of Interim Control       |  |  |  |  |
|                                 |  |  |  |  |
| No prior Comp. Expires in 1 yr. |  |  |  |  |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

|                                             |  |  |  |  |
|---------------------------------------------|--|--|--|--|
| Recertification of Interim Control          |  |  |  |  |
|                                             |  |  |  |  |
| Expires 2 yrs from original Interim Control |  |  |  |  |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

|                                   |  |  |  |  |
|-----------------------------------|--|--|--|--|
| Letter of Full Dealing Compliance |  |  |  |  |
|                                   |  |  |  |  |
| Dust wipes if No Reocc.           |  |  |  |  |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

|                                      |  |  |  |  |
|--------------------------------------|--|--|--|--|
| Certificate of Maintained Compliance |  |  |  |  |
|                                      |  |  |  |  |
| No Work= No Dust Work = ? Dust       |  |  |  |  |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

|                                    |  |  |  |  |
|------------------------------------|--|--|--|--|
| Certificate of Restored Compliance |  |  |  |  |
|                                    |  |  |  |  |
| Dust wipes and airt people         |  |  |  |  |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

## COMPLIANCE HISTORY (CONT.)

|                                      |  |  |  |  |
|--------------------------------------|--|--|--|--|
| Certificate of Maintained Compliance |  |  |  |  |
|                                      |  |  |  |  |
| No Work= No Dust Work = ? Dust       |  |  |  |  |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

|                                    |  |  |  |  |
|------------------------------------|--|--|--|--|
| Certificate of Restored Compliance |  |  |  |  |
|                                    |  |  |  |  |
| Dust wipes and airt people         |  |  |  |  |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

|                                      |  |  |  |  |
|--------------------------------------|--|--|--|--|
| Certificate of Maintained Compliance |  |  |  |  |
|                                      |  |  |  |  |
| No Work= No Dust Work = ? Dust       |  |  |  |  |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

|                                    |  |  |  |  |
|------------------------------------|--|--|--|--|
| Certificate of Restored Compliance |  |  |  |  |
|                                    |  |  |  |  |
| Dust wipes and airt people         |  |  |  |  |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

## OTHER HISTORY: WAIVERS/UD/EPA RRP

|                       |  |  |  |  |
|-----------------------|--|--|--|--|
| Approved CLPPP Waiver |  |  |  |  |
|                       |  |  |  |  |
| Attach to Comp Docs   |  |  |  |  |

CLPPP Insp. Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

|                       |  |  |  |  |
|-----------------------|--|--|--|--|
| Approved CLPPP Waiver |  |  |  |  |
|                       |  |  |  |  |
| Attach to Comp Docs   |  |  |  |  |

CLPPP Insp. Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

|                              |  |  |  |  |
|------------------------------|--|--|--|--|
| UD / DES Visual Reinspection |  |  |  |  |
|                              |  |  |  |  |
| No LOC Issued                |  |  |  |  |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

|                              |  |  |  |  |
|------------------------------|--|--|--|--|
| UD / DES Visual Reinspection |  |  |  |  |
|                              |  |  |  |  |
| No LOC Issued                |  |  |  |  |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

|                     |  |  |  |  |
|---------------------|--|--|--|--|
| UD / DES Dust Taken |  |  |  |  |
|                     |  |  |  |  |
| No LOC Issued       |  |  |  |  |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

|                     |  |  |  |  |
|---------------------|--|--|--|--|
| UD / DES Dust Taken |  |  |  |  |
|                     |  |  |  |  |
| No LOC Issued       |  |  |  |  |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

**EXPLANATION OF LEAD INSPECTION / RISK ASSESSMENT REPORT FORM COLUMNS**

This page provides general information needed to understand the lead inspection/risk assessment report. However, you should speak with the inspector/risk assessor before you start to do any work on your home.

|                              |                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                 |
|------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| <b>SIDE</b>                  | Refers to A, B, C, or D side of the building or room. See the diagram on the cover sheet. The "A" side of the building or room is the side facing the street that gives the property its address (usually, it is the front of the building). Keeping your back to this street, from the "A" side move clockwise to the "B" side on your left, the "C" side opposite you, and the "D" side to the right. Numbering is from left to right.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                        |
| <b>LOCATION/<br/>SURFACE</b> | Refers to the building component(s) being tested. Some surfaces may be made up of more than one part. For example, "Baseboard" may refer to four separate pieces of wood (one on each wall), but is still considered one surface.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                               |
| <b>LEAD</b>                  | <p>The actual lead result. Each surface tested must have a result recorded in the "Lead" column.</p> <ul style="list-style-type: none"> <li>A number shows that the surface was tested with an XRF analyzer. A number (or average number) equal to or greater than 1.0 mg/cm<sup>2</sup> is a dangerous level of lead.</li> <li>A "pos" or "neg" shows that the surface was tested with sodium sulfide. "Pos" means that there is a dangerous level of lead.</li> <li>"N/A" means that the inspector was not able to test the surface. Unless the owner can get a sample to test, the inspector must assume the surface contains lead and require it to be delead, if necessary.</li> <li>"MET" or "MR" means that a metal surface was not tested and only needs to be intact, even if it is a leaded surface. However, metal handrails, metal window sills, and metal railing caps, need to be delead if they test equal to or greater than 1.0 mg/cm<sup>2</sup>, or is marked "N/A."</li> <li>For key to abbreviations like "COV", "VB", "VR" or "MR", "NC", "Tile", "DC", see the cover page.</li> <li>When a component box is slashed and there are test results above and below the diagonal line, the result on the "bottom" represents results below 5 ft. and the "top" result indicates the test result above 5 ft.</li> </ul>                                                                                                                                                                                        |
| <b>TYPE OF<br/>HAZARD</b>    | <p>Not all lead paint must be delead. This column tells you IF and WHY a surface needs deleading. The deleading standards below may not apply for Interim Controls. Speak to your risk assessor for more information.</p> <ul style="list-style-type: none"> <li>"MT" circled means that the surface is a moveable/impacted surface and must be delead in its entirety.</li> <li>"SF" circled indicates that there is a storm frame present which requires the blind stop and exterior sill be delead as interior moveable / impacted surfaces.</li> <li>"A/M" circled means that the surface is "accessible mouthable" and must be delead to a minimum of five feet high, four inches in from the edge or corner.</li> <li>"L" circled means that the surface is loose and must, at minimum, be made intact.</li> <li>If more than one choice is circled, the rules for deleading may change depending upon what method of deleading you choose. Speak to the inspector for more information.</li> <li>"N/A" means the inspector was unable to determine if the surface was a lead hazard. The person doing the deleading must check this surface and follow all the rules for deleading. Speak to the inspector for more information.</li> <li>If nothing is circled in the column, then it is likely the surface does not need deleading. Speak to the inspector for more information. Remember, this does not mean the entire surface is lead free, it just does not require deleading in its current condition.</li> </ul> |
| <b>URG HAZ?</b>              | This column is only completed during a risk assessment. A risk assessment is an evaluation of a home's suitability for Interim Control. <b>Only a licensed risk assessor can do a risk assessment, not all inspectors are risk assessors.</b> If "Y" is circled, then this surface is considered an "Urgent Lead Hazard" and some type of deleading work is required to qualify for Interim Control.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                            |
| <b>IC DATE</b>               | The date the licensed risk assessor determines the surface meets the standards for Interim Control.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                             |
| <b>IC METH</b>               | The deleading method or structural repair done to qualify the surface for Interim Control. Refer to the deleading codes key on the cover page.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                  |
| <b>DELEAD<br/>DATE</b>       | The date that the lead inspector reinspects the surface and finds that it has been successfully brought back into compliance.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                   |
| <b>DELEAD<br/>METH</b>       | The method used to bring a surface into full compliance. Refer to codes in the Key on the cover page of the PCAD                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                |
| <b>EXCLUDED<br/>SURFACES</b> | The amount of loose paint on a surface as measured by the lead inspector. "N/A" means that the inspector was not able to measure the loose paint, but has determined it is more than the cut-off for moderate risk making intact.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                               |

(b) (6)

09-20-2012

Page 5 of 25

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 917 Main St.

Apt #: AAAAA

City: Vineyard Haven, MA 02568

ROOM # 1

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A B  | Up Walls             | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Low Walls            |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Baseboards           | 21.6 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Chair Rail           |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Radiator             | 0.00 | A/M L N/A         | Y           |            |            |                |                |
|      | Floor                | 0.01 | A/M L N/A         | Y           |            |            |                |                |
|      | Ceiling              | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          | 2.6  | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            | 0.01 | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            | 0.05 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A    | Closet Door          |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Cl Casing            |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Closet Jamb          |      | A/M L N/A         | Y           |            |            |                |                |
| D    | Closet Walls         |      | A/M L N/A         | Y           |            |            |                |                |
|      | Cl Baseboard         |      | A/M L N/A         | Y           |            |            |                |                |
| 1    | Closet Pole          |      | A/M L N/A         | Y           |            |            |                |                |
| 2    | Closet Shelf         |      | A/M L N/A         | Y           |            |            |                |                |
| 3    | Cl Supports          |      | A/M L N/A         | Y           |            |            |                |                |
| 4    | Closet Floor         |      | A/M L N/A         | Y           |            |            |                |                |
|      | Closet Ceiling       |      | A/M L N/A         | Y           |            |            |                |                |

COMMENTS / STRUCTURAL DEFECTS:

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A    | Window Sill          | 2.1  | M/I A/M L N/A     | Y           |            |            |                |                |
| B    | Win Apron            | 0.4  | A/M L N/A         | Y           |            |            |                |                |
| C    | Win Casing           | 5.1  | A/M L N/A         | Y           |            |            |                |                |
| D    | Header Stop          | 0.01 | M/I A/M L N/A     | Y           |            |            |                |                |
|      | Int Stops            | 0.01 | M/I A/M L N/A     | Y           |            |            |                |                |
| 1    | Win Int Sash         | 0.01 | M/I A/M L N/A     | Y           |            |            |                |                |
| 2    | Exterior Sill        | 0.2  | M/I (SF) L N/A    | Y           |            |            |                |                |
| 3    | Part Bead            | 0.00 | M/I L N/A         | Y           |            |            |                |                |
| 4    | Blind Stop           | 2.1  | M/I (SF) L N/A    | Y           |            |            |                |                |
|      | Win Ext Sash         | 0.00 | M/I L N/A         | Y           |            |            |                |                |
| A    | Window Sill          | 2.6  | M/I (SF) L N/A    | Y           |            |            |                |                |
| B    | Win Apron            | 0.4  | A/M L N/A         | Y           |            |            |                |                |
| C    | Win Casing           | 5.4  | A/M L N/A         | Y           |            |            |                |                |
| D    | Header Stop          | 0.00 | M/I A/M L N/A     | Y           |            |            |                |                |
|      | Int Stops            | 0.01 | M/I A/M L N/A     | Y           |            |            |                |                |
| 1    | Win Int Sash         | 0.01 | M/I A/M L N/A     | Y           |            |            |                |                |
| 2    | Exterior Sill        | 2.6  | M/I (SF) L N/A    | Y           |            |            |                |                |
| 3    | Part Bead            | 0.00 | M/I L N/A         | Y           |            |            |                |                |
| 4    | Blind Stop           | 2.1  | M/I (SF) L N/A    | Y           |            |            |                |                |
|      | Win Ext Sash         | 0.00 | M/I L N/A         | Y           |            |            |                |                |
| A    | Window Sill          | 2.6  | M/I (SF) L N/A    | Y           |            |            |                |                |
| B    | Win Apron            | 0.11 | A/M L N/A         | Y           |            |            |                |                |
| C    | Win Casing           | 4.1  | A/M L N/A         | Y           |            |            |                |                |
| D    | Header Stop          | 0.01 | M/I A/M L N/A     | Y           |            |            |                |                |
|      | Int Stops            | 0.01 | M/I A/M L N/A     | Y           |            |            |                |                |
| 1    | Win Int Sash         | 0.00 | M/I A/M L N/A     | Y           |            |            |                |                |
| 2    | Exterior Sill        | 1.4  | M/I (SF) L N/A    | Y           |            |            |                |                |
| 3    | Part Bead            | 0.00 | M/I L N/A         | Y           |            |            |                |                |
| 4    | Blind Stop           | 1.6  | M/I (SF) L N/A    | Y           |            |            |                |                |
|      | Win Ext Sash         | 0.01 | M/I L N/A         | Y           |            |            |                |                |
| A B  | Fireplace            |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Mantle               |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Win Above S          |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Ceiling Molding      |      | A/M L N/A         | Y           |            |            |                |                |
| B    | P. 263               | 0.01 | A/M L N/A         | Y           |            |            |                |                |
|      |                      |      | A/M L N/A         | Y           |            |            |                |                |
|      |                      |      | A/M L N/A         | Y           |            |            |                |                |

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |



(b) (6)

09-20-2012

Page 6 of 25

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 917 Main St.

Apt #: AAAAAA

City: Vineyard Haven, MA 02568

ROOM # 2

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A B  | Up Walls             | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Low Walls            |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Baseboards           | 31.5 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Chair Rail           |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Radiator             | 0.25 | A/M L N/A         | Y           |            |            |                |                |
|      | Floor                | 0.00 | A/M L N/A         | Y           |            |            |                |                |
|      | Ceiling              | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          | 4.6  | A/M L N/A         | Y           |            |            |                |                |
| 12   | Door Jamb            | 7.1  | A/M L N/A         | Y           |            |            |                |                |
| 34   | Threshold            | 0.02 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 | 0.02 | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          | 2.1  | A/M L N/A         | Y           |            |            |                |                |
| 12   | Door Jamb            | 4.1  | A/M L N/A         | Y           |            |            |                |                |
| 34   | Threshold            | 0.11 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| 12   | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
| 34   | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| 12   | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
| 34   | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A    | Closet Door          | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| B    | Cl Casing            | 7.1  | A/M L N/A         | Y           |            |            |                |                |
| C    | Closet Jamb          | 7.0  | A/M L N/A         | Y           |            |            |                |                |
| D    | Closet Walls         | 10.1 | A/M L N/A         | Y           |            |            |                |                |
|      | Cl Baseboard         | 1.7  | A/M L N/A         | Y           |            |            |                |                |
| 1    | Closet Pipes         | 0.11 | A/M L N/A         | Y           |            |            |                |                |
| 2    | Closet Shelf         | 4.2  | A/M L N/A         | Y           |            |            |                |                |
| 3    | Cl Supports          | 12.6 | A/M L N/A         | Y           |            |            |                |                |
| 4    | Closet Floor         | 0.20 | A/M L N/A         | Y           |            |            |                |                |
|      | Closet Ceiling       | N/A  | A/M L N/A         | Y           |            |            |                |                |

COMMENTS / STRUCTURAL DEFECTS:

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A    | Window Sill          | 4.1  | A/M L N/A         | Y           |            |            |                |                |
| B    | Win Apron            | 0.02 | A/M L N/A         | Y           |            |            |                |                |
| C    | Win Casing           | 4.1  | A/M L N/A         | Y           |            |            |                |                |
| D    | Header Stop          | 0.00 | A/M L N/A         | Y           |            |            |                |                |
|      | Int Stops            | 0.02 | A/M L N/A         | Y           |            |            |                |                |
| 1    | Win Int Sash         | 0.01 | A/M L N/A         | Y           |            |            |                |                |
| 2    | Exterior Sill        | 1.6  | A/M L N/A         | Y           |            |            |                |                |
| 3    | Part Bead            | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| 4    | Blind Stop           | 0.5  | A/M L N/A         | Y           |            |            |                |                |
|      | Win Ext Sash         | 0.01 | A/M L N/A         | Y           |            |            |                |                |
| A    | Window Sill          | 4.2  | A/M L N/A         | Y           |            |            |                |                |
| B    | Win Apron            | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| C    | Win Casing           | 4.0  | A/M L N/A         | Y           |            |            |                |                |
| D    | Header Stop          | 0.01 | A/M L N/A         | Y           |            |            |                |                |
|      | Int Stops            | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| 1    | Win Int Sash         | 0.02 | A/M L N/A         | Y           |            |            |                |                |
| 2    | Exterior Sill        | 1.7  | A/M L N/A         | Y           |            |            |                |                |
| 3    | Part Bead            | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| 4    | Blind Stop           | 0.5  | A/M L N/A         | Y           |            |            |                |                |
|      | Win Ext Sash         | 0.02 | A/M L N/A         | Y           |            |            |                |                |
| A    | Window Sill          |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Win Apron            |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| D    | Header Stop          |      | A/M L N/A         | Y           |            |            |                |                |
|      | Int Stops            |      | A/M L N/A         | Y           |            |            |                |                |
| 1    | Win Int Sash         |      | A/M L N/A         | Y           |            |            |                |                |
| 2    | Exterior Sill        |      | A/M L N/A         | Y           |            |            |                |                |
| 3    | Part Bead            |      | A/M L N/A         | Y           |            |            |                |                |
| 4    | Blind Stop           |      | A/M L N/A         | Y           |            |            |                |                |
|      | Win Ext Sash         |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Fireplace            |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Mantle               |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Win Above 5'         |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Ceiling Molding      |      | A/M L N/A         | Y           |            |            |                |                |
| A    | Pipes                | 0.25 | A/M L N/A         | Y           |            |            |                |                |
|      |                      |      | A/M L N/A         | Y           |            |            |                |                |
|      |                      |      | A/M L N/A         | Y           |            |            |                |                |

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 200 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 200 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

(b) (6)

09-20-2012

Page 7 of 25

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 917 Main St.

Apt #: AAAAAA

City: Vineyard Haven, MA 02568

ROOM # 3

| SIDE       | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A B<br>C D | Up Walls             | 0.4  | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Low Walls            |      | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Baseboards           | 18.6 | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Chair Rail           |      | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Radiator             | 0.02 | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Floor                | 0.05 | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Ceiling              | 16.3 | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Door                 | 0.00 | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Door Casing          | 6.1  | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Door Jamb            | 8.3  | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Threshold            |      | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Door                 | 0.04 | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Door Casing          | 2.1  | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Door Jamb            | 6.3  | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Threshold            |      | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Door                 |      | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Door Casing          |      | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Door Jamb            |      | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Threshold            |      | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Door                 |      | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Door Casing          |      | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Door Jamb            |      | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Threshold            |      | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Closet Door          | 0.04 | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Closet Casing        | 4.1  | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Closet Jamb          | 8.2  | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Closet Walls         | 16.1 | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Closet Baseboard     | 7.9  | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Closet Pole          | 0.00 | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Closet Shelf         | 8.5  | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Closet Supports      | 8.1  | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Closet Floor         | 0.02 | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Closet Ceiling       | 9.6  | AM L N/A          | Y           |            |            |                |                |

COMMENTS / STRUCTURAL DEFECTS:

| SIDE       | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A          | Window Sill          | 4.1  | AM L N/A          | Y           |            |            |                |                |
| B          | Win Apron            | 3.6  | AM L N/A          | Y           |            |            |                |                |
| C          | Win Casing           | 4.0  | AM L N/A          | Y           |            |            |                |                |
| D          | Header Stop          | 0.02 | AM L N/A          | Y           |            |            |                |                |
|            | Int Stops            | 0.00 | AM L N/A          | Y           |            |            |                |                |
| 1          | Win Int Sash         | 0.00 | AM L N/A          | Y           |            |            |                |                |
| 2          | Exterior Sill        | 3.4  | AM SF L N/A       | Y           |            |            |                |                |
| 3          | Part Bead            | 0.00 | AM L N/A          | Y           |            |            |                |                |
| 4          | Blind Stop           | 3.6  | AM SF L N/A       | Y           |            |            |                |                |
|            | Win Ext Sash         | 0.05 | AM L N/A          | Y           |            |            |                |                |
| A          | Window Sill          | 4.1  | AM L N/A          | Y           |            |            |                |                |
| B          | Win Apron            | 3.6  | AM L N/A          | Y           |            |            |                |                |
| C          | Win Casing           | 4.0  | AM L N/A          | Y           |            |            |                |                |
| D          | Header Stop          | 0.02 | AM L N/A          | Y           |            |            |                |                |
|            | Int Stops            | 0.00 | AM L N/A          | Y           |            |            |                |                |
| 1          | Win Int Sash         | 0.01 | AM L N/A          | Y           |            |            |                |                |
| 2          | Exterior Sill        | 4.1  | AM SF L N/A       | Y           |            |            |                |                |
| 3          | Part Bead            | 0.00 | AM L N/A          | Y           |            |            |                |                |
| 4          | Blind Stop           | 4.0  | AM SF L N/A       | Y           |            |            |                |                |
|            | Win Ext Sash         | 0.05 | AM L N/A          | Y           |            |            |                |                |
| A          | Window Sill          |      | AM L N/A          | Y           |            |            |                |                |
| B          | Win Apron            |      | AM L N/A          | Y           |            |            |                |                |
| C          | Win Casing           |      | AM L N/A          | Y           |            |            |                |                |
| D          | Header Stop          |      | AM L N/A          | Y           |            |            |                |                |
|            | Int Stops            |      | AM L N/A          | Y           |            |            |                |                |
| 1          | Win Int Sash         |      | AM L N/A          | Y           |            |            |                |                |
| 2          | Exterior Sill        |      | AM SF L N/A       | Y           |            |            |                |                |
| 3          | Part Bead            |      | AM L N/A          | Y           |            |            |                |                |
| 4          | Blind Stop           |      | AM SF L N/A       | Y           |            |            |                |                |
|            | Win Ext Sash         |      | AM L N/A          | Y           |            |            |                |                |
| A B        | Fireplace            |      | AM L N/A          | Y           |            |            |                |                |
| C D        | Mantle               |      | AM L N/A          | Y           |            |            |                |                |
| A B<br>C D | Win Above 5'         |      | AM L N/A          | Y           |            |            |                |                |
|            | Ceiling Molding      |      | AM L N/A          | Y           |            |            |                |                |
|            |                      |      | AM L N/A          | Y           |            |            |                |                |
|            |                      |      | AM L N/A          | Y           |            |            |                |                |
|            |                      |      | AM L N/A          | Y           |            |            |                |                |

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

(b) (6)

09-20-2012

Page 8 of 25

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 917 Main St.

Apt #: AAAAAA

City: Vineyard Haven, MA 02568

ROOM # 4

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A/B  | Up Walls             | 7.1  | AM L N/A          | Y           |            |            |                |                |
| A/B  | Low Walls            |      | AM L N/A          | Y           |            |            |                |                |
| A/B  | Baseboards           | 13.0 | AM L N/A          | Y           |            |            |                |                |
| A/B  | Chair Rail           |      | AM L N/A          | Y           |            |            |                |                |
| A/B  | Radiator             | 0.04 | AM L N/A          | Y           |            |            |                |                |
|      | Floor                | 0.01 | AM L N/A          | Y           |            |            |                |                |
|      | Ceiling              | 7.9  | AM L N/A          | Y           |            |            |                |                |
| A/B  | Door                 | 1.2  | AM L N/A          | Y           |            |            |                |                |
| C/D  | Door Casing          | 4.1  | AM L N/A          | Y           |            |            |                |                |
| 1/2  | Door Jamb            | 2.6  | AM L N/A          | Y           |            |            |                |                |
| 3/4  | Threshold            |      | AM L N/A          | Y           |            |            |                |                |
| A/B  | Door                 | 1.2  | AM L N/A          | Y           |            |            |                |                |
| C/D  | Door Casing          | 4.9  | AM L N/A          | Y           |            |            |                |                |
| 1/2  | Door Jamb            | 2.6  | AM L N/A          | Y           |            |            |                |                |
| 3/4  | Threshold            | 0.03 | AM L N/A          | Y           |            |            |                |                |
| A/B  | Door                 | 0.04 | AM L N/A          | Y           |            |            |                |                |
| C/D  | Door Casing          | 7.1  | AM L N/A          | Y           |            |            |                |                |
| 1/2  | Door Jamb            | 7.6  | AM L N/A          | Y           |            |            |                |                |
| 3/4  | Threshold            | 0.03 | AM L N/A          | Y           |            |            |                |                |
| A/B  | Door (1)             | 1.2  | AM L N/A          | Y           |            |            |                |                |
| C/D  | Door Casing          |      | AM L N/A          | Y           |            |            |                |                |
| 1/2  | Door Jamb            | 4.9  | AM L N/A          | Y           |            |            |                |                |
| 3/4  | Threshold            | 0.03 | AM L N/A          | Y           |            |            |                |                |
| A    | Closet Door          | 18.2 | AM L N/A          | Y           |            |            |                |                |
| B    | Closet Casing        | 3.2  | AM L N/A          | Y           |            |            |                |                |
| C    | Closet Jamb          | 9.0  | AM L N/A          | Y           |            |            |                |                |
| D    | Closet Walls         | 19.1 | AM L N/A          | Y           |            |            |                |                |
|      | Closet Baseboard     | 6.8  | AM L N/A          | Y           |            |            |                |                |
| 1    | Closet Pole          | 0.04 | AM L N/A          | Y           |            |            |                |                |
| 2    | Closet Shelf         |      | AM L N/A          | Y           |            |            |                |                |
| 3    | Closet Supports      | 0.03 | AM L N/A          | Y           |            |            |                |                |
| 4    | Closet Floor         | 0.00 | AM L N/A          | Y           |            |            |                |                |
|      | Closet Ceiling       | 7.1  | AM L N/A          | Y           |            |            |                |                |

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A    | Window Sill          | 2.6  | AM L N/A          | Y           |            |            |                |                |
| B    | Win Apron            | 5.7  | AM L N/A          | Y           |            |            |                |                |
| C    | Win Casing           | 2.9  | AM L N/A          | Y           |            |            |                |                |
| D    | Header Stop          | 0.00 | AM L N/A          | Y           |            |            |                |                |
|      | Int Stops            | 0.00 | AM L N/A          | Y           |            |            |                |                |
| 1    | Win Int Sash         | 0.00 | AM L N/A          | Y           |            |            |                |                |
| 2    | Exterior Sill        | 1.3  | AM SF L N/A       | Y           |            |            |                |                |
| 3    | Part Bead            | 0.00 | AM L N/A          | Y           |            |            |                |                |
| 4    | Blind Stop           | 1.6  | AM SF L N/A       | Y           |            |            |                |                |
|      | Win Ext Sash         | 0.00 | AM L N/A          | Y           |            |            |                |                |
| A    | Window Sill          |      | AM L N/A          | Y           |            |            |                |                |
| B    | Win Apron            |      | AM L N/A          | Y           |            |            |                |                |
| C    | Win Casing           |      | AM L N/A          | Y           |            |            |                |                |
| D    | Header Stop          |      | AM L N/A          | Y           |            |            |                |                |
|      | Int Stops            |      | AM L N/A          | Y           |            |            |                |                |
| 1    | Win Int Sash         |      | AM L N/A          | Y           |            |            |                |                |
| 2    | Exterior Sill        |      | AM SF L N/A       | Y           |            |            |                |                |
| 3    | Part Bead            |      | AM L N/A          | Y           |            |            |                |                |
| 4    | Blind Stop           |      | AM SF L N/A       | Y           |            |            |                |                |
|      | Win Ext Sash         |      | AM L N/A          | Y           |            |            |                |                |
| A    | Window Sill          |      | AM L N/A          | Y           |            |            |                |                |
| B    | Win Apron            |      | AM L N/A          | Y           |            |            |                |                |
| C    | Win Casing           |      | AM L N/A          | Y           |            |            |                |                |
| D    | Header Stop          |      | AM L N/A          | Y           |            |            |                |                |
|      | Int Stops            |      | AM L N/A          | Y           |            |            |                |                |
| 1    | Win Int Sash         |      | AM L N/A          | Y           |            |            |                |                |
| 2    | Exterior Sill        |      | AM SF L N/A       | Y           |            |            |                |                |
| 3    | Part Bead            |      | AM L N/A          | Y           |            |            |                |                |
| 4    | Blind Stop           |      | AM SF L N/A       | Y           |            |            |                |                |
|      | Win Ext Sash         |      | AM L N/A          | Y           |            |            |                |                |
| A/B  | Fireplace            |      | AM L N/A          | Y           |            |            |                |                |
| C/D  | Mantle               |      | AM L N/A          | Y           |            |            |                |                |
| A/B  | Win Above S          |      | AM L N/A          | Y           |            |            |                |                |
| C/D  | Ceiling Molding      |      | AM L N/A          | Y           |            |            |                |                |
| C2   | Ceiling Molding      |      | AM L N/A          | Y           |            |            |                |                |
| C2   | Ceiling Molding      |      | AM L N/A          | Y           |            |            |                |                |
| C2   | Ceiling Molding      |      | AM L N/A          | Y           |            |            |                |                |

COMMENTS / STRUCTURAL DEFECTS:  
(1) other side of EZ door in CRAWL SPACE

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |



(b) (6)

09-20-2012

Page 9 of 25

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 917 Main St.

Apt #: AAAAAA

City: Vineyard Haven, MA 02568

ROOM # 5

| SIDE    | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|---------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A B C D | Up Walls             | 15.0 | (M) N/A           | Y           |            |            |                |                |
| A B C D | Low Walls            | /    | A/M L N/A         | Y           |            |            |                |                |
| A B C D | Baseboards           | 12.1 | (A/M) L N/A       | Y           |            |            |                |                |
| A B C D | Chair Rail           | /    | A/M L N/A         | Y           |            |            |                |                |
| A B C D | Radiator             | 0.00 | A/M L N/A         | Y           |            |            |                |                |
|         | Floor                | 0.00 | A/M L N/A         | Y           |            |            |                |                |
|         | Ceiling              | 8.1  | A/M L N/A         | Y           |            |            |                |                |
| A B     | Door                 | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| C D     | Door Casing          | 3.1  | (A/M) L N/A       | Y           |            |            |                |                |
| 1 2     | Door Jamb            | 3.0  | (A/M) L N/A       | Y           |            |            |                |                |
| 3 4     | Threshold            | /    | A/M L N/A         | Y           |            |            |                |                |
| A B     | Door                 | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| C D     | Door Casing          | 4.4  | (A/M) L N/A       | Y           |            |            |                |                |
| 1 2     | Door Jamb            | 3.8  | (A/M) L N/A       | Y           |            |            |                |                |
| 3 4     | Threshold            | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A B     | Door                 | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| C D     | Door Casing          | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| 1 2     | Door Jamb            | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| 3 4     | Threshold            | /    | A/M L N/A         | Y           |            |            |                |                |
| A B     | Door                 | /    | A/M L N/A         | Y           |            |            |                |                |
| C D     | Door Casing          | /    | A/M L N/A         | Y           |            |            |                |                |
| 1 2     | Door Jamb            | /    | A/M L N/A         | Y           |            |            |                |                |
| 3 4     | Threshold            | /    | A/M L N/A         | Y           |            |            |                |                |
| A B     | Door                 | /    | A/M L N/A         | Y           |            |            |                |                |
| C D     | Door Casing          | /    | A/M L N/A         | Y           |            |            |                |                |
| 1 2     | Door Jamb            | /    | A/M L N/A         | Y           |            |            |                |                |
| 3 4     | Threshold            | /    | A/M L N/A         | Y           |            |            |                |                |
| A B     | Door                 | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| C D     | Door Casing          | 3.6  | (M) L N/A         | Y           |            |            |                |                |
| 1 2     | Door Jamb            | 3.1  | (A/M) L N/A       | Y           |            |            |                |                |
| 3 4     | Threshold            | 11.3 | A/M L N/A         | Y           |            |            |                |                |
| 1       | Closet Baseboard     | 29.6 | A/M L N/A         | Y           |            |            |                |                |
| 2       | Closet Pole          | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| 3       | Closet Shelf         | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| 4       | Closet Support       | 12.6 | A/M L N/A         | Y           |            |            |                |                |
|         | Closet Floor         | 0.00 | A/M L N/A         | Y           |            |            |                |                |
|         | Closet Ceiling       | N/A  | A/M L N/A         | Y           |            |            |                |                |

COMMENTS / STRUCTURAL DEFECTS:

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

(b) (6)

09-20-2012

Page 10 of 25

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 917 Main St.

Apt #: AAAAAA

City: Vineyard Haven, MA 02568

## KITCHEN

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A/B  | Up Walls             | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A/B  | Low Walls            |      | A/M L N/A         | Y           |            |            |                |                |
| A/B  | Baseboards           | 15.7 | A/M L N/A         | Y           |            |            |                |                |
| A/B  | Chair Rail           |      | A/M L N/A         | Y           |            |            |                |                |
| A/B  | Radiator             | 0.0  | A/M L N/A         | Y           |            |            |                |                |
|      | Floor                | 0.0  | A/M L N/A         | Y           |            |            |                |                |
|      | Ceiling              | NA   | A/M L N/A         | Y           |            |            |                |                |
| A/B  | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C/D  | Door Casing          | 2.1  | A/M L N/A         | Y           |            |            |                |                |
| 1/2  | Door Jamb            | 4.5  | A/M L N/A         | Y           |            |            |                |                |
| 3/4  | Threshold            | 0.0  | A/M L N/A         | Y           |            |            |                |                |
| A/B  | Door                 | 0.03 | A/M L N/A         | Y           |            |            |                |                |
| C/D  | Door Casing          | 1.6  | A/M L N/A         | Y           |            |            |                |                |
| 1/2  | Door Jamb            | 2.4  | A/M L N/A         | Y           |            |            |                |                |
| 3/4  | Threshold            | 0.0  | A/M L N/A         | Y           |            |            |                |                |
| A/B  | Door                 | 0.03 | A/M L N/A         | Y           |            |            |                |                |
| C/D  | Door Casing          | 3.3  | A/M L N/A         | Y           |            |            |                |                |
| 1/2  | Door Jamb            | 3.2  | A/M L N/A         | Y           |            |            |                |                |
| 3/4  | Threshold            | 0.0  | A/M L N/A         | Y           |            |            |                |                |
| A/B  | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C/D  | Door Casing          | 1.6  | A/M L N/A         | Y           |            |            |                |                |
| 1/2  | Door Jamb            | 1.9  | A/M L N/A         | Y           |            |            |                |                |
| 3/4  | Threshold            | 0.0  | A/M L N/A         | Y           |            |            |                |                |
| A    | Closet Door          |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Closet Casing        |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Closet Jamb          |      | A/M L N/A         | Y           |            |            |                |                |
| D    | Closet Walls         |      | A/M L N/A         | Y           |            |            |                |                |
|      | Closet Baseboard     |      | A/M L N/A         | Y           |            |            |                |                |
| 1    | Closet Pole          |      | A/M L N/A         | Y           |            |            |                |                |
| 2    | Closet Shelf         |      | A/M L N/A         | Y           |            |            |                |                |
| 3    | Closet Supports      |      | A/M L N/A         | Y           |            |            |                |                |
| 4    | Closet Floor         |      | A/M L N/A         | Y           |            |            |                |                |
|      | Closet Ceiling       |      | A/M L N/A         | Y           |            |            |                |                |

COMMENTS / STRUCTURAL DEFECTS:

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A    | Window Sill          | 0.00 | M/I A/M L N/A     | Y           |            |            |                |                |
| B    | Win Apron            | 0.0  | A/M L N/A         | Y           |            |            |                |                |
| C    | Win Casing           | 0.02 | A/M L N/A         | Y           |            |            |                |                |
| D    | Header Stop          | 0.0  | M/I A/M L N/A     | Y           |            |            |                |                |
|      | Int Stops            | 0.0  | M/I A/M L N/A     | Y           |            |            |                |                |
| 1    | Win Int Sash         | 0.02 | M/I A/M L N/A     | Y           |            |            |                |                |
| 2    | Exterior Sill        | 0.0  | M/I SF L N/A      | Y           |            |            |                |                |
| 3    | Part Bead            | 0.0  | M/I L N/A         | Y           |            |            |                |                |
| 4    | Blind Stop           | 0.0  | M/I SF L N/A      | Y           |            |            |                |                |
|      | Win Ext Sash         | 0.0  | M/I L N/A         | Y           |            |            |                |                |
| A    | Window Sill          | 0.00 | M/I A/M L N/A     | Y           |            |            |                |                |
| B    | Win Apron            |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Win Casing           | 0.0  | A/M L N/A         | Y           |            |            |                |                |
| D    | Header Stop          | 0.00 | M/I A/M L N/A     | Y           |            |            |                |                |
|      | Int Stops            | 0.00 | M/I A/M L N/A     | Y           |            |            |                |                |
| 1    | Win Int Sash         | 0.00 | M/I A/M L N/A     | Y           |            |            |                |                |
| 2    | Exterior Sill        | 0.05 | M/I SF L N/A      | Y           |            |            |                |                |
| 3    | Part Bead            | 0.0  | M/I L N/A         | Y           |            |            |                |                |
| 4    | Blind Stop           | 0.00 | M/I SF L N/A      | Y           |            |            |                |                |
|      | Win Ext Sash         | 0.00 | M/I L N/A         | Y           |            |            |                |                |
| A/B  | Up Cab Frame         | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| C/D  | Up Cab Door          | 0.00 | A/M L N/A         | Y           |            |            |                |                |
|      | Up Cab Walls         | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| 1/2  | Up Cab Shlvs         | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| 3/4  | Supports             |      | A/M L N/A         | Y           |            |            |                |                |
|      | Low Cab Frame        | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A/B  | Low Cab Door         | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| C/D  | Low Cab Walls        | 0.00 | A/M L N/A         | Y           |            |            |                |                |
|      | Low Cab Shlvs        | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| 1/2  | Supports             |      | A/M L N/A         | Y           |            |            |                |                |
| 3/4  | Drawers              | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A/B  | Win Above S          |      | M/I A/M L N/A     | Y           |            |            |                |                |
| C/D  |                      |      | M/I A/M L N/A     | Y           |            |            |                |                |
|      |                      |      | M/I A/M L N/A     | Y           |            |            |                |                |
|      |                      |      | M/I A/M L N/A     | Y           |            |            |                |                |
|      |                      |      | M/I A/M L N/A     | Y           |            |            |                |                |
|      |                      |      | M/I A/M L N/A     | Y           |            |            |                |                |

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

(b) (6)

09- 20- 2012

Page 1 of 2

|                   |      |           |
|-------------------|------|-----------|
| Inspector (print) | Date | Signature |
|-------------------|------|-----------|

LiC-4

Signature \_\_\_\_\_

State

(b) (6)

|                       |      |           |
|-----------------------|------|-----------|
| Task Assessor (print) | List | Signature |
|-----------------------|------|-----------|

List

Signature \_\_\_\_\_

Date: \_\_\_\_\_

Address of Property: 917 Main St Ant #:

Ant # 444444

City: Vineyard Haven, MA 02568

BATHROOM# 1

| SIDE    | LOCATION/ SURFACE | LEAD | TYPE OF HAZARD | URG HAZ? | IC DATE | IC METH | DELEAD DATE | DELEAD METH |
|---------|-------------------|------|----------------|----------|---------|---------|-------------|-------------|
| A B C D | Up Walls          | 0.00 | A/M L N/A      | Y        |         |         |             |             |
| A B C D | Low Walls         | /    | A/M L N/A      | Y        |         |         |             |             |
| A B C D | Baseboards        | 13.7 | A/M L N/A      | Y        |         |         |             |             |
| A B C D | Chair Rail        | /    | A/M L N/A      | Y        |         |         |             |             |
| A B C D | Radiator          | /    | A/M L N/A      | Y        |         |         |             |             |
|         | Floor             | 11.4 | A/M L N/A      | Y        |         |         |             |             |
|         | Ceiling           | 0.00 | A/M L N/A      | Y        |         |         |             |             |
| A B     | Door              | 0.00 | A/M L N/A      | Y        |         |         |             |             |
| C D     | Door Casing       | 2.1  | A/M L N/A      | Y        |         |         |             |             |
| 1 2     | Door Jamb         | 1.0  | A/M L N/A      | Y        |         |         |             |             |
| 3 4     | Threshold         | 0.00 | A/M L N/A      | Y        |         |         |             |             |
| A B     | Door              | /    | A/M L N/A      | Y        |         |         |             |             |
| C D     | Door Casing       | 4.0  | A/M L N/A      | Y        |         |         |             |             |
| 1 2     | Door Jamb         | 4.1  | A/M L N/A      | Y        |         |         |             |             |
| 3 4     | Threshold         | 0.00 | A/M L N/A      | Y        |         |         |             |             |
| A       | Closet Door       | /    | A/M L N/A      | Y        |         |         |             |             |
| B       | CI Casing         | /    | A/M L N/A      | Y        |         |         |             |             |
| C       | Closet Jamb       | /    | A/M L N/A      | Y        |         |         |             |             |
| D       | Closet Walls      | /    | A/M L N/A      | Y        |         |         |             |             |
|         | CI Baseboard      | /    | A/M L N/A      | Y        |         |         |             |             |
| 1       | Closet Pole       | /    | A/M L N/A      | Y        |         |         |             |             |
| 2       | Closet Shelf      | /    | A/M L N/A      | Y        |         |         |             |             |
| 3       | CI Supports       | /    | A/M L N/A      | Y        |         |         |             |             |
| 4       | Closet Floor      | /    | A/M L N/A      | Y        |         |         |             |             |
|         | Closet Ceiling    | /    | A/M L N/A      | Y        |         |         |             |             |
| A B     | Up Cab Frame      | /    | A/M L N/A      | Y        |         |         |             |             |
| C D     | Up Cab Door       | /    | A/M L N/A      | Y        |         |         |             |             |
|         | Up Cab Walls      | /    | A/M L N/A      | Y        |         |         |             |             |
| 1 2     | Up Cab Shlvs      | /    | A/M L N/A      | Y        |         |         |             |             |
| 3 4     | Supports          | /    | A/M L N/A      | Y        |         |         |             |             |
|         |                   | /    | M/I A/M L N/A  | Y        |         |         |             |             |
|         |                   | /    | M/I A/M L N/A  | Y        |         |         |             |             |
|         |                   | /    | M/I A/M L N/A  | Y        |         |         |             |             |

COMMENTS / STRUCTURAL DEFECTS:

[illegible]

|                                |   |   |   |   |   |   |   |   |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |     |
|--------------------------------|---|---|---|---|---|---|---|---|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|-----|
| 1                              | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 | 13 | 14 | 15 | 16 | 17 | 18 | 19 | 20 | 21 | 22 | 23 | 24 | 25 | 26 | 27 | 28 | 29 | 30 | 31 | 32 | 33 | 34 | 35 | 36 | 37 | 38 | 39 | 40 | 41 | 42 | 43 | 44 | 45 | 46 | 47 | 48 | 49 | 50 | 51 | 52 | 53 | 54 | 55 | 56 | 57 | 58 | 59 | 60 | 61 | 62 | 63 | 64 | 65 | 66 | 67 | 68 | 69 | 70 | 71 | 72 | 73 | 74 | 75 | 76 | 77 | 78 | 79 | 80 | 81 | 82 | 83 | 84 | 85 | 86 | 87 | 88 | 89 | 90 | 91 | 92 | 93 | 94 | 95 | 96 | 97 | 98 | 99 | 100 |
| COMMENTS / STRUCTURAL DEFECTS: |   |   |   |   |   |   |   |   |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |    |     |

**EXCLUDED SURFACES:** Surfaces listed in these boxes can be made intact only by a licensed dealer.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |



(b) (6)

09-20-2012

Page 12 of 25

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 917 Main St.

Apt #: AAAAAA

City: Vineyard Haven, MA 02568

BATHROOM # 2

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A B  | Up Walls             | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Low Walls            | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Baseboards           | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Chair Rail           |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Radiator             | 0.00 | A/M L N/A         | Y           |            |            |                |                |
|      | Floor                | 0.00 | A/M L N/A         | Y           |            |            |                |                |
|      | Ceiling              | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A    | Closet Door          |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Cl Casing            |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Closet Jamb          |      | A/M L N/A         | Y           |            |            |                |                |
| D    | Closet Walls         |      | A/M L N/A         | Y           |            |            |                |                |
|      | Cl Baseboard         |      | A/M L N/A         | Y           |            |            |                |                |
| 1    | Closet Pole          |      | A/M L N/A         | Y           |            |            |                |                |
| 2    | Closet Shelf         |      | A/M L N/A         | Y           |            |            |                |                |
| 3    | Cl Supports          |      | A/M L N/A         | Y           |            |            |                |                |
| 4    | Closet Floor         |      | A/M L N/A         | Y           |            |            |                |                |
|      | Closet Ceiling       |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Up Cab Frame         |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Up Cab Door          |      | A/M L N/A         | Y           |            |            |                |                |
|      | Up Cab Walls         |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Up Cab Shlvs         |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Supports             |      | A/M L N/A         | Y           |            |            |                |                |
|      |                      |      | M/L A/M L N/A     | Y           |            |            |                |                |
|      |                      |      | M/L A/M L N/A     | Y           |            |            |                |                |
|      |                      |      | M/L A/M L N/A     | Y           |            |            |                |                |

COMMENTS / STRUCTURAL DEFECTS:

COMMENTS / STRUCTURAL DEFECTS:

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |

(b) (6)

09-20-2012

Page 13 of 25

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 917 Main St.

Apt #: AAAAAA

City: Vineyard Haven, MA 02568

HALLWAY -H

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A B  | Up Walls             | 0.51 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Low Walls            |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Baseboards           | 16.4 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Chair Rail           |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Radiator             |      | A/M L N/A         | Y           |            |            |                |                |
|      | Floor                | 11.2 | A/M L N/A         | Y           |            |            |                |                |
|      | Ceiling              | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          | 2.3  | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            | 2.4  | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            | 0.01 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          | 0.01 | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            | 2.9  | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            | 0.20 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| #    | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
|      | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A    | Closet Door          |      | A/M L N/A         | Y           |            |            |                |                |
| B    | CI Casing            |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Closet Jamb          |      | A/M L N/A         | Y           |            |            |                |                |
| D    | Closet Walls         |      | A/M L N/A         | Y           |            |            |                |                |
|      | CI Baseboard         |      | A/M L N/A         | Y           |            |            |                |                |
| 1    | Closet Pole          |      | A/M L N/A         | Y           |            |            |                |                |
| 2    | Closet Shelf         |      | A/M L N/A         | Y           |            |            |                |                |
| 3    | CI Supports          |      | A/M L N/A         | Y           |            |            |                |                |
| 4    | Closet Floor         |      | A/M L N/A         | Y           |            |            |                |                |
|      | Closet Ceiling       |      | A/M L N/A         | Y           |            |            |                |                |

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A    | Closet Door          |      | A/M L N/A         | Y           |            |            |                |                |
| B    | CI Casing            |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Closet Jamb          |      | A/M L N/A         | Y           |            |            |                |                |
| D    | Closet Walls         |      | A/M L N/A         | Y           |            |            |                |                |
|      | CI Baseboard         |      | A/M L N/A         | Y           |            |            |                |                |
| 1    | Closet Pole          |      | A/M L N/A         | Y           |            |            |                |                |
| 2    | Closet Shelf         |      | A/M L N/A         | Y           |            |            |                |                |
| 3    | CI Supports          |      | A/M L N/A         | Y           |            |            |                |                |
| 4    | Closet Floor         |      | A/M L N/A         | Y           |            |            |                |                |
|      | Closet Ceiling       |      | A/M L N/A         | Y           |            |            |                |                |
| A    | Window Sill          |      | M/I A/M L N/A     | Y           |            |            |                |                |
| B    | Win Apron            |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| D    | Header Stop          |      | M/I A/M L N/A     | Y           |            |            |                |                |
|      | Int Stops            |      | M/I A/M L N/A     | Y           |            |            |                |                |
| 1    | Win Int Sash         |      | M/I A/M L N/A     | Y           |            |            |                |                |
| 2    | Exterior Sill        |      | M/I SF L N/A      | Y           |            |            |                |                |
| 3    | Part Bead            |      | M/I L N/A         | Y           |            |            |                |                |
| 4    | Blind Stop           |      | M/I SF L N/A      | Y           |            |            |                |                |
|      | Win Ext Sash         |      | M/I L N/A         | Y           |            |            |                |                |
| A    | Window Sill          |      | M/I A/M L N/A     | Y           |            |            |                |                |
| B    | Win Apron            |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| D    | Header Stop          |      | M/I A/M L N/A     | Y           |            |            |                |                |
|      | Int Stops            |      | M/I A/M L N/A     | Y           |            |            |                |                |
| 1    | Win Int Sash         |      | M/I A/M L N/A     | Y           |            |            |                |                |
| 2    | Exterior Sill        |      | M/I SF L N/A      | Y           |            |            |                |                |
| 3    | Part Bead            |      | M/I L N/A         | Y           |            |            |                |                |
| 4    | Blind Stop           |      | M/I SF L N/A      | Y           |            |            |                |                |
|      | Win Ext Sash         |      | M/I L N/A         | Y           |            |            |                |                |
| A B  | Win Above 5'         |      | M/I A/M L N/A     | Y           |            |            |                |                |
| A B  | Ceiling Molding      |      | M/I A/M L N/A     | Y           |            |            |                |                |
| B    | Support              | 0.00 | M/I A/M L N/A     | Y           |            |            |                |                |

COMMENTS / STRUCTURAL DEFECTS:

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 285 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 285 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |





(b) (6)

09-20-2012

Page

15 of 25

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 917 Main St.

Apt #: AAAAAA

City: Vineyard Haven, MA 02558

HALLWAY # 3

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A B  | Up Walls             | 13.4 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Low Walls            |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Baseboards           | 12.0 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Chair Rail           |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Radiator             |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Floor                | 0.0  | A/M L N/A         | Y           |            |            |                |                |
| A B  | Ceiling              | 9.3  | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 | 0.0  | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          | 2.4  | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            | 3.0  | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            | 0.0  | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 | 0.0  | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          | 0.1  | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            | 0.0  | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            | 0.0  | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 | 0.1  | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          | 2.4  | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            | 2.3  | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            | 0.0  | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A    | Closet Door          |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Closet Casing        |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Closet Jamb          |      | A/M L N/A         | Y           |            |            |                |                |
| D    | Closet Walls         |      | A/M L N/A         | Y           |            |            |                |                |
|      | Closet Baseboard     |      | A/M L N/A         | Y           |            |            |                |                |
| 1    | Closet Pole          |      | A/M L N/A         | Y           |            |            |                |                |
| 2    | Closet Shelf         |      | A/M L N/A         | Y           |            |            |                |                |
| 3    | Closet Supports      |      | A/M L N/A         | Y           |            |            |                |                |
| 4    | Closet Floor         |      | A/M L N/A         | Y           |            |            |                |                |
|      | Closet Ceiling       |      | A/M L N/A         | Y           |            |            |                |                |

COMMENTS / STRUCTURAL DEFECTS:

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A    | Window Sill          |      | M/I A/M L N/A     | Y           |            |            |                |                |
| B    | Win Apron            |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| D    | Header Stop          |      | M/I A/M L N/A     | Y           |            |            |                |                |
|      | Int Stops            |      | M/I A/M L N/A     | Y           |            |            |                |                |
| 1    | Win Int Sash         |      | M/I A/M L N/A     | Y           |            |            |                |                |
| 2    | Exterior Sill        |      | M/I SF L N/A      | Y           |            |            |                |                |
| 3    | Part Bead            |      | M/I L N/A         | Y           |            |            |                |                |
| 4    | Blind Stop           |      | M/I SF L N/A      | Y           |            |            |                |                |
|      | Win Ext Sash         |      | M/I L N/A         | Y           |            |            |                |                |
| A    | Window Sill          |      | M/I A/M L N/A     | Y           |            |            |                |                |
| B    | Win Apron            |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| D    | Header Stop          |      | M/I A/M L N/A     | Y           |            |            |                |                |
|      | Int Stops            |      | M/I A/M L N/A     | Y           |            |            |                |                |
| 1    | Win Int Sash         |      | M/I A/M L N/A     | Y           |            |            |                |                |
| 2    | Exterior Sill        |      | M/I SF L N/A      | Y           |            |            |                |                |
| 3    | Part Bead            |      | M/I L N/A         | Y           |            |            |                |                |
| 4    | Blind Stop           |      | M/I SF L N/A      | Y           |            |            |                |                |
|      | Win Ext Sash         |      | M/I L N/A         | Y           |            |            |                |                |
| A B  | Fireplace            |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Mantle               |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Win Above S          |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Ceiling Molding      |      | A/M L N/A         | Y           |            |            |                |                |
| A    | Header               | Sr 7 | A/M L N/A         | Y           |            |            |                |                |
|      |                      |      | A/M L N/A         | Y           |            |            |                |                |
|      |                      |      | A/M L N/A         | Y           |            |            |                |                |

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

(b) (6)

09-20-2012

Page 16 of 25

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 917 Main St.

Apt #: AAAAAA

City: Vineyard Haven, MA 02568

STAIRCASE 1ST TO 2ND

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A B  | Up Walls             | 0.3  | A/M L N/A         | Y           |            |            |                |                |
| A B  | Low Walls            |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Baseboards           | 1.7  | A/M L N/A         | Y           |            |            |                |                |
| A B  | Chair Rail           |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Radiator             | 1.1  | A/M L N/A         | Y           |            |            |                |                |
|      | Floor                | THE  | A/M L N/A         | Y           |            |            |                |                |
|      | Ceiling              | 0.12 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door 1st             | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          | 4.2  | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            | 1.9  | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            | 0.3  | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door 1st             | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          | 1.9  | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            | 7.1  | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            | 0.02 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          | 3.1  | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            | 0.6  | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            | 0.01 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          | 2.6  | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            | 2.2  | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            | 0.01 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| #    | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
|      | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A    | Closet Door          |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Cl Casing            |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Closet Jamb          |      | A/M L N/A         | Y           |            |            |                |                |
| D    | Closet Walls         |      | A/M L N/A         | Y           |            |            |                |                |
|      | Cl Baseboard         |      | A/M L N/A         | Y           |            |            |                |                |
| 1    | Closet Pole          |      | A/M L N/A         | Y           |            |            |                |                |
| 2    | Closet Shelf         |      | A/M L N/A         | Y           |            |            |                |                |
| 3    | Cl Supports          |      | A/M L N/A         | Y           |            |            |                |                |
| 4    | Closet Floor         |      | A/M L N/A         | Y           |            |            |                |                |
|      | Closet Ceiling       |      | A/M L N/A         | Y           |            |            |                |                |

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A    | Window Sill          | 3.1  | A/M L N/A         | Y           |            |            |                |                |
| B    | Win Apron            | 3.0  | A/M L N/A         | Y           |            |            |                |                |
| C    | Win Casing           | 3.6  | A/M L N/A         | Y           |            |            |                |                |
| D    | Header Stop          | 0.01 | A/M L N/A         | Y           |            |            |                |                |
|      | Int Stops            | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| 1    | Win Int Sash         | 0.01 | A/M L N/A         | Y           |            |            |                |                |
| 2    | Exterior Sill        | 4.5  | A/M L N/A         | Y           |            |            |                |                |
| 3    | Part Bead            | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| 4    | Blind Stop           | 4.2  | A/M L N/A         | Y           |            |            |                |                |
|      | Win Ext Sash         | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A    | Window Sill          |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Win Apron            |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| D    | Header Stop          |      | A/M L N/A         | Y           |            |            |                |                |
|      | Int Stops            |      | A/M L N/A         | Y           |            |            |                |                |
| 1    | Win Int Sash         |      | A/M L N/A         | Y           |            |            |                |                |
| 2    | Exterior Sill        |      | A/M SF L N/A      | Y           |            |            |                |                |
| 3    | Part Bead            |      | A/M L N/A         | Y           |            |            |                |                |
| 4    | Blind Stop           |      | A/M SF L N/A      | Y           |            |            |                |                |
|      | Win Ext Sash         |      | A/M L N/A         | Y           |            |            |                |                |
|      | Newel Post           | 0.00 | A/M L N/A         | Y           |            |            |                |                |
|      | Railing Cap          | 0.01 | A/M L N/A         | Y           |            |            |                |                |
|      | Handrail             |      | A/M L N/A         | Y           |            |            |                |                |
|      | Balusters            | 0.01 | A/M L N/A         | Y           |            |            |                |                |
|      | Lower rail           |      | A/M L N/A         | Y           |            |            |                |                |
|      | Treads               | 0.6  | A/M L N/A         | Y           |            |            |                |                |
|      | Risers               | 22.4 | A/M L N/A         | Y           |            |            |                |                |
|      | Stringer             | 22.4 | A/M L N/A         | Y           |            |            |                |                |
|      | Floor Edge           | 24.1 | A/M L N/A         | Y           |            |            |                |                |
|      | Floor Casing         | 22.4 | A/M L N/A         | Y           |            |            |                |                |
| A    | Win Apron            | 10.2 | A/M L N/A         | Y           |            |            |                |                |

COMMENTS / STRUCTURAL DEFECTS:

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

Page 17 of 25

Date: \_\_\_\_\_

Date \_\_\_\_\_

City: Vineyard Haven, MA 02568

COMMENTS / STRUCTURAL DEFECTS

(1) FOUNDATION SIZE AND TOWERS

**EXCLUDED SURFACES:** Surfaces listed in these boxes can be made intact only by a licensed dealer.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD | SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |      |          |                                                 |            |              |
|      |          |                                                 |            |              |      |          |                                                 |            |              |
|      |          |                                                 |            |              |      |          |                                                 |            |              |



(b) (6)

09-20-2012

Page 18 of 25

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 917 Main St.

Apt #: 000000

City: Vineyard Haven, MA 02568

## BASEMENT/LAUNDRY AREA

| SIDE     | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|----------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| AB<br>CD | Walls                | NC   | A/M L N/A         | Y           |            |            |                |                |
| AB<br>CD | Walls                | NC   | A/M L N/A         | Y           |            |            |                |                |
| AB<br>CD | Walls (2)            | 2.4  | A/M L N/A         | Y           |            |            |                |                |
| AB<br>CD | Walls                | /    | A/M L N/A         | Y           |            |            |                |                |
| AB<br>CD | Baseboards           | /    | A/M L N/A         | Y           |            |            |                |                |
| AB<br>CD | Chair rails          | /    | A/M L N/A         | Y           |            |            |                |                |
| AB<br>CD | Floor                | NC   | A/M L N/A         | Y           |            |            |                |                |
| AB<br>CD | Ceiling              | /    | A/M L N/A         | Y           |            |            |                |                |
| AB<br>CD | Chimney              | NC   | A/M L N/A         | Y           |            |            |                |                |
| AB<br>CD | Support Column       | NC   | A/M L N/A         | Y           |            |            |                |                |
| AB<br>CD | Door                 | 18.6 | A/M L N/A         | Y           |            |            |                |                |
| AB<br>CD | Door Casing          | 18.0 | A/M L N/A         | Y           |            |            |                |                |
| AB<br>CD | Door Jamb            | 18.1 | A/M L N/A         | Y           |            |            |                |                |
| AB<br>CD | Threshold            | /    | A/M L N/A         | Y           |            |            |                |                |
| AB<br>CD | Door (1)             | 18.6 | A/M L N/A         | Y           |            |            |                |                |
| AB<br>CD | Door Casing          | /    | A/M L N/A         | Y           |            |            |                |                |
| AB<br>CD | Door Jamb            | 18.6 | A/M L N/A         | Y           |            |            |                |                |
| AB<br>CD | Threshold            | /    | A/M L N/A         | Y           |            |            |                |                |
| AB<br>CD | Door                 | /    | A/M L N/A         | Y           |            |            |                |                |
| AB<br>CD | Door Casing          | /    | A/M L N/A         | Y           |            |            |                |                |
| AB<br>CD | Door Jamb            | /    | A/M L N/A         | Y           |            |            |                |                |
| AB<br>CD | Threshold            | /    | A/M L N/A         | Y           |            |            |                |                |
| AB<br>CD | Cabinets             | 19.6 | A/M L N/A         | Y           |            |            |                |                |
| AB<br>CD | Benches              | /    | A/M L N/A         | Y           |            |            |                |                |
| AB<br>CD | Supports             | /    | A/M L N/A         | Y           |            |            |                |                |
| AB<br>CD | Closet Door          | /    | A/M L N/A         | Y           |            |            |                |                |
| AB<br>CD | Closet Casing        | /    | A/M L N/A         | Y           |            |            |                |                |
| AB<br>CD | Closet Jamb          | /    | A/M L N/A         | Y           |            |            |                |                |
| AB<br>CD | Closet Walls         | /    | A/M L N/A         | Y           |            |            |                |                |
| AB<br>CD | Closet Baseboard     | /    | A/M L N/A         | Y           |            |            |                |                |
| AB<br>CD | Closet Pole          | /    | A/M L N/A         | Y           |            |            |                |                |
| AB<br>CD | Closet Shelf         | /    | A/M L N/A         | Y           |            |            |                |                |
| AB<br>CD | Closet Supports      | /    | A/M L N/A         | Y           |            |            |                |                |
| AB<br>CD | Closet Floor         | /    | A/M L N/A         | Y           |            |            |                |                |
| AB<br>CD | Closet Ceiling       | /    | A/M L N/A         | Y           |            |            |                |                |

Comments/Structural Defects:  
(1) outside of D door  
(2) Bottom side of stairs

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE                                                        | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|-------------------------------------------------------------|----------|-------------------------------------------------|------------|--------------|
| AB<br>CD <td>Oil Tank</td> <td>2.0</td> <td></td> <td></td> | Oil Tank | 2.0                                             |            |              |

(b) (6)

9-20-2012

Page 19 of 25

Inspector (print)

Lic #

Signature

Date

(b) (6)

sk Assessor (print)

Lic #

Signature

Date

Address of Property:

917

Main St

Apt #:

City:

VINEYARD

HAUEN, MA

02568

LAUNDRY ROOM

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A B  | Up Walls             | 0.01 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Low Walls            |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Baseboards           | 0.01 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Chair Rail           |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Radiator             |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Floor                | 0.05 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Ceiling              | N/A  | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          | 0.15 | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            | 0.22 | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            | 0.05 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Closet Door          |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Ci Casing            |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Closet Jamb          |      | A/M L N/A         | Y           |            |            |                |                |
| D    | Closet Walls         |      | A/M L N/A         | Y           |            |            |                |                |
|      | Ci Baseboard         |      | A/M L N/A         | Y           |            |            |                |                |
| 1    | Closet Pole          |      | A/M L N/A         | Y           |            |            |                |                |
| 2    | Closet Shelf         |      | A/M L N/A         | Y           |            |            |                |                |
| 3    | Ci Supports          |      | A/M L N/A         | Y           |            |            |                |                |
| 4    | Closet Floor         |      | A/M L N/A         | Y           |            |            |                |                |
|      | Closet Ceiling       |      | A/M L N/A         | Y           |            |            |                |                |

COMMENTS / STRUCTURAL DEFECTS:

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A    | Window Sill          | 2.0  | M/I A/M L N/A     | Y           |            |            |                |                |
| B    | Win Apron            | 0.15 | A/M L N/A         | Y           |            |            |                |                |
| C    | Win Casing           | 4.6  | M/I A/M L N/A     | Y           |            |            |                |                |
| D    | Header Stop          | 0.02 | M/I A/M L N/A     | Y           |            |            |                |                |
|      | Int Stops            | 0.01 | M/I A/M L N/A     | Y           |            |            |                |                |
| 1    | Win Int Sash         | 0.05 | M/I A/M L N/A     | Y           |            |            |                |                |
| 2    | Exterior Sill        | 1.4  | M/I SF L N/A      | Y           |            |            |                |                |
| 3    | Part Bead            | 0.02 | M/I L N/A         | Y           |            |            |                |                |
| 4    | Blind Stop           | 1.3  | M/I SF L N/A      | Y           |            |            |                |                |
|      | Win Ext Sash         | 0.02 | M/I L N/A         | Y           |            |            |                |                |
| A    | Window Sill          |      | M/I A/M L N/A     | Y           |            |            |                |                |
| B    | Win Apron            |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| D    | Header Stop          |      | M/I A/M L N/A     | Y           |            |            |                |                |
|      | Int Stops            |      | M/I A/M L N/A     | Y           |            |            |                |                |
| 1    | Win Int Sash         |      | M/I A/M L N/A     | Y           |            |            |                |                |
| 2    | Exterior Sill        |      | M/I SF L N/A      | Y           |            |            |                |                |
| 3    | Part Bead            |      | M/I L N/A         | Y           |            |            |                |                |
| 4    | Blind Stop           |      | M/I SF L N/A      | Y           |            |            |                |                |
|      | Win Ext Sash         |      | M/I L N/A         | Y           |            |            |                |                |
| A B  | Fireplace            |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Mantle               |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Win Above 5'         |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Ceiling Molding      |      | A/M L N/A         | Y           |            |            |                |                |
|      |                      |      | A/M L N/A         | Y           |            |            |                |                |
|      |                      |      | A/M L N/A         | Y           |            |            |                |                |
|      |                      |      | A/M L N/A         | Y           |            |            |                |                |

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

(b) (6)

9-20-2012

Page 20 of 25

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 917 MAIN ST. Apt #

City: VINEYARD HAVEN MA 02568

PORCH (A) B C D (circle one) (1st fl) 2nd fl 3rd fl 4th fl (circle one)

| SIDE                           | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|--------------------------------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A B                            | Siding               | 0.00 | L N/A             | Y           |            |            |                |                |
| C D                            | Corner Boards        | 0.00 | L N/A             | Y           |            |            |                |                |
|                                | Upper Trim           | N/A  | L N/A             | Y           |            |            |                |                |
|                                | Ceiling              | N/A  | L N/A             | Y           |            |            |                |                |
|                                | Joists               | N/A  | L N/A             | Y           |            |            |                |                |
| (A)                            | Door                 | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| B                              | Storm Door           | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| C                              | Door Casing          | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| D                              | Door Jamb            | 2.00 | A/M L N/A         | Y           |            |            |                |                |
| 1 2                            | Threshold            | 1.00 | A/M L N/A         | Y           |            |            |                |                |
| 3 4                            | Kickplate            | 1.00 | A/M L N/A         | Y           |            |            |                |                |
| A B                            | Window Sill          |      | A/M L N/A         | Y           |            |            |                |                |
| C D                            | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2                            | Window Sash          |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4                            | Mullions             |      | A/M L N/A         | Y           |            |            |                |                |
| A B                            | Window Sill          |      | A/M L N/A         | Y           |            |            |                |                |
| C D                            | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2                            | Window Sash          |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4                            | Mullions             |      | A/M L N/A         | Y           |            |            |                |                |
| A B                            | Window Sill          |      | A/M L N/A         | Y           |            |            |                |                |
| C D                            | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2                            | Window Sash          |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4                            | Mullions             |      | A/M L N/A         | Y           |            |            |                |                |
| A B                            | Window Sill          |      | A/M L N/A         | Y           |            |            |                |                |
| C D                            | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2                            | Window Sash          |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4                            | Mullions             |      | A/M L N/A         | Y           |            |            |                |                |
| COMMENTS / STRUCTURAL DEFECTS: |                      |      |                   |             |            |            |                |                |

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 1440 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|--------------------------------------------------|------------|--------------|
|      |          |                                                  |            |              |
|      |          |                                                  |            |              |
|      |          |                                                  |            |              |



(b) (6)

09-20-2012

Page 21 of 25

Inspector (print) \_\_\_\_\_ Lic # \_\_\_\_\_ Signature \_\_\_\_\_

Date \_\_\_\_\_

(b) (6)

Risk Assessor (print) \_\_\_\_\_ Lic # \_\_\_\_\_ Signature \_\_\_\_\_

Date \_\_\_\_\_

Address of Property: 917 Main St.

Apt #: AAAAAA

City: Vineyard Haven, MA 02568

PORCH A B C D (circle one) (1st fl 2nd fl 3rd fl 4th fl (circle one))

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH | SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A B  | Siding               | 3.1  | L N/A             | Y           |            |            |                |                |      | Support Clms         | 3.3  | A/M L N/A         | Y           |            |            |                |                |
| C D  | Corner Boards        | 1.4  | L N/A             | Y           |            |            |                |                |      | Newel post           | 3.3  | A/M L N/A         | Y           |            |            |                |                |
|      | Upper Trim           | N/A  | L N/A             | Y           |            |            |                |                |      | Railing Cap          | 3.3  | A/M L N/A         | Y           |            |            |                |                |
|      | Ceiling              | N/A  | L N/A             | Y           |            |            |                |                |      | Handrail             | 3.3  | A/M L N/A         | Y           |            |            |                |                |
|      | Joists               | N/A  | L N/A             | Y           |            |            |                |                |      | Balusters            | 3.3  | A/M L N/A         | Y           |            |            |                |                |
| A    | Door                 | 2.3  | A/M L N/A         | Y           |            |            |                |                |      | Lower Rail           | 3.3  | A/M L N/A         | Y           |            |            |                |                |
| B    | Storm Door           | 3.3  | A/M L N/A         | Y           |            |            |                |                |      | Treads               | 3.3  | A/M L N/A         | Y           |            |            |                |                |
| C    | Door Casing          | 1.2  | A/M L N/A         | Y           |            |            |                |                |      | Risers               | 3.3  | A/M L N/A         | Y           |            |            |                |                |
| D    | Door Jamb            | 1.2  | A/M L N/A         | Y           |            |            |                |                |      | Stringer             | 3.3  | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Threshold            | 1.2  | A/M L N/A         | Y           |            |            |                |                |      | Lower Walls          | 3.3  | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Kickplate            | 1.3  | A/M L N/A         | Y           |            |            |                |                |      | Lattice              | 3.3  | A/M L N/A         | Y           |            |            |                |                |
| A    | Door                 |      | A/M L N/A         | Y           |            |            |                |                |      | Lower Trim           | 3.3  | A/M L N/A         | Y           |            |            |                |                |
| B    | Storm Door           |      | A/M L N/A         | Y           |            |            |                |                |      | Floor                | 3.3  | A/M L N/A         | Y           |            |            |                |                |
| C    | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |      |                      |      | A/M L N/A         | Y           |            |            |                |                |
| D    | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |      |                      |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |      |                      |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Kickplate            |      | A/M L N/A         | Y           |            |            |                |                |      |                      |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Window Sill          |      | A/M L N/A         | Y           |            |            |                |                |      |                      |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |      |                      |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Window Sash          |      | A/M L N/A         | Y           |            |            |                |                |      |                      |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Mullions             |      | A/M L N/A         | Y           |            |            |                |                |      |                      |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Window Sill          | 1.5  | A/M L N/A         | Y           |            |            |                |                |      |                      |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Win Casing           | 1.4  | A/M L N/A         | Y           |            |            |                |                |      |                      |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Window Sash          | 3.3  | A/M L N/A         | Y           |            |            |                |                |      |                      |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Mullions             |      | A/M L N/A         | Y           |            |            |                |                |      |                      |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Window Sill          |      | A/M L N/A         | Y           |            |            |                |                |      |                      |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |      |                      |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Window Sash          |      | A/M L N/A         | Y           |            |            |                |                |      |                      |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Mullions             |      | A/M L N/A         | Y           |            |            |                |                |      |                      |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Window Sill          |      | A/M L N/A         | Y           |            |            |                |                |      |                      |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |      |                      |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Window Sash          |      | A/M L N/A         | Y           |            |            |                |                |      |                      |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Mullions             |      | A/M L N/A         | Y           |            |            |                |                |      |                      |      | A/M L N/A         | Y           |            |            |                |                |

COMMENTS / STRUCTURAL DEFECTS:

COMMENTS / STRUCTURAL DEFECTS:

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 1440 SQ. IN.) | IC<br>DATE | IC<br>METHOD | SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|--------------------------------------------------|------------|--------------|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                  |            |              |      |          |                                                 |            |              |
|      |          |                                                  |            |              |      |          |                                                 |            |              |
|      |          |                                                  |            |              |      |          |                                                 |            |              |

(b) (6)

09-20-2012

Page 22 of 25

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic#

Signature

Date

Address of Property: 917 Main St.

Apt #: AAAAAA

City: Vineyard Haven, MA 02568

## EXTERIOR A Side

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A    | Siding               | 0.00 | L N/A             | Y           |            |            |                |                |
| A    | Corner Boards        | 1.00 | L N/A             | Y           |            |            |                |                |
| A    | Lower Trim           | /    | L N/A             | Y           |            |            |                |                |
| A    | Upper Trim           | 0.00 | L N/A             | Y           |            |            |                |                |
| A    | Win Above 5'         | NA   | L N/A             | Y           |            |            |                |                |
| A    | Porch Above 5'       | /    | L N/A             | Y           |            |            |                |                |
| A    | Storm Door           | /    | A/M L N/A         | Y           |            |            |                |                |
| A    | Door                 | /    | A/M L N/A         | Y           |            |            |                |                |
| A    | Door Casing          | /    | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            | /    | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            | /    | A/M L N/A         | Y           |            |            |                |                |
| A    | Kickplate            | /    | A/M L N/A         | Y           |            |            |                |                |
| A    | Storm Door           | /    | A/M L N/A         | Y           |            |            |                |                |
| A    | Door                 | /    | A/M L N/A         | Y           |            |            |                |                |
| A    | Door Casing          | /    | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            | /    | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            | /    | A/M L N/A         | Y           |            |            |                |                |
| A    | Kickplate            | /    | A/M L N/A         | Y           |            |            |                |                |
| A    | Door                 | /    | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Casing          | /    | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Door Jamb            | /    | A/M L N/A         | Y           |            |            |                |                |
| A    | Threshold            | /    | A/M L N/A         | Y           |            |            |                |                |
| A    | Window Sill          | 1.00 | A/M L N/A         | Y           |            |            |                |                |
| A    | Win Casing           | 1.00 | A/M L N/A         | Y           |            |            |                |                |
| A    | Window Sash          | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A    | Window Sill          | /    | A/M L N/A         | Y           |            |            |                |                |
| A    | Win Casing           | /    | A/M L N/A         | Y           |            |            |                |                |
| A    | Window Sash          | /    | A/M L N/A         | Y           |            |            |                |                |
| A    | Window Sill          | /    | A/M L N/A         | Y           |            |            |                |                |
| A    | Win Casing           | /    | A/M L N/A         | Y           |            |            |                |                |
| A    | Window Sash          | /    | A/M L N/A         | Y           |            |            |                |                |
| A    | Lamp Post            | /    | L N/A             | Y           |            |            |                |                |

COMMENTS / STRUCTURAL DEFECTS:

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A    | Window Sill          | /    | A/M L N/A         | Y           |            |            |                |                |
| A    | Win Casing           | /    | A/M L N/A         | Y           |            |            |                |                |
| A    | Window Sash          | /    | A/M L N/A         | Y           |            |            |                |                |
| A    | Cellar Win Sill      | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A    | Cell Win Sash        | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A    | Cell Win Frame       | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A    | Screen Frame         | /    | A/M L N/A         | Y           |            |            |                |                |
| A    | Cellar Win Sill      | /    | A/M L N/A         | Y           |            |            |                |                |
| A    | Cell Win Sash        | /    | A/M L N/A         | Y           |            |            |                |                |
| A    | Cell Win Frame       | /    | A/M L N/A         | Y           |            |            |                |                |
| A    | Screen Frame         | /    | A/M L N/A         | Y           |            |            |                |                |
| A    | Cellar Win Sill      | /    | A/M L N/A         | Y           |            |            |                |                |
| A    | Cell Win Sash        | /    | A/M L N/A         | Y           |            |            |                |                |
| A    | Cell Win Frame       | /    | A/M L N/A         | Y           |            |            |                |                |
| A    | Screen Frame         | /    | A/M L N/A         | Y           |            |            |                |                |
| A    | Foundation           | 0.00 | L N/A             | Y           |            |            |                |                |
| A    | Bulkhead             | /    | A/M L N/A         | Y           |            |            |                |                |
| A    | Fences               | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A    | Shutters             | /    | A/M L N/A         | Y           |            |            |                |                |
| A    | Novel pool           | /    | A/M L N/A         | Y           |            |            |                |                |
| A    | Rolling Cap          | /    | A/M L N/A         | Y           |            |            |                |                |
| A    | Handrail             | /    | A/M L N/A         | Y           |            |            |                |                |
| A    | Balusters            | /    | A/M L N/A         | Y           |            |            |                |                |
| A    | Lower Rail           | /    | A/M L N/A         | Y           |            |            |                |                |
| A    | Treads               | /    | A/M L N/A         | Y           |            |            |                |                |
| A    | Risers               | /    | A/M L N/A         | Y           |            |            |                |                |
| A    | Stringer             | /    | A/M L N/A         | Y           |            |            |                |                |
| A    | Lattice              | /    | A/M L N/A         | Y           |            |            |                |                |
| A    | Flag Pole            | 0.00 | L N/A             | Y           |            |            |                |                |
| A    | Elec Conduit         | /    | L N/A             | Y           |            |            |                |                |
| A    | Oil Fill Pipe        | 0.00 | L N/A             | Y           |            |            |                |                |
| A    | Overhang Trim        | /    | A/M L N/A         | Y           |            |            |                |                |

Excluded Surfaces: Surfaces listed in this box can be made  
infect only by a licensed deleader

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 1440 SQ. IN.) | IC<br>DATE | IC<br>METH |
|------|----------|--------------------------------------------------|------------|------------|
| A    |          |                                                  |            |            |
| A    |          |                                                  |            |            |
| A    |          |                                                  |            |            |
| A    |          |                                                  |            |            |

## Soil Test Results

(Must be less than 400 ppm for play area / 1200 ppm for bare soil)

| LOCATION  | AREA MEASUREMENT<br>(Square Feet) | RESULT<br>(PPM) | REMED<br>DATE | REMED<br>METH |
|-----------|-----------------------------------|-----------------|---------------|---------------|
| Play Area |                                   |                 |               |               |
| Bare Soil |                                   |                 |               |               |
| Comments: |                                   |                 |               |               |

(b) (6)

09-20-2012

Page 23 Of 25

Inspector (print) \_\_\_\_\_ Lic# \_\_\_\_\_ Signature \_\_\_\_\_

Date \_\_\_\_\_

(b) (6)

Risk Assessor (print) \_\_\_\_\_ Lic# \_\_\_\_\_ Signature \_\_\_\_\_

Date \_\_\_\_\_

Address of Property: 917 Main St.

Apt #: AAAAAA

City: Vineyard Haven, MA 02568

## EXTERIOR B Side

| SIDE | LOCATION/SURFACE | LEAD | TYPE OF HAZARD | URG HAZ? | IC DATE | IC METH | DELEAD DATE | DELEAD METH |
|------|------------------|------|----------------|----------|---------|---------|-------------|-------------|
| B    | Siding           | 0.4  | L N/A          | Y        |         |         |             |             |
| B    | Corner Boards    | 1.2  | L N/A          | Y        |         |         |             |             |
| B    | Lower Trim       | 0.4  | L N/A          | Y        |         |         |             |             |
| B    | Upper Trim       | 0.4  | L N/A          | Y        |         |         |             |             |
| B    | Win Above 5'     | N/A  | L N/A          | Y        |         |         |             |             |
| B    | Porch Above 5'   |      | L N/A          | Y        |         |         |             |             |
| B    | Storm Door       |      | A/M L N/A      | Y        |         |         |             |             |
| B    | Door             | 3.2  | A/M L N/A      | Y        |         |         |             |             |
| B    | Door Casing      | 3.2  | A/M L N/A      | Y        |         |         |             |             |
| 1 2  | Door Jamb        | 0.4  | A/M L N/A      | Y        |         |         |             |             |
| 3 4  | Threshold        | 0.4  | A/M L N/A      | Y        |         |         |             |             |
| B    | Kickplate        |      | A/M L N/A      | Y        |         |         |             |             |
| B    | Storm Door       |      | A/M L N/A      | Y        |         |         |             |             |
| B    | Door             |      | A/M L N/A      | Y        |         |         |             |             |
| B    | Door Casing      |      | A/M L N/A      | Y        |         |         |             |             |
| 1 2  | Door Jamb        |      | A/M L N/A      | Y        |         |         |             |             |
| 3 4  | Threshold        |      | A/M L N/A      | Y        |         |         |             |             |
| B    | Kickplate        |      | A/M L N/A      | Y        |         |         |             |             |
| B    | Door             |      | A/M L N/A      | Y        |         |         |             |             |
| B    | Door Casing      |      | A/M L N/A      | Y        |         |         |             |             |
| 1 2  | Door Jamb        |      | A/M L N/A      | Y        |         |         |             |             |
| 3 4  | Threshold        |      | A/M L N/A      | Y        |         |         |             |             |
| B    | Window Sill      |      | A/M L N/A      | Y        |         |         |             |             |
| B    | Win Casing       |      | A/M L N/A      | Y        |         |         |             |             |
| #    | Window Sash      |      | A/M L N/A      | Y        |         |         |             |             |
| B    | Window Sill      |      | A/M L N/A      | Y        |         |         |             |             |
| B    | Win Casing       |      | A/M L N/A      | Y        |         |         |             |             |
| #    | Window Sash      |      | A/M L N/A      | Y        |         |         |             |             |
| B    | Window Sill      |      | A/M L N/A      | Y        |         |         |             |             |
| B    | Win Casing       |      | A/M L N/A      | Y        |         |         |             |             |
| #    | Window Sash      |      | A/M L N/A      | Y        |         |         |             |             |
| B    | Lamp Post        |      | L N/A          | Y        |         |         |             |             |

COMMENTS / STRUCTURAL DEFECTS:

| SIDE | LOCATION/SURFACE | LEAD | TYPE OF HAZARD | URG HAZ? | IC DATE | IC METH | DELEAD DATE | DELEAD METH |
|------|------------------|------|----------------|----------|---------|---------|-------------|-------------|
| B    | Window Sill      |      | A/M L N/A      | Y        |         |         |             |             |
| B    | Win Casing       |      | A/M L N/A      | Y        |         |         |             |             |
| #    | Window Sash      |      | A/M L N/A      | Y        |         |         |             |             |
| B    | Cellar Win Sill  | 0.4  | A/M L N/A      | Y        |         |         |             |             |
| #    | Cell Win Sash    | 0.4  | A/M L N/A      | Y        |         |         |             |             |
| #    | Cell Win Frame   | 0.4  | A/M L N/A      | Y        |         |         |             |             |
| B    | Screen Frame     |      | A/M L N/A      | Y        |         |         |             |             |
| B    | Cellar Win Sill  |      | A/M L N/A      | Y        |         |         |             |             |
| B    | Cell Win Sash    |      | A/M L N/A      | Y        |         |         |             |             |
| #    | Cell Win Frame   |      | A/M L N/A      | Y        |         |         |             |             |
| B    | Screen Frame     |      | A/M L N/A      | Y        |         |         |             |             |
| B    | Cellar Win Sill  |      | A/M L N/A      | Y        |         |         |             |             |
| #    | Cell Win Sash    |      | A/M L N/A      | Y        |         |         |             |             |
| #    | Cell Win Frame   |      | A/M L N/A      | Y        |         |         |             |             |
| B    | Screen Frame     |      | A/M L N/A      | Y        |         |         |             |             |
| B    | Foundation       | 0.4  | L N/A          | Y        |         |         |             |             |
| B    | Bulkhead         |      | A/M L N/A      | Y        |         |         |             |             |
| B    | Fences           |      | A/M L N/A      | Y        |         |         |             |             |
| B    | Shutters         |      | A/M L N/A      | Y        |         |         |             |             |
| B    | Newel post       |      | A/M L N/A      | Y        |         |         |             |             |
| B    | Railing Cap      |      | A/M L N/A      | Y        |         |         |             |             |
| B    | Handrail         |      | A/M L N/A      | Y        |         |         |             |             |
| B    | Balusters        |      | A/M L N/A      | Y        |         |         |             |             |
| B    | Lower Rail       |      | A/M L N/A      | Y        |         |         |             |             |
| B    | Treads           |      | A/M L N/A      | Y        |         |         |             |             |
| B    | Risers           |      | A/M L N/A      | Y        |         |         |             |             |
| B    | Stringer         |      | A/M L N/A      | Y        |         |         |             |             |
| B    | Lattice          |      | A/M L N/A      | Y        |         |         |             |             |
| B    |                  |      | L N/A          | Y        |         |         |             |             |
| B    | Elec Conduit     |      | L N/A          | Y        |         |         |             |             |
| B    | Oil Fill Pipe    |      | L N/A          | Y        |         |         |             |             |
| B    | Overhang Trim    |      | A/M L N/A      | Y        |         |         |             |             |

Excluded Surfaces: Surfaces listed in this box can be made intact only by a licensed deleader

## Soil Test Results

(Must be less than 400 ppm for play area / 1200 ppm for bare soil)

| SIDE | LOCATION | MEASURE: LOOSE PAINT (MORE THAN 1440 SQ. IN.) | IC DATE | IC METH |
|------|----------|-----------------------------------------------|---------|---------|
| B    |          |                                               |         |         |
| B    |          |                                               |         |         |
| B    |          |                                               |         |         |
| B    |          |                                               |         |         |

| LOCATION  | AREA MEASUREMENT (Square Feet) | RESULT (PPM) | REMED DATE | REMED METH |
|-----------|--------------------------------|--------------|------------|------------|
| Play Area |                                |              |            |            |
| Bare Soil |                                |              |            |            |
| Comments: |                                |              |            |            |



Page 24 of 25

Date \_\_\_\_\_

Date \_\_\_\_\_

City: Vineyard Haven, MA 02568

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| C    | Window Sill          | /    | A/M L N/A         | Y           |            |            |                |                |
|      | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
|      | Window Sash          |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Cellar Win Sill      | /    | A/M L N/A         | Y           |            |            |                |                |
|      | Cell Win Sash        |      | A/M L N/A         | Y           |            |            |                |                |
|      | Cell Win Frame       |      | A/M L N/A         | Y           |            |            |                |                |
|      | Screen Frame         |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Cellar Win Sill      | /    | A/M L N/A         | Y           |            |            |                |                |
|      | Cell Win Sash        |      | A/M L N/A         | Y           |            |            |                |                |
|      | Cell Win Frame       |      | A/M L N/A         | Y           |            |            |                |                |
|      | Screen Frame         |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Cellar Win Sill      | /    | A/M L N/A         | Y           |            |            |                |                |
|      | Cell Win Sash        |      | A/M L N/A         | Y           |            |            |                |                |
|      | Cell Win Frame       |      | A/M L N/A         | Y           |            |            |                |                |
|      | Screen Frame         |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Cellar Win Sill      | /    | A/M L N/A         | Y           |            |            |                |                |
|      | Cell Win Sash        |      | A/M L N/A         | Y           |            |            |                |                |
|      | Cell Win Frame       |      | A/M L N/A         | Y           |            |            |                |                |
|      | Screen Frame         |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Cellar Win Sill      | /    | A/M L N/A         | Y           |            |            |                |                |
|      | Cell Win Sash        |      | A/M L N/A         | Y           |            |            |                |                |
|      | Cell Win Frame       |      | A/M L N/A         | Y           |            |            |                |                |
|      | Screen Frame         |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Foundation           | /    | L N/A             | Y           |            |            |                |                |
|      | Bulkhead             |      | A/M L N/A         | Y           |            |            |                |                |
|      | Fences               |      | A/M L N/A         | Y           |            |            |                |                |
|      | Shutters             |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Newel post           | /    | A/M L N/A         | Y           |            |            |                |                |
|      | Railing Cap          |      | A/M L N/A         | Y           |            |            |                |                |
|      | Handrail             |      | A/M L N/A         | Y           |            |            |                |                |
|      | Balusters            |      | A/M L N/A         | Y           |            |            |                |                |
|      | Lower Rail           |      | A/M L N/A         | Y           |            |            |                |                |
|      | Treads               |      | A/M L N/A         | Y           |            |            |                |                |
|      | Risers               |      | A/M L N/A         | Y           |            |            |                |                |
|      | Stringer             |      | A/M L N/A         | Y           |            |            |                |                |
|      | Lattice              |      | A/M L N/A         | Y           |            |            |                |                |
|      |                      |      | L N/A             | Y           |            |            |                |                |
| C    | Elec Conduit         | /    | L N/A             | Y           |            |            |                |                |
|      | Oil Fill Pipe        |      | L N/A             | Y           |            |            |                |                |
|      | Overhang Trim        |      | A/M L N/A         | Y           |            |            |                |                |

**Excluded Surfaces:** Surfaces listed in this box can be made intact only by a licensed dealer

(Must be less than 400 ppm for play area / 1200 ppm for bare soil)

| LOCATION  | AREA MEASUREMENT<br>( Square Feet ) | RESULT<br>(PPM) | REMED<br>DATE | REMED<br>METH. |
|-----------|-------------------------------------|-----------------|---------------|----------------|
| Play Area |                                     |                 |               |                |
| Bare Soil |                                     |                 |               |                |
| Comments: |                                     |                 |               |                |

(b) (6)

09-20-2012

Page 25 of 25

Inspector (print) \_\_\_\_\_ Lic # \_\_\_\_\_ Signature \_\_\_\_\_

Date

(b) (6)

Risk Assessor (print) \_\_\_\_\_ Lic # \_\_\_\_\_ Signature \_\_\_\_\_

Date

Address of Property: 917 Main St.

Apt #: AAAAAA

City: Vineyard Haven, MA 02568

## EXTERIOR D Side

| SIDE | LOCATION/<br>SURFACE | LEAD  | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|-------|-------------------|-------------|------------|------------|----------------|----------------|
| D    | Siding               | Q-4-L | L N/A             | Y           |            |            |                |                |
|      | Corner Boards        | Q-1-b | L N/A             | Y           |            |            |                |                |
|      | Lower Trim           | Q-1-a | L N/A             | Y           |            |            |                |                |
|      | Upper Trim           | A-1-a | L N/A             | Y           |            |            |                |                |
|      | Win Above 5'         | A-1-a | L N/A             | Y           |            |            |                |                |
|      | Porch Above 5'       |       | L N/A             | Y           |            |            |                |                |
| D    | Storm Door           |       | A/M L N/A         | Y           |            |            |                |                |
|      | Door                 |       | A/M L N/A         | Y           |            |            |                |                |
|      | Door Casing          |       | A/M L N/A         | Y           |            |            |                |                |
|      | Door Jamb            |       | A/M L N/A         | Y           |            |            |                |                |
|      | Threshold            |       | A/M L N/A         | Y           |            |            |                |                |
|      | Kickplate            |       | A/M L N/A         | Y           |            |            |                |                |
| D    | Storm Door           |       | A/M L N/A         | Y           |            |            |                |                |
|      | Door                 |       | A/M L N/A         | Y           |            |            |                |                |
|      | Door Casing          |       | A/M L N/A         | Y           |            |            |                |                |
|      | Door Jamb            |       | A/M L N/A         | Y           |            |            |                |                |
|      | Threshold            |       | A/M L N/A         | Y           |            |            |                |                |
|      | Kickplate            |       | A/M L N/A         | Y           |            |            |                |                |
| D    | Door                 |       | A/M L N/A         | Y           |            |            |                |                |
|      | Door Casing          |       | A/M L N/A         | Y           |            |            |                |                |
|      | Door Jamb            |       | A/M L N/A         | Y           |            |            |                |                |
|      | Threshold            |       | A/M L N/A         | Y           |            |            |                |                |
|      |                      |       | A/M L N/A         | Y           |            |            |                |                |
|      |                      |       | A/M L N/A         | Y           |            |            |                |                |
| D    | Window Sill          |       | A/M L N/A         | Y           |            |            |                |                |
|      | Win Casing           |       | A/M L N/A         | Y           |            |            |                |                |
|      | Window Sash          |       | A/M L N/A         | Y           |            |            |                |                |
|      | Window Sill          |       | A/M L N/A         | Y           |            |            |                |                |
|      | Win Casing           |       | A/M L N/A         | Y           |            |            |                |                |
|      | Window Sash          |       | A/M L N/A         | Y           |            |            |                |                |
| D    | Window Sill          |       | A/M L N/A         | Y           |            |            |                |                |
|      | Win Casing           |       | A/M L N/A         | Y           |            |            |                |                |
|      | Window Sash          |       | A/M L N/A         | Y           |            |            |                |                |
|      | Window Sill          |       | A/M L N/A         | Y           |            |            |                |                |
|      | Win Casing           |       | A/M L N/A         | Y           |            |            |                |                |
|      | Window Sash          |       | A/M L N/A         | Y           |            |            |                |                |
| D    | Lamp Post            |       | L N/A             | Y           |            |            |                |                |
|      |                      |       |                   |             |            |            |                |                |
|      |                      |       |                   |             |            |            |                |                |
|      |                      |       |                   |             |            |            |                |                |
|      |                      |       |                   |             |            |            |                |                |
|      |                      |       |                   |             |            |            |                |                |

COMMENTS / STRUCTURAL DEFECTS:

Excluded Surfaces: Surfaces listed in this box can be made intact only by a licensed deleader

| SIDE | LOCATION | MEASURED LOOSE PAINT<br>(MORE THAN 1440 SQ. IN.) | IC<br>DATE | IC<br>METH |
|------|----------|--------------------------------------------------|------------|------------|
| D    |          |                                                  |            |            |
| D    |          |                                                  |            |            |
| D    |          |                                                  |            |            |
| D    |          |                                                  |            |            |

## Soil Test Results

(Must be less than 400 ppm for play area / 1200 ppm for bare soil.)

| LOCATION  | AREA MEASUREMENT<br>(Square Feet) | RESULT<br>(PPM) | REMED<br>DATE | REMED<br>METH |
|-----------|-----------------------------------|-----------------|---------------|---------------|
| Play Area |                                   |                 |               |               |
| Bare Soil |                                   |                 |               |               |
| Comments: |                                   |                 |               |               |

**Attachment B**

Lead Inspection Report/Field Notes  
920 East Main Street



September 23, 2012

US Coast Guard Air Station Cape Cod  
Martha's Vineyard Housing  
West Chop #1 & #2  
(917 & 920 Main Street)  
Vineyard Haven, MA 02568

#### XRF Lead Paint Narrative

This report presents the results of testing for the presence of lead by X-Ray Fluorescence (XRF) analysis on interior and exterior painted surfaces at the above-referenced location. The lead testing was performed on September 20, 2012, by (b) (6) Commonwealth of Massachusetts Licensed Lead Inspector (License No. (b) (6), (b) (6) trained in the proper use and interpretation of results of the XRF Spectrum Analyzer.

The XRF testing was performed to evaluate the lead content on painted surfaces for interior and exterior surfaces in housing, and determine the presence of lead hazards as defined by the Massachusetts Lead Law (105 CMR 460.000 – Lead Poisoning Prevention and Control). Surfaces tested included: walls, ceilings, floors, shelving, closet features, window systems, door systems, exterior siding, exterior trim, porch trim and features, garage exterior components, and any other component with a surface coating that was visible and reachable during the inspection.

Lead paint content of components was not consistent or representative from one area to another; this is likely due to previous work that has been performed to the property from over the years of maintenance and updates. The following building components were commonly found to contain dangerous levels of lead (see individual reports for exact results):

- Plaster walls and ceilings
- Baseboards
- Doors, door casings, and door jambs
- Window sills, casings, interior stop edges, aprons, exterior sills, blind stops, and exterior casings.
- Stair risers, treads, stringers, floor edges, and floor casings
- Shelves and shelf supports
- Garage exterior components

Less commonly found to contain lead, but still having at least some locations which are considered to have dangerous amounts of lead are:

- Door thresholds and kickplates
- Exterior Cornerboards
- Porch columns

In addition to these components containing dangerous levels of lead, many of these components present one or more lead hazards as defined by 105 CMR 460.000. These

hazards are either: Accessible/mouthable surfaces, moveable/impact surfaces, and/or loose/chipping/peeling/deteriorated paint.

Anyone who performs work to correct lead hazards must be authorized and licensed according to 105 CMR 460.00 – Lead Poisoning Prevention and Control and 454 CMR 22.00 – Deleading and Lead Safe Renovation Regulations.

Additionally, the employer of workers who disturb or remove lead paint must comply with OSHA Standard 29 CFR 1926.62 - Lead. This applies to all construction work, alteration, or repair, including painting, where an employee may be occupationally exposed to lead.

### **Limitations**

Lead testing was limited to accessible interior and exterior painted surfaces located at 917 & 920 Main Street, Vineyard Haven, Massachusetts. Additional lead-containing building substrates and components may be present in inaccessible building areas or areas not tested.

Sincerely,

(b) (6)

Master Lead Inspector/Risk Assessor  
MA Lic # (b) (6)

**Positive Lead Paint Results by XRF**  
**US Coast Guard Air Base Cape Cod**  
**Martha's Vineyard Housing**  
**920 Main St.**  
**Vineyard Haven, Massachusetts**  
**September 20, 2012**

| Location/Component      | Substrate | Results (mg/cm <sup>2</sup> ) |
|-------------------------|-----------|-------------------------------|
| <b>Room # 1</b>         |           |                               |
| Baseboards              | Wood      | 9.8                           |
| C Door Casing           | Wood      | 1.5                           |
| C Door Jamb             | Wood      | 4.1                           |
| D Door Casing           | Wood      | 1.4                           |
| A1 Window Apron         | Wood      | 2.1                           |
| A1 Window Stop Edges    | Wood      | 3.3                           |
| A1 Exterior Window Sill | Wood      | 1.1                           |
| A1 Blind Stop           | Wood      | 1.2                           |
| A2 Window Apron         | Wood      | 2.1                           |
| A2 Window Stop Edges    | Wood      | 3.3                           |
| A2 Exterior Window Sill | Wood      | 1.6                           |
| A2 Blind Stop           | Wood      | 1.8                           |
| B Window Stop Edges     | Wood      | 1.5                           |
| D Window Stop Edges     | Wood      | 3.2                           |
| <b>Room # 2</b>         |           |                               |
| Baseboards              | Wood      | 6.0                           |
| C1 Door Casing          | Wood      | 2.6                           |
| C2 Door                 | Wood      | 1.9                           |
| C2 Door Casing          | Wood      | 3.9                           |
| C2 Door Jamb            | Wood      | 4.4                           |
| D Window Stop Edges     | Wood      | 3.1                           |
| B1 Exterior Window Sill | Wood      | 1.1                           |
| B2 Window Sill          | Wood      | 1.2                           |
| C2 Closet Door          | Wood      | 1.5                           |
| C2 Closet Door Jamb     | Wood      | 4.4                           |
| C2 Closet Walls         | Plaster   | 15.1                          |
| C2 Closet Baseboard     | Wood      | 21.2                          |
| C2 Closet Shelf         | Wood      | 5.1                           |

- Dangerous level of lead by XRF is equal to or greater than 1.0 mg/cm<sup>2</sup>
- mg/cm<sup>2</sup> = milligrams of lead per square centimeter of sampled surface area.
- NA = not able to test, assume positive



**Positive Lead Paint Results by XRF**  
**US Coast Guard Air Base Cape Cod**  
**Martha's Vineyard Housing**  
**920 Main St.**  
**Vineyard Haven, Massachusetts**  
**September 20, 2012**

| Location/Component       | Substrate | Results (mg/cm <sup>2</sup> ) |
|--------------------------|-----------|-------------------------------|
| C2 Closet Ceiling        | Wood      | 4.3                           |
| <b>Room # 3</b>          |           |                               |
| Walls                    | Plaster   | 13.1                          |
| Ceiling                  | Plaster   | 11.1                          |
| Baseboards               | Wood      | 18.2                          |
| C1 Door Jamb             | Wood      | 1.5                           |
| C2 Door Casing           | Wood      | 1.5                           |
| A1 Window Sill           | Wood      | 2.6                           |
| A1 Window Apron          | Wood      | 2.4                           |
| A1 Window Casing         | Wood      | 2.4                           |
| A1 Window Stop Edges     | Wood      | 1.8                           |
| A1 Exterior Window Sill  | Wood      | 2.1                           |
| A1 Blind Stop            | Wood      | 7.5                           |
| A2 Window Sill           | Wood      | 2.6                           |
| A2 Window Apron          | Wood      | 2.4                           |
| A2 Window Casing         | Wood      | 2.4                           |
| A2 Window Stop Edges     | Wood      | 1.9                           |
| A2 Exterior Window Sill  | Wood      | 2.1                           |
| A2 Blind Stop            | Wood      | 7.5                           |
| C1 Closet Door Casing    | Wood      | 3.1                           |
| C1 Closet Walls          | Plaster   | 15.5                          |
| C1 Closet Baseboard      | Wood      | 16.8                          |
| C1 Closet Shelf Supports | Wood      | 2.6                           |
| C1 Closet Ceiling        | Plaster   | 11.4                          |
| C Shelf (in room)        | Wood      | 15.2                          |
| <b>Room # 4</b>          |           |                               |
| Walls                    | Plaster   | 10.4                          |
| Ceiling                  | Plaster   | 9.4                           |
| Baseboards               | Wood      | 17.2                          |

- Dangerous level of lead by XRF is equal to or greater than 1.0 mg/cm<sup>2</sup>
- mg/cm<sup>2</sup> = milligrams of lead per square centimeter of sampled surface area.
- NA = not able to test, assume positive

**Positive Lead Paint Results by XRF**  
**US Coast Guard Air Base Cape Cod**  
**Martha's Vineyard Housing**  
**920 Main St.**  
**Vineyard Haven, Massachusetts**  
**September 20, 2012**

| Location/Component         | Substrate | Results (mg/cm <sup>2</sup> ) |
|----------------------------|-----------|-------------------------------|
| A Door Casing              | Wood      | 4.2                           |
| A Door Jamb                | Wood      | 1.6                           |
| D Door Casing              | Wood      | 4.2                           |
| D Door Jamb                | Wood      | 1.9                           |
| B Window Sill              | Wood      | 2.4                           |
| B Window Casing            | Wood      | 2.5                           |
| B Window Stop Edges        | Wood      | 3.0                           |
| B Exterior Window Sill     | Wood      | 1.1                           |
| B Blind Stop               | Wood      | 1.6                           |
| A Closet Door Jamb         | Wood      | 3.2                           |
| A Closet Walls             | Plaster   | 8.0                           |
| A Closet Baseboard         | Wood      | 19.3                          |
| A Closet Shelf Supports    | Wood      | 8.0                           |
| A Shelves (in room)        | Wood      | 11.8                          |
| A Shelf Supports (in room) | Wood      | 10.0                          |
| <b>Room # 5</b>            |           |                               |
| Walls                      | Plaster   | 8.7                           |
| Ceiling                    | Plaster   | 6.9                           |
| Baseboards                 | Wood      | 13.7                          |
| C2 Door                    | Wood      | 1.9                           |
| C2 Door Casing             | Wood      | 2.2                           |
| C2 Door Jamb               | Wood      | 7.1                           |
| B Door Casing              | Wood      | 7.9                           |
| C2 Closet Door Jamb        | Wood      | 4.6                           |
| D Window Casing            | Wood      | 2.9                           |
| A Shelf (in room)          | Wood      | 8.3                           |
| A Shelf Support (in room)  | Wood      | 6.1                           |
| <b>Kitchen</b>             |           |                               |
| B1 Door Casing             | Wood      |                               |

- Dangerous level of lead by XRF is equal to or greater than 1.0 mg/cm<sup>2</sup>
- mg/cm<sup>2</sup> = milligrams of lead per square centimeter of sampled surface area.
- NA = not able to test, assume positive

**Positive Lead Paint Results by XRF**  
**US Coast Guard Air Base Cape Cod**  
**Martha's Vineyard Housing**  
**920 Main St.**  
**Vineyard Haven, Massachusetts**  
**September 20, 2012**

| Location/Component       | Substrate | Results (mg/cm <sup>2</sup> ) |
|--------------------------|-----------|-------------------------------|
| A2 Door Jamb             | Wood      | 1.2                           |
| C Door Jamb              | Wood      | 1.3                           |
| B Exterior Window Sill   | Wood      | 1.5                           |
| B Blind Stop             | Wood      | 2.6                           |
| C Exterior Window Sill   | Wood      | 1.6                           |
| C Blind Stop             | Wood      | 2.9                           |
| A2 Closet Door Casing    | Wood      | 4.4                           |
| A2 Closet Door Jamb      | Wood      | 1.2                           |
| A2 Closet Walls          | Plaster   | 19.6                          |
| A2 Closet Baseboard      | Wood      | 15.5                          |
| A2 Closet Shelves        | Wood      | 1.3                           |
| A2 Closet Shelf Supports | Wood      | 20.8                          |
| A2 Closet Ceiling        | Plaster   | 11.3                          |
| A2 Closet Pipes          | Metal     | 1.4                           |
| <b>Bathroom # 1</b>      |           |                               |
| Baseboards               | Wood      | 18.8                          |
| A Door Jamb              | Wood      | 1.7                           |
| C Window Casing          | Wood      | 1.6                           |
| C Window Stop Edges      | Wood      | 2.0                           |
| <b>Bathroom # 2</b>      |           |                               |
| Baseboards               | Wood      | 8.4                           |
| A Door Casing            | Wood      | 5.1                           |
| C Window Sill            | Wood      | 2.9                           |
| C Window Stop Edges      | Wood      | 3.0                           |
| C Window Exterior Sill   | Wood      | 2.1                           |
| D Shelves                | Wood      | 3.7                           |
| D Shelf Supports         | Wood      | 6.2                           |
| <b>Hallway # 1</b>       |           |                               |
| Baseboards               | Wood      | 28.3                          |

- Dangerous level of lead by XRF is equal to or greater than 1.0 mg/cm<sup>2</sup>
- mg/cm<sup>2</sup> = milligrams of lead per square centimeter of sampled surface area.
- NA = not able to test, assume positive



**Positive Lead Paint Results by XRF**  
**US Coast Guard Air Base Cape Cod**  
**Martha's Vineyard Housing**  
**920 Main St.**  
**Vineyard Haven, Massachusetts**  
**September 20, 2012**

| Location/Component       | Substrate | Results (mg/cm <sup>2</sup> ) |
|--------------------------|-----------|-------------------------------|
| A Door Casing            | Wood      | 1.7                           |
| B Door Jamb              | Wood      | 1.2                           |
| <b>Hallway # 2</b>       |           |                               |
| Walls                    | Plaster   | 17.2                          |
| Baseboards               | Wood      | 13.1                          |
| A1 Door Casing           | Wood      | 3.7                           |
| A1 Door Jamb             | Wood      | 2.2                           |
| A2 Door Casing           | Wood      | 3.7                           |
| B Door                   | Wood      | 1.6                           |
| B Door Casing            | Wood      | 1.0                           |
| B Door Jamb              | Wood      | 1.7                           |
| B Closet Door            | Wood      | 2.4                           |
| B Closet Door Jamb       | Wood      | 1.8                           |
| B Closet Walls           | Plaster   | 11.9                          |
| B Closet Baseboard       | Wood      | 13.0                          |
| B Closet Shelf Supports  | Wood      | 3.9                           |
| B Closet Ceiling         | Wood      | 1.8                           |
| A2 Closet Door Casing    | Wood      | 3.5                           |
| A2 Closet Walls          | Plaster   | 19.6                          |
| A2 Closet Baseboard      | Wood      | 12.1                          |
| A2 Closet Shelf Supports | Wood      | 14.9                          |
| A2 Closet Ceiling        | Plaster   | 10.1                          |
| <b>Hallway # 3</b>       |           |                               |
| Walls                    | Plaster   | 15.6                          |
| Baseboards               | Wood      | 13.6                          |
| B Door Casing            | Wood      | 4.2                           |
| D Door Jamb              | Wood      | 3.4                           |
| D Door Casing            | Wood      | 3.6                           |
| A Header                 | Wood      | 9.4                           |

- Dangerous level of lead by XRF is equal to or greater than 1.0 mg/cm<sup>2</sup>
- mg/cm<sup>2</sup> = milligrams of lead per square centimeter of sampled surface area.
- NA = not able to test, assume positive

**Positive Lead Paint Results by XRF**  
**US Coast Guard Air Base Cape Cod**  
**Martha's Vineyard Housing**  
**920 Main St.**  
**Vineyard Haven, Massachusetts**  
**September 20, 2012**

| Location/Component                                | Substrate | Results (mg/cm <sup>2</sup> ) |
|---------------------------------------------------|-----------|-------------------------------|
| <b>Staircase 1<sup>st</sup> to 2<sup>nd</sup></b> |           |                               |
| Walls                                             | Plaster   | 17.2                          |
| Radiator                                          | Metal     | 2.2                           |
| Baseboards                                        | Wood      | 13.1                          |
| A Door Casing                                     | Wood      | 2.1                           |
| A Door Jamb                                       | Wood      | 1.1                           |
| B Door Casing                                     | Wood      | 3.2                           |
| B Door Jamb                                       | Wood      | 1.7                           |
| D Door Casing                                     | Wood      | 2.3                           |
| D Door Jamb                                       | Wood      | 1.3                           |
| A Window Sill                                     | Wood      | 4.7                           |
| A Window Casing                                   | Wood      | 7.1                           |
| A Window Stop Edges                               | Wood      | 4.2                           |
| A Exterior Window Sill                            | Wood      | 1.8                           |
| A Blind Stop                                      | Wood      | 1.6                           |
| Stair Risers                                      | Wood      | 3.4                           |
| Stair Stringer                                    | Wood      | 4.6                           |
| Floor Edge                                        | Wood      | 1.8                           |
| Floor Casing                                      | Wood      | 11.2                          |
| A Window Above 5'                                 | Wood      | 13.8                          |
| <b>Staircase 1<sup>st</sup> to Basement</b>       |           |                               |
| Lower Walls                                       | Wood      | 8.2                           |
| B Door Casing                                     | Wood      | 4.2                           |
| B Door Jamb                                       | Wood      | 4.5                           |
| Columns                                           | Wood      | 10.9                          |
| Stair Treads                                      | Wood      | 4.4                           |
| Stair Risers                                      | Wood      | 20.0                          |
| Stair Stringer                                    | Wood      | 7.6                           |
| Floor Edge                                        | Wood      | 21.1                          |

- Dangerous level of lead by XRF is equal to or greater than 1.0 mg/cm<sup>2</sup>
- mg/cm<sup>2</sup> = milligrams of lead per square centimeter of sampled surface area.
- NA = not able to test, assume positive

**Positive Lead Paint Results by XRF**  
**US Coast Guard Air Base Cape Cod**  
**Martha's Vineyard Housing**  
**920 Main St.**  
**Vineyard Haven, Massachusetts**  
**September 20, 2012**

| Location/Component                | Substrate | Results (mg/cm <sup>2</sup> ) |
|-----------------------------------|-----------|-------------------------------|
| Floor Casing                      | Wood      | 21.1                          |
| <b>Basement Area</b>              |           |                               |
| Walls                             | Wood      | 3.6                           |
| D2 Door (Interior Side)           | Wood      | 1.9                           |
| D2 Door Casing (Interior Side)    | Wood      | 10.1                          |
| D2 Door (Exterior Side)           | Wood      | 1.9                           |
| D2 Door (Exterior Side)           | Wood      | 10.1                          |
| D Bulkhead Stair Treads           | Wood      | 2.4                           |
| D Bulkhead Stair Risers           | Wood      | 1.4                           |
| D Bulkhead Stair Stringer         | Wood      | 1.4                           |
| D2 Closet Walls                   | Wood      | 3.6                           |
| <b>Laundry Room</b>               |           |                               |
| C Window Sill                     | Wood      | 1.2                           |
| C Window Apron                    | Wood      | 1.2                           |
| C Window Stop Edges               | Wood      | 6.1                           |
| <b>Front Porch (A-Side Porch)</b> |           |                               |
| Upper Trim                        | Wood      | NA                            |
| Ceiling                           | Wood      | NA                            |
| Joists                            | Wood      | NA                            |
| A Door Threshold                  | Wood      | 1.8                           |
| <b>Rear Porch (C-Side Porch)</b>  |           |                               |
| Upper Trim                        | Wood      | NA                            |
| Ceiling                           | Wood      | NA                            |
| Joists                            | Wood      | NA                            |
| B Door                            | Wood      | 2.1                           |
| B Door Casing                     | Wood      | 8.6                           |
| B Door Threshold                  | Wood      | 1.4                           |
| B Door Kickplate                  | Wood      | 31.2                          |
| C Exterior Window Sill            | Wood      | 1.6                           |

- Dangerous level of lead by XRF is equal to or greater than 1.0 mg/cm<sup>2</sup>
- mg/cm<sup>2</sup> = milligrams of lead per square centimeter of sampled surface area.
- NA = not able to test, assume positive



**Positive Lead Paint Results by XRF**  
**US Coast Guard Air Base Cape Cod**  
**Martha's Vineyard Housing**  
**920 Main St.**  
**Vineyard Haven, Massachusetts**  
**September 20, 2012**

| Location/Component            | Substrate | Results (mg/cm <sup>2</sup> ) |
|-------------------------------|-----------|-------------------------------|
| C Exterior Window Casing      | Wood      | 1.4                           |
| Support Columns               | Wood      | 4.8                           |
| <b>Exterior A-Side</b>        |           |                               |
| Corner Boards                 | Wood      | 1.6                           |
| Upper Trim                    | Wood      | NA                            |
| Windows Above 5'              | Wood      | NA                            |
| A Exterior Window Sill (x2)   | Wood      | 1.7                           |
| A Exterior Window Casing (x2) | Wood      | 1.2                           |
| <b>Exterior B-Side</b>        |           |                               |
| Corner Boards                 | Wood      | 1.2                           |
| Upper Trim                    | Wood      | NA                            |
| Windows Above 5'              | Wood      | NA                            |
| B Exterior Window Casing (x1) | Wood      | 1.7                           |
| <b>Exterior C-Side</b>        |           |                               |
| Upper Trim                    | Wood      | NA                            |
| Windows Above 5'              | Wood      | NA                            |
| C Door                        | Wood      | 3.2                           |
| C Door Jamb                   | Wood      | NA                            |
| <b>Exterior D-Side</b>        |           |                               |
| Upper Trim                    | Wood      | NA                            |
| Windows Above 5'              | Wood      | NA                            |
| <b>Garage Exterior</b>        |           |                               |
| B Siding                      | Wood      | 2.1                           |
| C Siding                      | Wood      | 2.1                           |
| D Siding                      | Wood      | 5.1                           |
| A Upper Trim                  | Wood      | NA                            |
| B Upper Trim                  | Wood      | NA                            |
| C Upper Trim                  | Wood      | NA                            |
| D Upper Trim                  | Wood      | NA                            |

- Dangerous level of lead by XRF is equal to or greater than 1.0 mg/cm<sup>2</sup>
- mg/cm<sup>2</sup> = milligrams of lead per square centimeter of sampled surface area.
- NA = not able to test, assume positive

**Positive Lead Paint Results by XRF  
US Coast Guard Air Base Cape Cod  
Martha's Vineyard Housing  
920 Main St.  
Vineyard Haven, Massachusetts  
September 20, 2012**

| <b>Location/Component</b> | <b>Substrate</b> | <b>Results (mg/cm<sup>2</sup>)</b> |
|---------------------------|------------------|------------------------------------|
| B Foundation              | Brick            | 2.1                                |
| C Foundation              | Brick            | 1.8                                |
| D Foundation              | Brick            | 3.2                                |
| A Door Jamb               | Wood             | 1.2                                |

- Dangerous level of lead by XRF is equal to or greater than 1.0 mg/cm<sup>2</sup>
- mg/cm<sup>2</sup> = milligrams of lead per square centimeter of sampled surface area.
- NA = not able to test, assume positive

# Lead Inspection / Risk Assessment Report

Page 1 of 27

## MEL BLACKMAN

### MASTER LEAD INSPECTOR

P.O. BOX 358 - STONEHAM, MA. 02180  
PHONE / FAX 781- 665 - 3806

|                               |                            |                          |                      |
|-------------------------------|----------------------------|--------------------------|----------------------|
| St.#<br><b>920</b>            | Street Name<br><b>MAIN</b> | Street Type<br><b>ST</b> | Unit<br><b>-----</b> |
| City<br><b>VINEYARD HAVEN</b> |                            | Zip Code<br><b>02568</b> |                      |

Owner Name: **U.S. Government**

Owner Address: **917 Main St., Vineyard Haven, MA 02568**

Contact Information: Tel # \_\_\_\_\_

Email: \_\_\_\_\_

Client Name (if different from owner): **H&S Environmental Inc. (508-366-7442)**

Client Address: **160 E. Main St., Westborough, MA 01581**

Number of Rooms in Unit 9

Property Type:

Single Family ☒

Multi Family ☐ # Units \_\_\_\_\_

Condominium ☐ # Units \_\_\_\_\_

Day Care ☐ Other: \_\_\_\_\_

| Key: | Lead Column              | Key:  | Delayed IC Method Column |
|------|--------------------------|-------|--------------------------|
| COV  | Covered                  | CAP   | Capped                   |
| VB   | Vinyl Baseboard          | COV   | Covered                  |
| MET  | Metal                    | ENC   | Encapsulated             |
| VR   | Vinyl Rep. Window        | MI    | Made Intact              |
| MR   | Metal Rep. Window        | PRE   | Prepared for Enc         |
| NA   | Not Accessible           | VR/MR | Vinyl/Metal Rep Window   |
| NC   | No Coating               | SFR   | Storm Frame Removed      |
| Tie  | Tile (testing suggested) |       | Component Does not Exist |
| DC   | Dropped Ceiling          |       |                          |

Laundry in Basement? Yes or No ☒  
Finished Space in Basement? Yes or No ☒

Testing Method Used:  
Na<sub>2</sub>S Exp. Date \_\_\_\_\_  
X-Ray Fluorescence  
Model **XLp303A** Serial # **24687**




Comments / Notes

**BASEMENT INCLUDED AT OWNER'S REQUEST.**

Floor# 1 (this is the level within building of unit being inspected)

Floor# 2

Property Diagram/ Unit Labels

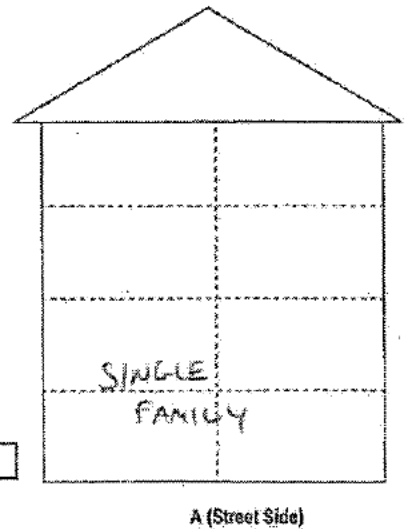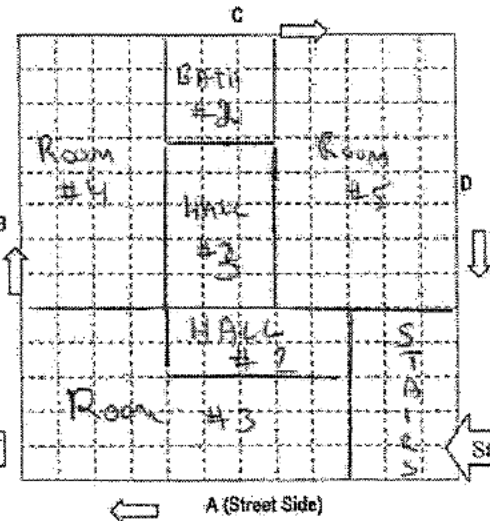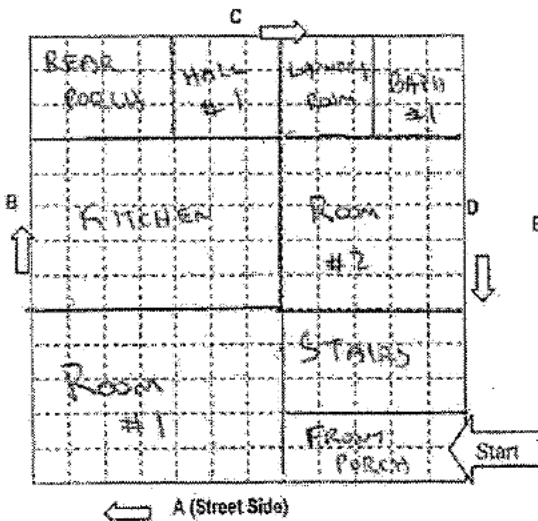

Pb (lead) equal to or greater than 1.0 mg/cm<sup>2</sup> with x-ray fluorescence or positive with Na<sub>2</sub>S is Dangerous.

XRF Calibration Recorded in Log Book  
Address verified through USPS  
Research on Lead-Related History for Address  
[www.state.ma.us/dph/clhpp](http://www.state.ma.us/dph/clhpp) or 800-532-9571



✓ -Check off when complete  
✓ -Check off when complete  
✓ -Check off when complete

(b) (6)

Inspector Name **(b) (6)**

Lic # **(b) (6)**

Signature **(b) (6)**

Date **09-20-2012**



ADDRESS: 920 Main St.

Apte \_\_\_\_\_ City Vineyard Haven, MA 02568

Page 2 of 27

### INSPECTION HISTORY

|               |                                                                     |
|---------------|---------------------------------------------------------------------|
| Determination | <input type="checkbox"/> Y<br><input checked="" type="checkbox"/> N |
| Lead Hazards? |                                                                     |

|                                  |                                                                     |
|----------------------------------|---------------------------------------------------------------------|
| Comprehensive Initial Inspection | <input checked="" type="checkbox"/> Y<br><input type="checkbox"/> N |
| 092012                           |                                                                     |
| Lead Hazards?                    |                                                                     |

|                             |                                                                     |
|-----------------------------|---------------------------------------------------------------------|
| Comp Initial w/Partial PCAD | <input type="checkbox"/> Y<br><input checked="" type="checkbox"/> N |
| Lead Hazards?               |                                                                     |

|                                         |                                                                     |
|-----------------------------------------|---------------------------------------------------------------------|
| Addendum (add-on to Initial Inspection) | <input type="checkbox"/> Y<br><input checked="" type="checkbox"/> N |
| Lead Hazards?                           |                                                                     |

|                                    |                                                                     |
|------------------------------------|---------------------------------------------------------------------|
| Addendum as Full Insp. (Last Docs) | <input type="checkbox"/> Y<br><input checked="" type="checkbox"/> N |
| Lead Hazards?                      |                                                                     |

|                                   |  |
|-----------------------------------|--|
| Walk Through for E&C Consultation |  |
|-----------------------------------|--|

### REINSPECTION HISTORY

|                                      |                                                                     |
|--------------------------------------|---------------------------------------------------------------------|
| Visual Portion of Reoc. Reinspection | <input type="checkbox"/> P<br><input checked="" type="checkbox"/> F |
|--------------------------------------|---------------------------------------------------------------------|

|                                      |                                                                     |
|--------------------------------------|---------------------------------------------------------------------|
| Visual Portion of Reoc. Reinspection | <input type="checkbox"/> P<br><input checked="" type="checkbox"/> F |
|--------------------------------------|---------------------------------------------------------------------|

|                                   |                                                                     |
|-----------------------------------|---------------------------------------------------------------------|
| Dust Taken for Reoc. Reinspection | <input type="checkbox"/> P<br><input checked="" type="checkbox"/> F |
|-----------------------------------|---------------------------------------------------------------------|

|                                   |                                                                     |
|-----------------------------------|---------------------------------------------------------------------|
| Dust Taken for Reoc. Reinspection | <input type="checkbox"/> P<br><input checked="" type="checkbox"/> F |
|-----------------------------------|---------------------------------------------------------------------|

|                                      |                                                                     |
|--------------------------------------|---------------------------------------------------------------------|
| Visual Portion of Final Reinspection | <input type="checkbox"/> P<br><input checked="" type="checkbox"/> F |
|--------------------------------------|---------------------------------------------------------------------|

|                                      |                                                                     |
|--------------------------------------|---------------------------------------------------------------------|
| Visual Portion of Final Reinspection | <input type="checkbox"/> P<br><input checked="" type="checkbox"/> F |
|--------------------------------------|---------------------------------------------------------------------|

|                                         |                                                                     |
|-----------------------------------------|---------------------------------------------------------------------|
| Dust Taken for Final Reinsp. (No Reoc.) | <input type="checkbox"/> P<br><input checked="" type="checkbox"/> F |
|-----------------------------------------|---------------------------------------------------------------------|

|                                         |                                                                     |
|-----------------------------------------|---------------------------------------------------------------------|
| Dust Taken for Final Reinsp. (No Reoc.) | <input type="checkbox"/> P<br><input checked="" type="checkbox"/> F |
|-----------------------------------------|---------------------------------------------------------------------|

### INTERIM CONTROL

|                    |                                                                     |
|--------------------|---------------------------------------------------------------------|
| Risk Assessment    | <input type="checkbox"/> Y<br><input checked="" type="checkbox"/> N |
| Urgent Pb Hazards? |                                                                     |

|                                |                                                                     |
|--------------------------------|---------------------------------------------------------------------|
| Dust Taken for Risk Assessment | <input type="checkbox"/> P<br><input checked="" type="checkbox"/> F |
|--------------------------------|---------------------------------------------------------------------|

|                                                    |                                                                     |
|----------------------------------------------------|---------------------------------------------------------------------|
| Visual Portion of Reinspection for Interim Control | <input type="checkbox"/> P<br><input checked="" type="checkbox"/> F |
|----------------------------------------------------|---------------------------------------------------------------------|

|                                        |                                                                     |
|----------------------------------------|---------------------------------------------------------------------|
| Dust Taken for Risk Assessment Reinsp. | <input type="checkbox"/> P<br><input checked="" type="checkbox"/> F |
|----------------------------------------|---------------------------------------------------------------------|

|                                                    |                                                                     |
|----------------------------------------------------|---------------------------------------------------------------------|
| Visual Portion of Reinspection for Interim Control | <input type="checkbox"/> P<br><input checked="" type="checkbox"/> F |
|----------------------------------------------------|---------------------------------------------------------------------|

|                                        |                                                                     |
|----------------------------------------|---------------------------------------------------------------------|
| Dust Taken for Risk Assessment Reinsp. | <input type="checkbox"/> P<br><input checked="" type="checkbox"/> F |
|----------------------------------------|---------------------------------------------------------------------|

|                                 |                                                                     |
|---------------------------------|---------------------------------------------------------------------|
| Risk Assessment Recertification | <input type="checkbox"/> Y<br><input checked="" type="checkbox"/> N |
| Urgent Pb Hazards?              |                                                                     |

|                                     |                                                                     |
|-------------------------------------|---------------------------------------------------------------------|
| Dust Taken for R.A. Recertification | <input type="checkbox"/> P<br><input checked="" type="checkbox"/> F |
|-------------------------------------|---------------------------------------------------------------------|

### POST COMPLIANCE ASSESSMENT DETERMINATIONS

|               |                                                                     |
|---------------|---------------------------------------------------------------------|
| PCAD          | <input type="checkbox"/> Y<br><input checked="" type="checkbox"/> N |
| Lead Hazards? |                                                                     |

|                               |                                                                     |
|-------------------------------|---------------------------------------------------------------------|
| Full Inspection Achieves PCAD | <input type="checkbox"/> Y<br><input checked="" type="checkbox"/> N |
| Lead Hazards?                 |                                                                     |

|                                     |                                                                     |
|-------------------------------------|---------------------------------------------------------------------|
| Visual Portion of PCAD Reinspection | <input type="checkbox"/> P<br><input checked="" type="checkbox"/> F |
|-------------------------------------|---------------------------------------------------------------------|

|                                  |                                                                     |
|----------------------------------|---------------------------------------------------------------------|
| Dust Taken for PCAD Reinspection | <input type="checkbox"/> P<br><input checked="" type="checkbox"/> F |
|----------------------------------|---------------------------------------------------------------------|

|                                  |                                                                     |
|----------------------------------|---------------------------------------------------------------------|
| Dust Taken for PCAD Reinspection | <input type="checkbox"/> P<br><input checked="" type="checkbox"/> F |
|----------------------------------|---------------------------------------------------------------------|

Inspector Name: \_\_\_\_\_ Lic# \_\_\_\_\_

Signature \_\_\_\_\_

Inspector Name: (b) (6) Lic# \_\_\_\_\_

Signature (b) (6)

Inspector Name: \_\_\_\_\_ Lic# \_\_\_\_\_

Signature \_\_\_\_\_

Inspector Name: \_\_\_\_\_ Lic# \_\_\_\_\_

Signature \_\_\_\_\_

Inspector Name: \_\_\_\_\_ Lic# \_\_\_\_\_

Signature \_\_\_\_\_

Inspector Name: \_\_\_\_\_ Lic# \_\_\_\_\_

Signature \_\_\_\_\_

Inspector Name: \_\_\_\_\_ Lic# \_\_\_\_\_

Signature \_\_\_\_\_

Inspector Name: \_\_\_\_\_ Lic# \_\_\_\_\_

Signature \_\_\_\_\_

Inspector Name: \_\_\_\_\_ Lic# \_\_\_\_\_

Signature \_\_\_\_\_

Inspector Name: \_\_\_\_\_ Lic# \_\_\_\_\_

Signature \_\_\_\_\_

Inspector Name: \_\_\_\_\_ Lic# \_\_\_\_\_

Signature \_\_\_\_\_

Inspector Name: \_\_\_\_\_ Lic# \_\_\_\_\_

Signature \_\_\_\_\_

Inspector Name: \_\_\_\_\_ Lic# \_\_\_\_\_

Signature \_\_\_\_\_

Inspector Name: \_\_\_\_\_ Lic# \_\_\_\_\_

Signature \_\_\_\_\_

R.A. Name: \_\_\_\_\_ Lic# \_\_\_\_\_

Signature \_\_\_\_\_

R.A. Name: \_\_\_\_\_ Lic# \_\_\_\_\_

Signature \_\_\_\_\_

R.A. Name: \_\_\_\_\_ Lic# \_\_\_\_\_

Signature \_\_\_\_\_

R.A. Name: \_\_\_\_\_ Lic# \_\_\_\_\_

Signature \_\_\_\_\_

R.A. Name: \_\_\_\_\_ Lic# \_\_\_\_\_

Signature \_\_\_\_\_

R.A. Name: \_\_\_\_\_ Lic# \_\_\_\_\_

Signature \_\_\_\_\_

R.A. Name: \_\_\_\_\_ Lic# \_\_\_\_\_

Signature \_\_\_\_\_

R.A. Name: \_\_\_\_\_ Lic# \_\_\_\_\_

Signature \_\_\_\_\_

Inspector Name: \_\_\_\_\_ Lic# \_\_\_\_\_

Signature \_\_\_\_\_

Inspector Name: \_\_\_\_\_ Lic# \_\_\_\_\_

Signature \_\_\_\_\_

Inspector Name: \_\_\_\_\_ Lic# \_\_\_\_\_

Signature \_\_\_\_\_

Inspector Name: \_\_\_\_\_ Lic# \_\_\_\_\_

Signature \_\_\_\_\_

Inspector Name: \_\_\_\_\_ Lic# \_\_\_\_\_

Signature \_\_\_\_\_

Inspector Name: \_\_\_\_\_ Lic# \_\_\_\_\_

Signature \_\_\_\_\_

ADDRESS: 920 Main St.

Apt# \_\_\_\_\_ City Vineyard Haven, MA 02568

Page 3 of 27

### REOCCUPANCY CERTIFICATE HISTORY

|                                         |
|-----------------------------------------|
| Certificate of Reoccupancy              |
| Only after High/Mod Risk (# rooms rule) |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

|                                         |
|-----------------------------------------|
| Certificate of Reoccupancy              |
| Only after High/Mod Risk (# rooms rule) |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

|                                         |
|-----------------------------------------|
| Certificate of Reoccupancy              |
| Only after High/Mod Risk (# rooms rule) |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

### COMPLIANCE HISTORY

|                                   |
|-----------------------------------|
| Letter of Full Initial Compliance |
| No prior history/ No signs of UD  |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

|                                 |
|---------------------------------|
| Letter of Interim Control       |
| No prior Comp. Expires in 1 yr. |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

|                                             |
|---------------------------------------------|
| Renewal of Interim Control                  |
| Expires 1 yrs from original Interim Control |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

|                                           |
|-------------------------------------------|
| Letter of Full Decontamination Compliance |
| Dust wipes if No Repoc.                   |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

|                                      |
|--------------------------------------|
| Certificate of Maintained Compliance |
| No Work=No Dust Work=7 Dust          |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

|                                    |
|------------------------------------|
| Certificate of Restored Compliance |
| Dust wipes and auth. people        |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

### COMPLIANCE HISTORY (CONT.)

|                                      |
|--------------------------------------|
| Certificate of Maintained Compliance |
| No Work=No Dust Work=7 Dust          |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

|                                    |
|------------------------------------|
| Certificate of Restored Compliance |
| Dust wipes and auth. people        |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

|                                      |
|--------------------------------------|
| Certificate of Maintained Compliance |
| No Work=No Dust Work=7 Dust          |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

|                                    |
|------------------------------------|
| Certificate of Restored Compliance |
| Dust wipes and auth. people        |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

### OTHER HISTORY: WAIVERS/UD/EPA RRP

|                       |
|-----------------------|
| Approved CLPPP Waiver |
| Attach to Comp Docs   |

CLPPP Insp. Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

|                       |
|-----------------------|
| Approved CLPPP Waiver |
| Attach to Comp Docs   |

CLPPP Insp. Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

|                            |
|----------------------------|
| UD/DES Visual Reinspection |
| No LOC Issued              |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

|                            |
|----------------------------|
| UD/DES Visual Reinspection |
| No LOC Issued              |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

|                   |
|-------------------|
| UD/DES Dust Taken |
| No LOC Issued     |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

|                   |
|-------------------|
| UD/DES Dust Taken |
| No LOC Issued     |

Inspector Name: \_\_\_\_\_, Lic# \_\_\_\_\_

Signature \_\_\_\_\_

**EXPLANATION OF LEAD INSPECTION / RISK ASSESSMENT REPORT FORM COLUMNS**

This page provides general information needed to understand the lead inspection/risk assessment report. However, you should speak with the inspector/risk assessor before you start to do any work on your home.

|                              |                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                  |
|------------------------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| <b>SIDE</b>                  | Refers to A, B, C, or D side of the building or room. See the diagram on the cover sheet. The "A" side of the building or room is the side facing the street that gives the property its address (usually, it is the front of the building). Keeping your back to this street, from the "A" side move clockwise to the "B" side on your left, the "C" side opposite you, and the "D" side to the right. Numbering is from left to right.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                         |
| <b>LOCATION/<br/>SURFACE</b> | Refers to the building component(s) being tested. Some surfaces may be made up of more than one part. For example, "Baseboard" may refer to four separate pieces of wood (one on each wall), but is still considered one surface.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                |
| <b>LEAD</b>                  | <p>The actual lead result. Each surface tested must have a result recorded in the "Lead" column.</p> <ul style="list-style-type: none"> <li>A number shows that the surface was tested with an XRF analyzer. A number (or average number) equal to or greater than 1.0 mg/cm<sup>2</sup> is a dangerous level of lead.</li> <li>A "pos" or "neg" shows that the surface was tested with sodium sulfide. "Pos" means that there is a dangerous level of lead.</li> <li>"N/A" means that the inspector was not able to test the surface. Unless the owner can get a sample to test, the inspector must assume the surface contains lead and require it to be delead, if necessary.</li> <li>"MET" or "MR" means that a metal surface was not tested and only needs to be intact, even if it is a leaded surface. However, metal handrails, metal window sills, and metal railing caps, need to be delead if they test equal to or greater than 1.0 mg/cm<sup>2</sup>, or is marked "N/A."</li> <li>For key to abbreviations like "COV", "VB", "VR" or "MR", "NC", "Tile", "DC", see the cover page.</li> <li>When a component box is slashed and there are test results above and below the diagonal line, the result on the "bottom" represents results below 5 ft. and the "top" result indicates the test result above 5 ft.</li> </ul>                                                                                                                                                                                         |
| <b>TYPE OF<br/>HAZARD</b>    | <p>Not all lead paint must be delead. This column tells you IF and WHY a surface needs deleading. The deleading standards below may not apply for Interim Controls. Speak to your risk assessor for more information.</p> <ul style="list-style-type: none"> <li>"M/I" circled means that the surface is a moveable/impacted surface and must be delead in its entirety.</li> <li>"SF" circled indicates that there is a storm frame present which requires the blind stop and exterior sill be delead as interior moveable / impacted surfaces.</li> <li>"A/M" circled means that the surface is "accessible mouthable" and must be delead to a minimum of five feet high, four inches in from the edge or corner.</li> <li>"L" circled means that the surface is loose and must, at minimum, be made intact.</li> <li>If more than one choice is circled, the rules for deleading may change depending upon what method of deleading you choose. Speak to the inspector for more information.</li> <li>"N/A" means the inspector was unable to determine if the surface was a lead hazard. The person doing the deleading must check this surface and follow all the rules for deleading. Speak to the inspector for more information.</li> <li>If nothing is circled in the column, then it is likely the surface does not need deleading. Speak to the inspector for more information. Remember, this does not mean the entire surface is lead free, it just does not require deleading in its current condition.</li> </ul> |
| <b>URG HAZ?</b>              | This column is only completed during a risk assessment. A risk assessment is an evaluation of a home's suitability for Interim Control. <b>Only a licensed risk assessor can do a risk assessment, not all inspectors are risk assessors.</b> If "Y" is circled, then this surface is considered an "Urgent Lead Hazard" and some type of deleading work is required to qualify for Interim Control.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                             |
| <b>IC DATE</b>               | The date the licensed risk assessor determines the surface meets the standards for Interim Control.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                              |
| <b>IC METH</b>               | The deleading method or structural repair done to qualify the surface for Interim Control. Refer to the deleading codes key on the cover page.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                   |
| <b>DELEAD<br/>DATE</b>       | The date that the lead inspector reinspects the surface and finds that it has been successfully brought back into compliance.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                    |
| <b>DELEAD<br/>METH</b>       | The method used to bring a surface into full compliance. Refer to codes in the Key on the cover page of the PCAD                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                 |
| <b>EXCLUDED<br/>SURFACES</b> | The amount of loose paint on a surface as measured by the lead inspector. "N/A" means that the inspector was not able to measure the loose paint, but has determined it is more than the cut-off for moderate risk making intact.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                |



(b) (6)

09-20-2012

Page 5 of 27

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 920 Main St.

Apt #: 000000

City: Vineyard Haven, MA 02568

ROOM # 1 (PAGE 1 of 2)

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A B  | Up Walls             | 0.01 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Low Walls            | /    | A/M L N/A         | Y           |            |            |                |                |
| A B  | Baseboards           | 0.2  | A/M L N/A         | Y           |            |            |                |                |
| A B  | Chair Rail           | /    | A/M L N/A         | Y           |            |            |                |                |
| A B  | Radiator             | 0.28 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Floor                | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Ceiling              | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 | /    | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          | 1.5  | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            | 4.1  | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 | /    | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          | 1.4  | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            | 0.5  | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 | /    | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          | /    | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            | /    | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            | /    | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 | /    | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          | /    | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            | /    | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            | /    | A/M L N/A         | Y           |            |            |                |                |
| A    | Closet Door          | /    | A/M L N/A         | Y           |            |            |                |                |
| B    | Cl Casing            | /    | A/M L N/A         | Y           |            |            |                |                |
| C    | Closet Jamb          | /    | A/M L N/A         | Y           |            |            |                |                |
| D    | Closet Walls         | /    | A/M L N/A         | Y           |            |            |                |                |
|      | Cl Baseboard         | /    | A/M L N/A         | Y           |            |            |                |                |
| 1    | Closet Pole          | /    | A/M L N/A         | Y           |            |            |                |                |
| 2    | Closet Shelf         | /    | A/M L N/A         | Y           |            |            |                |                |
| 3    | Cl Supports          | /    | A/M L N/A         | Y           |            |            |                |                |
| 4    | Closet Floor         | /    | A/M L N/A         | Y           |            |            |                |                |
|      | Closet Ceiling       | /    | A/M L N/A         | Y           |            |            |                |                |

COMMENTS / STRUCTURAL DEFECTS:  
(1) OLDER LIP NEXT TO NEW STOPS  
IS LEAD.

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

(b) (6)

09-20-2012

Page 6 of 27

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 920 Main St.

Apt #: AAAAAA

City: Vineyard Haven, MA 02568

ROOM # 1 (CONTINUED) (PAGE 2 of 2)

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A B  | Up Walls             | /    | A/M L N/A         | Y           |            |            |                |                |
| A B  | Low Walls            | /    | A/M L N/A         | Y           |            |            |                |                |
| A B  | Baseboards           | /    | A/M L N/A         | Y           |            |            |                |                |
| A B  | Chair Rail           | /    | A/M L N/A         | Y           |            |            |                |                |
| A B  | Radiator             | /    | A/M L N/A         | Y           |            |            |                |                |
| A B  | Floor                | /    | A/M L N/A         | Y           |            |            |                |                |
| A B  | Ceiling              | /    | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 | /    | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          | /    | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            | /    | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            | /    | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 | /    | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          | /    | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            | /    | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            | /    | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 | /    | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          | /    | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            | /    | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            | /    | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 | /    | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          | /    | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            | /    | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            | /    | A/M L N/A         | Y           |            |            |                |                |
| A    | Closet Door          | /    | A/M L N/A         | Y           |            |            |                |                |
| B    | Closet Casing        | /    | A/M L N/A         | Y           |            |            |                |                |
| C    | Closet Jamb          | /    | A/M L N/A         | Y           |            |            |                |                |
| D    | Closet Walls         | /    | A/M L N/A         | Y           |            |            |                |                |
|      | Closet Baseboard     | /    | A/M L N/A         | Y           |            |            |                |                |
| 1    | Closet Pole          | /    | A/M L N/A         | Y           |            |            |                |                |
| 2    | Closet Shelf         | /    | A/M L N/A         | Y           |            |            |                |                |
| 3    | Closet Supports      | /    | A/M L N/A         | Y           |            |            |                |                |
| 4    | Closet Floor         | /    | A/M L N/A         | Y           |            |            |                |                |
|      | Closet Ceiling       | /    | A/M L N/A         | Y           |            |            |                |                |

COMMENTS / STRUCTURAL DEFECTS:  
(1) INNER EDGE LIP OF STOPS NEXT TO  
NEWER STOPS IS LEAD

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

(b) (6)

09-20-2012

Page 7 of 27

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 920 Main St.

Apt #: AAAAAA

City: Vineyard Haven, MA 02568

ROOM # 2

| SIDE | LOCATION/ SURFACE | LEAD | TYPE OF HAZARD | URG HAZ? | IC DATE | IC METH | DELEAD DATE | DELEAD METH |
|------|-------------------|------|----------------|----------|---------|---------|-------------|-------------|
| A B  | Up Walls (1)      | 0.00 | A/M L N/A      | Y        |         |         |             |             |
| A B  | Low Walls         |      | A/M L N/A      | Y        |         |         |             |             |
| A B  | Baseboards (2)    | 0.0  | A/M L N/A      | Y        |         |         |             |             |
| A B  | Chair Rail        |      | A/M L N/A      | Y        |         |         |             |             |
| A B  | Radiator          | 0.01 | A/M L N/A      | Y        |         |         |             |             |
|      | Floor             | 0.00 | A/M L N/A      | Y        |         |         |             |             |
|      | Ceiling           | 0.01 | A/M L N/A      | Y        |         |         |             |             |
| A B  | Door              | 0.00 | A/M L N/A      | Y        |         |         |             |             |
| C D  | Door Casing       | 0.00 | A/M L N/A      | Y        |         |         |             |             |
| 1 2  | Door Jamb         | 0.00 | A/M L N/A      | Y        |         |         |             |             |
| 3 4  | Threshold         | 0.01 | A/M L N/A      | Y        |         |         |             |             |
| A B  | Door              | 0.00 | A/M L N/A      | Y        |         |         |             |             |
| C D  | Door Casing       | 2.6  | A/M L N/A      | Y        |         |         |             |             |
| 1 2  | Door Jamb         | 0.3  | A/M L N/A      | Y        |         |         |             |             |
| 3 4  | Threshold         | 0.00 | A/M L N/A      | Y        |         |         |             |             |
| A B  | Door              | 1.9  | A/M L N/A      | Y        |         |         |             |             |
| C D  | Door Casing       | 2.8  | A/M L N/A      | Y        |         |         |             |             |
| 1 2  | Door Jamb         | 4.4  | A/M L N/A      | Y        |         |         |             |             |
| 3 4  | Threshold         |      | A/M L N/A      | Y        |         |         |             |             |
| A B  | Door              |      | A/M L N/A      | Y        |         |         |             |             |
| C D  | Door Casing       |      | A/M L N/A      | Y        |         |         |             |             |
| 1 2  | Door Jamb         |      | A/M L N/A      | Y        |         |         |             |             |
| 3 4  | Threshold         |      | A/M L N/A      | Y        |         |         |             |             |
| A    | Closet Door       | 1.5  | A/M L N/A      | Y        |         |         |             |             |
| B    | Closet Casing     |      | A/M L N/A      | Y        |         |         |             |             |
| C    | Closet Jamb       | 4.4  | A/M L N/A      | Y        |         |         |             |             |
| D    | Closet Walls      | 15.1 | A/M L N/A      | Y        |         |         |             |             |
|      | Closet Baseboard  | 21.2 | A/M L N/A      | Y        |         |         |             |             |
| 1    | Closet Pole       |      | A/M L N/A      | Y        |         |         |             |             |
| 2    | Closet Shelf      | 5.1  | A/M L N/A      | Y        |         |         |             |             |
| 3    | Closet Supports   | 0.21 | A/M L N/A      | Y        |         |         |             |             |
| 4    | Closet Floor      | 0.00 | A/M L N/A      | Y        |         |         |             |             |
|      | Closet Ceiling    | 4.3  | A/M L N/A      | Y        |         |         |             |             |

COMMENTS / STRUCTURAL DEFECTS:  
 (1) Plaster walls behind sheetrock = 2.7  
 (2) TOP EDGE (3) UPPER/LOWER DOORS

| SIDE | LOCATION/ SURFACE | LEAD | TYPE OF HAZARD | URG HAZ? | IC DATE | IC METH | DELEAD DATE | DELEAD METH |
|------|-------------------|------|----------------|----------|---------|---------|-------------|-------------|
| A    | Window Sill       | 0.6  | A/M L N/A      | Y        |         |         |             |             |
| B    | Win Apron         | 0.34 | A/M L N/A      | Y        |         |         |             |             |
| C    | Win Casing        | 0.01 | A/M L N/A      | Y        |         |         |             |             |
| D    | Header Stop       | 0.00 | A/M L N/A      | Y        |         |         |             |             |
|      | Int Stops         | 0.00 | A/M L N/A      | Y        |         |         |             |             |
| 1    | Win Int Sash      | 0.00 | A/M L N/A      | Y        |         |         |             |             |
| 2    | Exterior Sill     | 1.1  | A/M L N/A      | Y        |         |         |             |             |
| 3    | Part Bead         | 0.00 | A/M L N/A      | Y        |         |         |             |             |
| 4    | Blind Stop        | 1.2  | A/M L N/A      | Y        |         |         |             |             |
|      | Win Ext Sash      | 0.00 | A/M L N/A      | Y        |         |         |             |             |
| A    | Window Sill       |      | A/M L N/A      | Y        |         |         |             |             |
| B    | Win Apron         |      | A/M L N/A      | Y        |         |         |             |             |
| C    | Win Casing        |      | A/M L N/A      | Y        |         |         |             |             |
| D    | Header Stop       |      | A/M L N/A      | Y        |         |         |             |             |
|      | Int Stops         |      | A/M L N/A      | Y        |         |         |             |             |
| 1    | Win Int Sash      |      | A/M L N/A      | Y        |         |         |             |             |
| 2    | Exterior Sill     |      | A/M L N/A      | Y        |         |         |             |             |
| 3    | Part Bead         |      | A/M L N/A      | Y        |         |         |             |             |
| 4    | Blind Stop        |      | A/M L N/A      | Y        |         |         |             |             |
|      | Win Ext Sash      |      | A/M L N/A      | Y        |         |         |             |             |
| A B  | Fireplace         |      | A/M L N/A      | Y        |         |         |             |             |
| C D  | Mantle            |      | A/M L N/A      | Y        |         |         |             |             |
| A B  | Win Above 5'      |      | A/M L N/A      | Y        |         |         |             |             |
|      | Ceiling Molding   |      | A/M L N/A      | Y        |         |         |             |             |
| A    | PIES              | 0.14 | A/M L N/A      | Y        |         |         |             |             |
|      |                   |      | A/M L N/A      | Y        |         |         |             |             |
|      |                   |      | A/M L N/A      | Y        |         |         |             |             |

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.) | IC DATE | IC METHOD |
|------|----------|----------------------------------------------|---------|-----------|
|      |          |                                              |         |           |
|      |          |                                              |         |           |

| SIDE | LOCATION | MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.) | IC DATE | IC METHOD |
|------|----------|----------------------------------------------|---------|-----------|
|      |          |                                              |         |           |
|      |          |                                              |         |           |

(3) INNER LIP/EDGE NEXT TO NEWER TOPS IS LEAD



(b) (6)

09-20-2012

Page 8 of 27

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 920 Main St.

Apt #: 000000

City: Vineyard Haven, MA 02568

ROOM # 3

| SIDE    | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|---------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A B C D | Up Walls (1)         | 13.1 | A/M L N/A         | Y           |            |            |                |                |
| A B C D | Low Walls            |      | A/M L N/A         | Y           |            |            |                |                |
| A B C D | Baseboards (2)       | 13.2 | A/M L N/A         | Y           |            |            |                |                |
| A B C D | Chair Rail           |      | A/M L N/A         | Y           |            |            |                |                |
| A B C D | Radiator             | 2.01 | A/M L N/A         | Y           |            |            |                |                |
| A B C D | Floor                | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A B C D | Ceiling              | 11.1 | A/M L N/A         | Y           |            |            |                |                |
| A B     | Door                 | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| C D     | Door Casing          | 2.6  | A/M L N/A         | Y           |            |            |                |                |
| 1 2     | Door Jamb            | 1.5  | A/M L N/A         | Y           |            |            |                |                |
| 3 4     | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A B     | Door                 | 1.8  | A/M L N/A         | Y           |            |            |                |                |
| C D     | Door Casing          | 1.5  | A/M L N/A         | Y           |            |            |                |                |
| 1 2     | Door Jamb            | 0.4  | A/M L N/A         | Y           |            |            |                |                |
| 3 4     | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A B     | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C D     | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2     | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4     | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A B     | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C D     | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2     | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4     | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A       | Closet Door          | 0.01 | A/M L N/A         | Y           |            |            |                |                |
| B       | Closet Casing        | 2.1  | A/M L N/A         | Y           |            |            |                |                |
| C       | Closet Jamb          | 0.14 | A/M L N/A         | Y           |            |            |                |                |
| D       | Closet Walls         | 15.1 | A/M L N/A         | Y           |            |            |                |                |
| 1       | Closet Baseboard     | 16.3 | A/M L N/A         | Y           |            |            |                |                |
| 2       | Closet Pole          | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| 3       | Closet Shelf         | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| 4       | Closet Supports      | 2.6  | A/M L N/A         | Y           |            |            |                |                |
|         | Closet Floor         | 0.00 | A/M L N/A         | Y           |            |            |                |                |
|         | Closet Ceiling       | 16.4 | A/M L N/A         | Y           |            |            |                |                |

COMMENTS / STRUCTURAL DEFECTS:

(1) C WALL o/c.

(2) INNER LIP NEXT TO NEWER STOPS IS LEAD

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 920 Main St.

Apt #: AAAAAA

City: Vineyard Haven, MA 02568

ROOM # 4

| SIDE                                      | LOCATION/ SURFACE | LEAD | TYPE OF HAZARD | URG HAZ? | IC DATE | IC METH | DELEAD DATE | DELEAD METH | SIDE    | LOCATION/ SURFACE | LEAD | TYPE OF HAZARD | URG HAZ? | IC DATE | IC METH | DELEAD DATE | DELEAD METH |
|-------------------------------------------|-------------------|------|----------------|----------|---------|---------|-------------|-------------|---------|-------------------|------|----------------|----------|---------|---------|-------------|-------------|
| A B C D                                   | Up Walls          | 10.4 | (A/M) L N/A    | Y        |         |         |             |             | A       | Window Sill       | 2.4  | MI (A/M) L N/A | Y        |         |         |             |             |
| A B C D                                   | Low Walls         |      | A/M L N/A      | Y        |         |         |             |             | B       | Win Apron         | 0.4  | A/M L N/A      | Y        |         |         |             |             |
| A B C D                                   | Baseboards        | 12.2 | (A/M) L N/A    | Y        |         |         |             |             | C       | Win Casing        | 2.5  | (A/M) L N/A    | Y        |         |         |             |             |
| A B C D                                   | Chair Rail        |      | A/M L N/A      | Y        |         |         |             |             | D       | Header Stop       | 3.8  | MI A/M L N/A   | Y        |         |         |             |             |
| A B C D                                   | Radiator          | 0.29 | A/M L N/A      | Y        |         |         |             |             |         | Int Stops         | 3.8  | MI (A/M) L N/A | Y        |         |         |             |             |
|                                           | Floor             | 0.01 | A/M L N/A      | Y        |         |         |             |             | 1       | Win Int Sash      | 0.02 | MI A/M L N/A   | Y        |         |         |             |             |
|                                           | Ceiling           | 9.4  | A/M L N/A      | Y        |         |         |             |             | 2       | Exterior Sill     | 1.1  | MI (SE) L N/A  | Y        |         |         |             |             |
| A B                                       | Door              | 0.00 | A/M L N/A      | Y        |         |         |             |             | 3       | Part Bead         | 0.01 | MI L N/A       | Y        |         |         |             |             |
| C D                                       | Door Casing       | 4.2  | (A/M) L N/A    | Y        |         |         |             |             | 4       | Blind Stop        | 1.6  | MI (SF) L N/A  | Y        |         |         |             |             |
| 1 2                                       | Door Jamb         | 1.6  | (A/M) L N/A    | Y        |         |         |             |             |         | Win Ext Sash      | 0.00 | MI L N/A       | Y        |         |         |             |             |
| 3 4                                       | Threshold         |      | A/M L N/A      | Y        |         |         |             |             | A       | Window Sill       |      | MI A/M L N/A   | Y        |         |         |             |             |
| A B                                       | Door              | 0.03 | A/M L N/A      | Y        |         |         |             |             | B       | Win Apron         |      | A/M L N/A      | Y        |         |         |             |             |
| C D                                       | Door Casing       | 4.2  | (A/M) L N/A    | Y        |         |         |             |             | C       | Win Casing        |      | A/M L N/A      | Y        |         |         |             |             |
| 1 2                                       | Door Jamb         | 1.9  | (A/M) L N/A    | Y        |         |         |             |             | D       | Header Stop       |      | MI A/M L N/A   | Y        |         |         |             |             |
| 3 4                                       | Threshold         |      | A/M L N/A      | Y        |         |         |             |             |         | Int Stops         |      | MI A/M L N/A   | Y        |         |         |             |             |
| A B                                       | Door              |      | A/M L N/A      | Y        |         |         |             |             | 1       | Win Int Sash      |      | MI A/M L N/A   | Y        |         |         |             |             |
| C D                                       | Door Casing       |      | A/M L N/A      | Y        |         |         |             |             | 2       | Exterior Sill     |      | MI SF L N/A    | Y        |         |         |             |             |
| 1 2                                       | Door Jamb         |      | A/M L N/A      | Y        |         |         |             |             | 3       | Part Bead         |      | MI L N/A       | Y        |         |         |             |             |
| 3 4                                       | Threshold         |      | A/M L N/A      | Y        |         |         |             |             | 4       | Blind Stop        |      | MI SF L N/A    | Y        |         |         |             |             |
| A B                                       | Door              |      | A/M L N/A      | Y        |         |         |             |             |         | Win Ext Sash      |      | MI L N/A       | Y        |         |         |             |             |
| C D                                       | Door Casing       |      | A/M L N/A      | Y        |         |         |             |             | A       | Window Sill       |      | MI A/M L N/A   | Y        |         |         |             |             |
| 1 2                                       | Door Jamb         |      | A/M L N/A      | Y        |         |         |             |             | B       | Win Apron         |      | A/M L N/A      | Y        |         |         |             |             |
| 3 4                                       | Threshold         |      | A/M L N/A      | Y        |         |         |             |             | C       | Win Casing        |      | A/M L N/A      | Y        |         |         |             |             |
| A                                         | Closet Door       | 0.00 | A/M L N/A      | Y        |         |         |             |             | D       | Header Stop       |      | MI A/M L N/A   | Y        |         |         |             |             |
| B                                         | Cl Casing         | 0.5  | A/M L N/A      | Y        |         |         |             |             |         | Int Stops         |      | MI A/M L N/A   | Y        |         |         |             |             |
| C                                         | Closet Jamb       | 3.2  | (A/M) L N/A    | Y        |         |         |             |             | 1       | Win Int Sash      |      | MI A/M L N/A   | Y        |         |         |             |             |
| D                                         | Closet Walls      | 0.0  | A/M L N/A      | Y        |         |         |             |             | 2       | Exterior Sill     |      | MI SF L N/A    | Y        |         |         |             |             |
|                                           | Cl Baseboard      | 14.3 | A/M L N/A      | Y        |         |         |             |             | 3       | Part Bead         |      | MI L N/A       | Y        |         |         |             |             |
| 1                                         | Closet Pole       | 0.00 | A/M L N/A      | Y        |         |         |             |             | 4       | Blind Stop        |      | MI SF L N/A    | Y        |         |         |             |             |
| 2                                         | Closet Shelf      | 0.0  | A/M L N/A      | Y        |         |         |             |             |         | Win Ext Sash      |      | MI L N/A       | Y        |         |         |             |             |
| 3                                         | Cl Supports       | 0.0  | (A/M) L N/A    | Y        |         |         |             |             | A B     | Fireplace         |      | A/M L N/A      | Y        |         |         |             |             |
| 4                                         | Closet Floor      | 0.01 | A/M L N/A      | Y        |         |         |             |             | C D     | Mantle            |      | A/M L N/A      | Y        |         |         |             |             |
|                                           | Closet Ceiling    | 0.02 | A/M L N/A      | Y        |         |         |             |             | A B C D | Win Above S       |      | A/M L N/A      | Y        |         |         |             |             |
| COMMENTS / STRUCTURAL DEFECTS:            |                   |      |                |          |         |         |             |             |         | Ceiling Molding   |      | A/M L N/A      | Y        |         |         |             |             |
| (1) INNER LIP NEXT TO NEWER STOPS IS LEAD |                   |      |                |          |         |         |             |             |         | Shelves           | 1.8  | (A/M) L N/A    | Y        |         |         |             |             |
|                                           |                   |      |                |          |         |         |             |             |         | Supports          | 0.01 | (A/M) L N/A    | Y        |         |         |             |             |

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.) | IC DATE | IC METHOD | SIDE | LOCATION | MEASURE: LOOSE PAINT (MORE THAN 288 SQ. IN.) | IC DATE | IC METHOD |
|------|----------|----------------------------------------------|---------|-----------|------|----------|----------------------------------------------|---------|-----------|
|      |          |                                              |         |           |      |          |                                              |         |           |
|      |          |                                              |         |           |      |          |                                              |         |           |

(b) (6)

9-20-2012

Page 10 of 27

Inspector (print)

Lic #

Signature

Date

(b) (6)

sk Assessor (print)

Lic #

Signature

Date

Address of Property: 920 MAW ST. Apt #:

City: VINEYARD HAVEN MA 02658

Room # 5

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A B  | Up Walls             | 2.7  | A/M L N/A         | Y           |            |            |                |                |
| A B  | Low Walls            |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Baseboards           | 13.2 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Chair Rail           |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Radiator             | 2.6  | A/M L N/A         | Y           |            |            |                |                |
| A B  | Floor                | 0.31 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Ceiling              | 6.9  | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door Casing          | 0.01 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door Jamb            | NC   | A/M L N/A         | Y           |            |            |                |                |
| A B  | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 | 1.9  | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door Casing          | 2.2  | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door Jamb            | 7.1  | A/M L N/A         | Y           |            |            |                |                |
| A B  | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 | 0.01 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door Casing          | 7.9  | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door Jamb            | 0.6  | A/M L N/A         | Y           |            |            |                |                |
| A B  | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 | NC   | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door Jamb            | NC   | A/M L N/A         | Y           |            |            |                |                |
| A B  | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Closet Door          | 0.01 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Closet Casing        |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Closet Jamb          | 4.6  | A/M L N/A         | Y           |            |            |                |                |
| A B  | Closet Walls         | NC   | A/M L N/A         | Y           |            |            |                |                |
| A B  | Closet Baseboard     |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Closet Pole          |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Closet Shelf         |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Closet Supports      |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Closet Floor         | NC   | A/M L N/A         | Y           |            |            |                |                |
| A B  | Closet Ceiling       | NC   | A/M L N/A         | Y           |            |            |                |                |

COMMENTS / STRUCTURAL DEFECTS:  
 (1) attic crawl space  
 (2) other side of door for pipe access

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 285 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 285 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |



(b) (6)

09-20-2012

Page 11 of 27

Inspector (print)

Lic#

Signature

Date

(b) (6)

Risk Assessor (print)

Lic#

Signature

Date

Address of Property: 920 Main St.

Apt #: AAAAAA

City: Vineyard Haven, MA 02568

## KITCHEN

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A B  | Up Walls             | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Low Walls            | /    | A/M L N/A         | Y           |            |            |                |                |
| A B  | Baseboards           | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Chair Rail           | /    | A/M L N/A         | Y           |            |            |                |                |
| A B  | Radiator             | 0.06 | A/M L N/A         | Y           |            |            |                |                |
|      | Floor                | 0.00 | A/M L N/A         | Y           |            |            |                |                |
|      | Ceiling              | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 | /    | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          | 0.01 | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            | 0.07 | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            | 1.2  | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            | /    | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 | /    | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            | 1.3  | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 | /    | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          | /    | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            | /    | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            | /    | A/M L N/A         | Y           |            |            |                |                |
| A    | Closet Door          | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| B    | Closet Casing        | 4.4  | A/M L N/A         | Y           |            |            |                |                |
| C    | Closet Jamb          | 1.2  | A/M L N/A         | Y           |            |            |                |                |
| D    | Closet Walls         | 19.6 | A/M L N/A         | Y           |            |            |                |                |
|      | Closet Baseboard     | 15.5 | A/M L N/A         | Y           |            |            |                |                |
| 1    | Closet Pole          | /    | A/M L N/A         | Y           |            |            |                |                |
| 2    | Closet Shelf         | 1.3  | A/M L N/A         | Y           |            |            |                |                |
| 3    | Closet Supports      | 29.8 | A/M L N/A         | Y           |            |            |                |                |
| 4    | Closet Floor         | 0.00 | A/M L N/A         | Y           |            |            |                |                |
|      | Closet Ceiling       | 11.3 | A/M L N/A         | Y           |            |            |                |                |

COMMENTS / STRUCTURAL DEFECTS:  
 1) PLASTER BEHIND SHEETROCK = 3.6

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |



(b) (6)

09-20-2012

Page 13 of 27

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic#

Signature

Date

Address of Property:

920 Main St.

Apt #:

A A A A A

City: Vineyard Haven, MA 02568

BATHROOM # 2

| SIDE | LOCATION/<br>SURFACE | LEAD  | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|-------|-------------------|-------------|------------|------------|----------------|----------------|
| A B  | Up Walls             | 0.00  | A/M L N/A         | Y           |            |            |                |                |
| A B  | Low Walls            | Trace | A/M L N/A         | Y           |            |            |                |                |
| A B  | Baseboards           | 0.4   | A/M L N/A         | Y           |            |            |                |                |
| A B  | Chair Rail           |       | A/M L N/A         | Y           |            |            |                |                |
| A B  | Radiator             | 0.1   | A/M L N/A         | Y           |            |            |                |                |
| A B  | Floor                | 0.00  | A/M L N/A         | Y           |            |            |                |                |
| A B  | Ceiling              | 0.00  | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 | 0.00  | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          | 5.1   | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            | 0.3   | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            | 0.00  | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 |       | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          |       | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            |       | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            |       | A/M L N/A         | Y           |            |            |                |                |
| A    | Closet Door          |       | A/M L N/A         | Y           |            |            |                |                |
| B    | Cl Casing            |       | A/M L N/A         | Y           |            |            |                |                |
| C    | Closet Jamb          |       | A/M L N/A         | Y           |            |            |                |                |
| D    | Closet Walls         |       | A/M L N/A         | Y           |            |            |                |                |
|      | Cl Baseboard         |       | A/M L N/A         | Y           |            |            |                |                |
| 1    | Closet Pole          |       | A/M L N/A         | Y           |            |            |                |                |
| 2    | Closet Shelf         |       | A/M L N/A         | Y           |            |            |                |                |
| 3    | Cl Supports          |       | A/M L N/A         | Y           |            |            |                |                |
| 4    | Closet Floor         |       | A/M L N/A         | Y           |            |            |                |                |
|      | Closet Ceiling       |       | A/M L N/A         | Y           |            |            |                |                |
| A B  | Up Cab Frame         |       | A/M L N/A         | Y           |            |            |                |                |
| C D  | Up Cab Door          |       | A/M L N/A         | Y           |            |            |                |                |
|      | Up Cab Walls         |       | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Up Cab Shlvs         |       | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Supports             |       | A/M L N/A         | Y           |            |            |                |                |
|      |                      |       | M/I A/M L N/A     | Y           |            |            |                |                |
|      |                      |       | M/I A/M L N/A     | Y           |            |            |                |                |
|      |                      |       | M/I A/M L N/A     | Y           |            |            |                |                |

COMMENTS / STRUCTURAL DEFECTS:

(1) INNER LIP NEXT TO NEWER STOPS IS LEAD

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
|      | Low Cab Frame        | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Low Cab Door         | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| C D  | Low Cab Walls        | 0.00 | A/M L N/A         | Y           |            |            |                |                |
|      | Low Cab Shlvs        | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Supports             |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Drawers              |      | A/M L N/A         | Y           |            |            |                |                |
| A    | Window Sill          | 2.9  | M/I A/M L N/A     | Y           |            |            |                |                |
| B    | Win Apron            | 0.04 | A/M L N/A         | Y           |            |            |                |                |
| C    | Win Casing           | 0.3  | A/M L N/A         | Y           |            |            |                |                |
| D    | Header Stop          | 0.6  | M/I A/M L N/A     | Y           |            |            |                |                |
|      | Int Stops (1)        | 0.8  | M/I A/M L N/A     | Y           |            |            |                |                |
| 1    | Win Int Sash         | 0.00 | M/I A/M L N/A     | Y           |            |            |                |                |
| 2    | Exterior Sill        | 2.1  | M/I SF L N/A      | Y           |            |            |                |                |
| 3    | Part Bead            | 0.00 | M/I L N/A         | Y           |            |            |                |                |
| 4    | Blind Stop           | 0.01 | M/I SF L N/A      | Y           |            |            |                |                |
|      | Win Ext Sash         | 0.00 | M/I L N/A         | Y           |            |            |                |                |
| A B  | Win Above 5'         |      | M/I A/M L N/A     | Y           |            |            |                |                |
| A B  | Ceiling Molding      |      | M/I A/M L N/A     | Y           |            |            |                |                |
| A B  | Medicine Cab         | 0.00 | M/I A/M L N/A     | Y           |            |            |                |                |
| A B  | Wall O/C             |      | M/I A/M L N/A     | Y           |            |            |                |                |
| D    | Shelves              | 3.7  | M/I A/M L N/A     | Y           |            |            |                |                |
|      | Supports             | 6.2  | M/I A/M L N/A     | Y           |            |            |                |                |
|      |                      |      | M/I A/M L N/A     | Y           |            |            |                |                |
|      |                      |      | M/I A/M L N/A     | Y           |            |            |                |                |
|      |                      |      | M/I A/M L N/A     | Y           |            |            |                |                |
|      |                      |      | M/I A/M L N/A     | Y           |            |            |                |                |
|      |                      |      | M/I A/M L N/A     | Y           |            |            |                |                |
|      |                      |      | M/I A/M L N/A     | Y           |            |            |                |                |
|      |                      |      | M/I A/M L N/A     | Y           |            |            |                |                |
|      |                      |      | M/I A/M L N/A     | Y           |            |            |                |                |
|      |                      |      | M/I A/M L N/A     | Y           |            |            |                |                |

COMMENTS / STRUCTURAL DEFECTS:

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |



(b) (6)

09-20-2012

Page 14 of 27

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property:

920 Main St.

Apt #:

AAAAA

City: Vineyard Haven, MA 02568

HALLWAY #1

| SIDE       | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A B<br>C D | Up Walls (1)         | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A B<br>C D | Low Walls            | /    | A/M L N/A         | Y           |            |            |                |                |
| A B<br>C D | Baseboards           | 2.3  | A/M L N/A         | Y           |            |            |                |                |
| A B<br>C D | Chair Rail           | /    | A/M L N/A         | Y           |            |            |                |                |
| A B<br>C D | Radiator             | /    | A/M L N/A         | Y           |            |            |                |                |
|            | Floor                | 0.00 | A/M L N/A         | Y           |            |            |                |                |
|            | Ceiling              | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A B<br>C D | Door                 | /    | A/M L N/A         | Y           |            |            |                |                |
|            | Door Casing          | 0.7  | A/M L N/A         | Y           |            |            |                |                |
| 1 2        | Door Jamb            | 0.9  | A/M L N/A         | Y           |            |            |                |                |
| 3 4        | Threshold            | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A B<br>C D | Door                 | 0.00 | A/M L N/A         | Y           |            |            |                |                |
|            | Door Casing          | 0.01 | A/M L N/A         | Y           |            |            |                |                |
| 1 2        | Door Jamb            | 1.2  | A/M L N/A         | Y           |            |            |                |                |
| 3 4        | Threshold            | 0.5  | A/M L N/A         | Y           |            |            |                |                |
| A B<br>C D | Door                 | 0.00 | A/M L N/A         | Y           |            |            |                |                |
|            | Door Casing          | 0.01 | A/M L N/A         | Y           |            |            |                |                |
| 1 2        | Door Jamb            | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| 3 4        | Threshold            | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A B<br>C D | Door                 | /    | A/M L N/A         | Y           |            |            |                |                |
|            | Door Casing          | /    | A/M L N/A         | Y           |            |            |                |                |
| 1 2        | Door Jamb            | /    | A/M L N/A         | Y           |            |            |                |                |
| 3 4        | Threshold            | /    | A/M L N/A         | Y           |            |            |                |                |
| A B<br>C D | Door                 | /    | A/M L N/A         | Y           |            |            |                |                |
|            | Door Casing          | /    | A/M L N/A         | Y           |            |            |                |                |
| #          | Door Jamb            | /    | A/M L N/A         | Y           |            |            |                |                |
|            | Threshold            | /    | A/M L N/A         | Y           |            |            |                |                |
| A          | Closet Door          | /    | A/M L N/A         | Y           |            |            |                |                |
| B          | Cl Casing            | /    | A/M L N/A         | Y           |            |            |                |                |
| C          | Closet Jamb          | /    | A/M L N/A         | Y           |            |            |                |                |
| D          | Closet Walls         | /    | A/M L N/A         | Y           |            |            |                |                |
|            | Cl Baseboard         | /    | A/M L N/A         | Y           |            |            |                |                |
| 1          | Closet Pole          | /    | A/M L N/A         | Y           |            |            |                |                |
| 2          | Closet Shelf         | /    | A/M L N/A         | Y           |            |            |                |                |
| 3          | Cl Supports          | /    | A/M L N/A         | Y           |            |            |                |                |
| 4          | Closet Floor         | /    | A/M L N/A         | Y           |            |            |                |                |
|            | Closet Ceiling       | /    | A/M L N/A         | Y           |            |            |                |                |

| SIDE       | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A          | Closet Door          | /    | A/M L N/A         | Y           |            |            |                |                |
| B          | Cl Casing            | /    | A/M L N/A         | Y           |            |            |                |                |
| C          | Closet Jamb          | /    | A/M L N/A         | Y           |            |            |                |                |
| D          | Closet Walls         | /    | A/M L N/A         | Y           |            |            |                |                |
|            | Cl Baseboard         | /    | A/M L N/A         | Y           |            |            |                |                |
| 1          | Closet Pole          | /    | A/M L N/A         | Y           |            |            |                |                |
| 2          | Closet Shelf         | /    | A/M L N/A         | Y           |            |            |                |                |
| 3          | Cl Supports          | /    | A/M L N/A         | Y           |            |            |                |                |
| 4          | Closet Floor         | /    | A/M L N/A         | Y           |            |            |                |                |
|            | Closet Ceiling       | /    | A/M L N/A         | Y           |            |            |                |                |
| A          | Window Sill          | MM   | A/M L N/A         | Y           |            |            |                |                |
| B          | Win Apron            | /    | A/M L N/A         | Y           |            |            |                |                |
| C          | Win Casing           | /    | A/M L N/A         | Y           |            |            |                |                |
| D          | Header Stop          | MM   | A/M L N/A         | Y           |            |            |                |                |
|            | Int Stops            | MM   | A/M L N/A         | Y           |            |            |                |                |
| 1          | Win Int Sash         | MM   | A/M L N/A         | Y           |            |            |                |                |
| 2          | Exterior Sill        | MM   | SF L N/A          | Y           |            |            |                |                |
| 3          | Part Bead            | MM   | L N/A             | Y           |            |            |                |                |
| 4          | Blind Stop           | MM   | SF L N/A          | Y           |            |            |                |                |
|            | Win Ext Sash         | MM   | L N/A             | Y           |            |            |                |                |
| A          | Window Sill          | MM   | A/M L N/A         | Y           |            |            |                |                |
| B          | Win Apron            | /    | A/M L N/A         | Y           |            |            |                |                |
| C          | Win Casing           | /    | A/M L N/A         | Y           |            |            |                |                |
| D          | Header Stop          | MM   | A/M L N/A         | Y           |            |            |                |                |
|            | Int Stops            | MM   | A/M L N/A         | Y           |            |            |                |                |
| 1          | Win Int Sash         | MM   | A/M L N/A         | Y           |            |            |                |                |
| 2          | Exterior Sill        | MM   | SF L N/A          | Y           |            |            |                |                |
| 3          | Part Bead            | MM   | L N/A             | Y           |            |            |                |                |
| 4          | Blind Stop           | MM   | SF L N/A          | Y           |            |            |                |                |
|            | Win Ext Sash         | MM   | L N/A             | Y           |            |            |                |                |
| A B<br>C D | Pipe Chock           | 0.02 | MM                | A/M L N/A   | Y          |            |                |                |
| A B<br>C D | Ceiling Molding      | /    | MM                | A/M L N/A   | Y          |            |                |                |
| D          | Supports             | 0.00 | MM                | A/M L N/A   | Y          |            |                |                |

COMMENTS / STRUCTURAL DEFECTS:

Cl plaster beneath sheet rock is 2.2

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

(b) (6)

09-20-2012

Page 15 of 27

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property:

920 Main St.

Apt #:

A A A A A

City: Vineyard Haven, MA 02568

HALLWAY # 2

| SIDE       | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH | SIDE                           | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|--------------------------------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A B<br>C D | Up Walls             | 17.2 | A/M L N/A         | Y           |            |            |                |                | A                              | Closet Door          | 3.00 | A/M L N/A         | Y           |            |            |                |                |
| A B<br>C D | Low Walls            | /    | A/M L N/A         | Y           |            |            |                |                | B                              | Ci Casing            | 3.5  | A/M L N/A         | Y           |            |            |                |                |
| A B<br>C D | Baseboards           | 13.1 | A/M L N/A         | Y           |            |            |                |                | C                              | Closet Jamb          | 0.6  | L N/A             | Y           |            |            |                |                |
| A B<br>C D | Chair Rail           | /    | A/M L N/A         | Y           |            |            |                |                | D                              | Closet Walls         | 12.6 | A/M L N/A         | Y           |            |            |                |                |
| A B<br>C D | Radiator             | /    | A/M L N/A         | Y           |            |            |                |                |                                | Ci Baseboard         | 12.1 | A/M L N/A         | Y           |            |            |                |                |
|            | Floor                | 0.05 | A/M L N/A         | Y           |            |            |                |                | 1                              | Closet Pole          | 0.00 | A/M L N/A         | Y           |            |            |                |                |
|            | Ceiling              | 0.01 | A/M L N/A         | Y           |            |            |                |                | 2                              | Closet Shelf         | 0.01 | A/M L N/A         | Y           |            |            |                |                |
| A B        | Door                 | 0.01 | A/M L N/A         | Y           |            |            |                |                | 3                              | Ci Supports          | 14.9 | A/M L N/A         | Y           |            |            |                |                |
| C D        | Door Casing          | 3.7  | A/M L N/A         | Y           |            |            |                |                | 4                              | Closet Floor         | 0.01 | A/M L N/A         | Y           |            |            |                |                |
| 1 2        | Door Jamb            | 2.2  | A/M L N/A         | Y           |            |            |                |                |                                | Closet Ceiling       | 10.1 | A/M L N/A         | Y           |            |            |                |                |
| 3 4        | Threshold            | /    | A/M L N/A         | Y           |            |            |                |                | A                              | Window Sill          | /    | M/A/M L N/A       | Y           |            |            |                |                |
| A B        | Door                 | 0.00 | A/M L N/A         | Y           |            |            |                |                | B                              | Win Apron            | /    | A/M L N/A         | Y           |            |            |                |                |
| C D        | Door Casing          | 3.7  | A/M L N/A         | Y           |            |            |                |                | C                              | Win Casing           | /    | A/M L N/A         | Y           |            |            |                |                |
| 1 2        | Door Jamb            | 0.3  | A/M L N/A         | Y           |            |            |                |                | D                              | Header Stop          | /    | M/A/M L N/A       | Y           |            |            |                |                |
| 3 4        | Threshold            | /    | A/M L N/A         | Y           |            |            |                |                |                                | Int Stops            | /    | M/A/M L N/A       | Y           |            |            |                |                |
| A B        | Door                 | 1.6  | A/M L N/A         | Y           |            |            |                |                | 1                              | Win Int Sash         | /    | M/A/M L N/A       | Y           |            |            |                |                |
| C D        | Door Casing          | 3.0  | A/M L N/A         | Y           |            |            |                |                | 2                              | Exterior Sill        | /    | M/A SF L N/A      | Y           |            |            |                |                |
| 1 2        | Door Jamb            | 1.7  | A/M L N/A         | Y           |            |            |                |                | 3                              | Part Bead            | /    | M/A L N/A         | Y           |            |            |                |                |
| 3 4        | Threshold            | /    | A/M L N/A         | Y           |            |            |                |                | 4                              | Blind Stop           | /    | M/A SF L N/A      | Y           |            |            |                |                |
| A B        | Door                 | /    | A/M L N/A         | Y           |            |            |                |                |                                | Win Ext Sash         | /    | M/A L N/A         | Y           |            |            |                |                |
| C D        | Door Casing          | /    | A/M L N/A         | Y           |            |            |                |                | A                              | Window Sill          | /    | M/A/M L N/A       | Y           |            |            |                |                |
| 1 2        | Door Jamb            | /    | A/M L N/A         | Y           |            |            |                |                | B                              | Win Apron            | /    | A/M L N/A         | Y           |            |            |                |                |
| 3 4        | Threshold            | /    | A/M L N/A         | Y           |            |            |                |                | C                              | Win Casing           | /    | A/M L N/A         | Y           |            |            |                |                |
| A B        | Door                 | /    | A/M L N/A         | Y           |            |            |                |                | D                              | Header Stop          | /    | M/A/M L N/A       | Y           |            |            |                |                |
| C D        | Door Casing          | /    | A/M L N/A         | Y           |            |            |                |                |                                | Int Stops            | /    | M/A/M L N/A       | Y           |            |            |                |                |
| #          | Door Jamb            | /    | A/M L N/A         | Y           |            |            |                |                | 1                              | Win Int Sash         | /    | M/A/M L N/A       | Y           |            |            |                |                |
|            | Threshold            | /    | A/M L N/A         | Y           |            |            |                |                | 2                              | Exterior Sill        | /    | M/A SF L N/A      | Y           |            |            |                |                |
| A          | Closet Door          | 2.4  | A/M L N/A         | Y           |            |            |                |                | 3                              | Part Bead            | /    | M/A L N/A         | Y           |            |            |                |                |
| B          | Ci Casing            | /    | A/M L N/A         | Y           |            |            |                |                | 4                              | Blind Stop           | /    | M/A SF L N/A      | Y           |            |            |                |                |
| C          | Closet Jamb          | 1.8  | A/M L N/A         | Y           |            |            |                |                |                                | Win Ext Sash         | /    | M/A L N/A         | Y           |            |            |                |                |
| D          | Closet Walls         | 11.9 | A/M L N/A         | Y           |            |            |                |                | A B<br>C D                     | Win Above S          | /    | M/A/M L N/A       | Y           |            |            |                |                |
|            | Ci Baseboard         | 13.0 | A/M L N/A         | Y           |            |            |                |                | A B<br>C D                     | Ceiling Molding      | /    | M/A/M L N/A       | Y           |            |            |                |                |
| 1          | Closet Pole          | /    | A/M L N/A         | Y           |            |            |                |                |                                |                      | /    | M/A/M L N/A       | Y           |            |            |                |                |
| 2          | Closet Shelf         | 0.09 | A/M L N/A         | Y           |            |            |                |                | COMMENTS / STRUCTURAL DEFECTS: |                      |      |                   |             |            |            |                |                |
| 3          | Ci Supports          | 3.9  | A/M L N/A         | Y           |            |            |                |                |                                |                      |      |                   |             |            |            |                |                |
| 4          | Closet Floor         | 0.01 | A/M L N/A         | Y           |            |            |                |                |                                |                      |      |                   |             |            |            |                |                |
|            | Closet Ceiling       | 1.3  | A/M L N/A         | Y           |            |            |                |                |                                |                      |      |                   |             |            |            |                |                |

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD | SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |      |          |                                                 |            |              |
|      |          |                                                 |            |              |      |          |                                                 |            |              |

(b) (6)

09-20-2012

Page 16 of 27

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 920 Main St.

Apt #: 000000

City: Vineyard Haven, MA 02568

HALLWAY #3

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A B  | Up Walls             | 15.6 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Low Walls            |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Baseboards           | 12.6 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Chair Rail           |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Radiator             |      | A/M L N/A         | Y           |            |            |                |                |
|      | Floor                | 0.00 | A/M L N/A         | Y           |            |            |                |                |
|      | Ceiling              | 0.01 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 | 0.01 | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          | 4.1  | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            | 0.01 | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          | 0.8  | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            | 3.4  | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          | 3.6  | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            | 0.24 | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A    | Closet Door          |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Ci Casing            |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Closet Jamb          |      | A/M L N/A         | Y           |            |            |                |                |
| D    | Closet Walls         |      | A/M L N/A         | Y           |            |            |                |                |
|      | Ci Baseboard         |      | A/M L N/A         | Y           |            |            |                |                |
| 1    | Closet Pole          |      | A/M L N/A         | Y           |            |            |                |                |
| 2    | Closet Shelf         |      | A/M L N/A         | Y           |            |            |                |                |
| 3    | Ci Supports          |      | A/M L N/A         | Y           |            |            |                |                |
| 4    | Closet Floor         |      | A/M L N/A         | Y           |            |            |                |                |
|      | Closet Ceiling       |      | A/M L N/A         | Y           |            |            |                |                |
| A    | Closet Door          |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Ci Casing            |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Closet Jamb          |      | A/M L N/A         | Y           |            |            |                |                |
| D    | Closet Walls         |      | A/M L N/A         | Y           |            |            |                |                |
|      | Ci Baseboard         |      | A/M L N/A         | Y           |            |            |                |                |
| 1    | Closet Pole          |      | A/M L N/A         | Y           |            |            |                |                |
| 2    | Closet Shelf         |      | A/M L N/A         | Y           |            |            |                |                |
| 3    | Ci Supports          |      | A/M L N/A         | Y           |            |            |                |                |
| 4    | Closet Floor         |      | A/M L N/A         | Y           |            |            |                |                |
|      | Closet Ceiling       |      | A/M L N/A         | Y           |            |            |                |                |
| A    | Window Sill          |      | M/I A/M L N/A     | Y           |            |            |                |                |
| B    | Win Apron            |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| D    | Header Stop          |      | M/I A/M L N/A     | Y           |            |            |                |                |
|      | Int Stops            |      | M/I A/M L N/A     | Y           |            |            |                |                |
| 1    | Win Int Sash         |      | M/I A/M L N/A     | Y           |            |            |                |                |
| 2    | Exterior Sill        |      | M/I SF L N/A      | Y           |            |            |                |                |
| 3    | Part Bead            |      | M/I L N/A         | Y           |            |            |                |                |
| 4    | Blind Stop           |      | M/I SF L N/A      | Y           |            |            |                |                |
|      | Win Ext Sash         |      | M/I L N/A         | Y           |            |            |                |                |
| A    | Window Sill          |      | M/I A/M L N/A     | Y           |            |            |                |                |
| B    | Win Apron            |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| D    | Header Stop          |      | M/I A/M L N/A     | Y           |            |            |                |                |
|      | Int Stops            |      | M/I A/M L N/A     | Y           |            |            |                |                |
| 1    | Win Int Sash         |      | M/I A/M L N/A     | Y           |            |            |                |                |
| 2    | Exterior Sill        |      | M/I SF L N/A      | Y           |            |            |                |                |
| 3    | Part Bead            |      | M/I L N/A         | Y           |            |            |                |                |
| 4    | Blind Stop           |      | M/I SF L N/A      | Y           |            |            |                |                |
|      | Win Ext Sash         |      | M/I L N/A         | Y           |            |            |                |                |
| A B  | Win Above S          |      | M/I A/M L N/A     | Y           |            |            |                |                |
| A B  | Ceiling Molding      |      | M/I A/M L N/A     | Y           |            |            |                |                |
| A    | HEADER               |      | M/I A/M L N/A     | Y           |            |            |                |                |

COMMENTS / STRUCTURAL DEFECTS:

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 266 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 266 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |



(b) (6)

09-20-2012

Page 17 of 27

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 920 Main St.

Apt #: AAAAAA

City: Vineyard Haven, MA 02568

STAIRCASE 1ST TO 2ND

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A B  | Up Walls             | 1.2  | A/M L N/A         | Y           |            |            |                |                |
| A B  | Low Walls            |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Baseboards           | 13.1 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Chair Rail           |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Radiator             | 2.2  | A/M L N/A         | Y           |            |            |                |                |
|      | Floor                | 0.00 | A/M L N/A         | Y           |            |            |                |                |
|      | Ceiling              | 0.05 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door 1st             | 0.02 | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          | 2.1  | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            | 1.1  | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            | 0.14 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door 1st             |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          | 3.2  | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            | 1.7  | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            | 0.30 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door 1st             | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            | 0.02 | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            | 0.30 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door 1st             | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          | 2.5  | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            | 1.3  | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            | 0.01 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| #    | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
|      | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A    | Closet Door          |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Closet Casing        |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Closet Jamb          |      | A/M L N/A         | Y           |            |            |                |                |
| D    | Closet Walls         |      | A/M L N/A         | Y           |            |            |                |                |
|      | Closet Baseboard     |      | A/M L N/A         | Y           |            |            |                |                |
| 1    | Closet Pole          |      | A/M L N/A         | Y           |            |            |                |                |
| 2    | Closet Shelf         |      | A/M L N/A         | Y           |            |            |                |                |
| 3    | Closet Supports      |      | A/M L N/A         | Y           |            |            |                |                |
| 4    | Closet Floor         |      | A/M L N/A         | Y           |            |            |                |                |
|      | Closet Ceiling       |      | A/M L N/A         | Y           |            |            |                |                |

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A    | Window Sill          | 4.7  | A/M L N/A         | Y           |            |            |                |                |
| B    | Win Apron            | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| C    | Win Casing           | 7.1  | A/M L N/A         | Y           |            |            |                |                |
| D    | Header Stop          | 1.1  | A/M L N/A         | Y           |            |            |                |                |
|      | Int Stops            | 1.1  | A/M L N/A         | Y           |            |            |                |                |
| 1    | Win Int Sash         | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| 2    | Exterior Sill        | 1.0  | A/M L N/A         | Y           |            |            |                |                |
| 3    | Part Bead            | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| 4    | Blind Stop           | 1.0  | A/M L N/A         | Y           |            |            |                |                |
|      | Win Ext Sash         | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A    | Window Sill          |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Win Apron            |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| D    | Header Stop          |      | A/M L N/A         | Y           |            |            |                |                |
|      | Int Stops            |      | A/M L N/A         | Y           |            |            |                |                |
| 1    | Win Int Sash         |      | A/M L N/A         | Y           |            |            |                |                |
| 2    | Exterior Sill        |      | A/M L N/A         | Y           |            |            |                |                |
| 3    | Part Bead            |      | A/M L N/A         | Y           |            |            |                |                |
| 4    | Blind Stop           |      | A/M L N/A         | Y           |            |            |                |                |
|      | Win Ext Sash         |      | A/M L N/A         | Y           |            |            |                |                |
|      | Newel Post           | 0.10 | A/M L N/A         | Y           |            |            |                |                |
|      | Railing Cap          | 0.00 | A/M L N/A         | Y           |            |            |                |                |
|      | Handrail             |      | A/M L N/A         | Y           |            |            |                |                |
|      | Balusters            | 0.00 | A/M L N/A         | Y           |            |            |                |                |
|      | Lower rail           |      | A/M L N/A         | Y           |            |            |                |                |
|      | Treads               | 0.12 | A/M L N/A         | Y           |            |            |                |                |
|      | Risers               | 3.4  | A/M L N/A         | Y           |            |            |                |                |
|      | Stringer             | 4.4  | A/M L N/A         | Y           |            |            |                |                |
|      | Floor Edge           | 1.8  | A/M L N/A         | Y           |            |            |                |                |
|      | Floor Casing         | 11.2 | A/M L N/A         | Y           |            |            |                |                |
| A    | Win Apron            | 13.2 | A/M L N/A         | Y           |            |            |                |                |

COMMENTS / STRUCTURAL DEFECTS:

(1) INNER LIP NEXT TO STOPS IS LEAD

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

(b) (6)

2012

Page 18 of 27

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property:

Apt #:

City:

STAIRCASE 1ST to 3rd

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A B  | Up Walls             | 0.02 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Low Walls            | 0.2  | A/M L N/A         | Y           |            |            |                |                |
| A B  | Baseboards           |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Chair Rail           |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Radiator             |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Floor                | 1.2  | A/M L N/A         | Y           |            |            |                |                |
| A B  | Ceiling              | 0.0  | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door 1st             | 0.1  | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          | 4.2  | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            | 4.5  | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            | 0.0  | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| #    | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
|      | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A    | Closet Door          |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Cl Casing            |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Closet Jamb          |      | A/M L N/A         | Y           |            |            |                |                |
| D    | Closet Walls         |      | A/M L N/A         | Y           |            |            |                |                |
|      | Cl Baseboard         |      | A/M L N/A         | Y           |            |            |                |                |
| 1    | Closet Pole          |      | A/M L N/A         | Y           |            |            |                |                |
| 2    | Closet Shelf         |      | A/M L N/A         | Y           |            |            |                |                |
| 3    | Cl Supports          |      | A/M L N/A         | Y           |            |            |                |                |
| 4    | Closet Floor         |      | A/M L N/A         | Y           |            |            |                |                |
|      | Closet Ceiling       |      | A/M L N/A         | Y           |            |            |                |                |

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A    | Window Sill          | N/C  | M/I A/M L N/A     | Y           |            |            |                |                |
| B    | Win Apron            |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Win Casing           | N/C  | A/M L N/A         | Y           |            |            |                |                |
| D    | Header Stop          |      | M/I A/M L N/A     | Y           |            |            |                |                |
|      | Int Stops            |      | M/I A/M L N/A     | Y           |            |            |                |                |
| 1    | Win Int Sash         | N/C  | M/I A/M L N/A     | Y           |            |            |                |                |
| 2    | Exterior Sill        | N/C  | M/I SF L N/A      | Y           |            |            |                |                |
| 3    | Part Bead            | N/C  | M/I L N/A         | Y           |            |            |                |                |
| 4    | Blind Stop           |      | M/I SF L N/A      | Y           |            |            |                |                |
|      | Win Ext Sash         | N/C  | M/I L N/A         | Y           |            |            |                |                |
| A    | Window Sill          |      | M/I A/M L N/A     | Y           |            |            |                |                |
| B    | Win Apron            |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| D    | Header Stop          |      | M/I A/M L N/A     | Y           |            |            |                |                |
|      | Int Stops            |      | M/I A/M L N/A     | Y           |            |            |                |                |
| 1    | Win Int Sash         |      | M/I A/M L N/A     | Y           |            |            |                |                |
| 2    | Exterior Sill        |      | M/I SF L N/A      | Y           |            |            |                |                |
| 3    | Part Bead            |      | M/I L N/A         | Y           |            |            |                |                |
| 4    | Blind Stop           |      | M/I SF L N/A      | Y           |            |            |                |                |
|      | Win Ext Sash         |      | M/I L N/A         | Y           |            |            |                |                |
|      | Newel Post           | N/C  | A/M L N/A         | Y           |            |            |                |                |
|      | Railing Cap          |      | A/M L N/A         | Y           |            |            |                |                |
|      | Handrail             | 0.0  | A/M L N/A         | Y           |            |            |                |                |
|      | Balusters            |      | A/M L N/A         | Y           |            |            |                |                |
|      | Lower rail           |      | A/M L N/A         | Y           |            |            |                |                |
|      | Treads               | 4.1  | A/M L N/A         | Y           |            |            |                |                |
|      | Risers               | 0.0  | A/M L N/A         | Y           |            |            |                |                |
|      | Stringer             | 0.0  | A/M L N/A         | Y           |            |            |                |                |
|      | Floor Edge           | 2.1  | A/M L N/A         | Y           |            |            |                |                |
|      | Floor Casing         | 2.1  | A/M L N/A         | Y           |            |            |                |                |
|      | Baseboard            | 0.0  | M/I A/M L N/A     | Y           |            |            |                |                |

COMMENTS / STRUCTURAL DEFECTS:

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

(b) (6)

09-20-2012

Page 19 of 27

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 920 Main St.

Apt #: AAAAAA

City: Vineyard Haven, MA 02568

## BASEMENT/LAUNDRY AREA

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| AB   | Walls                | N/C  | AM L N/A          | Y           |            |            |                |                |
| AB   | Walls                | 3.6  | AM L N/A          | Y           |            |            |                |                |
| AB   | Walls                | /    | AM L N/A          | Y           |            |            |                |                |
| AB   | Walls                | /    | AM L N/A          | Y           |            |            |                |                |
| AB   | Baseboards           | /    | AM L N/A          | Y           |            |            |                |                |
| AB   | Chair rails          | /    | AM L N/A          | Y           |            |            |                |                |
| AB   | Floor                | N/C  | AM L N/A          | Y           |            |            |                |                |
| AB   | Ceiling              | N/C  | AM L N/A          | Y           |            |            |                |                |
| AB   | Chimney              | /    | AM L N/A          | Y           |            |            |                |                |
| AB   | Support Column       | /    | AM L N/A          | Y           |            |            |                |                |
| AB   | Door (3)             | 1.4  | AM L N/A          | Y           |            |            |                |                |
| CD   | Door Casing          | 10.2 | AM L N/A          | Y           |            |            |                |                |
| CD   | Door Jamb            | N/C  | AM L N/A          | Y           |            |            |                |                |
| 34   | Threshold            | /    | AM L N/A          | Y           |            |            |                |                |
| AB   | Door                 | 0.2  | AM L N/A          | Y           |            |            |                |                |
| CD   | Door Casing          | /    | AM L N/A          | Y           |            |            |                |                |
| CD   | Door Jamb            | /    | AM L N/A          | Y           |            |            |                |                |
| 34   | Threshold            | /    | AM L N/A          | Y           |            |            |                |                |
| AB   | Door                 | /    | AM L N/A          | Y           |            |            |                |                |
| CD   | Door Casing          | /    | AM L N/A          | Y           |            |            |                |                |
| 12   | Door Jamb            | /    | AM L N/A          | Y           |            |            |                |                |
| 34   | Threshold            | /    | AM L N/A          | Y           |            |            |                |                |
| AB   | Cabinets             | /    | AM L N/A          | Y           |            |            |                |                |
| AB   | Benches              | /    | AM L N/A          | Y           |            |            |                |                |
| CD   | Supports             | /    | AM L N/A          | Y           |            |            |                |                |
| A    | Closet Door          | 10.1 | AM L N/A          | Y           |            |            |                |                |
| B    | Closet Casing        | /    | AM L N/A          | Y           |            |            |                |                |
| C    | Closet Jamb          | /    | AM L N/A          | Y           |            |            |                |                |
| D    | Closet Walls         | 3.6  | AM L N/A          | Y           |            |            |                |                |
|      | Closet Baseboard     | /    | AM L N/A          | Y           |            |            |                |                |
| 1    | Closet Pole          | /    | AM L N/A          | Y           |            |            |                |                |
| 2    | Closet Shelf         | 10.0 | AM L N/A          | Y           |            |            |                |                |
| 3    | Closet Supports      | 0.2  | AM L N/A          | Y           |            |            |                |                |
| 4    | Closet Floor         | N/C  | AM L N/A          | Y           |            |            |                |                |
|      | Closet Ceiling       | 0.4  | AM L N/A          | Y           |            |            |                |                |

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| AB   | Pipes Supp.          | 0.0  | AM L N/A          | Y           |            |            |                |                |
| AB   | Sink                 | /    | AM L N/A          | Y           |            |            |                |                |
| AB   | Drainpipe            | /    | AM L N/A          | Y           |            |            |                |                |
| AB   | Serviceboard         | 0.0  | AM L N/A          | Y           |            |            |                |                |
| AB   | Shelves              | /    | AM L N/A          | Y           |            |            |                |                |
| CD   | Supports             | /    | AM L N/A          | Y           |            |            |                |                |
| AB   | Shelves              | /    | AM L N/A          | Y           |            |            |                |                |
| CD   | Supports             | /    | AM L N/A          | Y           |            |            |                |                |
| AB   | Shelves              | /    | AM L N/A          | Y           |            |            |                |                |
| CD   | Supports             | /    | AM L N/A          | Y           |            |            |                |                |
| AB   | Window frame         | 3.3  | AM L N/A          | Y           |            |            |                |                |
| AB   | Window Sash          | 0.0  | AM L N/A          | Y           |            |            |                |                |
| CD   | Exterior Sill        | 0.0  | AM L N/A          | Y           |            |            |                |                |
| 12   | Part Bead            | /    | AM L N/A          | Y           |            |            |                |                |
| 34   | Win Ext Sash         | 0.0  | AM L N/A          | Y           |            |            |                |                |
| AB   | Window frame         | 0.2  | AM L N/A          | Y           |            |            |                |                |
| AB   | Window Sash          | 0.0  | AM L N/A          | Y           |            |            |                |                |
| CD   | Exterior Sill        | 0.0  | AM L N/A          | Y           |            |            |                |                |
| 12   | Part Bead            | /    | AM L N/A          | Y           |            |            |                |                |
| 34   | Win Ext Sash         | 0.0  | AM L N/A          | Y           |            |            |                |                |
| AB   | Window frame         | 0.0  | AM L N/A          | Y           |            |            |                |                |
| AB   | Window Sash          | 0.0  | AM L N/A          | Y           |            |            |                |                |
| CD   | Exterior Sill        | 0.0  | AM L N/A          | Y           |            |            |                |                |
| 12   | Part Bead            | /    | AM L N/A          | Y           |            |            |                |                |
| 34   | Win Ext Sash         | 0.0  | AM L N/A          | Y           |            |            |                |                |
| AB   | Window frame         | 0.0  | AM L N/A          | Y           |            |            |                |                |
| AB   | Window Sash          | 0.0  | AM L N/A          | Y           |            |            |                |                |
| CD   | Exterior Sill        | 0.0  | AM L N/A          | Y           |            |            |                |                |
| 12   | Part Bead            | /    | AM L N/A          | Y           |            |            |                |                |
| 34   | Win Ext Sash         | 0.0  | AM L N/A          | Y           |            |            |                |                |
| AB   | Handrail             | /    | AM L N/A          | Y           |            |            |                |                |
| CD   | Balusters            | /    | AM L N/A          | Y           |            |            |                |                |
| 12   | Lower rail           | /    | AM L N/A          | Y           |            |            |                |                |
| 34   | Treads               | 2.4  | AM L N/A          | Y           |            |            |                |                |
|      | Risers               | 1.4  | AM L N/A          | Y           |            |            |                |                |
|      | Stringer             | 1.4  | AM L N/A          | Y           |            |            |                |                |
| AB   | Oil Tank             | /    | L N/A             | Y           |            |            |                |                |

Comments/Structural Defects

(1) BOTH SIDES

(2) AROUND D2 "CLOSET"

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |



(b) (6)

09-20-2012

Page 20 of 27

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic #

Signature

Date

Address of Property: 920 Main St.

Apt #: AAAAAA

City: Vineyard Haven, MA 02568

ROOM # LAUNDRY ROOM

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A B  | Up Walls             | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Low Walls            |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Baseboards           | 0.01 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Chair Rail           |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Radiator             |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Floor                | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Ceiling              |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            | 0.01 | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A    | Closet Door          |      | A/M L N/A         | Y           |            |            |                |                |
| B    | Closet Casing        |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Closet Jamb          |      | A/M L N/A         | Y           |            |            |                |                |
| D    | Closet Walls         |      | A/M L N/A         | Y           |            |            |                |                |
|      | Closet Baseboard     |      | A/M L N/A         | Y           |            |            |                |                |
| 1    | Closet Pole          |      | A/M L N/A         | Y           |            |            |                |                |
| 2    | Closet Shelf         |      | A/M L N/A         | Y           |            |            |                |                |
| 3    | Closet Support       |      | A/M L N/A         | Y           |            |            |                |                |
| 4    | Closet Floor         |      | A/M L N/A         | Y           |            |            |                |                |
|      | Closet Ceiling       |      | A/M L N/A         | Y           |            |            |                |                |

COMMENTS / STRUCTURAL DEFECTS:  
 (1) INNER LIP/EDGE NEAR NEWER STOPS  
 IS LEAD

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A    | Window Sill          | 0.02 | A/M L N/A         | Y           |            |            |                |                |
| B    | Win Apron            | 0.2  | A/M L N/A         | Y           |            |            |                |                |
| C    | Win Casing           | 0.5  | A/M L N/A         | Y           |            |            |                |                |
| D    | Header Stop          | 0.01 | A/M L N/A         | Y           |            |            |                |                |
|      | Int Stops (1)        | 0.01 | A/M L N/A         | Y           |            |            |                |                |
| 1    | Win Int Sash         | 0.01 | A/M L N/A         | Y           |            |            |                |                |
| 2    | Exterior Sill        | 0.00 | M/ SF L N/A       | Y           |            |            |                |                |
| 3    | Part Bead            | 0.00 | M/ L N/A          | Y           |            |            |                |                |
| 4    | Blind Stop           | 0.01 | M/ SF L N/A       | Y           |            |            |                |                |
|      | Win Ext Sash         | 0.00 | M/ L N/A          | Y           |            |            |                |                |
| A    | Window Sill          |      | M/ A/M L N/A      | Y           |            |            |                |                |
| B    | Win Apron            |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| D    | Header Stop          |      | M/ A/M L N/A      | Y           |            |            |                |                |
|      | Int Stops            |      | M/ A/M L N/A      | Y           |            |            |                |                |
| 1    | Win Int Sash         |      | M/ A/M L N/A      | Y           |            |            |                |                |
| 2    | Exterior Sill        |      | M/ SF L N/A       | Y           |            |            |                |                |
| 3    | Part Bead            |      | M/ L N/A          | Y           |            |            |                |                |
| 4    | Blind Stop           |      | M/ SF L N/A       | Y           |            |            |                |                |
|      | Win Ext Sash         |      | M/ L N/A          | Y           |            |            |                |                |
| A    | Window Sill          |      | M/ A/M L N/A      | Y           |            |            |                |                |
| B    | Win Apron            |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| D    | Header Stop          |      | M/ A/M L N/A      | Y           |            |            |                |                |
|      | Int Stops            |      | M/ A/M L N/A      | Y           |            |            |                |                |
| 1    | Win Int Sash         |      | M/ A/M L N/A      | Y           |            |            |                |                |
| 2    | Exterior Sill        |      | M/ SF L N/A       | Y           |            |            |                |                |
| 3    | Part Bead            |      | M/ L N/A          | Y           |            |            |                |                |
| 4    | Blind Stop           |      | M/ SF L N/A       | Y           |            |            |                |                |
|      | Win Ext Sash         |      | M/ L N/A          | Y           |            |            |                |                |
| A B  | Fireplace            |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Mantle               |      | A/M L N/A         | Y           |            |            |                |                |
| A B  | Win Above 5'         |      | A/M L N/A         | Y           |            |            |                |                |
| C D  | Ceiling Molding      |      | A/M L N/A         | Y           |            |            |                |                |
| A    | Shelves              | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| A    | Supports             | 0.01 | A/M L N/A         | Y           |            |            |                |                |
|      |                      |      | A/M L N/A         | Y           |            |            |                |                |

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

(b) (6)

09-20-2012

Page 21 of 27

| Inspector (print) | Lic # | Signature |
|-------------------|-------|-----------|
| b) (6)            |       |           |

|      |           |
|------|-----------|
| Lic# | Signature |
|------|-----------|

Signature \_\_\_\_\_

Date \_\_\_\_\_

|                       |             |           |
|-----------------------|-------------|-----------|
| Risk Assessor (print) | Lic #       | Signature |
| Address of Property:  | 920 Main St | Apt #:    |

|         |           |
|---------|-----------|
| Lic #   | Signature |
| Main St | Apt #:    |

Signature \_\_\_\_\_ Apt #: \_\_\_\_\_

Date \_\_\_\_\_  
Vineyard Haven, MA \_\_\_\_\_

Address of Property: 920 Main St Apt #: 11

Apt #: 4A

City: Vineyard Haven, MA 02568

PORCH (A) B C D (circle one) 1st fl 2nd fl 3rd fl 4th fl (circle one)

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| AB   | Siding               | 0.02 | L N/A             | Y           |            |            |                |                |
| CD   | Corner Boards        | 0.10 | L N/A             | Y           |            |            |                |                |
|      | Upper Trim           | N/A  | L N/A             | Y           |            |            |                |                |
|      | Ceiling              | N/A  | L N/A             | Y           |            |            |                |                |
|      | Joists               | N/A  | L N/A             | Y           |            |            |                |                |
| (A)  | Door                 | 0.02 | A/M L N/A         | Y           |            |            |                |                |
| B    | Storm Door           | 0.02 | A/M L N/A         | Y           |            |            |                |                |
| C    | Door Casing          | 0.06 | A/M L N/A         | Y           |            |            |                |                |
| D    | Door Jamb            | 0.3  | A/M L N/A         | Y           |            |            |                |                |
| 12   | Threshold            | 1.2  | A/M L N/A         | Y           |            |            |                |                |
| 34   | Kickplate            | 0.14 | A/M L N/A         | Y           |            |            |                |                |
| A    | Door                 | /    | A/M L N/A         | Y           |            |            |                |                |
| B    | Storm Door           | /    | A/M L N/A         | Y           |            |            |                |                |
| C    | Door Casing          | /    | A/M L N/A         | Y           |            |            |                |                |
| D    | Door Jamb            | /    | A/M L N/A         | Y           |            |            |                |                |
| 12   | Threshold            | /    | A/M L N/A         | Y           |            |            |                |                |
| 34   | Kickplate            | /    | A/M L N/A         | Y           |            |            |                |                |
| AB   | Window Sill          | /    | A/M L N/A         | Y           |            |            |                |                |
| CD   | Win Casing           | /    | A/M L N/A         | Y           |            |            |                |                |
| 12   | Window Sash          | /    | A/M L N/A         | Y           |            |            |                |                |
| 34   | Mullions             | /    | A/M L N/A         | Y           |            |            |                |                |
| (A)3 | Window Sill          | /    | A/M L N/A         | Y           |            |            |                |                |
| (C)D | Win Casing           | /    | A/M L N/A         | Y           |            |            |                |                |
| 12   | Window Sash          | /    | A/M L N/A         | Y           |            |            |                |                |
| 34   | Mullions             | /    | A/M L N/A         | Y           |            |            |                |                |
| AB   | Window Sill          | 0.7  | A/M L N/A         | Y           |            |            |                |                |
| (C)D | Win Casing           | 0.19 | A/M L N/A         | Y           |            |            |                |                |
| 12   | Window Sash          | 0.4  | A/M L N/A         | Y           |            |            |                |                |
| 34   | Mullions             | /    | A/M L N/A         | Y           |            |            |                |                |
| AB   | Window Sill          | /    | A/M L N/A         | Y           |            |            |                |                |
| CD   | Win-Casing           | /    | A/M L N/A         | Y           |            |            |                |                |
| 12   | Window Sash          | /    | A/M L N/A         | Y           |            |            |                |                |
| 34   | Mullions             | /    | A/M L N/A         | Y           |            |            |                |                |

COMMENTS / STRUCTURAL DEFECTS:

[illegible]

|                                |
|--------------------------------|
| COMMENTS / STRUCTURAL DEFECTS: |
|--------------------------------|

**EXCLUDED SURFACES:** Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 1440 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|--------------------------------------------------|------------|--------------|
|      |          |                                                  |            |              |
|      |          |                                                  |            |              |
|      |          |                                                  |            |              |

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 200 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |

(b) (6)

Page 22 of 27

Date \_\_\_\_\_

| Inspector (Name) | File # | Signature |
|------------------|--------|-----------|
| (b) (6)          |        |           |

Date \_\_\_\_\_

City: Vineyard Haven, MA 02568

PORCH A (B) C D (circle one) 1st fl 2nd fl 3rd fl 4th fl (circle one)

| SIDE  | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|-------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A/B   | Siding               | 0.4  | L N/A             | Y           |            |            |                |                |
| C/D   | Corner Boards        | 1.5  | (L) N/A           | Y           |            |            |                |                |
|       | Upper Trim           | N/A  | L N/A             | Y           |            |            |                |                |
|       | Ceiling              | N/A  | L N/A             | Y           |            |            |                |                |
|       | Joists               | N/A  | L N/A             | Y           |            |            |                |                |
| A     | Door                 | 2.1  | (A) L N/A         | Y           |            |            |                |                |
| (B)   | Storm Door           | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| C     | Door Casing          | 3.6  | (A) L N/A         | Y           |            |            |                |                |
| D     | Door Jamb            | 0.02 | A/M L N/A         | Y           |            |            |                |                |
| 1/2   | Threshold            | 1.4  | (A) L N/A         | Y           |            |            |                |                |
| 3/4   | Kickplate            | 3.2  | A/M L N/A         | Y           |            |            |                |                |
| A     | Door                 | /    | A/M L N/A         | Y           |            |            |                |                |
| B     | Storm Door           |      | A/M L N/A         | Y           |            |            |                |                |
| C     | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| D     | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
| 1/2   | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| 3/4   | Kickplate            |      | A/M L N/A         | Y           |            |            |                |                |
| A/B   | Window Sill          | /    | A/M L N/A         | Y           |            |            |                |                |
| D     | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| 1/2   | Window Sash          |      | A/M L N/A         | Y           |            |            |                |                |
| 3/4   | Mullions             |      | A/M L N/A         | Y           |            |            |                |                |
| A/B   | Window Sill          | 1.6  | (A) L N/A         | Y           |            |            |                |                |
| (C) D | Win Casing           | 1.4  | (A) L N/A         | Y           |            |            |                |                |
| 1/2   | Window Sash          | 0.00 | A/M L N/A         | Y           |            |            |                |                |
| 3/4   | Mullions             | /    | A/M L N/A         | Y           |            |            |                |                |
| A/B   | Window Sill          | /    | A/M L N/A         | Y           |            |            |                |                |
| C/D   | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| 1/2   | Window Sash          |      | A/M L N/A         | Y           |            |            |                |                |
| 3/4   | Mullions             |      | A/M L N/A         | Y           |            |            |                |                |
| A/B   | Window Sill          | /    | A/M L N/A         | Y           |            |            |                |                |
| C/D   | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| 1/2   | Window Sash          |      | A/M L N/A         | Y           |            |            |                |                |
| 3/4   | Mullions             |      | A/M L N/A         | Y           |            |            |                |                |

COMMENTS / STRUCTURAL DEFECTS:

[illegible]

COMMENTS / STRUCTURAL DEFECTS:

**EXCLUDED SURFACES:** Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 1440 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|--------------------------------------------------|------------|--------------|
|      |          |                                                  |            |              |
|      |          |                                                  |            |              |
|      |          |                                                  |            |              |

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 288 SQ. IN.) | IC<br>DATE | IC<br>METHOD |
|------|----------|-------------------------------------------------|------------|--------------|
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |
|      |          |                                                 |            |              |



(b) (6)

09-20-2012

Page 23 Of 27

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic#

Signature

Date

Address of Property: 920 Main St.

Apt #: AAAAAA

City: Vineyard Haven, MA 02568

## EXTERIOR A-Side

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| A    | Siding               | 0.03 | L N/A             | Y           |            |            |                |                |
| A    | Corner Boards        | 0.03 | L N/A             | Y           |            |            |                |                |
| A    | Lower Trim           | 0.03 | L N/A             | Y           |            |            |                |                |
| A    | Upper Trim           | NA   | L N/A             | Y           |            |            |                |                |
| A    | Win Above 5'         | NA   | L N/A             | Y           |            |            |                |                |
| A    | Porch Above 5'       |      | L N/A             | Y           |            |            |                |                |
| A    | Storm Door           |      | A/M L N/A         | Y           |            |            |                |                |
| A    | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| A    | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A    | Kickplate            |      | A/M L N/A         | Y           |            |            |                |                |
| A    | Storm Door           |      | A/M L N/A         | Y           |            |            |                |                |
| A    | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| A    | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A    | Kickplate            |      | A/M L N/A         | Y           |            |            |                |                |
| A    | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| A    | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
| A    | Window Sill          | 1.7  | A/M L N/A         | Y           |            |            |                |                |
| A    | Win Casing           | 1.7  | A/M L N/A         | Y           |            |            |                |                |
| A    | Window Sash          | 0.03 | A/M L N/A         | Y           |            |            |                |                |
| A    | Window Sill          |      | A/M L N/A         | Y           |            |            |                |                |
| A    | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| #    | Window Sash          |      | A/M L N/A         | Y           |            |            |                |                |
| A    | Window Sill          |      | A/M L N/A         | Y           |            |            |                |                |
| A    | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| #    | Window Sash          |      | A/M L N/A         | Y           |            |            |                |                |
| A    | Lamp Post            |      | L N/A             | Y           |            |            |                |                |

COMMENTS / STRUCTURAL DEFECTS:

Excluded Surfaces: Surfaces listed in this box can be made intact only by a licensed deleader

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 1440 SQ. IN.) | IC<br>DATE | IC<br>METH |
|------|----------|--------------------------------------------------|------------|------------|
| A    |          |                                                  |            |            |
| A    |          |                                                  |            |            |
| A    |          |                                                  |            |            |
| A    |          |                                                  |            |            |

## Soil Test Results

(Must be less than 400 ppm for play area / 1200 ppm for bare soil)

| LOCATION  | AREA MEASUREMENT<br>( Square Feet ) | RESULT<br>(PPM) | REMED<br>DATE | REMED<br>METH |
|-----------|-------------------------------------|-----------------|---------------|---------------|
| Play Area |                                     |                 |               |               |
| Bare Soil |                                     |                 |               |               |
| Comments: |                                     |                 |               |               |

Date \_\_\_\_\_

Date \_\_\_\_\_

City: Vineyard Haven, MA 02568

| SIDE | LOCATION/       | LEAD | TYPE OF   | URG  | IC   | IC   | DELEAD | DELEAD |
|------|-----------------|------|-----------|------|------|------|--------|--------|
| B    | SURFACE         |      | HAZARD    | HAZ? | DATE | METH | DATE   | METH   |
|      | Window Sill     | /    | A/M L N/A | Y    |      |      |        |        |
| B    | Win Casing      | /    | A/M L N/A | Y    |      |      |        |        |
| #    | Window Sash     | /    | A/M L N/A | Y    |      |      |        |        |
| B    | Cellar Win Sill | /    | A/M L N/A | Y    |      |      |        |        |
| #    | Cell Win Sash   | /    | A/M L N/A | Y    |      |      |        |        |
|      | Cell Win Frame  | /    | A/M L N/A | Y    |      |      |        |        |
|      | Screen Frame    | /    | A/M L N/A | Y    |      |      |        |        |
| B    | Cellar Win Sill | /    | A/M L N/A | Y    |      |      |        |        |
| #    | Cell Win Sash   | /    | A/M L N/A | Y    |      |      |        |        |
|      | Cell Win Frame  | /    | A/M L N/A | Y    |      |      |        |        |
|      | Screen Frame    | /    | A/M L N/A | Y    |      |      |        |        |
| B    | Cellar Win Sill | /    | A/M L N/A | Y    |      |      |        |        |
| #    | Cell Win Sash   | /    | A/M L N/A | Y    |      |      |        |        |
|      | Cell Win Frame  | /    | A/M L N/A | Y    |      |      |        |        |
|      | Screen Frame    | /    | A/M L N/A | Y    |      |      |        |        |
| B    | Cellar Win Sill | /    | A/M L N/A | Y    |      |      |        |        |
| #    | Cell Win Sash   | /    | A/M L N/A | Y    |      |      |        |        |
|      | Cell Win Frame  | /    | A/M L N/A | Y    |      |      |        |        |
|      | Screen Frame    | /    | A/M L N/A | Y    |      |      |        |        |
| B    | Foundation      | /    | L N/A     | Y    |      |      |        |        |
| #    | Bulkhead        | /    | A/M L N/A | Y    |      |      |        |        |
|      | Fences          | /    | A/M L N/A | Y    |      |      |        |        |
|      | Shutters        | /    | A/M L N/A | Y    |      |      |        |        |
| B    | Novel post      | /    | A/M L N/A | Y    |      |      |        |        |
| #    | Railing Cap     | /    | A/M L N/A | Y    |      |      |        |        |
|      | Handrail        | /    | A/M L N/A | Y    |      |      |        |        |
|      | Balusters       | /    | A/M L N/A | Y    |      |      |        |        |
|      | Lower Rail      | /    | A/M L N/A | Y    |      |      |        |        |
|      | Treads          | /    | A/M L N/A | Y    |      |      |        |        |
|      | Risers          | /    | A/M L N/A | Y    |      |      |        |        |
|      | Stringer        | /    | A/M L N/A | Y    |      |      |        |        |
|      | Lattice         | /    | A/M L N/A | Y    |      |      |        |        |
| B    |                 | /    | L N/A     | Y    |      |      |        |        |
| #    | Elec Conduit    | /    | L N/A     | Y    |      |      |        |        |
|      | Oil Fill Pipe   | /    | L N/A     | Y    |      |      |        |        |
|      | Overhang Trim   | /    | A/M L N/A | Y    |      |      |        |        |

(Must be less than 400 ppm for play area / 1200 ppm for bare soil)

| LOCATION  | AREA MEASUREMENT<br>(Square Feet) | RESULT<br>(PPM) | REMED<br>DATE | REMED<br>METH. |
|-----------|-----------------------------------|-----------------|---------------|----------------|
| Play Area |                                   |                 |               |                |
| Bare Soil |                                   |                 |               |                |
| Comments: |                                   |                 |               |                |

(b) (6)

09-20-2012

Page 25 of 27

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic#

Signature

Date

Address of Property: 920 Main St.

Apt #: AAAAAA

City: Vineyard Haven, MA 02568

## EXTERIOR C Side

| SIDE | LOCATION/<br>SURFACE | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|----------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| C    | Siding               | 0.00 | L N/A             | Y           |            |            |                |                |
|      | Corner Boards        |      | L N/A             | Y           |            |            |                |                |
| C    | Lower Trim           | 0.01 | L N/A             | Y           |            |            |                |                |
|      | Upper Trim           | 0.02 | L N/A             | Y           |            |            |                |                |
|      | Win Above 5'         | N/A  | L N/A             | Y           |            |            |                |                |
|      | Porch Above 5'       |      | L N/A             | Y           |            |            |                |                |
|      | Storm Door           |      | A/M L N/A         | Y           |            |            |                |                |
|      | Door                 | 0.2  | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Casing          | 0.4  | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Door Jamb            | N/A  | A/M L N/A         | Y           |            |            |                |                |
|      | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
|      | Kickplate            |      | A/M L N/A         | Y           |            |            |                |                |
|      | Storm Door           |      | A/M L N/A         | Y           |            |            |                |                |
|      | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
|      | Kickplate            |      | A/M L N/A         | Y           |            |            |                |                |
|      | Door                 |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Door Casing          |      | A/M L N/A         | Y           |            |            |                |                |
| 1 2  | Door Jamb            |      | A/M L N/A         | Y           |            |            |                |                |
| 3 4  | Threshold            |      | A/M L N/A         | Y           |            |            |                |                |
|      | Window Sill          |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| #    | Window Sash          |      | A/M L N/A         | Y           |            |            |                |                |
|      | Window Sill          |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| #    | Window Sash          |      | A/M L N/A         | Y           |            |            |                |                |
|      | Window Sill          |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Win Casing           |      | A/M L N/A         | Y           |            |            |                |                |
| #    | Window Sash          |      | A/M L N/A         | Y           |            |            |                |                |
| C    | Lamp Post            |      | L N/A             | Y           |            |            |                |                |

COMMENTS / STRUCTURAL DEFECTS:

Excluded Surfaces: Surfaces listed in this box can be made  
Intact only by a licensed deleader

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 1440 SQ. IN.) | IC<br>DATE | IC<br>METH |
|------|----------|--------------------------------------------------|------------|------------|
| C    |          |                                                  |            |            |
| C    |          |                                                  |            |            |
| C    |          |                                                  |            |            |
| C    |          |                                                  |            |            |

## Soil Test Results

(Must be less than 400 ppm for play area / 1200 ppm for bare soil)

| LOCATION  | AREA MEASUREMENT<br>(Square Feet) | RESULT<br>(PPM) | REMED<br>DATE | REMED<br>METH |
|-----------|-----------------------------------|-----------------|---------------|---------------|
| Play Area |                                   |                 |               |               |
| Bare Soil |                                   |                 |               |               |
| Comments: |                                   |                 |               |               |



(b) (6)

09- 20- 2012

Page 26 of 27

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic#

Signature

Date

Address of Property: 920 Main St.

Apt #: AAAAAA

City: Vineyard Haven, MA 02568

## EXTERIOR D Side

| SIDE | LOCATION/<br>SURFACE           | LEAD | TYPE OF<br>HAZARD | URG<br>HAZ? | IC<br>DATE | IC<br>METH | DELEAD<br>DATE | DELEAD<br>METH |
|------|--------------------------------|------|-------------------|-------------|------------|------------|----------------|----------------|
| D    | Siding                         | Dys  | L N/A             | Y           |            |            |                |                |
|      | Corner Boards                  | Dys  | L N/A             | Y           |            |            |                |                |
|      | Lower Trim                     | Dys  | L N/A             | Y           |            |            |                |                |
|      | Upper Trim                     | Dys  | L N/A             | Y           |            |            |                |                |
|      | Win. Above 6'                  | N/A  | L N/A             | Y           |            |            |                |                |
|      | Porch Above 6'                 | N/A  | L N/A             | Y           |            |            |                |                |
| D    | Storm Door                     | /    | A/M L N/A         | Y           |            |            |                |                |
|      | Door                           | /    | A/M L N/A         | Y           |            |            |                |                |
|      | Door Casing                    | /    | A/M L N/A         | Y           |            |            |                |                |
|      | Door Jamb                      | /    | A/M L N/A         | Y           |            |            |                |                |
|      | Threshold                      | /    | A/M L N/A         | Y           |            |            |                |                |
|      | Kickplate                      | /    | A/M L N/A         | Y           |            |            |                |                |
| D    | Storm Door                     | /    | A/M L N/A         | Y           |            |            |                |                |
|      | Door                           | /    | A/M L N/A         | Y           |            |            |                |                |
|      | Door Casing                    | /    | A/M L N/A         | Y           |            |            |                |                |
|      | Door Jamb                      | /    | A/M L N/A         | Y           |            |            |                |                |
|      | Threshold                      | /    | A/M L N/A         | Y           |            |            |                |                |
|      | Kickplate                      | /    | A/M L N/A         | Y           |            |            |                |                |
| D    | Door                           | /    | A/M L N/A         | Y           |            |            |                |                |
|      | Door Casing                    | /    | A/M L N/A         | Y           |            |            |                |                |
|      | Door Jamb                      | /    | A/M L N/A         | Y           |            |            |                |                |
|      | Threshold                      | /    | A/M L N/A         | Y           |            |            |                |                |
|      | Window Sill                    | /    | A/M L N/A         | Y           |            |            |                |                |
|      | Win Casing                     | /    | A/M L N/A         | Y           |            |            |                |                |
| D    | Window Sash                    | /    | A/M L N/A         | Y           |            |            |                |                |
|      | Window Sill                    | /    | A/M L N/A         | Y           |            |            |                |                |
|      | Win Casing                     | /    | A/M L N/A         | Y           |            |            |                |                |
|      | Window Sash                    | /    | A/M L N/A         | Y           |            |            |                |                |
|      | Window Sill                    | /    | A/M L N/A         | Y           |            |            |                |                |
|      | Win Casing                     | /    | A/M L N/A         | Y           |            |            |                |                |
| D    | Window Sash                    | /    | A/M L N/A         | Y           |            |            |                |                |
|      | Lamp Post                      | /    | L N/A             | Y           |            |            |                |                |
|      | COMMENTS / STRUCTURAL DEFECTS: |      |                   |             |            |            |                |                |
|      |                                |      |                   |             |            |            |                |                |
|      |                                |      |                   |             |            |            |                |                |
|      |                                |      |                   |             |            |            |                |                |

Excluded Surfaces: Surfaces listed in this box can be made  
intact only by a licensed deleader

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 1440 SQ. IN.) | IC<br>DATE | IC<br>METH |
|------|----------|--------------------------------------------------|------------|------------|
| D    |          |                                                  |            |            |
| D    |          |                                                  |            |            |
| D    |          |                                                  |            |            |
| D    |          |                                                  |            |            |

## Soil Test Results

(Must be less than 400 ppm for play area / 1200 ppm for bare soil)

| LOCATION  | AREA MEASUREMENT<br>( Square Feet ) | RESULT<br>(PPM) | REMED<br>DATE | REMED<br>METH |
|-----------|-------------------------------------|-----------------|---------------|---------------|
| Play Area |                                     |                 |               |               |
| Bare Soil |                                     |                 |               |               |
| Comments: |                                     |                 |               |               |

(b) (6)

09-20-2012

Page 27 of 27

Inspector (print)

Lic #

Signature

Date

(b) (6)

Risk Assessor (print)

Lic#

Signature

Date

Address of Property: 90 Main St.

Apt #: AAAAAA

City: Vineyard Haven, MA 02568

GARAGE SHED OTHER

| SIDE | LOCATION/    | LEAD | TYPE OF   | URG  | IC   | IC   | DELEAD | DELEAD |
|------|--------------|------|-----------|------|------|------|--------|--------|
| A    | SURFACE      |      | HAZARD    | HAZ? | DATE | METH | DATE   | METH   |
| A    | Siding       | 0.5  | L N/A     | Y    |      |      |        |        |
|      | Corner Board | 0.00 | L N/A     | Y    |      |      |        |        |
|      | Lower Trim   | /    | L N/A     | Y    |      |      |        |        |
|      | Upper Trim   | N/A  | L N/A     | Y    |      |      |        |        |
| A    | Door         | 0.00 | A/M L N/A | Y    |      |      |        |        |
|      | Door Casing  | 0.00 | A/M L N/A | Y    |      |      |        |        |
|      | Door Jamb    | 1.2  | A/M L N/A | Y    |      |      |        |        |
|      | Threshold    | N/A  | A/M L N/A | Y    |      |      |        |        |
| A    | Window Sill  | /    | A/M L N/A | Y    |      |      |        |        |
|      | Win Casing   | /    | A/M L N/A | Y    |      |      |        |        |
|      | Win Sash     | /    | A/M L N/A | Y    |      |      |        |        |
| A    | Foundation   | /    | L N/A     | Y    |      |      |        |        |

COMMENTS / STRUCTURAL DEFECTS:

| SIDE | LOCATION/     | LEAD | TYPE OF   | URG  | IC   | IC   | DELEAD | DELEAD |
|------|---------------|------|-----------|------|------|------|--------|--------|
| C    | SURFACE       |      | HAZARD    | HAZ? | DATE | METH | DATE   | METH   |
| C    | Siding        | 2.1  | L N/A     | Y    |      |      |        |        |
|      | Corner Boards | 0.00 | L N/A     | Y    |      |      |        |        |
|      | Lower Trim    | /    | L N/A     | Y    |      |      |        |        |
|      | Upper Trim    | N/A  | L N/A     | Y    |      |      |        |        |
| C    | Door          | /    | A/M L N/A | Y    |      |      |        |        |
|      | Door Casing   | /    | A/M L N/A | Y    |      |      |        |        |
|      | Door Jamb     | /    | A/M L N/A | Y    |      |      |        |        |
|      | Threshold     | /    | A/M L N/A | Y    |      |      |        |        |
| C    | Window Sill   | 0.40 | A/M L N/A | Y    |      |      |        |        |
|      | Win Casing    | 0.00 | A/M L N/A | Y    |      |      |        |        |
|      | Win Sash      | 0.00 | A/M L N/A | Y    |      |      |        |        |
| C    | Foundation    | 1.3  | L N/A     | Y    |      |      |        |        |

COMMENTS / STRUCTURAL DEFECTS:

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 1440 SQ. IN.) | IC   | IC     |
|------|----------|--------------------------------------------------|------|--------|
| A    |          |                                                  | DATE | METHOD |
| A    |          |                                                  |      |        |
| A    |          |                                                  |      |        |
| A    |          |                                                  |      |        |

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 1440 SQ. IN.) | IC   | IC     |
|------|----------|--------------------------------------------------|------|--------|
| C    |          |                                                  | DATE | METHOD |
| C    |          |                                                  |      |        |
| C    |          |                                                  |      |        |
| C    |          |                                                  |      |        |

| SIDE | LOCATION/     | LEAD | TYPE OF   | URG  | IC   | IC   | DELEAD | DELEAD |
|------|---------------|------|-----------|------|------|------|--------|--------|
| B    | SURFACE       |      | HAZARD    | HAZ? | DATE | METH | DATE   | METH   |
| B    | Siding        | 2.1  | L N/A     | Y    |      |      |        |        |
|      | Corner Boards | 0.00 | L N/A     | Y    |      |      |        |        |
|      | Lower Trim    | /    | L N/A     | Y    |      |      |        |        |
|      | Upper Trim    | N/A  | L N/A     | Y    |      |      |        |        |
| B    | Door          | /    | A/M L N/A | Y    |      |      |        |        |
|      | Door Casing   | /    | A/M L N/A | Y    |      |      |        |        |
|      | Door Jamb     | /    | A/M L N/A | Y    |      |      |        |        |
|      | Threshold     | /    | A/M L N/A | Y    |      |      |        |        |
| B    | Window Sill   | /    | A/M L N/A | Y    |      |      |        |        |
|      | Win Casing    | /    | A/M L N/A | Y    |      |      |        |        |
|      | Win Sash      | /    | A/M L N/A | Y    |      |      |        |        |
| B    | Foundation    | 3.1  | L N/A     | Y    |      |      |        |        |

COMMENTS / STRUCTURAL DEFECTS:

| SIDE | LOCATION/     | LEAD | TYPE OF   | URG  | IC   | IC   | DELEAD | DELEAD |
|------|---------------|------|-----------|------|------|------|--------|--------|
| D    | SURFACE       |      | HAZARD    | HAZ? | DATE | METH | DATE   | METH   |
| D    | Siding        | 3.1  | L N/A     | Y    |      |      |        |        |
|      | Corner Boards | 0.00 | L N/A     | Y    |      |      |        |        |
|      | Lower Trim    | /    | L N/A     | Y    |      |      |        |        |
|      | Upper Trim    | N/A  | L N/A     | Y    |      |      |        |        |
| D    | Door          | 0.00 | A/M L N/A | Y    |      |      |        |        |
|      | Door Casing   | 0.00 | A/M L N/A | Y    |      |      |        |        |
|      | Door Jamb     | 0.00 | A/M L N/A | Y    |      |      |        |        |
|      | Threshold     | 0.00 | A/M L N/A | Y    |      |      |        |        |
| D    | Window Sill   | 0.12 | A/M L N/A | Y    |      |      |        |        |
|      | Win Casing    | 0.00 | A/M L N/A | Y    |      |      |        |        |
|      | Win Sash      | 0.00 | A/M L N/A | Y    |      |      |        |        |
| D    | Foundation    | 3.2  | L N/A     | Y    |      |      |        |        |

COMMENTS / STRUCTURAL DEFECTS:

EXCLUDED SURFACES: Surfaces listed in these boxes can be made intact only by a licensed deleader.

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 1440 SQ. IN.) | IC   | IC     |
|------|----------|--------------------------------------------------|------|--------|
| B    |          |                                                  | DATE | METHOD |
| B    |          |                                                  |      |        |
| B    |          |                                                  |      |        |
| B    |          |                                                  |      |        |

| SIDE | LOCATION | MEASURE: LOOSE PAINT<br>(MORE THAN 1440 SQ. IN.) | IC   | IC     |
|------|----------|--------------------------------------------------|------|--------|
| D    |          |                                                  | DATE | METHOD |
| D    |          |                                                  |      |        |
| D    |          |                                                  |      |        |
| D    |          |                                                  |      |        |

**Attachment C**

Commonwealth of Massachusetts  
Residential Deleading Advisory





DEVAL L. PATRICK  
GOVERNOR

TIMOTHY P. MURRAY  
LIEUTENANT GOVERNOR

JUDYANN BIGBY, MD  
SECRETARY

JOHN AUERBACH  
COMMISSIONER

**The Commonwealth of Massachusetts**  
Executive Office of Health and Human Services  
Department of Public Health  
Bureau of Environmental Health  
Childhood Lead Poisoning Prevention Program  
250 Washington Street, 7<sup>th</sup> floor  
Boston, MA 02108  
(800) 532-9571

**RESIDENTIAL DELEADING ADVISORY**

The process of removing or covering lead paint hazards, commonly called deleading, can be dangerous if it is not done properly. That's why the Lead Law (Massachusetts General Laws chapter 111, sections 189A through 199B), the Regulations for Lead Poisoning Prevention and Control (105 Code of Massachusetts Regulations 460.000) and the Deleading Regulations (454 CMR 22.00) have rules for how deleading is done in homes and apartments. These rules say who can do the work, safety steps that have to be taken while the work is done, how to clean up after the work and how the work is finally approved. These rules are enforced by the Department of Public Health's Childhood Lead Poisoning Prevention Program (CLPPP), the Division of Occupational Safety (DOS) and local boards of health.

**Who can do deleading work**

Under these laws, only a licensed deleading contractor can do high-risk work, such as scraping or stripping lead paint, repairing more than a small amount of chipping or peeling lead paint so it can be repainted, and demolishing lead-painted building parts. Besides deleaders, property owners and their agents who take a one-day course can do moderate-risk deleading work, such as removing windows, woodwork, and just about any surface of a house, as well as repairing small amounts of chipping and peeling lead paint so it can be repainted. Lead-safe renovators trained and licensed by DOS may also be hired to do moderate-risk deleading work. Finally, low-risk deleading work can be done by all the people who can do high- or moderate-risk deleading work, and also owners and their agents, including contractors, who just complete the CLPPP low-risk booklet (and/or encapsulant booklet). Low-risk deleading means covering surfaces, applying encapsulants, capping baseboards, removing doors, cabinet doors and shutters, and applying exterior siding. Property owners and their agents may also do structural repairs and lead-dust cleaning for interim control.

**Staying out of the home or parts of the home during deleading**

To protect the people who live in the home or apartment being delead, the law also has rules about making sure they stay out of the home or apartment, or the area being worked on, in these ways:

- All people and pets have to be temporarily moved from the home or apartment for the whole time that high- or moderate-risk deleading work is taking place inside the home or apartment. The owner has to provide residents with a reasonable alternative place to live for this time. Property owners and residents should refer to the CLPPP document, "Notice to Property Owners and Tenants: Tenants' Rights, Responsibilities, and Remedies" for more information on alternative housing during deleading.
- People and pets have to stay out of the work area while most low-risk deleading work,

structural repairs or cleaning of lead dust, is taking place. They also have to stay out of the work area when deleading work of any kind is taking place in common areas outside the home or apartment, as long as they have another regular way (not a fire escape) to go in and out of the building. In these cases, people and pets can use the area once cleanup is completed after all the work in the area is done.

- People and pets have to stay out of the home or apartment for the day during application of encapsulants with an airless sprayer. They also have to stay out for the day during deleading of common areas when they do not have another regular way to go in and out of the building. When people and pets are out of their home or apartment for the day, it means they can come back to the home or apartment after cleanup at the end of the workday, and don't have to be out overnight.

It is very important that people whose home or apartment is being delead think carefully about what they will need during the time they are away from home, and take it with them. No one can return to a home or apartment while deleading that requires them to be out is still taking place, and has not been properly cleaned up. Property owners and residents must take deleading safety rules seriously and cooperate fully to make sure everyone is protected. No one should interfere with the work being done safely.

### **Getting ready for deleading to begin**

People who live in a home or apartment in which any kind of deleading work is going to be taking place have to get written notice at least 10 days before the start of this work. This applies also to other residents of a building, if any deleading work will take place in common areas. Before deleading work begins, all household possessions of every type should be removed or stored in plastic bags in non-work areas. Closets and cabinets to be delead must be emptied. As a last resort, large furniture and belongings not removed from the work area should be put in plastic bags and left in the center of the room, where they will be covered with heavy plastic by the person doing the deleading. The reason for this is to protect everything in the home or apartment from lead dust contamination. Belongings must also be protected before an owner or agent performs low-risk deleading work, or other work that may be required for interim control, but the precautions are not as extensive for this type of work. In general, it is recommended that furniture and belongings be moved outside the work area, or covered with thick plastic and sealed with duct tape, before low-risk deleading begins.

### **Cleanup after deleading and returning home**

A final cleanup will be done at least two hours after all the interior high- or moderate-risk deleading work is done. This delay is to make sure that fine lead dust will settle out of the air and be removed in the final cleanup. People and pets who were temporarily moved to alternative housing can return only after a lead inspector or risk assessor says that the home is safe. The inspector decides this after doing a reoccupancy reinspection, which includes an analysis of lead dust levels within the home. Residents should leave a phone number where they can be reached so that the inspector or risk assessor can call them and let them know when it is safe to return home. If the property owner or agent is going to be doing low-risk deleading work or other work for interim control after the residents return home, they will be taking some safety steps for this, as described in the CLPPP low-risk booklet. They will also be doing a cleanup when they are done with the low-risk work. An inspector or risk assessor will return at the completion of all the work and do a reinspection to check the owner's or agent's work.

### **Temporary ways to protect children from lead poisoning**

Children exposed to lead paint hazards are at risk of becoming lead poisoned. This disease can affect every part of a young child's developing body, and in particular, can seriously and permanently hurt the brain, kidneys and nervous system. Even at lower levels of exposure, lead can cause children to have learning and behavioral problems.

The best and only permanent way to protect children from lead poisoning is deleading. But even before that process begins, there are some important steps that can be taken to protect young children from lead poisoning. Your lead inspector's or risk assessor's advice should be carefully followed because he or she knows your child's home.

As part of their normal behavior, young children place things in their mouths, especially toys and their own fingers. If there are lead paint chips and dust in your home, they may be picked up by your child's fingers, as well as by toys, foods and pacifiers that fall on the floor, and end up in your child's mouth. It is especially important to wash your child's toys and to keep your child's hands clean, particularly before meals and at bedtime.

Areas of peeling or chipping lead paint and dust should be cleaned. Wet wiping with paper towels and a general household detergent is best. Do not use your household vacuum cleaner to clean up paint chips, because this will only send fine lead dust into the air. Windows, windowsills and the floors under windows in particular are often areas from which children can get exposed to lead. Sills should be cleaned regularly if paint dust or flakes collect there. If windows are in poor condition, the best thing to do may be to keep the lower sash closed and open only the upper sash for ventilation. (This also protects your child from accidentally falling from the window.) Contact paper may be applied to areas of peeling paint on windowsills, walls or other surfaces as a temporary measure.


Sometimes furniture can be moved to block children from deteriorating paint or plaster. If deteriorating paint or plaster is in the child's bedroom, use another room as the child's room, if possible. Think of those parts of the home where your child spends most of his or her time, and try to keep them as clean as you can before your home is delead.

Lead paint can also get into soil. If the outside of your home has chipping or peeling paint, do not let your child play in the soil closest to the house. Be careful to wipe your shoes off on a mat before walking into your house, so you don't track in soil from these areas. Follow the advice of your lead inspector or risk assessor about soil on the property.

For more information about how the deleading process works, and how to protect your children from lead poisoning, call the toll-free CLPPP information line, at 1(800) 532-9571.



**Attachment D**  
Commonwealth of Massachusetts  
Tenant's Rights and Responsibilities



# The Commonwealth of Massachusetts

Executive Office of Health and Human Services

Department of Public Health

Bureau of Environmental Health

Childhood Lead Poisoning Prevention Program

250 Washington Street, 7<sup>th</sup> floor

Boston, MA 02108

(800) 532-9571

DEVAL L. PATRICK  
GOVERNOR

TIMOTHY P. MURRAY  
LIEUTENANT GOVERNOR

JUDYANN BIGBY, MD  
SECRETARY

JOHN AUERBACH  
COMMISSIONER

## NOTICE TO PROPERTY OWNERS AND TENANTS: TENANT'S RIGHTS AND RESPONSIBILITIES

### Violations

Lead paint violations under the Lead Law and the state Sanitary Code have been found in the home or apartment listed in the attached documents. These violations may be a danger to the health of the people living in the home or apartment. Children younger than six years old are at the most risk of being lead poisoned. Lead can damage a child's growing brain and other parts of the body. Even small amounts of lead can harm a child.

The owner of this home or apartment is responsible for removing or covering the lead violations. (This is called deleading.)

### Legal Rights and Responsibilities

For these lead violations to be deleaded as quickly and safely as possible, it helps if both the owner and the tenant cooperate with each other. It is important that tenants and owners know their rights under state law. Because the laws are not simple, tenants may need to get legal help and/or legal advice before trying to use the rights found below.

- (1) Temporary Housing. (Massachusetts General Laws chapter 111, section 197)  
Tenants and their pets **must** be temporarily moved out of the home or apartment for the whole time that high-risk or moderate-risk deleading work is taking place inside the home or apartment. They cannot return until that work is done, the unit is cleaned up and a licensed lead inspector finds that the home or apartment is safe.

The owner and tenants have to agree on a plan for temporary housing. If the tenants choose to move in with family or friends they do not have to pay rent to their landlord while they are out of their home. If they do not so choose, the owner finds the temporary housing and offers it to the tenant. The Law requires that owners pay any charges for the temporary housing the owner offers, and that tenants continue to pay their full normal rent during the time they live in the temporary housing. The temporary housing must be one that "does not cause undue economic or personal hardship to the tenant." If the temporary housing chosen by the owner would not cause a hardship, and the tenant still refuses to accept it, then the tenant has to find and arrange for his or her own temporary

housing during deleading. In this case, the tenant doesn't have to pay rent for the days he or she is not at home, but has to pay the cost of the temporary housing he or she has chosen. In this case, the owner has to pay the tenant any amount by which the cost of the temporary housing first chosen by the owner is more than the rent for that period. No matter where the tenant stays, the owner must pay reasonable moving costs. Tenants are advised to get legal help if they can not agree with the owner on a plan.

(2) Protection from Retaliatory Rent Increase or Eviction.

A property owner may not evict a tenant, or increase the rent or refuse to renew the lease of a tenant in retaliation (getting even) for the tenant reporting a suspected lead paint violation to a code enforcement agency such as the local board of health. If the rent is raised, or tenants get an eviction notice or their lease is not renewed within **six** months after the tenants called the board of health or got their home delead, a court can automatically find that the owner took this action in retaliation **unless** the owner can show clear evidence that he or she had other reasons, unrelated to the violations. **An eviction based on not paying the rent is not retaliatory.** Property owners who are found to have threatened or taken actions against tenants for exercising rights under the Lead Law are liable for damages under M.G.L. c. 186, s. 18 and M.G.L. c. 93A.

A tenant who believes that the owner has retaliated against him or her because of lead violations may also file a complaint with the Massachusetts Commission Against Discrimination (MCAD).

(3) Rent Withholding. (Massachusetts General Laws chapter 239, section 8A)

Tenants have a basic obligation to pay rent for their home or apartment to the owner. But, if lead violations are not being delead, tenants may have a right to hold back their rent payments. Tenants may take this step **only** if they were up to date in their rent at the time the owner was notified of the lead paint violations, and they did not begin withholding until this point. Owners have the right to go to court to evict tenants for not paying rent. To fully protect themselves against attempted evictions, tenants withholding rent for Lead Law violations may need to place withheld rent money in an escrow (separate savings) account, or may be ordered to do so by the court. If these conditions are met, tenants may not be evicted for not paying rent or for any other violation that is not the tenants' fault.

Owners have the right to enter the tenants' home or apartment, if possible by appointment, but in any case in emergencies, to inspect for lead violations and to have them repaired. Tenants have a responsibility to cooperate with owners and allow all necessary access to their home or apartment for repairs. Tenants who do not cooperate with this right of entry may be subject to eviction. If rent was withheld, the court may order that all or part of the withheld rent be paid to the owner after the violations are delead.

(4) Abatement of Rent or Damages. Even when the rent withholding statute does not apply, tenants may be able to have their rent reduced or get back rent they have already paid, if their home or apartment has Lead Law violations. The landlord always has a duty to provide housing that meets basic housing standards. A tenant can bring a court action for breach of this "implied warranty".

(5) "Rent Receivership". (Massachusetts General Laws, chapter 111, sections 127C - 127J)



This law allows tenants, the state Childhood Lead Poisoning Prevention Program or the local board of health to ask the court to find that Lead Law violations exist, and to allow rent to be paid into court rather than to the owner, to pay for necessary repairs.

(6) Owner Liability: Compensatory and Punitive Damages. (Massachusetts General Laws chapter 111, section 199)


The owner of a home or apartment built before 1978 is liable for damages to a child under age six who becomes lead poisoned as a result of the owner's failure to comply with the Lead Law and regulations. The owner of such home or apartment who is notified through an Order to Correct Violations or Order to Restore Interim Control Measures of lead violations, and who willfully fails to correct the violations, in accordance with the Lead Law and Regulations, is also subject to punitive damages, which are triple the actual damages found.

**NOTE:** All the information presented above is only a summary of the law. Before you decide to withhold your rent or take any other legal action, it is advisable that you consult an attorney. If you can not afford to consult an attorney, you should contact the nearest Legal Services office.

### **Repainting**

Violations of the Lead Law are also violations of the state Sanitary Code. Surfaces from which lead paint or other coatings have been removed have to be repainted under 105 CMR 410.020 of the state Sanitary Code. Delead surfaces have to be sealed and made easy to clean. Delead surfaces can only be repainted **after** the surfaces have been reinspected while bare and approved by a licensed lead inspector.

Tenants may want to contact the owner if the required repainting is not done. If the owner does not respond, tenants should call the local board of health.



DEVAL L. PATRICK  
GOVERNOR  
TIMOTHY P. MURRAY  
LIEUTENANT GOVERNOR  
JUDYANN BIGBY, MD  
SECRETARY  
JOHN AUERBACH  
COMMISSIONER

# The Commonwealth of Massachusetts

Executive Office of Health and Human Services  
Department of Public Health  
Bureau of Environmental Health  
Childhood Lead Poisoning Prevention Program  
250 Washington Street, 7<sup>th</sup> floor  
Boston, MA 02108  
(800) 532-9571

## NOTICE TO TENANTS OF LEAD PAINT HAZARDS

Lead in violation of the Lead Law (Massachusetts General Laws, chapter 111, sections 189A-199B) and the state Department of Public Health's Regulations for Lead Poisoning Prevention and Control (105 Code of Massachusetts Regulations 460.000) has been found in apartment \_\_\_\_\_, in this building. Children exposed to lead hazards are at risk of becoming lead poisoned. This disease can affect all parts of a young child's developing body, and in particular, can seriously and permanently hurt the brain, kidneys and nervous system. Even at lower levels of exposure, lead can cause children to have learning and behavioral problems.

If you have a child under six years of age, it is important that he or she be regularly tested for lead poisoning, as the law requires. If your child has not been tested recently, you should ask your child's doctor or health care provider to test him or her. If you don't have a regular health care provider, you can call your local board of health, or the state Childhood Lead Poisoning Prevention Program (CLPPP), at 1-800-532-9571, to find out where you can get your child tested for lead for free. Lead poisoning can only be detected by such testing.

Since lead violations have been found in an apartment in this building, it is quite possible that your unit may have lead violations too. If you have a child under six years of age, you should ask the owner of your building about having your apartment inspected for lead paint. You can call your local board of health to check for lead (ask for a lead determination), or call CLPPP at 1-800-532-9571 for further advice. It is against state law for property owners to discriminate against tenants with children because of lead paint hazards in their apartment.

If deleading of apartment \_\_\_\_\_ will also include deleading of common hallways, staircases and porches of your building, you will get a written notice 10 days before any deleading will begin. While the deleading is being done, everyone must keep out of the areas being worked on. You have to use another way to go in and out of your building during this time. If your apartment is on the same floor and is in the work area as a common area in which deleading is being done, the person or persons doing the deleading work will protect your apartment too. They will be temporarily covering your doorway with thick plastic sheeting and taping it down with masking tape, so that fine lead dust can't be blown in, around, or under your door. If they have not properly covered areas to protect them from lead dust and debris from the deleading work, tell the owner of your building or call the state Division of Occupational Safety (DOS) at 1-800-425-0004, or CLPPP at 1-800-532-9571. If you don't have an alternative way of

getting in and out of your building, talk to the owner of your building, or the person or people doing the deleading, and coordinate the work.

Check your windowsills and doorways for any visible dust after deleading. Lead dust can be cleaned up with paper towels and a mixture of regular household detergent and water. If you notice lead dust from deleading in your apartment, tell the person doing the deleading, and the owner of your building.

Deleading work that is done the right way should not result in lead contamination of your building. However, if you notice any lead paint dust or debris that has not been properly cleaned up at the end of the workday, tell the owner of your building. You can also call DOS at 1-800-425-0004 or CLPPP at 1-800-532-9571 or the local health department.



**APPENDIX C**  
**Radon Laboratory Analysis Results**

NEHA NRPP 101193 AL  
NRSB ARL0017

EPA Method #402-R-92-004  
Liquid Scintillation  
NEHA Device Code 8088  
NRSB Device Code 12193

**Laboratory Report For**
**Property Tested**

Axiom Partners, Inc.  
979 Main Street  
Wakefield MA 01880

USCG  
921 Main Street  
Vineyard Haven MA 02568

| Log Number | Device Number | Exposure Period |         |           |          | Area Tested | Result (pCi/L) |
|------------|---------------|-----------------|---------|-----------|----------|-------------|----------------|
| 1402703    | 2262237       | 9/17/2012       | 8:51 am | 9/20/2012 | 11:12 am | Basement    | 1.6            |
| 1402704    | 2262238       | 9/17/2012       | 8:51 am | 9/20/2012 | 11:12 am | Basement    | 1.5            |
| 1402705    | 2382769       | 9/17/2012       | 8:46 am | 9/20/2012 | 12:03 pm | Basement    | 2.3            |
| 1402706    | 2382770       | 9/17/2012       | 8:46 am | 9/20/2012 | 12:03 pm | Basement    | 2.1            |
| 1402707    | 2382771       | 9/17/2012       | 8:46 am | 9/20/2012 | 12:03 pm | Field Blank | < 0.4          |
| 1402708    | 2382772       | 9/17/2012       | 8:46 am | 9/20/2012 | 12:03 pm | Field Blank | < 0.4          |

**Comment:** Axiom Partners, Inc. was e-mailed a copy of this report. A copy of this report was emailed to pdeldette@axiomenv.com.

Distributed By: Axiom Partners, Inc.

Date Received: 9/25/2012

Date Analyzed: 9/25/2012

Date Reported: 9/26/2012

Report Reviewed By: \_\_\_\_\_

Report Approved By: \_\_\_\_\_

**Disclaimer:**


The uncertainty of this radon measurement is ~+/- 10 %. Factors contributing to uncertainty include statistical variations, daily and seasonal variations in radon concentrations, sample collection techniques and operation of the dwelling. Interference with test conditions may influence the test results.

This report may only be transferred to a third party in its entirety. Analytical results relate to the samples AS RECEIVED BY THE LABORATORY. Results shown on this report represent levels of radon gas measured between the dates shown in the room or area of the site identified above as "Property Tested". Incorrect information will affect results. The results may not be construed as either predictive or supportive of measurements conducted in any area of this structure at any other time. AccuStar Labs, its employees and agents are not responsible for the consequences of any action taken or not taken based upon the results reported or any verbal or written interpretation of the results.

# ***RHODE ISLAND ANALYTICAL***

**WEST CHOP 1  
WEST CHOP 2**

## **LBP INSPECTION & RISK ASSESSMENT REPORT**

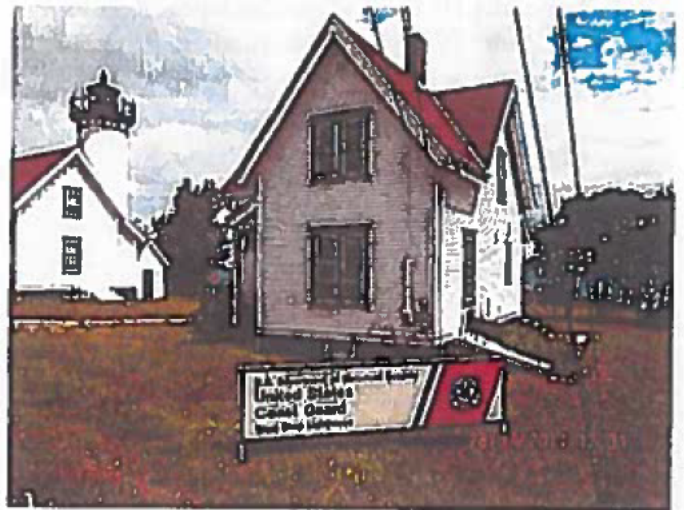

### **PERFORMED AT:**

917 Main Street  
921 Main Street  
Vineyard Haven, MA

### **PREPARED FOR:**

Edward Rowse Architects  
115 Cedar St  
Providence, RI 02903

### **PREPARED BY:**

Environmental Lead Inspector/Risk Assessor  
State of Massachusetts License (b) (6)  
(b) (6)

436 Gardners Neck Road  
Swansea, MA 02777  
TEL: 774-526-8223  
FAX: 508-674-8730  
ELD1988@comcast.net  
Project No.: 072814-01



## TABLE OF CONTENTS

|                                                       |    |
|-------------------------------------------------------|----|
| Executive Summary.....                                | 3  |
| Paint Sampling and Inspection .....                   | 4  |
| Identified LBP hazards .....                          | 7  |
| Conclusion.....                                       | 8  |
| Paint Chip Sampling & Laboratory Information.....     | 9  |
| Interior Dust Sampling & Laboratory Information ..... | 10 |
| Soil Sampling and Laboratory Information .....        | 11 |
| LBP hazard Control Options.....                       | 12 |
| Additional Notes.....                                 | 13 |
| LBP Hazard Control Plan .....                         | 13 |
| Appendix I XRF Lead-In-Paint Results                  |    |
| Appendix II Paint Chip Sampling Analytical Results    |    |
| Appendix III Dust Wipe Analytical Results             |    |
| Appendix IV Soil Sample Analytical Results            |    |
| Appendix V XRF Performance Characteristic Sheet       |    |

## EXECUTIVE SUMMARY

---

Rhode Island Analytical was contracted to evaluate two wood frame houses and detached garage known as West Chop 1 and 2 at West Chop Light, 917 & 921 Main Street, Vineyard Haven, MA. Both houses were built in the late 1800's and most of the surfaces would have originally been painted with lead-based paint (LBP). The garage has an unknown construction date.

According to information provided to this firm, in 1993 a remediation project was executed. At the time of this evaluation, it appears that the original exterior siding, porch floor and rail systems and some exterior trim work had been replaced. All of the window sashes have been replaced and vinyl window balances installed. Our observation is that many of the interior and exterior wooden trim components have had paint removed by either scraping or sanding methods. The walls on the first floor level of each house have been enclosed with gypsum board, the walls in the staircases and most rooms on the second floor levels have the original plaster walls coated with LBP. The majority of the painted surfaces are in sound condition.

The goal of this evaluation was to measure the extent of remaining lead hazards to determine if the properties are lead-safe. The testing methods employed included the use of the Radiation Monitoring Device (RMD) LPA-1, X-ray Fluorescence analyzer (including substrate correction measures), paint chip sampling, chemical spot testing by sodium rhodizonate, lead in dust sampling and lead in soil sampling.

Normally with houses of this age, we would find XRF results to be at the highest level an XRF would yield, with uniform results across entire surface areas. Our sampling found varying results on most of the wood trim work indicating that the paint layers had been inconsistently removed.

With the exception of limited areas with minor LBP damage and some surfaces with elevated lead in dust levels, the housing units are near to a lead-safe condition. Even though many of the surfaces have LBP over the regulatory thresholds, the fact that they are in sound condition would render them lead-safe. Although not an immediate hazard, levels of lead in soil over the acceptable thresholds were found around the perimeter of each house. The soil is currently not a hazard because of sufficient grass ground cover.

## PAINT SAMPLING AND INSPECTION

### XRF Findings

Testing was performed by (b) (6) Massachusetts Lead Inspector/Risk Assessor (b) (6) and (b) (6) Massachusetts Lead Inspector/Risk Assessor (b) (6) using the Radiation Monitoring Device (RMD) LPA-1 X-ray Fluorescence analyzer (S/N 2979, State of Massachusetts license (b) (6)). The XRF analyzer is designed to measure the lead content of surface coatings on a variety of building surfaces, substrates and components. The measurement is rapid and nondestructive, and according to the manufacturer, is capable of detecting lead concentrations that occur within numerous layers of various surface coatings.

The purpose of this Inspection effort is to give a general indication of the presence of lead based paint (LBP) on surfaces that are sealed with paints, stains, varnishes, shellacs, lacquers, epoxies, polyurethanes, etc. (Surface Coatings). This LBP Inspection is an interior and exterior investigation to identify all LBP on a representative surface-by-surface basis. A LBP Inspection conforming to HUD guidelines was performed on all applicable surfaces and components at the two dwelling units' interiors, building exteriors and detached garage. The XRF locations for the LBP Inspection were taken in HUD recommended areas and on HUD recommended components and substrates. A total of 614 tests (assays) were taken at all identified surfaces on the inside and outside of the targeted dwelling units using an x-ray fluorescence analyzer. Lead concentrations that meet or exceed the HUD published levels identified as being potentially dangerous (e. g., greater than or equal to 1.0 milligrams per centimeter square [ $\geq 1.0 \text{ mg/cm}^2$ ]) were encountered on interior walls, wall corner beads, ceilings, doors, door casings, door jambs, door stop, thresholds, baseboard, window casings, window sills, window aprons, window wells, shelves, closet shelves and supports, hutch components, stair risers, stair stringers, stair floor casing, and exterior corner boards, doors, door casings, door jambs, thresholds, kick plates, window casings, window sills, supports columns, down spout pan, garage siding, garage upper trim and garage window exterior sash/track.

Our sampling found varying results on most of the wood trim work indicating that the paint layers had been inconsistently removed during previous remediation projects. Fig 1 below is a good illustration of this. The picture is from a door casing inside of a closet. The black scroll separates two different levels of paint buildup. On the left side the paint was more effectively removed ( $1.3 \text{ mg/cm}^2$ ) while on the right side you can observe that there was paint left unremoved ( $9.9 \text{ mg/cm}^2$ ).



Fig. 1



## IDENTIFIED LBP HAZARDS

As of the date of the Evaluations, the exterior painted wood components of the structures were in reasonably good structural condition, as were the interior plaster and gypsum wallboard (GWB) wall surfaces and wood trim components.

Minor paint damage was observed on interior plaster walls, doors, door casings, door jambs, thresholds, window wells, baseboard, closet shelves and supports, closet walls and ceilings, stair risers, and stair floor casing.

Minor to moderate paint damage was observed on exterior support columns, thresholds, access door and garage upper trim. Upper trim and joists at 921 Main St. have moderate paint damage, were inaccessible, and should be assumed positive.

The analytical results from the samples collected, showed that LBP hazards exist, as defined in the Residential LBP Hazard Reduction Act of 1992 (Title X) and as defined by the Environmental Protection Agency (EPA) regulation published in the January 5, 2001 Federal Register. The Evaluation results indicate that lead levels meet or exceed the EPA and/or US Department of Housing and Urban Development (HUD) standards in the following locations:

### Existing lead hazards – 917 Main Street

- Minor paint damage on interior plaster walls, doors, door casings, door jambs, threshold, window wells, baseboard, closet shelves and supports, closet walls and ceilings.
- Minor paint damage on exterior support columns and threshold.
- Dust lead hazards were identified at one (1) interior window sill and two (2) interior window wells.

### Existing lead hazards – 921 Main Street

- Minor paint damage on interior plaster walls, doors, door casings, door jambs, window wells, baseboard, closet shelves and supports, closet walls and ceilings, stair risers, and stair floor casing.
- Minor to moderate paint damage on exterior support columns, threshold and access door, upper trim and joists.
- Moderate paint damage on exterior garage upper trim.
- Dust lead hazards were identified on one (1) floor, one (1) interior window sill and one (1) interior window well.

Hazard control options are discussed later in this report.

## CONCLUSION

---

Both properties are in an overall good condition. There are limited areas with minor to moderate LBP damage and some surfaces with elevated lead in dust levels. Even though many of the surfaces have LBP over the regulatory thresholds, the fact that they are in sound condition would render them lead-safe.

Our recommendation would be that properly trained personnel, following HUD, EPA and OSHA guidelines and/or regulations for Lead Safe Work Practices, make all damaged painted surfaces intact. Window wells should be securely covered with aluminum coil stock. Thorough cleaning should be conducted on all surfaces using a HEPA vacuum and a high phosphate cleaner. Post cleaning and prior to occupancy, a duly authorized inspector should conduct a visual inspection and dust sampling to ensure that the housing units are lead-safe to HUD standards. This, however, will not satisfy the Massachusetts definition of lead compliance.

Any component with deteriorated paint that is not tested and does not have a painting history similar to a tested component should be considered a LBP hazard. In the event that all paint tests are below the standard, the owner cannot presume that all surfaces in the dwelling are free of LBP, since not all surfaces were tested. Instead, the owner must have a complete lead-based paint inspection (not a risk assessment) performed to document the absence of lead-based paint on a property.

Although high levels of lead in soil were detected around the perimeter of each house, the soil is currently not a hazard because of sufficient grass ground cover. As long as covering remains in place the soil will be considered lead-safe.

**PAINT CHIP SAMPLING & LABORATORY INFORMATION**

A total of 9 confirmatory paint chip samples were collected, 8 from 917 Main Street and 1 from 921 Main Street. If paint contains lead equal to or greater than either of the following levels, it is considered to be LBP under the Lead-Based Paint Poisoning Prevention Act (5,000 µg/g (also expressed as 0.5 percent by weight, 5,000 mg/kg, or 5,000 ppm by weight). Paint chip samples analyzed in the laboratory by atomic absorption spectroscopy or inductively coupled plasma emission spectroscopy will usually be reported by weight percent. 1.0 mg/cm<sup>2</sup> (XRF machines report lead content by area). These are not equivalent standards. They are alternative standards, which are necessary because of the fundamentally different methods of measurement: the first is a concentration (mass over mass), and the second, "loading" (mass over area).

As indicated below, lead in paint quantities greater than EPA, HUD, and Massachusetts standards were detected in the two units tested. Out of 9 samples collected, 8 were over the regulatory thresholds. Please refer to *Appendix II Paint Sampling Analytical Results* for the laboratory reports.

**917 Main Street**

| Sample No.    | Location  | Component    | Substrate | Weight Total ug | Test Results Conc. By % |
|---------------|-----------|--------------|-----------|-----------------|-------------------------|
| 109078-001-1P | Liv. Room | Window Case  | Wood      | 12800           | 5.47%                   |
| 109078-002-2P | Din. Room | Door Case    | Wood      | 7460            | 2.39%                   |
| 109078-003-3P | Bedroom 3 | Wall         | Plaster   | 24700           | 7.19%                   |
| 109078-004-4P | Ext. B    | Window Case  | Wood      | 1730            | 0.531%                  |
| 109078-006-6P | Porch D   | Support Col. | Wood      | 37000           | 10.7%                   |
| 109078-007-7P | Porch A   | Support Col. | Wood      | 24300           | 7.23%                   |
| 109078-008-8P | Ext. D    | Window Sill  | Wood      | 2030            | 0.614%                  |

**921 Main Street**

| Sample No.    | Location   | Component   | Substrate | Sample Size (ft <sup>2</sup> ) | Test Results (µg/ft <sup>2</sup> ) |
|---------------|------------|-------------|-----------|--------------------------------|------------------------------------|
| 109077-001-9P | Bathroom 1 | Window sill | Wood      | 3770                           | 1.11%                              |

**Laboratory Information:**

Schneider Laboratories Global  
2512 W. Cary Street  
Richmond, Virginia 23220  
Phone (800) 785-5227

Paint Chip Analysis Protocol

EPA Method 7000B, using preparation method EPA 3050B

National Lead Laboratory Accreditation  
Program Serial number: #100527



**INTERIOR DUST SAMPLING & LABORATORY INFORMATION**

A total of 20 dust wipe samples were collected, 10 from each building, in an effort to help to determine the levels of lead-containing dust on the interior window sills, wells and floors. These samples were collected from areas most likely to be lead contaminated if lead-in-dust is present. EPA, HUD and State of Massachusetts regulations define the following as hazardous levels for lead dust in residences: floors –  $\geq 40 \mu\text{g}/\text{ft}^2$  (micrograms per square foot); interior windowsills –  $\geq 250 \mu\text{g}/\text{ft}^2$ ; and, interior window wells –  $\geq 400 \mu\text{g}/\text{ft}^2$ .

As indicated below, leaded dust in quantities greater than EPA, HUD, and Massachusetts standards were detected in the two units tested. Out of 20 samples collected at random locations, six were over the regulatory thresholds. All other testing locations registered lead levels below the EPA, HUD and State of Massachusetts standards. Please refer to *Appendix III Dust Wipe Analytical Results* for the laboratory reports.

**917 Main Street**

| Sample No.    | Location  | Component   | Substrate | Sample Size (ft <sup>2</sup> ) | Test Results ( $\mu\text{g}/\text{ft}^2$ ) |
|---------------|-----------|-------------|-----------|--------------------------------|--------------------------------------------|
| 109080-008-18 | Bedroom 3 | Window sill | Wood      | 0.711                          | 274                                        |
| 109080-009-19 | Liv. Room | Window well | Wood      | 0.944                          | 738                                        |
| 109080-010-20 | Bedroom 1 | Window well | Wood      | 0.642                          | 528                                        |

**921 Main Street**

| Sample No.    | Location  | Component   | Substrate | Sample Size (ft <sup>2</sup> ) | Test Results ( $\mu\text{g}/\text{ft}^2$ ) |
|---------------|-----------|-------------|-----------|--------------------------------|--------------------------------------------|
| 109079-001-1D | Liv. Room | Window sill | Wood      | 1.03                           | 12,100                                     |
| 109079-003-3D | Kitchen   | Floor       | Wood      | 1.00                           | 226                                        |
| 109079-009-9D | Liv. Room | Window well | Wood      | 0.977                          | 48,700                                     |

**Laboratory Information:**

Schneider Laboratories Global  
2512 W. Cary Street  
Richmond, Virginia 23220  
Phone (800) 785-5227

**Dust Analysis Protocol**

EPA Method 7000B, implementing a microwave-assisted digestion process.

National Lead Laboratory Accreditation  
Program Serial number: #100527

**SOIL SAMPLING AND LABORATORY INFORMATION**

A total of 8 composite soil samples were collected at these properties. A composite sample is a sample containing soil from a stated number of locations mixed together to form a composite sample. One composite sample was collected from each building side. The samples were collected from grass covered areas with very limited areas of bare soil.

The analytical results identified hazardous lead concentrations as defined by EPA and HUD in three (3) composite samples taken from 917 Main Street and four (4) composite samples taken from 921 Main Street. EPA and HUD define hazardous lead-in-soil levels as follows: High contact play areas –  $\geq 400$  ppm; all other bare soil areas –  $\geq 1,200$  ppm. Please refer to *Appendix IV - Soil Sample Analytical Results* for the laboratory reports. Listed below are the specific areas with soil-lead levels above EPA and HUD acceptable levels.

**917 Main Street**

| Sample No.    | Type      | Location         | Comments    | Test Results (ppm) |
|---------------|-----------|------------------|-------------|--------------------|
| 109076-002 1S | Composite | B Side Drip line | Grass Cover | 5820               |
| 109076-003 3S | Composite | C Side Drip line | Grass Cover | 1320               |
| 109076-004 4S | Composite | D Side Drip line | Grass Cover | 1810               |

**921 Main Street**

| Sample No.    | Type      | Location         | Comments    | Test Results (ppm) |
|---------------|-----------|------------------|-------------|--------------------|
| 109081-001 5S | Composite | A Side Drip line | Grass Cover | 2750               |
| 109081-002 6S | Composite | B Side Drip line | Grass Cover | 3880               |
| 109081-003 7S | Composite | C Side Drip line | Grass Cover | 2760               |
| 109081-004 8S | Composite | D Side Drip line | Grass Cover | 2710               |

**Laboratory Information:**

Schneider Laboratories Global  
2512 W. Cary Street  
Richmond, Virginia 23220  
Phone (800) 785-5227

**Soil Analysis Protocol**

EPA Method 7000B, implementing a microwave-assisted digestion process.

National Lead Laboratory Accreditation  
Program Serial number: #100527

## LBP HAZARD CONTROL OPTIONS

---

Lead-safe work practices and worker/occupant protection practices complying with current EPA, HUD and OSHA standards will be necessary to safely complete all work involving the disturbance of LBP coated surfaces and components. In addition, any work considered Lead Hazard Control would enlist the use of interim control (temporary) methods and/or abatement (permanent) methods. It should be noted that all lead hazard control activities have the potential of creating additional hazards, or even creating hazards that were not present before. Therefore, all designs, plans or specifications that are developed for lead hazard control should be developed by, a certified/licensed Project Designer. Additionally, all persons and/or firms performing lead hazard control activities must have received proper training in HUD Approved Lead-Safe Work Practices and/or EPA or state accredited/certified Lead Abatement. Details for the listed lead hazard control options and issues surrounding occupant/worker protection practices can be found in the publication entitled: *Guidelines for the Evaluation and Control of LBP Hazards in Housing (2012)* published by the HUD, as well as in the Occupational Safety and Health Administration (OSHA) regulations found in 29 CFR, Part 1926.62, known as the OSHA Lead Exposure in Construction Industry Standard.

**Interim controls**, as defined by HUD, means a set of measures designed to temporarily reduce human exposure to LBP hazards and/or lead containing materials. These activities include, but are not limited to: component and/or substrate repairs; paint and varnish repairs; the removal of dust-lead hazards; renovation; remodeling; maintenance; temporary containment; placement of seed, sod or other forms of vegetation over bare soil areas; the placement of at least 6 inches of an appropriate mulch material over an impervious material, laid on top of bare soil areas; the tilling of bare soil areas; extensive and specialized cleaning; and, ongoing LBP maintenance activities. Unless directed otherwise by more stringent requirements of State agencies, **ONLY** Persons who have received HUD approved lead-safe work practices training, from a HUD Approved training provider, must accomplish all renovation/remodeling/maintenance type work.

**Abatement**, as defined by HUD, means any set of measures designed to permanently eliminate LBP and/or LBP hazards. The product manufacturer and/or contractor must warrant abatement methods to last a minimum of twenty (20) years, or these methods must have a design life of at least twenty (20) years. These activities include, but are not necessarily limited to: the removal of LBP from substrates and components; the replacement of components or fixtures with lead containing materials and/or lead containing paint; the permanent enclosure of LBP with construction materials; the encapsulation of LBP with approved products; the removal or permanent covering (concrete or asphalt) of soil-lead hazards; and, extensive and specialized cleaning activities. All abatement work must be accomplished **ONLY** by properly trained and EPA or State licensed/certified staff using appropriate lead-safe work practices. All lead hazard control/abatement specifications, plans or designs should be detailed by a certified/licensed Project Designer.



## ADDITIONAL NOTES

---

Clean up of the remediated areas should be accomplished on an ongoing basis throughout all activities that impact or disturb any known or assumed lead containing materials (LCM) and Paint. When a material, surface coating, substrate, component, or surface is to be impacted as a result of any activity and the lead content is not known, those areas and/or items should be assumed to contain hazardous concentrations of lead. Accumulation of debris is not recommended, and all plastic drop cloths must be replaced and disposed of properly each day. All trash must be promptly and properly removed from the site and the area left clean and as close to original condition as possible. Following the HUD guidelines will help increase the chances of attaining HUD and State lead in dust clearance levels.

Great care should be taken by the Owner and Contractor if, at a later date, any repair, maintenance, remodeling or renovation activities disturb any paint where the concentrations of lead are not known. In lieu of any additional testing, all surfaces and paint should be assumed to contain hazardous and hazardous levels of lead.

## LBP HAZARD CONTROL PLAN

---

Except in the case of complete removal of all LBP, some level of ongoing management and maintenance of LBP hazards are recommended for all properties. Owners of some dwelling units may have adequate manage staff in place to address LBP concerns, but this new responsibility may not be understood. The Owner should assign responsibility for managing the various aspects of a LBP hazard control program. This program should be described in a LBP Hazard Control Policy Statement. The statement should document the owner's awareness of the LBP hazard problem and intention to control it. The statement should also authorize a specific individual to carry out the LBP hazard control plan.

**APPENDIX I**  
**XRF LEAD-IN-PAINT RESULTS**

---

West Chop 2 - 917 Main Street Vineyard Haven XRF Lead-In-Paint Results

| Component            | Substrate | Side | Condition | Floor | Room        | XRF-1              | XRF-2 | Results | Substrate Correction | Paint Chip Results |
|----------------------|-----------|------|-----------|-------|-------------|--------------------|-------|---------|----------------------|--------------------|
| Calibration          |           |      |           |       |             |                    | 0.9   |         |                      |                    |
| Calibration          |           |      |           |       |             |                    | 0.8   |         |                      |                    |
| Calibration          |           |      |           |       |             |                    | 0.9   |         |                      |                    |
| Wall                 | Gypsum    | A    | Intact    | 1     | Living Room |                    | -0.1  | Neg     |                      |                    |
| Wall                 | Gypsum    | B    | Intact    | 1     | Living Room |                    | -0.1  | Neg     |                      |                    |
| Wall                 | Gypsum    | C    | Intact    | 1     | Living Room |                    | 0.0   | Neg     |                      |                    |
| Wall                 | Gypsum    | D    | Intact    | 1     | Living Room |                    | -0.2  | Neg     |                      |                    |
| Baseboard            | Wood      | B    | Intact    | 1     | Living Room |                    | 9.9   | Pos     |                      |                    |
| Floor                | Wood      |      | Intact    | 1     | Living Room |                    | 0.0   | Neg     |                      |                    |
| Door                 | Wood      | B    | Intact    | 1     | Living Room |                    | 0.5   | Neg     |                      |                    |
| Door Casing          | Wood      | B    | Intact    | 1     | Living Room |                    | 0.0   | Neg     |                      |                    |
| Door Casing Header   | Wood      | B    | Intact    | 1     | Living Room |                    | 1.0   | Pos     |                      |                    |
| Door Jamb            | Wood      | B    | Intact    | 1     | Living Room |                    | 0.2   | Neg     |                      |                    |
| Window Sill          | Wood      | D    | Intact    | 1     | Living Room |                    | 0.3   | Neg     |                      |                    |
| Window Casing        | Wood      | D    | Intact    | 1     | Living Room | 3.2 Edge           | 0.1   | Pos     | 3.2/0.1 = 3.1        | 5.473              |
| Window Apron         | Wood      | D    | Intact    | 1     | Living Room |                    | -0.1  | Neg     |                      |                    |
| Window Interior Stop | Wood      | D    | Intact    | 1     | Living Room |                    | -0.2  | Neg     |                      |                    |
| Window Interior Sash | Wood      | D    | Intact    | 1     | Living Room |                    | 0.0   | Neg     |                      |                    |
| Window Exterior Sash | Wood      | D    | Intact    | 1     | Living Room |                    | 0.1   | Neg     |                      |                    |
| Window Well          | Wood      | D    | Intact    | 1     | Living Room |                    | 2.0   | Pos     |                      |                    |
| Radiator             | Metal     | A    | Intact    | 1     | Living Room |                    | -0.2  | Neg     |                      |                    |
| Pipe                 | Metal     | A    | Intact    | 1     | Living Room |                    | 0.0   | Neg     |                      |                    |
| Ceiling              | Plaster   |      | Intact    | 1     | Dining Room |                    | 0.1   | Neg     |                      |                    |
| Wall                 | Gypsum    | A    | Intact    | 1     | Dining Room |                    | -0.3  | Neg     |                      |                    |
| Wall                 | Gypsum    | B    | Intact    | 1     | Dining Room |                    | -0.1  | Neg     |                      |                    |
| Wall                 | Gypsum    | C    | Intact    | 1     | Dining Room |                    | -0.1  | Neg     |                      |                    |
| Wall                 | Gypsum    | D    | Intact    | 1     | Dining Room |                    | -0.2  | Neg     |                      |                    |
| Baseboard            | Wood      | B    | Intact    | 1     | Dining Room | 0.0 Outside Corner | 9.9   | Pos     |                      |                    |
| Floor                | Wood      |      | Intact    | 1     | Dining Room |                    | 0.0   | Neg     |                      |                    |
| Door                 | Wood      | D(L) | Intact    | 1     | Dining Room |                    | 0.1   | Neg     |                      |                    |
| Door Casing          | Wood      | D(L) | Intact    | 1     | Dining Room |                    | 3.5   | Pos     | 3.5/0.5 = 3.1        | 2.39               |
| Door Jamb            | Wood      | D(L) | Intact    | 1     | Dining Room |                    | 0.5   | Neg     |                      |                    |
| Door                 | Wood      | D(R) | Intact    | 1     | Dining Room |                    | 0.0   | Neg     |                      |                    |
| Door Casing          | Wood      | D(R) | Intact    | 1     | Dining Room |                    | 6.5   | Pos     |                      |                    |
| Door Jamb            | Wood      | D(R) | Intact    | 1     | Dining Room |                    | 4.6   | Pos     |                      |                    |



West Chop 2 - 917 Main Street Vineyard Haven XRF Lead-In-Paint Results

| Component            | Substrate | Side | Condition | Floor | Room        | XRF-1 | XRF-2 Results | Substrate Correction | Paint Chip Results |
|----------------------|-----------|------|-----------|-------|-------------|-------|---------------|----------------------|--------------------|
| Door Stop            | Wood      | A    | Intact    | 1     | Dining Room |       | 9.9 Pos       |                      |                    |
| Window Sill          | Wood      | B(R) | Intact    | 1     | Dining Room |       | -0.2 Neg      |                      |                    |
| Window Casing        | Wood      | B(R) | Intact    | 2     | Dining Room |       | 0.0 Neg       |                      |                    |
| Window Apron         | Wood      | B(R) | Intact    | 1     | Dining Room |       | 0.0 Neg       |                      |                    |
| Window Interior Stop | Wood      | B(R) | Intact    | 1     | Dining Room |       | -0.1 Neg      |                      |                    |
| Window Interior Sash | Wood      | B(R) | Intact    | 1     | Dining Room |       | 0.2 Neg       |                      |                    |
| Window Exterior Sash | Wood      | B(R) | Intact    | 1     | Dining Room |       | 0.1 Neg       |                      |                    |
| Window Well          | Wood      | B(R) | Intact    | 1     | Dining Room |       | 0.8 Neg       |                      |                    |
| Closet Door          | Wood      | D    | Intact    | 1     | Dining Room |       | 0.0 Neg       |                      |                    |
| Closet Door Casing   | Wood      | D    | Poor      | 1     | Dining Room |       | 5.9 Pos       |                      |                    |
| Closet Door Jamb     | Wood      | D    | Poor      | 1     | Dining Room |       | 2.9 Pos       |                      |                    |
| Closet Wall          | Plaster   | D    | Poor      | 1     | Dining Room |       | 9.9 Pos       |                      |                    |
| Closet Baseboard     | Wood      | D    | Poor      | 1     | Dining Room |       | 9.9 Pos       |                      |                    |
| Closet Shelf (Lower) | Wood      | D    | Intact    | 1     | Dining Room |       | 0.1 Neg       |                      |                    |
| Closet Shelf (Upper) | Wood      | D    | Poor      | 1     | Dining Room |       | 2.7 Pos       |                      |                    |
| Closet Shelf Support | Wood      | D    | Poor      | 1     | Dining Room |       | 9.9 Pos       |                      |                    |
| Closet Ceiling       | Plaster   | D    | Intact    | 1     | Dining Room |       | 0.0 Neg       |                      |                    |
| Radiator             | Metal     | A    | Intact    | 1     | Dining Room |       | -0.1 Neg      |                      |                    |
| Wall                 | Gypsum    | A    | Intact    | 1     | Laundry     |       | -0.2 Neg      |                      |                    |
| Wall                 | Gypsum    | B    | Intact    | 1     | Laundry     |       | 0.0 Neg       |                      |                    |
| Wall                 | Gypsum    | C    | Intact    | 1     | Laundry     |       | 0.1 Neg       |                      |                    |
| Wall                 | Gypsum    | D    | Intact    | 1     | Laundry     |       | -0.1 Neg      |                      |                    |
| Baseboard            | Wood      | C    | Poor      | 1     | Laundry     |       | 9.9 Pos       |                      |                    |
| Door Casing          | Wood      | D    | Intact    | 1     | Laundry     |       | 6.3 Pos       |                      |                    |
| Door Jamb            | Wood      | D    | Poor      | 1     | Laundry     |       | 9.9 Pos       |                      |                    |
| Threshold            | Wood      | D    | Intact    | 1     | Laundry     |       | -0.1 Neg      |                      |                    |
| Window Sill          | Wood      | C    | Intact    | 1     | Laundry     |       | 0.3 Neg       |                      |                    |
| Window Casing        | Wood      | C    | Intact    | 1     | Laundry     |       | 4.5 Pos       |                      |                    |
| Window Apron         | Wood      | C    | Intact    | 1     | Laundry     |       | 0.1 Neg       |                      |                    |
| Window Interior Stop | Wood      | C    | Intact    | 1     | Laundry     |       | -0.2 Neg      |                      |                    |
| Window Interior Sash | Wood      | C    | Intact    | 1     | Laundry     |       | 0.0 Neg       |                      |                    |
| Window Exterior Sash | Wood      | C    | Intact    | 1     | Laundry     |       | 0.0 Neg       |                      |                    |
| Window Well          | Wood      | C    | Poor      | 1     | Laundry     |       | 1.4 Pos       |                      |                    |
| Ceiling              | Plaster   |      | Intact    | 1     | Bathroom 1  |       | -0.3 Neg      |                      |                    |
| Wall                 | Gypsum    | A    | Intact    | 1     | Bathroom 1  |       | -0.2 Neg      |                      |                    |

West Chop 2 - 917 Main Street Vineyard Haven XRF Lead-In-Paint Results

| Component            | Substrate | Side | Condition | Floor | Room       | XRF-1              | XRF-2 | Results | Substrate<br>Correction | Paint Chip<br>Results |
|----------------------|-----------|------|-----------|-------|------------|--------------------|-------|---------|-------------------------|-----------------------|
| Wall                 | Gypsum    | B    | Intact    | 1     | Bathroom 1 |                    | -0.2  | Neg     |                         |                       |
| Wall                 | Gypsum    | C    | Intact    | 1     | Bathroom 1 |                    | -0.3  | Neg     |                         |                       |
| Wall                 | Gypsum    | D    | Intact    | 1     | Bathroom 1 |                    | 0.1   | Neg     |                         |                       |
| Baseboard            | Wood      | B    | Intact    | 1     | Bathroom 1 | 0.0 Outside Corner | 9.9   | Pos     |                         |                       |
| Door                 | Wood      | A    | Intact    | 1     | Bathroom 1 |                    | -0.3  | Neg     |                         |                       |
| Door Casing          | Wood      | A    | Intact    | 1     | Bathroom 1 |                    | 8.8   | Pos     |                         |                       |
| Door Jamb            | Wood      | A    | Intact    | 1     | Bathroom 1 |                    | 1.9   | Pos     |                         |                       |
| Threshold            | Wood      | A    | Intact    | 1     | Bathroom 1 |                    | 0.0   | Neg     |                         |                       |
| Window Sill          | Wood      | C    | Intact    | 1     | Bathroom 1 |                    | 0.2   | Neg     |                         |                       |
| Window Casing        | Wood      | C    | Intact    | 1     | Bathroom 1 |                    | 4.3   | Pos     |                         |                       |
| Window Apron         | Wood      | C    | Intact    | 1     | Bathroom 1 |                    | 0.0   | Neg     |                         |                       |
| Window Interior Stop | Wood      | C    | Intact    | 1     | Bathroom 1 |                    | -0.1  | Neg     |                         |                       |
| Window Interior Sash | Wood      | C    | Intact    | 1     | Bathroom 1 |                    | 0.1   | Neg     |                         |                       |
| Window Exterior Sash | Wood      | C    | Intact    | 1     | Bathroom 1 |                    | 0.2   | Neg     |                         |                       |
| Window Well          | Wood      | C    | Poor      | 1     | Bathroom 1 |                    | 1.9   | Pos     |                         |                       |
| Wall                 | Gypsum    | A    | Intact    | 1     | Foyer      |                    | -0.1  | Neg     |                         |                       |
| Wall                 | Gypsum    | B    | Intact    | 1     | Foyer      |                    | -0.3  | Neg     |                         |                       |
| Wall                 | Gypsum    | C    | Intact    | 1     | Foyer      |                    | -0.2  | Neg     |                         |                       |
| Wall                 | Gypsum    | D    | Intact    | 1     | Foyer      |                    | -0.1  | Neg     |                         |                       |
| Baseboard            | Wood      | B    | Intact    | 1     | Foyer      |                    | 9.9   | Pos     |                         |                       |
| Door Casing          | Wood      | A    | Intact    | 1     | Foyer      |                    | 1.0   | Pos     |                         |                       |
| Door Jamb            | Wood      | A    | Intact    | 1     | Foyer      |                    | 1.8   | Pos     |                         |                       |
| Threshold            | Wood      | A    | Intact    | 1     | Foyer      |                    | 0.1   | Neg     |                         |                       |
| Door                 | Wood      | D    | Friction  | 1     | Foyer      |                    | 2.2   | Pos     |                         |                       |
| Door Casing          | Wood      | D    | Intact    | 1     | Foyer      |                    | 0.0   | Neg     |                         |                       |
| Door Jamb            | Wood      | D    | Intact    | 1     | Foyer      |                    | 2.1   | Pos     |                         |                       |
| Threshold            | Wood      | D    | Intact    | 1     | Foyer      |                    | -0.1  | Neg     |                         |                       |
| Wall                 | Gypsum    | A    | Intact    | 1     | Kitchen    |                    | 0.0   | Neg     |                         |                       |
| Wall                 | Gypsum    | B    | Intact    | 1     | Kitchen    |                    | 0.1   | Neg     |                         |                       |
| Wall                 | Gypsum    | C    | Intact    | 1     | Kitchen    |                    | -0.1  | Neg     |                         |                       |
| Wall                 | Gypsum    | D    | Intact    | 1     | Kitchen    |                    | 0.1   | Neg     |                         |                       |
| Baseboard            | Wood      | B    | Intact    | 1     | Kitchen    |                    | 9.9   | Pos     |                         |                       |
| Door                 | Wood      | B(R) | Intact    | 1     | Kitchen    |                    | 0.0   | Neg     |                         |                       |
| Door Casing          | Wood      | B(R) | Intact    | 1     | Kitchen    |                    | 1.4   | Pos     |                         |                       |
| Door Jamb            | Wood      | B(R) | Intact    | 1     | Kitchen    |                    | 2.4   | Pos     |                         |                       |

West Chop 2 - 917 Main Street Vineyard Haven XRF Lead-In-Paint Results

| Component            | Substrate | Side | Condition | Floor | Room      | XRF-1      | XRF-2 | Results | Substrate Correction | Paint Chip Results |
|----------------------|-----------|------|-----------|-------|-----------|------------|-------|---------|----------------------|--------------------|
| Door Casing          | Wood      | C    | Intact    | 1     | Kitchen   |            | 1.0   | Pos     |                      |                    |
| Threshold            | Wood      | C    | Intact    | 1     | Kitchen   |            | 0.0   | Neg     |                      |                    |
| Window Sill          | Wood      | C    | Intact    | 1     | Kitchen   |            | -0.3  | Neg     |                      |                    |
| Window Casing        | Wood      | C    | Intact    | 1     | Kitchen   |            | -0.2  | Neg     |                      |                    |
| Window Apron         | Wood      | C    | Intact    | 1     | Kitchen   |            | -0.2  | Neg     |                      |                    |
| Window Interior Stop | Wood      | C    | Intact    | 1     | Kitchen   |            | 0.0   | Neg     |                      |                    |
| Window Interior Sash | Wood      | C    | Intact    | 1     | Kitchen   |            | -0.1  | Neg     |                      |                    |
| Window Exterior Sash | Wood      | C    | Intact    | 1     | Kitchen   |            | 0.1   | Neg     |                      |                    |
| Window Well          | Wood      | C    | Intact    | 1     | Kitchen   |            | 7.3   | Pos     |                      |                    |
| Ceiling              | Plaster   |      | Intact    | 1     | Staircase |            | 1.0   | Pos     |                      |                    |
| Wall                 | Plaster   | A    | Intact    | 1     | Staircase |            | 3.3   | Pos     |                      |                    |
| Wall                 | Plaster   | B    | Intact    | 1     | Staircase |            | 9.9   | Pos     |                      |                    |
| Wall                 | Plaster   | C    | Intact    | 1     | Staircase |            | 9.9   | Pos     |                      |                    |
| Wall                 | Plaster   | D    | Intact    | 1     | Staircase |            | 9.9   | Pos     |                      |                    |
| Baseboard            | Wood      | B    | Intact    | 1     | Staircase |            | 9.9   | Pos     |                      |                    |
| Door                 | Wood      | A    | Intact    | 1     | Staircase |            | -0.2  | Neg     |                      |                    |
| Door Casing          | Wood      | A    | Intact    | 1     | Staircase | 9.4 Edge   | 0.7   | Pos     |                      |                    |
| Door Jamb            | Wood      | A    | Poor      | 1     | Staircase | 9.9 Header | 5.0   | Pos     |                      |                    |
| Threshold            | Wood      | A    | Intact    | 1     | Staircase |            | -0.2  | Neg     |                      |                    |
| Door                 | Wood      | B    | Intact    | 1     | Staircase |            | 0.0   | Neg     |                      |                    |
| Window Sill          | Wood      | A    | Intact    | 1     | Staircase |            | -0.2  | Neg     |                      |                    |
| Window Casing        | Wood      | A    | Intact    | 1     | Staircase |            | 3.1   | Pos     |                      |                    |
| Window Apron         | Wood      | A    | Intact    | 1     | Staircase |            | 1.2   | Pos     |                      |                    |
| Window Interior Stop | Wood      | A    | Intact    | 1     | Staircase |            | 0.3   | Neg     |                      |                    |
| Window Interior Sash | Wood      | A    | Intact    | 1     | Staircase |            | 0.1   | Neg     |                      |                    |
| Window Exterior Sash | Wood      | A    | Intact    | 1     | Staircase |            | 0.0   | Neg     |                      |                    |
| Window Well          | Wood      | A    | Poor      | 1     | Staircase |            | 1.9   | Pos     |                      |                    |
| Newel Post           | Wood      |      | Intact    | 1     | Staircase |            | 0.1   | Neg     |                      |                    |
| Railing Cap          | Wood      |      | Intact    | 1     | Staircase |            | -0.1  | Neg     |                      |                    |
| Handrail             | Wood      |      | Intact    | 1     | Staircase |            | -0.2  | Neg     |                      |                    |
| Baluster             | Wood      |      | Intact    | 1     | Staircase |            | 0.0   | Neg     |                      |                    |
| Stair Tread          | Wood      |      | Intact    | 1     | Staircase |            | 0.2   | Neg     |                      |                    |
| Stair Riser          | Wood      |      | Intact    | 1     | Staircase |            | 9.9   | Pos     |                      |                    |
| Stringer             | Wood      |      | Intact    | 1     | Staircase |            | 9.9   | Pos     |                      |                    |
| Door                 | Wood      | A/R  | Poor      | 2     | Staircase |            | 4.7   | Pos     |                      |                    |



West Chop 2 - 917 Main Street Vineyard Haven XRF Lead-In-Paint Results

| Component             | Substrate | Side | Condition | Floor | Room      | XRF-1       | XRF-2 Results | Substrate Correction | Paint Chip Results |
|-----------------------|-----------|------|-----------|-------|-----------|-------------|---------------|----------------------|--------------------|
| Door Casing           | Wood      | A(R) | Intact    | 2     | Staircase |             | 0.3 Neg       |                      |                    |
| Door Jamb             | Wood      | A(R) | Poor      | 2     | Staircase |             | 4.5 Pos       |                      |                    |
| Closest Door          | Wood      | A    | Intact    | 2     | Staircase |             | 3.5 Pos       |                      |                    |
| Closest Door Casing   | Wood      | A    | Intact    | 2     | Staircase |             | 0.7 Neg       |                      |                    |
| Closest Door Jamb     | Wood      | A    | Intact    | 2     | Staircase |             | 5.0 Pos       |                      |                    |
| Closest Wall          | Plaster   | A    | Intact    | 2     | Staircase |             | 9.9 Pos       |                      |                    |
| Closest Baseboard     | Wood      | A    | Intact    | 2     | Staircase |             | 9.9 Pos       |                      |                    |
| Closest Shelf         | Wood      | A    | Intact    | 2     | Staircase |             | 7.1 Pos       |                      |                    |
| Closest Shelf Support | Wood      | A    | Intact    | 2     | Staircase |             | 7.0 Pos       |                      |                    |
| Closest Ceiling       | Plaster   | A    | Intact    | 2     | Staircase |             | 9.9 Pos       |                      |                    |
| Radiator              | Metal     | B    | Intact    | 2     | Staircase |             | -0.3 Neg      |                      |                    |
| Ceiling               | Plaster   |      | Intact    | 2     | Bedroom 1 |             | 4.9 Pos       |                      |                    |
| Wall                  | Plaster   | A    | Intact    | 2     | Bedroom 1 |             | 6.7 Pos       |                      |                    |
| Wall                  | Plaster   | B    | Intact    | 2     | Bedroom 1 |             | 6.3 Pos       |                      |                    |
| Wall                  | Plaster   | C    | Intact    | 2     | Bedroom 1 |             | 4.0 Pos       |                      |                    |
| Wall                  | Plaster   | D    | Intact    | 2     | Bedroom 1 |             | 7.1 Pos       |                      |                    |
| Baseboard             | Wood      | A    | Intact    | 2     | Bedroom 1 |             | 9.9 Pos       |                      |                    |
| Floor                 | Wood      |      | Intact    | 2     | Bedroom 1 |             | 0.0 Neg       |                      |                    |
| Door                  | Wood      | C(L) | Intact    | 2     | Bedroom 1 |             | 0.0 Neg       |                      |                    |
| Door Casing           | Wood      | C(L) | Intact    | 2     | Bedroom 1 |             | 1.0 Pos       |                      |                    |
| Door Jamb             | Wood      | C(L) | Poor      | 2     | Bedroom 1 |             | 6.4 Pos       |                      |                    |
| Window Sill           | Wood      | A    | Intact    | 2     | Bedroom 1 |             | 2.2 Pos       |                      |                    |
| Window Casing         | Wood      | A    | Intact    | 2     | Bedroom 1 | 7.6 molding | 1.0 Pos       |                      |                    |
| Window Apron          | Wood      | A    | Intact    | 2     | Bedroom 1 |             | 2.6 Pos       |                      |                    |
| Window Interior Stop  | Wood      | A    | Intact    | 2     | Bedroom 1 |             | 0.1 Neg       |                      |                    |
| Window Interior Sash  | Wood      | A    | Intact    | 2     | Bedroom 1 |             | 0.2 Neg       |                      |                    |
| Window Exterior Sash  | Wood      | A    | Intact    | 2     | Bedroom 1 |             | 0.1 Neg       |                      |                    |
| Window Wall           | Wood      | A    | Poor      | 2     | Bedroom 1 |             | 6.8 Pos       |                      |                    |
| Window I Hook         | Metal     | A    | Intact    | 2     | Bedroom 1 |             | 0.4 Neg       |                      |                    |
| Closest Door          | Wood      | C    | Intact    | 2     | Bedroom 1 |             | -0.2 Neg      |                      |                    |
| Closest Door Casing   | Wood      | C    | Poor      | 2     | Bedroom 1 | 9.9 Header  | 1.7 Pos       |                      |                    |
| Closest Door Jamb     | Wood      | C    | Intact    | 2     | Bedroom 1 |             | 3.4 Pos       |                      |                    |
| Closest Wall          | Plaster   | C    | Intact    | 2     | Bedroom 1 |             | 9.9 Pos       |                      |                    |
| Closest Baseboard     | Wood      | C    | Intact    | 2     | Bedroom 1 |             | 6.0 Pos       |                      |                    |
| Closest Ceiling       | Plaster   | C    | Intact    | 2     | Bedroom 1 |             | 9.9 Pos       |                      |                    |

West Chop 2 - 917 Main Street Vineyard Haven XRF Lead-In-Paint Results

| Component            | Substrate | Side | Condition | Floor | Room       | XRF-1 | XRF-2 Results | Substrate Correction | Paint Chip Results |
|----------------------|-----------|------|-----------|-------|------------|-------|---------------|----------------------|--------------------|
| Radiator             | Metal     | B    | Intact    | 2     | Bedroom 1  |       | 0.1 Neg       |                      |                    |
| Ceiling              | Plaster   |      | Intact    | 2     | Bedroom 2  |       | 7.2 Pos       |                      |                    |
| Wall                 | Plaster   | A    | Intact    | 2     | Bedroom 2  |       | 7.5 Pos       |                      |                    |
| Wall                 | Plaster   | B    | Intact    | 2     | Bedroom 2  |       | 7.0 Pos       |                      |                    |
| Wall                 | Plaster   | C    | Intact    | 2     | Bedroom 2  |       | 7.1 Pos       |                      |                    |
| Wall                 | Plaster   | D    | Intact    | 2     | Bedroom 2  |       | 9.9 Pos       |                      |                    |
| Baseboard            | Wood      | B    | Poor      | 2     | Bedroom 2  |       | 9.9 Pos       |                      |                    |
| Floor                | Wood      |      | Intact    | 2     | Bedroom 2  |       | 0.0 Neg       |                      |                    |
| Door                 | Wood      | D    | Intact    | 2     | Bedroom 2  |       | -0.3 Neg      |                      |                    |
| Door Casing          | Wood      | D    | Intact    | 2     | Bedroom 2  |       | 2.8 Pos       |                      |                    |
| Door Jamb            | Wood      | D    | Intact    | 2     | Bedroom 2  |       | 5.5 Pos       |                      |                    |
| Access Door          | Wood      | CIR  | Poor      | 2     | Bedroom 2  |       | 3.2 Pos       |                      |                    |
| Access Door Frame    | Wood      | CIR  | Poor      | 2     | Bedroom 2  |       | 5.5 Pos       |                      |                    |
| Window Sill          | Wood      | B    | Intact    | 2     | Bedroom 2  |       | 3.8 Pos       |                      |                    |
| Window Casing        | Wood      | B    | Intact    | 2     | Bedroom 2  |       | 1.4 Pos       |                      |                    |
| Window Apron         | Wood      | B    | Intact    | 2     | Bedroom 2  |       | 3.5 Pos       |                      |                    |
| Window Interior Stop | Wood      | B    | Intact    | 2     | Bedroom 2  |       | 0.2 Neg       |                      |                    |
| Window Interior Sash | Wood      | B    | Intact    | 2     | Bedroom 2  |       | 0.1 Neg       |                      |                    |
| Window Exterior Sash | Wood      | B    | Intact    | 2     | Bedroom 2  |       | 0.1 Neg       |                      |                    |
| Window Well          | Wood      | B    | Poor      | 2     | Bedroom 2  |       | 2.4 Pos       |                      |                    |
| Window I Hook        | Metal     | B    | Intact    | 2     | Bedroom 2  |       | 0.4 Neg       |                      |                    |
| Radiator             | Metal     | A    | Intact    | 2     | Bedroom 2  |       | -0.1 Neg      |                      |                    |
| Ceiling              | Plaster   |      | Intact    | 2     | Bathroom 2 |       | -0.2 Neg      |                      |                    |
| Wall                 | Gypsum    | A    | Intact    | 2     | Bathroom 2 |       | 0.1 Neg       |                      |                    |
| Wall                 | Gypsum    | B    | Intact    | 2     | Bathroom 2 |       | 0.0 Neg       |                      |                    |
| Wall                 | Gypsum    | C    | Intact    | 2     | Bathroom 2 |       | 0.2 Neg       |                      |                    |
| Wall                 | Gypsum    | D    | Intact    | 2     | Bathroom 2 |       | 0.0 Neg       |                      |                    |
| Baseboard            | Wood      | B    | Intact    | 2     | Bathroom 2 |       | 0.1 Neg       |                      |                    |
| Chair rail           | Wood      | B    | Intact    | 2     | Bathroom 2 |       | -0.1 Neg      |                      |                    |
| Door                 | Wood      | A    | Intact    | 2     | Bathroom 2 |       | -0.2 Neg      |                      |                    |
| Door Casing          | Wood      | A    | Intact    | 2     | Bathroom 2 |       | 0.0 Neg       |                      |                    |
| Door Jamb            | Wood      | A    | Intact    | 2     | Bathroom 2 |       | 0.1 Neg       |                      |                    |
| Window Sill          | Wood      | 3    | Intact    | 2     | Bathroom 2 |       | -0.1 Neg      |                      |                    |
| Window Casing        | Wood      | 3    | Intact    | 2     | Bathroom 2 |       | 0.0 Neg       |                      |                    |
| Window Apron         | Wood      | 3    | Intact    | 2     | Bathroom 2 |       | 0.1 Neg       |                      |                    |

West Chop 2 - 917 Main Street Vineyard Haven XRF Lead-In-Paint Results

| Component            | Substrate | Side | Condition | Floor | Room       | XRF-1      | XRF-2 Results | Substrate Correction | Paint Chip Results |
|----------------------|-----------|------|-----------|-------|------------|------------|---------------|----------------------|--------------------|
| Window Interior Stop | Wood      | 3    | Intact    | 2     | Bathroom 2 |            | -0.1 Neg      |                      |                    |
| Window Interior Sash | Wood      | B    | Intact    | 2     | Bathroom 2 |            | 0.1 Neg       |                      |                    |
| Window Exterior Sash | Wood      | B    | Intact    | 2     | Bathroom 2 |            | 0.2 Neg       |                      |                    |
| Window Wall          | Wood      | B    | Poor      | 2     | Bathroom 2 |            | 3.3 Pos       |                      |                    |
| Window I Hook        | Metal     | B    | Intact    | 2     | Bathroom 2 |            | 0.1 Neg       |                      |                    |
| Radiator             | Metal     | C    | Intact    | 2     | Bathroom 2 |            | -0.1 Neg      |                      |                    |
| Ceiling              | Plaster   |      | Intact    | 2     | Bedroom 3  |            | 5.3 Pos       |                      |                    |
| Wall                 | Plaster   | A    | Intact    | 2     | Bedroom 3  |            | 5.0 Pos       |                      |                    |
| Wall                 | Plaster   | B    | Intact    | 2     | Bedroom 3  |            | 7.3 Pos       |                      |                    |
| Wall                 | Plaster   | C    | Poor      | 2     | Bedroom 3  |            | 4.6 Pos       | 4.6/0.3 = 4.3        | 7.19               |
| Wall                 | Plaster   | D    | Intact    | 2     | Bedroom 3  |            | 5.3 Pos       |                      |                    |
| Baseboard            | Wood      | B    | Poor      | 2     | Bedroom 3  |            | 9.9 Pos       |                      |                    |
| Floor                | Wood      |      | Intact    | 2     | Bedroom 3  |            | 0.1 Neg       |                      |                    |
| Door                 | Wood      | B    | Intact    | 2     | Bedroom 3  |            | -0.2 Neg      |                      |                    |
| Door Casings         | Wood      | B    | Intact    | 2     | Bedroom 3  |            | 0.1 Neg       |                      |                    |
| Door Jamb            | Wood      | B    | Intact    | 2     | Bedroom 3  |            | 8.8 Pos       |                      |                    |
| Access Door          | Wood      | D    | Intact    | 2     | Bedroom 3  |            | -0.3 Neg      |                      |                    |
| Access Door Frame    | Wood      | D    | Intact    | 2     | Bedroom 2  |            | 0.2 Neg       |                      |                    |
| Window Sill          | Wood      | D    | Intact    | 2     | Bedroom 3  |            | 0.3 Neg       |                      |                    |
| Window Casings       | Wood      | D    | Intact    | 2     | Bedroom 3  |            | 0.4 Neg       |                      |                    |
| Window Apron         | Wood      | D    | Intact    | 2     | Bedroom 3  |            | 4.0 Pos       |                      |                    |
| Window Interior Stop | Wood      | D    | Intact    | 2     | Bedroom 3  |            | -0.1 Neg      |                      |                    |
| Window Interior Sash | Wood      | D    | Intact    | 2     | Bedroom 3  |            | 0.1 Neg       |                      |                    |
| Window Exterior Sash | Wood      | D    | Intact    | 2     | Bedroom 3  |            | 0.2 Neg       |                      |                    |
| Window Wall          | Wood      | D    | Poor      | 2     | Bedroom 3  |            | 1.0 Pos       |                      |                    |
| Window I Hook        | Metal     | D    | Intact    | 2     | Bedroom 3  |            | 0.0 Neg       |                      |                    |
| Closet Door          | Wood      | A    | Intact    | 2     | Bedroom 3  |            | 0.0 Neg       |                      |                    |
| Closet Door Casings  | Wood      | A    | Intact    | 2     | Bedroom 3  | 9.9 Header | 2.0 Pos       |                      |                    |
| Closet Door Jamb     | Wood      | A    | Poor      | 2     | Bedroom 3  |            | 3.7 Pos       |                      |                    |
| Closet Wall          | Plaster   | A    | Poor      | 2     | Bedroom 3  |            | 9.9 Pos       |                      |                    |
| Closet Baseboard     | Wood      | A    | Intact    | 2     | Bedroom 3  |            | 9.9 Pos       |                      |                    |
| Closet Shelf         | Wood      | A    | Intact    | 2     | Bedroom 3  |            | 0.1 Neg       |                      |                    |
| Closet Shelf Support | Wood      | A    | Poor      | 2     | Bedroom 3  |            | 9.9 Pos       |                      |                    |
| Radiator             | Metal     | A    | Intact    | 2     | Bedroom 3  |            | -0.2 Neg      |                      |                    |
| Wall                 | Plaster   | A    | Intact    | 2     | Hall       |            | 7.6 Pos       |                      |                    |



West Chop 2 - 917 Main Street Vineyard Haven XRF Lead-In-Paint Results

| Component             | Substrate | Side | Condition | Floor | Room     | XRF-1      | XRF-2 Results | Substrate Correction | Paint Chip Results |
|-----------------------|-----------|------|-----------|-------|----------|------------|---------------|----------------------|--------------------|
| Wall                  | Plaster   | B    | Intact    | 2     | Hall     |            | 6.6 Pos       |                      |                    |
| Wall                  | Plaster   | C    | Intact    | 2     | Hall     |            | 0.1 Neg       |                      |                    |
| Wall                  | Plaster   | D    | Intact    | 2     | Hall     |            | 9.9 Pos       |                      |                    |
| Baseboard             | Wood      | D    | Intact    | 2     | Hall     |            | 7.7 Pos       |                      |                    |
| Door                  | Wood      | B    | Intact    | 2     | Hall     |            | -0.1 Neg      |                      |                    |
| Door Casing           | Wood      | B    | Intact    | 2     | Hall     |            | -0.1 Neg      |                      |                    |
| Door Jamb             | Wood      | B    | Intact    | 2     | Hall     | 3.5 Header | 0.8 Pos       |                      |                    |
| Wall                  | Wood      | A    | Intact    |       | Exterior |            | -0.1 Neg      |                      |                    |
| Wall                  | Wood      | B    | Intact    |       | Exterior |            | -0.3 Neg      |                      |                    |
| Wall                  | Wood      | C    | Intact    |       | Exterior |            | 0.0 Neg       |                      |                    |
| Wall                  | Wood      | D    | Intact    |       | Exterior |            | -0.1 Neg      |                      |                    |
| Cornerboard           | Wood      | B    | Intact    |       | Exterior |            | 4.5 Pos       |                      |                    |
| Cornerboard           | Wood      | D    | Intact    |       | Exterior | 4.5 Edge   | 1.8 Pos       |                      |                    |
| Lower Trim            | Wood      | B    | Intact    |       | Exterior |            | -0.2 Neg      |                      |                    |
| Door                  | Wood      | A    | Intact    |       | Exterior |            | -0.2 Neg      |                      |                    |
| Door Casing           | Wood      | A    | Intact    |       | Exterior |            | 0.1 Neg       |                      |                    |
| Door Jamb             | Wood      | A    | Intact    |       | Exterior |            | 2.2 Pos       |                      |                    |
| Threshold             | Wood      | A    | Intact    |       | Exterior |            | 2.8 Pos       |                      |                    |
| Kickplate             | Wood      | A    | Intact    |       | Exterior |            | 1.5 Pos       |                      |                    |
| Window Sill           | Wood      | A    | Intact    |       | Exterior | 9.9 Edge   | 0.1 Pos       |                      |                    |
| Window Casing         | Wood      | A    | Intact    |       | Exterior |            | 5.3 Pos       |                      |                    |
| Window Sill           | Wood      | B(R) | Intact    |       | Exterior | 9.9 Edge   | 0.3 Pos       |                      |                    |
| Window Casing         | Wood      | B(R) | Intact    |       | Exterior |            | 2.8 Pos       | 2.8/0.2 = 2.6        | 0.531%             |
| Window Sill           | Wood      | D(R) | Intact    |       | Exterior | 9.9 Edge   | 1.5 Pos       |                      | 0.614%             |
| Window Casing         | Wood      | D(R) | Intact    |       | Exterior | 1.6 Edge   | -0.3 Pos      |                      |                    |
| Access Door           | Wood      | B    | Intact    |       | Exterior |            | 9.9 Pos       |                      |                    |
| Access Door Casing    | Wood      | B    | Intact    |       | Exterior |            | 2.0 Pos       |                      |                    |
| Access Door Threshold | Wood      | B    | Intact    |       | Exterior |            | 3.7 Pos       |                      |                    |
| Foundation            | Concrete  | A    | Intact    |       | Exterior |            | -0.1 Neg      |                      |                    |
| Down Spout Pan        | Concrete  | A    | Intact    |       | Exterior |            | 1.6 Pos       |                      |                    |
| Foundation Skirt      | Concrete  | A    | Intact    |       | Exterior |            | 0.7 Neg       |                      |                    |
| Cellar Window Sill    | Wood      | A    | Intact    |       | Exterior |            | 0.0 Neg       |                      |                    |
| Cellar Window Frame   | Wood      | A    | Intact    |       | Exterior |            | -0.1 Neg      |                      |                    |
| Bulkhead Door         | Wood      | C    | Intact    |       | Exterior |            | 0.0 Neg       |                      |                    |
| Bulkhead Door Frame   | Wood      | C    | Intact    |       | Exterior |            | 0.2 Neg       |                      |                    |

West Chop 1 - 921 Main Street Vineyard Haven XRF Lead-In-Paint Results

| Component            | Substrate | Side | Condition | Floor | Room        | XRF-1       | XRF-2 | Results | Substrate Correction | Paint Chip Results |
|----------------------|-----------|------|-----------|-------|-------------|-------------|-------|---------|----------------------|--------------------|
| Calibration          |           |      |           |       |             |             | 1.0   |         |                      |                    |
| Calibration          |           |      |           |       |             |             | 0.9   |         |                      |                    |
| Calibration          |           |      |           |       |             |             | 0.9   |         |                      |                    |
| Wall                 | Gypsum    | A    | Intact    | 1     | Living Room |             | -0.1  | Neg     |                      |                    |
| Wall                 | Gypsum    | B    | Intact    | 1     | Living Room |             | 0.0   | Neg     |                      |                    |
| Wall                 | Gypsum    | C    | Intact    | 1     | Living Room |             | -0.3  | Neg     |                      |                    |
| Wall                 | Gypsum    | D    | Intact    | 1     | Living Room |             | -0.2  | Neg     |                      |                    |
| Baseboard            | Wood      | B    | Intact    | 1     | Living Room |             | 6.1   | Pos     |                      |                    |
| Floor                | Wood      |      | Intact    | 1     | Living Room |             | 0.1   | Neg     |                      |                    |
| Door Casing          | Wood      | D    | Intact    | 1     | Living Room | 6.7 Molding | 0.7   | Pos     |                      |                    |
| Door Jamb            | Wood      | B    | Intact    | 1     | Living Room | Covered     | 0.3   | Neg     |                      |                    |
| Window Sill          | Wood      | B    | Intact    | 1     | Living Room |             | 0.2   | Neg     |                      |                    |
| Window Casing        | Wood      | B    | Intact    | 1     | Living Room |             | 0.0   | Neg     |                      |                    |
| Window Apron         | Wood      | B    | Intact    | 1     | Living Room |             | 0.4   | Neg     |                      |                    |
| Window Interior Stop | Wood      | B    | Intact    | 1     | Living Room |             | -0.1  | Neg     |                      |                    |
| Window Interior Sash | Wood      | B    | Intact    | 1     | Living Room |             | 0.0   | Neg     |                      |                    |
| Window Exterior Sash | Wood      | B    | Intact    | 1     | Living Room |             | 0.2   | Neg     |                      |                    |
| Window Well          | Wood      | B    | Intact    | 1     | Living Room |             | 5.7   | Pos     |                      |                    |
| Radiator             | Metal     | A    | Intact    | 1     | Living Room |             | -0.2  | Neg     |                      |                    |
| Wall                 | Gypsum    | A    | Intact    | 1     | Kitchen     |             | 0.1   | Neg     |                      |                    |
| Wall                 | Gypsum    | B    | Intact    | 1     | Kitchen     |             | -0.1  | Neg     |                      |                    |
| Wall                 | Gypsum    | C    | Intact    | 1     | Kitchen     |             | -0.1  | Neg     |                      |                    |
| Wall                 | Gypsum    | D    | Intact    | 1     | Kitchen     |             | 0.0   | Neg     |                      |                    |
| Baseboard            | Wood      | A    | Intact    | 1     | Kitchen     |             | -0.1  | Neg     |                      |                    |
| Door                 | Wood      | A(L) | Intact    | 1     | Kitchen     |             | 0.0   | Neg     |                      |                    |
| Door Casing          | Wood      | A(L) | Intact    | 1     | Kitchen     |             | 0.0   | Neg     |                      |                    |
| Door Jamb            | Wood      | A(L) | Intact    | 1     | Kitchen     |             | 0.3   | Neg     |                      |                    |
| Window Sill          | Wood      | B    | Intact    | 1     | Kitchen     |             | 0.1   | Neg     |                      |                    |
| Window Casing        | Wood      | B    | Intact    | 1     | Kitchen     |             | 0.0   | Neg     |                      |                    |
| Window Apron         | Wood      | B    | Intact    | 1     | Kitchen     |             | -0.1  | Neg     |                      |                    |
| Window Interior Stop | Wood      | B    | Intact    | 1     | Kitchen     |             | -0.2  | Neg     |                      |                    |
| Window Interior Sash | Wood      | B    | Intact    | 1     | Kitchen     |             | 0.1   | Neg     |                      |                    |
| Window Exterior Sash | Wood      | B    | Intact    | 1     | Kitchen     |             | 0.0   | Neg     |                      |                    |
| Window Well          | Wood      | B    | Intact    | 1     | Kitchen     |             | 1.4   | Pos     |                      |                    |
| Closet Door          | Wood      | A    | Intact    | 1     | Kitchen     |             | 0.0   | Neg     |                      |                    |

West Chop 2 - 917 Main Street Vineyard Haven XRF Lead-In-Paint Results

| Component        | Substrate | Side | Condition | Floor | Room  | XRF-1    | XRF-2 Results | Substrate Correction | Paint Chip Results |
|------------------|-----------|------|-----------|-------|-------|----------|---------------|----------------------|--------------------|
| Railing Cap      | Wood      | A    | Intact    |       | Porch |          | -0.1 Neg      |                      |                    |
| Stair Tread      | Wood      | A    | Intact    |       | Porch |          | 0.0 Neg       |                      |                    |
| Stair Riser      | Wood      | A    | Intact    |       | Porch |          | -0.3 Neg      |                      |                    |
| Support Column   | Wood      | A    | Poor      |       | Porch |          | 9.9 Pos       | 9.9/0.5 = 9.4        | 10.7%              |
| Floor            | Wood      | A    | Intact    |       | Porch |          | 0.0 Neg       |                      |                    |
| Lower Trim       | Wood      | A    | Intact    |       | Porch |          | -0.1 Neg      |                      |                    |
| Door             | Wood      | D    | Intact    |       | Porch |          | 2.8 Pos       |                      |                    |
| Door Casing      | Wood      | D    | Intact    |       | Porch |          | 2.4 Pos       | 2.4/0.1 = 2.3        | 0.475%             |
| Door Jamb        | Wood      | D    | Intact    |       | Porch |          | 3.4 Pos       |                      |                    |
| Threshold        | Wood      | D    | Intact    |       | Porch |          | -0.2 Neg      |                      |                    |
| Kickplate        | Wood      | D    | Intact    |       | Porch |          | 4.8 Pos       |                      |                    |
| Cornerboard      | Wood      | D    | Intact    |       | Porch | 3.7 Edge | 1.6 Pos       |                      |                    |
| Newel Post       | Wood      | D    | Intact    |       | Porch |          | -0.1 Neg      |                      |                    |
| Railing Cap      | Wood      | D    | Intact    |       | Porch |          | 0.0 Neg       |                      |                    |
| Handrail         | Wood      | D    | Intact    |       | Porch |          | 0.1 Neg       |                      |                    |
| Lower Rail       | Wood      | D    | Intact    |       | Porch |          | -0.1 Neg      |                      |                    |
| Stair Tread      | Wood      | D    | Intact    |       | Porch |          | 0.2 Neg       |                      |                    |
| Stair Riser      | Wood      | D    | Intact    |       | Porch |          | -0.1 Neg      |                      |                    |
| Wall Cornerboard | Wood      | D    | Intact    |       | Porch |          | 3.0 Pos       |                      |                    |
| Support Column   | Wood      | D    | Poor      |       | Porch |          | 1.9 Pos       |                      | 7.23%              |
| Calibration      |           |      |           |       |       |          | 1.0           |                      |                    |
| Calibration      |           |      |           |       |       |          | 0.9           |                      |                    |
| Calibration      |           |      |           |       |       |          | 0.9           |                      |                    |



West Chop 1 - 921 Main Street Vineyard Haven XRF Lead-In-Paint Results

| Component            | Substrate | Side | Condition | Floor | Room        | XRF-1      | XRF-2 | Results | Substrate Correction | Paint Chip Results |
|----------------------|-----------|------|-----------|-------|-------------|------------|-------|---------|----------------------|--------------------|
| Window Well          | Wood      | C    | Intact    | 1     | Laundry     |            | 1.4   | Pos     |                      |                    |
| Wall                 | Gypsum    | A    | Intact    | 1     | Bathroom 1  |            | 0.0   | Neg     |                      |                    |
| Wall                 | Gypsum    | B    | Intact    | 1     | Bathroom 1  |            | 0.1   | Neg     |                      |                    |
| Wall                 | Gypsum    | C    | Intact    | 1     | Bathroom 1  |            | -0.1  | Neg     |                      |                    |
| Wall                 | Gypsum    | D    | Intact    | 1     | Bathroom 1  |            | -0.1  | Neg     |                      |                    |
| Baseboard            | Wood      | A    | Intact    | 1     | Bathroom 1  |            | 9.9   | Pos     |                      |                    |
| Door                 | Wood      | A    | Intact    | 1     | Bathroom 1  |            | 0.0   | Neg     |                      |                    |
| Door Casing          | Wood      | A    | Intact    | 1     | Bathroom 1  |            | 3.3   | Pos     |                      |                    |
| Door Jamb            | Wood      | A    | Intact    | 1     | Bathroom 1  |            | 0.8   | Neg     |                      |                    |
| Threshold            | Wood      | A    | Intact    | 1     | Bathroom 1  |            | 0.0   | Neg     |                      |                    |
| Window Sill          | Wood      | C    | Intact    | 1     | Bathroom 1  |            | 0.5   | Pos     |                      | 1.118              |
| Window Casing        | Wood      | C    | Intact    | 1     | Bathroom 1  | 2.4 Header | 1.6   | Pos     | 1.6-0.2-1.4          |                    |
| Window Apron         | Wood      | C    | Intact    | 1     | Bathroom 1  |            | 0.0   | Neg     |                      |                    |
| Window Interior Stop | Wood      | C    | Intact    | 1     | Bathroom 1  |            | 0.1   | Neg     |                      |                    |
| Window Interior Sash | Wood      | C    | Intact    | 1     | Bathroom 1  |            | -0.1  | Neg     |                      |                    |
| Window Exterior Sash | Wood      | C    | Intact    | 1     | Bathroom 1  |            | 0.1   | Neg     |                      |                    |
| Window Well          | Wood      | C    | Intact    | 1     | Bathroom 1  |            | 4.4   | Pos     |                      |                    |
| Wall                 | Gypsum    | A    | Intact    | 1     | Dining Room |            | -0.2  | Neg     |                      |                    |
| Wall                 | Gypsum    | B    | Intact    | 1     | Dining Room |            | 0.0   | Neg     |                      |                    |
| Wall                 | Gypsum    | C    | Intact    | 1     | Dining Room |            | -0.1  | Neg     |                      |                    |
| Wall                 | Gypsum    | D    | Intact    | 1     | Dining Room |            | -0.1  | Neg     |                      |                    |
| Baseboard            | Wood      | A    | Poor      | 1     | Dining Room |            | 8.9   | Pos     |                      |                    |
| Door                 | Wood      | A    | Intact    | 1     | Dining Room |            | -0.1  | Neg     |                      |                    |
| Door Casing          | Wood      | A    | Intact    | 1     | Dining Room |            | -0.3  | Neg     |                      |                    |
| Door Jamb            | Wood      | A    | Intact    | 1     | Dining Room |            | 0.2   | Neg     |                      |                    |
| Door                 | Wood      | C    | Intact    | 1     | Dining Room |            | 0.1   | Neg     |                      |                    |
| Door Casing          | Wood      | C    | Intact    | 1     | Dining Room | 4.8 Header | 1.6   | Pos     |                      |                    |
| Door Jamb            | Wood      | C    | Intact    | 1     | Dining Room |            | 0.4   | Neg     |                      |                    |
| Window Sill          | Wood      | D    | Intact    | 1     | Dining Room |            | 0.0   | Neg     |                      |                    |
| Window Casing        | Wood      | D    | Intact    | 1     | Dining Room |            | -0.1  | Neg     |                      |                    |
| Window Apron         | Wood      | D    | Intact    | 1     | Dining Room |            | 0.1   | Neg     |                      |                    |
| Window Interior Stop | Wood      | D    | Intact    | 1     | Dining Room |            | -0.2  | Neg     |                      |                    |
| Window Interior Sash | Wood      | D    | Intact    | 1     | Dining Room |            | 0.1   | Neg     |                      |                    |
| Window Exterior Sash | Wood      | D    | Intact    | 1     | Dining Room |            | 0.0   | Neg     |                      |                    |
| Window Well          | Wood      | D    | Intact    | 1     | Dining Room |            | 0.2   | Neg     |                      |                    |

West Chop 1 - 921 Main Street Vineyard Haven XRF Lead-In-Paint Results

| Component            | Substrate | Side | Condition | Floor | Room    | XRF-1      | XRF-2 | Results | Substrate Correction | Paint Chip Results |
|----------------------|-----------|------|-----------|-------|---------|------------|-------|---------|----------------------|--------------------|
| Closet Door Casing   | Wood      | A    | Intact    | 1     | Kitchen |            | 1.1   | Pos     |                      |                    |
| Closet Door Jamb     | Wood      | A    | Intact    | 1     | Kitchen |            | 0.7   | Neg     |                      |                    |
| Closet Wall          | Plaster   | A    | Poor      | 1     | Kitchen |            | 9.9   | Pos     |                      |                    |
| Closet Baseboard     | Wood      | A    | Poor      | 1     | Kitchen |            | 9.9   | Pos     |                      |                    |
| Closet Shelf         | Wood      | A    | Poor      | 1     | Kitchen |            | 1.4   | Pos     |                      |                    |
| Closet Shelf Support | Wood      | A    | Poor      | 1     | Kitchen |            | 9.9   | Pos     |                      |                    |
| Closet Ceiling       | Plaster   | C    | Poor      | 1     | Kitchen |            | n/a   |         |                      |                    |
| Radiator             | Metal     | B    | Intact    | 1     | Kitchen |            | 0.0   | Neg     |                      |                    |
| Riser Pipe           | Metal     | A    | Poor      | 1     | Kitchen |            | 1.0   | Pos     |                      |                    |
| Wall                 | Gypsum    | A    | Intact    | 1     | Foyer   |            | -0.1  | Neg     |                      |                    |
| Wall                 | Gypsum    | B    | Intact    | 1     | Foyer   |            | -0.1  | Neg     |                      |                    |
| Wall                 | Gypsum    | C    | Intact    | 1     | Foyer   |            | 0.0   | Neg     |                      |                    |
| Wall                 | Gypsum    | D    | Intact    | 1     | Foyer   |            | 0.1   | Neg     |                      |                    |
| Baseboard            | Wood      | C    | Intact    | 1     | Foyer   |            | 9.9   | Pos     |                      |                    |
| Door Casing          | Wood      | A    | Intact    | 1     | Foyer   | 1.4 Header | 1.0   | Pos     |                      |                    |
| Door Jamb            | Wood      | A    | Intact    | 1     | Foyer   |            | 1.9   | Pos     |                      |                    |
| Door                 | Wood      | B    | Intact    | 1     | Foyer   |            | 0.0   | Neg     |                      |                    |
| Door Casing          | Wood      | B    | Intact    | 1     | Foyer   |            | 0.1   | Neg     |                      |                    |
| Door Jamb            | Wood      | B    | Intact    | 1     | Foyer   |            | 0.6   | Neg     |                      |                    |
| Threshold            | Wood      | B    | Intact    | 1     | Foyer   |            | 3.5   | Pos     |                      |                    |
| Pipe Chase           | Wood      | A    | Intact    | 1     | Foyer   |            | -0.3  | Neg     |                      |                    |
| Wall                 | Gypsum    | A    | Intact    | 1     | Laundry |            | 0.0   | Neg     |                      |                    |
| Wall                 | Gypsum    | B    | Intact    | 1     | Laundry |            | -0.2  | Neg     |                      |                    |
| Wall                 | Gypsum    | C    | Intact    | 1     | Laundry |            | -0.1  | Neg     |                      |                    |
| Wall                 | Gypsum    | D    | Intact    | 1     | Laundry |            | -0.1  | Neg     |                      |                    |
| Baseboard            | Wood      | A    | Intact    | 1     | Laundry |            | 0.0   | Neg     |                      |                    |
| Door                 | Wood      | B    | Intact    | 1     | Laundry |            | -0.1  | Neg     |                      |                    |
| Door Casing          | Wood      | B    | Intact    | 1     | Laundry |            | 0.0   | Neg     |                      |                    |
| Door Jamb            | Wood      | B    | Intact    | 1     | Laundry |            | 0.1   | Neg     |                      |                    |
| Window Sill          | Wood      | C    | Intact    | 1     | Laundry |            | 0.1   | Neg     |                      |                    |
| Window Casing        | Wood      | C    | Intact    | 1     | Laundry |            | 0.0   | Neg     |                      |                    |
| Window Apron         | Wood      | C    | Intact    | 1     | Laundry |            | -0.1  | Neg     |                      |                    |
| Window Interior Stop | Wood      | C    | Intact    | 1     | Laundry |            | 0.1   | Neg     |                      |                    |
| Window Interior Sash | Wood      | C    | Intact    | 1     | Laundry |            | 0.1   | Neg     |                      |                    |
| Window Exterior Sash | Wood      | C    | Intact    | 1     | Laundry |            | 0.0   | Neg     |                      |                    |

West Chop 1 - 921 Main Street Vineyard Haven XRF Lead-In-Paint Results

| Component            | Substrate | Side | Condition | Floor | Room      | XRF-1          | XRF-2 | Results | Substrate Correction | Paint Chip Results |
|----------------------|-----------|------|-----------|-------|-----------|----------------|-------|---------|----------------------|--------------------|
| Floor Casing         | Wood      |      | Poor      | 2     | Staircase |                | 6.3   | Pos     |                      |                    |
| Door                 | Wood      | A(R) | Intact    | 2     | Staircase |                | 0.0   | Neg     |                      |                    |
| Door Casing          | Wood      | A(R) | Intact    | 2     | Staircase |                | 3.6   | Pos     |                      |                    |
| Door Jamb            | Wood      | A(R) | Intact    | 2     | Staircase | covered        | 0.2   | Neg     |                      |                    |
| Closet Door          | Wood      | A    | Intact    | 2     | Staircase |                | 0.1   | Neg     |                      |                    |
| Closet Door Casing   | Wood      | A    | Intact    | 2     | Staircase | 9.9 >5'scraped | 2.6   | Pos     |                      |                    |
| Closet Wall          | Plaster   | A    | Intact    | 2     | Staircase |                | 9.9   | Pos     |                      |                    |
| Closet Baseboard     | Wood      | A    | Poor      | 2     | Staircase |                | 9.9   | Pos     |                      |                    |
| Closet Shelf         | Wood      | A    | Intact    | 2     | Staircase |                | 9.3   | Pos     |                      |                    |
| Closet Shelf Support | Wood      | A    | Intact    | 2     | Staircase |                | 9.9   | Pos     |                      |                    |
| Closet Ceiling       | Plaster   | A    | Intact    | 2     | Staircase |                | 9.9   | Pos     |                      |                    |
| Radiator             | Metal     | D    | Intact    | 2     | Staircase |                | 0.7   | Neg     |                      |                    |
| Ceiling              | Plaster   |      | Intact    | 2     | Bedroom 1 |                | 9.9   | Pos     |                      |                    |
| Wall                 | Plaster   | A    | Intact    | 2     | Bedroom 1 |                | 9.9   | Pos     |                      |                    |
| Wall                 | Plaster   | B    | Intact    | 2     | Bedroom 1 |                | 9.9   | Pos     |                      |                    |
| Wall                 | Plaster   | C    | Intact    | 2     | Bedroom 1 |                | 9.8   | Pos     |                      |                    |
| Wall                 | Plaster   | D    | Poor      | 2     | Bedroom 1 |                | 2.2   | Pos     |                      |                    |
| Baseboard            | Wood      | B    | Intact    | 2     | Bedroom 1 | 0.1 OC scraped | 9.9   | Pos     |                      |                    |
| Floor                | Wood      |      | Intact    | 2     | Bedroom 1 |                | -0.1  | Neg     |                      |                    |
| Door                 | Wood      | C(R) | Intact    | 2     | Bedroom 1 |                | 0.1   | Neg     |                      |                    |
| Door Casing          | Wood      | C(R) | Intact    | 2     | Bedroom 1 |                | 2.1   | Pos     |                      |                    |
| Door Jamb            | Wood      | C(R) | Intact    | 2     | Bedroom 1 | 5.9 <5'scraped | 4.5   | Pos     |                      |                    |
| Window Sill          | Wood      | A    | Intact    | 2     | Bedroom 1 |                | 1.6   | Pos     |                      |                    |
| Window Casing        | Wood      | A    | Intact    | 2     | Bedroom 1 |                | 1.3   | Pos     |                      |                    |
| Window Apron         | Wood      | A    | Intact    | 2     | Bedroom 1 |                | 0.0   | Neg     |                      |                    |
| Window Interior Stop | Wood      | A    | Intact    | 2     | Bedroom 1 |                | 0.1   | Neg     |                      |                    |
| Window Interior Sash | Wood      | A    | Intact    | 2     | Bedroom 1 |                | 0.0   | Neg     |                      |                    |
| Window Exterior Sash | Wood      | A    | Intact    | 2     | Bedroom 1 |                | 0.2   | Neg     |                      |                    |
| Window Wall          | Wood      | A    | Poor      | 2     | Bedroom 1 |                | 0.5   | Neg     |                      |                    |
| Closet Door          | Wood      | C    | Intact    | 2     | Bedroom 1 |                | 0.1   | Neg     |                      |                    |
| Closet Door Casing   | Wood      | C    | Intact    | 2     | Bedroom 1 |                | 2.5   | Pos     |                      |                    |
| Closet Door Jamb     | Wood      | C    | Intact    | 2     | Bedroom 1 |                | 0.3   | Neg     |                      |                    |
| Closet Wall          | Plaster   | C    | Intact    | 2     | Bedroom 1 |                | 9.9   | Pos     |                      |                    |
| Closet Baseboard     | Wood      | C    | Intact    | 2     | Bedroom 1 |                | 9.9   | Pos     |                      |                    |
| Closet Shelf         | Wood      | C    | Intact    | 2     | Bedroom 1 |                | 9.9   | Pos     |                      |                    |



West Chop 1 - 921 Main Street Vineyard Haven XRF Lead-In-Paint Results

| Component            | Substrate | Side | Condition | Floor | Room        | XRF-1        | XRF-2 | Results | Substrate Correction | Paint Chip Results |
|----------------------|-----------|------|-----------|-------|-------------|--------------|-------|---------|----------------------|--------------------|
| Hutch Door Upper     | Wood      | C    | Intact    | 1     | Dining Room | 7.7 Mullions | -0.3  | Pos     |                      |                    |
| Hutch Frame          | Wood      | C    | Intact    | 1     | Dining Room |              | 0.2   | Neg     |                      |                    |
| Hutch Wall           | Plaster   | C    | Intact    | 1     | Dining Room |              | 9.9   | Pos     |                      |                    |
| Hutch Shelf          | Wood      | C    | Intact    | 1     | Dining Room |              | 3.4   | Pos     |                      |                    |
| Hutch Shelf Support  | Wood      | C    | Intact    | 1     | Dining Room |              | 2.1   | Pos     |                      |                    |
| Hutch Door Lower     | Wood      | C    | Intact    | 1     | Dining Room |              | 1.5   | Pos     |                      |                    |
| Riser Pipe           | Metal     | A    | Intact    | 1     | Dining Room |              | -0.1  | Neg     |                      |                    |
| Ceiling              | Plaster   |      | Intact    | 1     | Staircase   |              | -0.3  | Neg     |                      |                    |
| Wall                 | Plaster   | A    | Intact    | 1     | Staircase   |              | 0.1   | Neg     |                      |                    |
| Wall                 | Plaster   | B    | Intact    | 1     | Staircase   |              | 0.0   | Neg     |                      |                    |
| Wall                 | Plaster   | C    | Intact    | 1     | Staircase   |              | 9.9   | Pos     |                      |                    |
| Wall                 | Plaster   | D    | Intact    | 1     | Staircase   |              | 9.9   | Pos     |                      |                    |
| Baseboard            | Wood      | B    | Intact    | 1     | Staircase   |              | 0.0   | Neg     |                      |                    |
| Baseboard            | Wood      | A    | Intact    | 1     | Staircase   |              | 9.9   | Pos     |                      |                    |
| Door                 | Wood      | A    | Intact    | 1     | Staircase   |              | 0.0   | Neg     |                      |                    |
| Door Casing          | Wood      | A    | Intact    | 1     | Staircase   |              | 4.1   | Pos     |                      |                    |
| Door Jamb            | Wood      | A    | Intact    | 1     | Staircase   |              | 0.8   | Neg     |                      |                    |
| Threshold            | Wood      | A    | Intact    | 1     | Staircase   |              | 0.1   | Neg     |                      |                    |
| Door Casing          | Wood      | B    | Poor      | 1     | Staircase   |              | 2.0   | Pos     |                      |                    |
| Door Jamb            | Wood      | B    | Poor      | 1     | Staircase   |              | 1.5   | Pos     |                      |                    |
| Door                 | Wood      | D    | Intact    | 1     | Staircase   |              | -0.1  | Neg     |                      |                    |
| Window Sill          | Wood      | C    | Intact    | 1     | Staircase   |              | 0.1   | Neg     |                      |                    |
| Window Casing        | Wood      | C    | Intact    | 1     | Staircase   |              | 0.0   | Neg     |                      |                    |
| Window Apron         | Wood      | C    | Intact    | 1     | Staircase   |              | -0.2  | Neg     |                      |                    |
| Window Interior Stop | Wood      | C    | Intact    | 1     | Staircase   |              | 0.2   | Neg     |                      |                    |
| Window Interior Sash | Wood      | C    | Intact    | 1     | Staircase   |              | 0.0   | Neg     |                      |                    |
| Window Exterior Sash | Wood      | C    | Intact    | 1     | Staircase   |              | 0.2   | Neg     |                      |                    |
| Window Well          | Wood      | C    | Poor      | 1     | Staircase   |              | 1.6   | Pos     |                      |                    |
| Newel Post           | Wood      |      | Intact    | 1     | Staircase   |              | 0.0   | Neg     |                      |                    |
| Railing Cap          | Wood      |      | Intact    | 1     | Staircase   |              | 0.1   | Neg     |                      |                    |
| Handrail             | Wood      |      | Intact    | 1     | Staircase   |              | -0.1  | Neg     |                      |                    |
| Baluster             | Wood      |      | Intact    | 1     | Staircase   |              | 0.0   | Neg     |                      |                    |
| Stair Tread          | Wood      |      | Intact    | 1     | Staircase   |              | -0.2  | Neg     |                      |                    |
| Stair Riser          | Wood      |      | Poor      | 1     | Staircase   |              | 9.9   | Pos     |                      |                    |
| Stringer             | Wood      |      | Intact    | 1     | Staircase   |              | 4.2   | Pos     |                      |                    |

West Chop 1 - 921 Main Street Vineyard Haven XRF Lead-In-Paint Results

| Component            | Substrate | Side | Condition | Floor | Room       | XRF-1            | XRF-2 | Results | Substrate Correction | Paint Chip Results |
|----------------------|-----------|------|-----------|-------|------------|------------------|-------|---------|----------------------|--------------------|
| Door                 | Wood      | A    | Intact    | 2     | Bathroom 2 |                  | 0.1   | Neg     |                      |                    |
| Door Casing          | Wood      | A    | Intact    | 2     | Bathroom 2 |                  | 2.7   | Pos     |                      |                    |
| Door Jamb            | Wood      | A    | Intact    | 2     | Bathroom 2 |                  | 0.3   | Neg     |                      |                    |
| Window Sill          | Wood      | C    | Intact    | 2     | Bathroom 2 |                  | 0.0   | Neg     |                      |                    |
| Window Casing        | Wood      | C    | Intact    | 2     | Bathroom 2 |                  | 0.1   | Neg     |                      |                    |
| Window Apron         | Wood      | C    | Intact    | 2     | Bathroom 2 |                  | -0.2  | Neg     |                      |                    |
| Window Interior Stop | Wood      | C    | Intact    | 2     | Bathroom 2 |                  | -0.1  | Neg     |                      |                    |
| Window Interior Sash | Wood      | C    | Intact    | 2     | Bathroom 2 |                  | 0.0   | Neg     |                      |                    |
| Window Exterior Sash | Wood      | C    | Intact    | 2     | Bathroom 2 |                  | 0.1   | Neg     |                      |                    |
| Window Well          | Wood      | C    | Poor      | 2     | Bathroom 2 |                  | 3.9   | Pos     |                      |                    |
| Radiator             | Metal     | C    | Intact    | 2     | Bathroom 2 |                  | 0.0   | Neg     |                      |                    |
| Ceiling              | Plaster   |      | Intact    | 2     | Bedroom 3  |                  | 8.2   | Pos     |                      |                    |
| Wall                 | Plaster   | A    | Intact    | 2     | Bedroom 3  |                  | 9.9   | Pos     |                      |                    |
| Wall                 | Plaster   | B    | Intact    | 2     | Bedroom 3  |                  | 9.9   | Pos     |                      |                    |
| Wall                 | Plaster   | C    | Intact    | 2     | Bedroom 3  |                  | 7.1   | Pos     |                      |                    |
| Wall                 | Plaster   | D    | Intact    | 2     | Bedroom 3  |                  | 5.0   | Pos     |                      |                    |
| Baseboard            | Wood      | A    | Intact    | 2     | Bedroom 3  | 0.0 OC scraped   | 9.9   | Pos     |                      |                    |
| Door                 | Wood      | B    | Intact    | 2     | Bedroom 3  |                  | 0.0   | Neg     |                      |                    |
| Door Casing          | Wood      | B    | Intact    | 2     | Bedroom 3  |                  | -0.1  | Neg     |                      |                    |
| Door Jamb            | Wood      | B    | Intact    | 2     | Bedroom 3  |                  | 0.2   | Neg     |                      |                    |
| Access Door          | Wood      | C(L) | Intact    | 2     | Bedroom 3  |                  | -0.1  | Neg     |                      |                    |
| Access Door Frame    | Wood      | C(L) | Intact    | 2     | Bedroom 2  |                  | 0.0   | Neg     |                      |                    |
| Access Door          | Wood      | C(R) | Intact    | 2     | Bedroom 3  | 2.5 Outside corr | 9.9   | Pos     |                      |                    |
| Access Door Frame    | Wood      | C(R) | Intact    | 2     | Bedroom 2  |                  | 0.0   | Neg     |                      |                    |
| Window Sill          | Wood      | D    | Intact    | 2     | Bedroom 3  |                  | -0.2  | Neg     |                      |                    |
| Window Casing        | Wood      | D    | Intact    | 2     | Bedroom 3  |                  | 0.8   | Neg     |                      |                    |
| Window Apron         | Wood      | D    | Intact    | 2     | Bedroom 3  |                  | -0.2  | Neg     |                      |                    |
| Window Interior Stop | Wood      | D    | Intact    | 2     | Bedroom 3  |                  | 0.1   | Neg     |                      |                    |
| Window Interior Sash | Wood      | D    | Intact    | 2     | Bedroom 3  |                  | 0.0   | Neg     |                      |                    |
| Window Exterior Sash | Wood      | D    | Intact    | 2     | Bedroom 3  |                  | 0.2   | Neg     |                      |                    |
| Window Well          | Wood      | D    | Poor      | 2     | Bedroom 3  |                  | 0.1   | Neg     |                      |                    |
| Shelf                | Wood      | A    | Intact    | 2     | Bedroom 3  |                  | 6.0   | Pos     |                      |                    |
| Shelf Support        | Metal     | A    | Intact    | 2     | Bedroom 3  |                  | 5.0   | Pos     |                      |                    |
| Radiator             | Metal     | D    | Intact    | 2     | Bedroom 3  |                  | 0.0   | Neg     |                      |                    |
| Wall                 | Plaster   | A    | Intact    | 2     | Hall       |                  | -0.2  | Neg     |                      |                    |

West Chop 1 - 921 Main Street Vineyard Haven XRF Lead-In-Paint Results

| Component            | Substrate | Side | Condition | Floor | Room       | XRF-1           | XRF-2 | Results | Substrate Correction | Paint Chip Results |
|----------------------|-----------|------|-----------|-------|------------|-----------------|-------|---------|----------------------|--------------------|
| Closet Shelf Support | Wood      | C    | Intact    | 2     | Bedroom 1  |                 | 9.9   | Pos     |                      |                    |
| Closet Ceiling       | Plaster   | C    | Intact    | 2     | Bedroom 1  |                 | -0.2  | Neg     |                      |                    |
| Shelf                | Wood      | C    | Intact    | 2     | Bedroom 1  |                 | 9.9   | Pos     |                      |                    |
| Radiator             | Metal     | B    | Intact    | 2     | Bedroom 1  |                 | -0.3  | Neg     |                      |                    |
| Ceiling              | Plaster   |      | Intact    | 2     | Bedroom 2  |                 | 9.9   | Pos     |                      |                    |
| Wall                 | Plaster   | A    | Intact    | 2     | Bedroom 2  |                 | 9.9   | Pos     |                      |                    |
| Wall                 | Plaster   | B    | Intact    | 2     | Bedroom 2  |                 | 9.9   | Pos     |                      |                    |
| Wall                 | Plaster   | C    | Intact    | 2     | Bedroom 2  |                 | 9.9   | Pos     |                      |                    |
| Wall                 | Plaster   | D    | Intact    | 2     | Bedroom 2  |                 | 9.0   | Pos     |                      |                    |
| Wall Cornerbead      | Wood      | A    | Intact    | 2     | Bedroom 2  |                 | 9.9   | Pos     |                      |                    |
| Baseboard            | Wood      | A    | Intact    | 2     | Bedroom 2  | 0.0 OC scraped  | 9.9   | Pos     |                      |                    |
| Door                 | Wood      | D    | Intact    | 2     | Bedroom 2  |                 | -0.1  | Neg     |                      |                    |
| Door Casing          | Wood      | D    | Intact    | 2     | Bedroom 2  |                 | 3.0   | Pos     |                      |                    |
| Door Jamb            | Wood      | D    | Intact    | 2     | Bedroom 2  | covered         | 0.0   | Neg     |                      |                    |
| Window Sill          | Wood      | B    | Intact    | 2     | Bedroom 2  |                 | 0.2   | Neg     |                      |                    |
| Window Casing        | Wood      | B    | Intact    | 2     | Bedroom 2  |                 | 3.5   | Pos     |                      |                    |
| Window Apron         | Wood      | B    | Intact    | 2     | Bedroom 2  |                 | 0.0   | Neg     |                      |                    |
| Window Interior Stop | Wood      | B    | Intact    | 2     | Bedroom 2  |                 | -0.1  | Neg     |                      |                    |
| Window Interior Sash | Wood      | B    | Intact    | 2     | Bedroom 2  |                 | 0.0   | Neg     |                      |                    |
| Window Exterior Sash | Wood      | B    | Intact    | 2     | Bedroom 2  |                 | 0.1   | Neg     |                      |                    |
| Window Well          | Wood      | B    | Poor      | 2     | Bedroom 2  |                 | -0.2  | Neg     |                      |                    |
| Closet Door          | Wood      | A    | Intact    | 2     | Bedroom 2  |                 | 0.0   | Neg     |                      |                    |
| Closet Door Casing   | Wood      | A    | Intact    | 2     | Bedroom 2  | 9.9 >5' scraped | 0.2   | Pos     |                      |                    |
| Closet Door Jamb     | Wood      | A    | Poor      | 2     | Bedroom 2  | covered         | 0.0   | Neg     |                      |                    |
| Closet Wall          | Plaster   | A    | Poor      | 2     | Bedroom 2  |                 | 8.5   | Pos     |                      |                    |
| Closet Baseboard     | Wood      | A    | Poor      | 2     | Bedroom 2  |                 | 9.9   | Pos     |                      |                    |
| Closet Shelf         | Wood      | A    | Intact    | 2     | Bedroom 2  |                 | 0.0   | Neg     |                      |                    |
| Closet Shelf Support | Wood      | A    | Poor      | 2     | Bedroom 2  |                 | 9.6   | Pos     |                      |                    |
| Shelf                | Wood      | A    | Intact    | 2     | Bedroom 2  |                 | 9.9   | Pos     |                      |                    |
| Radiator             | Metal     | B    | Intact    | 2     | Bedroom 2  |                 | 0.1   | Neg     |                      |                    |
| Wall                 | Gypsum    | A    | Intact    | 2     | Bathroom 2 |                 | -0.1  | Neg     |                      |                    |
| Wall                 | Gypsum    | B    | Intact    | 2     | Bathroom 2 |                 | 0.1   | Neg     |                      |                    |
| Wall                 | Gypsum    | C    | Intact    | 2     | Bathroom 2 |                 | 0.0   | Neg     |                      |                    |
| Wall                 | Gypsum    | D    | Intact    | 2     | Bathroom 2 |                 | -0.2  | Neg     |                      |                    |
| Baseboard            | Wood      | A    | Intact    | 2     | Bathroom 2 |                 | 9.9   | Pos     |                      |                    |



West Chop 1 - 921 Main Street Vineyard Haven XRF Lead-In-Paint Results

| Component           | Substrate | Side | Condition | Floor | Room     | XRF-1           | XRF-2 | Results | Substrate Correction | Paint Chip Results |
|---------------------|-----------|------|-----------|-------|----------|-----------------|-------|---------|----------------------|--------------------|
| Wall                | Plaster   | C    | Intact    | 2     | Hall     |                 | 9.9   | Pos     |                      |                    |
| Wall                | Plaster   | D    | Intact    | 2     | Hall     |                 | -0.2  | Neg     |                      |                    |
| Baseboard           | Wood      | D    | Intact    | 2     | Hall     | 0.1 OC scraped  | 8.0   | Pos     |                      |                    |
| Door                | Wood      | B    | Intact    | 2     | Hall     |                 | 0.0   | Neg     |                      |                    |
| Door Casing         | Wood      | B    | Intact    | 2     | Hall     | 4.0 Molding     | 0.2   | Neg     |                      |                    |
| Door Jamb           | Wood      | B    | Intact    | 2     | Hall     | covered         | 0.0   | Neg     |                      |                    |
| Wall                | Wood      | A    | Intact    |       | Exterior |                 | 0.0   | Neg     |                      |                    |
| Wall                | Wood      | B    | Intact    |       | Exterior |                 | 0.1   | Neg     |                      |                    |
| Wall                | Wood      | C    | Intact    |       | Exterior |                 | -0.1  | Neg     |                      |                    |
| Wall                | Wood      | D    | Intact    |       | Exterior |                 | -0.1  | Neg     |                      |                    |
| Cornerboard         | Wood      | A    | Intact    |       | Exterior |                 | -0.2  | Neg     |                      |                    |
| Lower Trim          | Wood      | A    | Intact    |       | Exterior |                 | 0.0   | Neg     |                      |                    |
| Door                | Wood      | A    | Intact    |       | Exterior |                 | -0.1  | Neg     |                      |                    |
| Door Casing         | Wood      | A    | Intact    |       | Exterior |                 | -0.1  | Neg     |                      |                    |
| Door Jamb           | Wood      | A    | Intact    |       | Exterior |                 | 0.0   | Neg     |                      |                    |
| Threshold           | Wood      | A    | Intact    |       | Exterior |                 | 3.1   | Pos     |                      |                    |
| Kickplate           | Wood      | A    | Intact    |       | Exterior |                 | -0.2  | Neg     |                      |                    |
| Window Sill         | Wood      | A(L) | Intact    |       | Exterior | 5.3 Edge        | 0.1   | Pos     |                      |                    |
| Window Casing       | Wood      | A(L) | Intact    |       | Exterior |                 | -0.3  | Neg     |                      |                    |
| Window Sill         | Wood      | B(R) | Intact    |       | Exterior | 9.9 Edge        | -0.1  | Pos     |                      |                    |
| Window Casing       | Wood      | B(R) | Intact    |       | Exterior |                 | -0.2  | Neg     |                      |                    |
| Window Casing       | Wood      | B(L) | Intact    |       | Exterior | 2.4 >5' scraped | -0.1  | Pos     |                      |                    |
| Window Sill         | Wood      | D(R) | Intact    |       | Exterior | 9.9 Edge        | 1.5   | Pos     |                      |                    |
| Window Casing       | Wood      | D(R) | Intact    |       | Exterior | 1.6 Edge        | -0.3  | Pos     |                      |                    |
| Access Door         | Wood      | C    | Poor      |       | Exterior |                 | 7.0   | Pos     |                      |                    |
| Access Door Casing  | Wood      | C    | Intact    |       | Exterior |                 | 0.1   | Neg     |                      |                    |
| Cellar Window Sill  | Wood      | D    | Intact    |       | Exterior |                 | -0.2  | Neg     |                      |                    |
| Cellar Window Frame | Wood      | D    | Intact    |       | Exterior |                 | -0.1  | Neg     |                      |                    |
| Foundation          | Concrete  | A    | Intact    |       | Exterior |                 | 0.0   | Neg     |                      |                    |
| Down Spout Pan      | Concrete  | A    | Intact    |       | Exterior |                 | 2.0   | Pos     |                      |                    |
| Foundation Skirt    | Concrete  | A    | Intact    |       | Exterior |                 | 0.6   | Neg     |                      |                    |
| Bulkhead Door       | Wood      | D    | Intact    |       | Exterior |                 | 0.0   | Neg     |                      |                    |
| Bulkhead Door Frame | Wood      | D    | Intact    |       | Exterior |                 | 0.1   | Neg     |                      |                    |
| Bulkhead Skirt      | Concrete  | D    | Intact    |       | Exterior |                 | 0.3   | Neg     |                      |                    |
| Oil Fill            | Metal     | D    | Intact    |       | Exterior |                 | -0.1  | Neg     |                      |                    |

West Chop 1 - 921 Main Street Vineyard Haven XRF Lead-In-Paint Results

| Component            | Substrate | Side | Condition | Floor | Room   | XRF-1           | XRF-2 | Results | Substrate Correction | Paint Chip Results |
|----------------------|-----------|------|-----------|-------|--------|-----------------|-------|---------|----------------------|--------------------|
| Stair Riser          | Wood      | A    | Intact    |       | Porch  |                 | 0.1   | Neg     |                      |                    |
| Railing Cap          | Wood      | A    | Intact    |       | Porch  |                 | -0.1  | Neg     |                      |                    |
| Support Column       | Wood      | A    | Poor      |       | Porch  | 2.0 >5' scraped | 0.0   | Pos     |                      |                    |
| Floor                | Wood      | A    | Intact    |       | Porch  |                 | -0.2  | Neg     |                      |                    |
| Door                 | Wood      | B    | Intact    |       | Porch  |                 | 0.1   | Neg     |                      |                    |
| Door Casing          | Wood      | B    | Intact    |       | Porch  |                 | 4.0   | Pos     |                      |                    |
| Door Jamb            | Wood      | B    | Intact    |       | Porch  |                 | 0.0   | Neg     |                      |                    |
| Threshold            | Wood      | B    | Intact    |       | Porch  |                 | 0.1   | Neg     |                      |                    |
| Kickplate            | Wood      | D    | Intact    |       | Porch  |                 | 9.9   | Pos     |                      |                    |
| Support Column       | Wood      | B    | Intact    |       | Porch  |                 | 0.1   | Neg     |                      |                    |
| Newel Post           | Wood      | B    | Intact    |       | Porch  |                 | -0.1  | Neg     |                      |                    |
| Railing Cap          | Wood      | B    | Intact    |       | Porch  |                 | 0.0   | Neg     |                      |                    |
| Handrail             | Wood      | B    | Intact    |       | Porch  |                 | -0.2  | Neg     |                      |                    |
| Lower Rail           | Wood      | B    | Intact    |       | Porch  |                 | 0.1   | Neg     |                      |                    |
| Stair Tread          | Wood      | B    | Intact    |       | Porch  |                 | 0.0   | Neg     |                      |                    |
| Stair Riser          | Wood      | B    | Intact    |       | Porch  |                 | -0.2  | Neg     |                      |                    |
| Floor                | Wood      | B    | Intact    |       | Porch  |                 | 0.1   | Neg     |                      |                    |
| Wall Cornerhead      | Wood      | B    | Intact    |       | Porch  |                 | 9.9   | Pos     |                      |                    |
| Siding               | Wood      | A    | Intact    |       | Garage |                 | 3.2   | Pos     |                      |                    |
| Cornerboard          | Wood      | A    | Intact    |       | Garage |                 | 0.3   | Neg     |                      |                    |
| Upper Trim           | Wood      | D    | Poor      |       | Garage |                 | 3.2   | Pos     |                      |                    |
| Door Casing          | Wood      | A    | Intact    |       | Garage |                 | -0.2  | Neg     |                      |                    |
| Door Jamb            | Wood      | A    | Intact    |       | Garage |                 | 0.0   | Neg     |                      |                    |
| Door                 | Metal     | D    | Intact    |       | Garage |                 | -0.1  | Neg     |                      |                    |
| Door Casing          | Wood      | D    | Intact    |       | Garage |                 | 0.1   | Neg     |                      |                    |
| Door Jamb            | Wood      | D    | Intact    |       | Garage |                 | 0.0   | Neg     |                      |                    |
| Window Casing        | Wood      | C    | Intact    |       | Garage |                 | 0.1   | Neg     |                      |                    |
| Window Sill          | Wood      | C    | Intact    |       | Garage |                 | 0.2   | Neg     |                      |                    |
| Window Exterior Sash | Wood      | C    | Intact    |       | Garage |                 | 0.1   | Neg     |                      |                    |
| Window Casing        | Wood      | D    | Intact    |       | Garage |                 | 0.0   | Neg     |                      |                    |
| Window Sill          | Wood      | D    | Intact    |       | Garage |                 | -0.1  | Neg     |                      |                    |
| Window Exterior Sash | Wood      | D    | Intact    |       | Garage |                 | 1.0   | Pos     |                      |                    |
| Window Track         | Wood      | D    | Intact    |       | Garage |                 | 2.0   | Pos     |                      |                    |
| Foundation           | Concrete  | D    | Intact    |       | Garage |                 | 0.1   | Neg     |                      |                    |
| Calibration          |           |      |           |       |        |                 | 0.9   |         |                      |                    |

**APPENDIX II**  
**PAINT CHIP SAMPLING ANALYTICAL RESULTS**

---



West Chop 1 - 921 Main Street Vineyard Haven XRF Lead-In-Paint Results

| Component   | Substrate | Side | Condition | Floor | Room | XRF-1 | XRF-2 | Results | Substrate Correction | Paint Chip Results |
|-------------|-----------|------|-----------|-------|------|-------|-------|---------|----------------------|--------------------|
| Calibration |           |      |           |       |      |       | 0.6   |         |                      |                    |
| Calibration |           |      |           |       |      |       | 0.9   |         |                      |                    |



## Analysis Report

## Schneider Laboratories Global, Inc

2512 W. Cary Street • Richmond, Virginia • 23220-5117  
804-353-6778 • 800-785-LABS (5227) • Fax 804-359-1475Customer: ENVIRONMENTAL LEAD DETECTION (482)  
Address: 436 Gardners Neck Rd  
Swansea, MA 02777-3105

Order #: 109079

Attn:

Matrix Wipe  
Received 07/31/14  
Analyzed 07/31/14  
Reported 07/31/14

Project:

PO Number:

Location: West Chop 1  
Number: 921 Main St., Vineyard Haven

| Sample ID  | Cust. Sample ID | Location          | Sample Date | Area      | Total         | Conc.        | RL          |
|------------|-----------------|-------------------|-------------|-----------|---------------|--------------|-------------|
| Parameter  |                 | Method            |             |           |               |              |             |
| 109079-001 | 1D              | Liv Rm FL         | 07/28/14    |           |               |              |             |
| Lead       |                 | EPA 7000B / 3050B |             | 1.00 ft2  | 14.1 µg/wipe  | 14.1 µg/ft2  | 10.0 µg/ft2 |
| 109079-002 | 2D              | Liv Rm SL         | 07/28/14    |           |               |              |             |
| Lead       |                 | EPA 7000B / 3050B |             | 1.03 ft2  | 12400 µg/wipe | 12100 µg/ft2 | 485 µg/ft2  |
| 109079-003 | 3D              | Kitchen FL        | 07/28/14    |           |               |              |             |
| Lead       |                 | EPA 7000B / 3050B |             | 1.00 ft2  | 226 µg/wipe   | 226 µg/ft2   | 10.0 µg/ft2 |
| 109079-004 | 4D              | Kitchen SL        | 07/28/14    |           |               |              |             |
| Lead       |                 | EPA 7000B / 3050B |             | 0.853 ft2 | <10.0 µg/wipe | <11.7 µg/ft2 | 11.7 µg/ft2 |
| 109079-005 | 5D              | Bed 1 FL          | 07/28/14    |           |               |              |             |
| Lead       |                 | EPA 7000B / 3050B |             | 1.00 ft2  | 10.4 µg/wipe  | 10.4 µg/ft2  | 10.0 µg/ft2 |
| 109079-006 | 6D              | Bed 1 SL          | 07/28/14    |           |               |              |             |
| Lead       |                 | EPA 7000B / 3050B |             | 0.678 ft2 | 30.7 µg/wipe  | 45.2 µg/ft2  | 14.7 µg/ft2 |
| 109079-007 | 7D              | Bed 2 FL          | 07/28/14    |           |               |              |             |
| Lead       |                 | EPA 7000B / 3050B |             | 1.00 ft2  | <10.0 µg/wipe | <10.0 µg/ft2 | 10.0 µg/ft2 |
| 109079-008 | 8D              | Bed 2 SL          | 07/28/14    |           |               |              |             |
| Lead       |                 | EPA 7000B / 3050B |             | 1.03 ft2  | 243 µg/wipe   | 236 µg/ft2   | 9.70 µg/ft2 |
| 109079-009 | 9D              | Liv Rm WL         | 07/28/14    |           |               |              |             |
| Lead       |                 | EPA 7000B / 3050B |             | 0.977 ft2 | 47600 µg/wipe | 48700 µg/ft2 | 1020 µg/ft2 |
| 109079-010 | 10D             | Bath 2 WL         | 07/28/14    |           |               |              |             |
| Lead       |                 | EPA 7000B / 3050B |             | 0.398 ft2 | 158 µg/wipe   | 397 µg/ft2   | 25.1 µg/ft2 |

Analyst: (b)  
109079-07/31/14 06:27 PM

(b) (6)

Metals Supervisor

Minimum Total Reporting Limit: 10.0 µg/wipe. EPA Clearance Std: 40 µg/ft<sup>2</sup> for floors, 250 µg/ft<sup>2</sup> for interior window sills, and 400 µg/ft<sup>2</sup> for window troughs. All internal QC parameters were met. Unusual sample conditions, if any, are described. Surrogate Spike results designated with "D" indicate that the analyte was diluted out. "MI" indicates matrix interference. Concentration and Reporting Limit (RL) based on areas provided by client. Values are reported to three significant figures. The analysis data reported relates only to the samples as submitted.

Accrediting bodies: AIHA-LAP, LLC 100527, VELAP/NELAC 460135 - Call laboratory for current national and state certifications.

**APPENDIX IV**  
**SOIL SAMPLE ANALYTICAL RESULTS**

---





## Analysis Report

## Schneider Laboratories Global, Inc

2512 W. Cary Street • Richmond, Virginia • 23220-5117  
804-353-6778 • 800-785-LABS (5227) • Fax 804-359-1475Customer: ENVIRONMENTAL LEAD DETECTION (482)  
Address: 438 Gardners Neck Rd  
Swansea, MA 02777-3105

Order #: 109081

Attn:  
Project: West Chop 1  
Location: 921 Main St Vineyard Haven  
Number:Matrix: Soil  
Received: 07/31/14  
Analyzed: 08/02/14  
Reported: 08/04/14

PO Number:

| Sample ID  | Cust. Sample ID | Location          | Sample Date | Weight   | Conc. % by WL RL |            | Conc.      |
|------------|-----------------|-------------------|-------------|----------|------------------|------------|------------|
| Parameter  |                 | Method            |             | Total µg |                  |            |            |
| 109081-001 | 55              | Side A            | 07/28/14    | 527 mg   |                  |            |            |
| Lead       |                 | EPA 7000B / 3050B |             | 1450 µg  | 0.275 %          | 94.9 mg/kg | 2750 mg/kg |
| 109081-002 | 85              | Side B            | 07/28/14    | 538 mg   |                  |            |            |
| Lead       |                 | EPA 7000B / 3050B |             | 2090 µg  | 0.388 %          | 92.9 mg/kg | 3880 mg/kg |
| 109081-003 | 75              | Side C            | 07/28/14    | 535 mg   |                  |            |            |
| Lead       |                 | EPA 7000B / 3050B |             | 1480 µg  | 0.276 %          | 93.5 mg/kg | 2760 mg/kg |
| 109081-004 | 85              | Side D            | 07/28/14    | 535 mg   |                  |            |            |
| Lead       |                 | EPA 7000B / 3050B |             | 1450 µg  | 0.271 %          | 93.5 mg/kg | 2710 mg/kg |

Analyst: (b)  
109081-08/04/14 10:01 AM

(b) (6)

Metals Supervisor

Minimum reporting limit: 10.0 µg. EPA Soil Std for bare residential soil: 400 mg/kg by wt in play areas, 1200 mg/kg by wt in bare soil in the remainder of the yard based on an avg of all other samples collected. EPA does not distinguish between lead-contaminated soil and soil-lead hazards. Concentration and Reporting Limit (RL) based on weights provided by client. All internal QC parameters were met. Unusual sample conditions, if any, are described. Values are reported to three significant figures. PPM = mg/kg | PPB = µg/kg. The analysis data reported relates only to the samples as submitted.

Accrediting bodies: AIHA-LAP, LLC 100527, VELAP/NELAC 480135 - Call laboratory for current national and state certifications.



## Analysis Report

## Schneider Laboratories Global, Inc

2512 W. Cary Street • Richmond, Virginia • 23220-5117  
804-353-6778 • 800-785-LABS (5227) • Fax 804-359-1475Customer: ENVIRONMENTAL LEAD DETECTION (482)  
Address: 436 Gardners Neck Rd  
Swansea, MA 02777-3105

Order #: 109076

Attn:  
Project: West Chop 2  
Location: 917 Main St Vineyard Haven  
Number:Matrix: Soil  
Received: 07/31/14  
Analyzed: 08/01/14  
Reported: 08/04/14

PO Number:

| Sample ID  | Cust. Sample ID | Location          | Sample Date | Weight   |               |            |            |
|------------|-----------------|-------------------|-------------|----------|---------------|------------|------------|
| Parameter  |                 | Method            |             | Total µg | Conc. % by Wt | RL         | Conc.      |
| 109076-001 | 1S              | Side A            | 07/28/14    | 535 mg   |               |            |            |
| Lead       |                 | EPA 7000B / 3050B |             | 553 µg   | 0.103 %       | 37.4 mg/kg | 1030 mg/kg |
| 109076-002 | 2S              | Side B            | 07/28/14    | 532 mg   |               |            |            |
| Lead       |                 | EPA 7000B / 3050B |             | 3100 µg  | 0.582 %       | 188 mg/kg  | 5820 mg/kg |
| 109076-003 | 3S              | Side C            | 07/28/14    | 544 mg   |               |            |            |
| Lead       |                 | EPA 7000B / 3050B |             | 718 µg   | 0.132 %       | 38.8 mg/kg | 1320 mg/kg |
| 109076-004 | 4S              | Side D            | 07/28/14    | 502 mg   |               |            |            |
| Lead       |                 | EPA 7000B / 3050B |             | 911 µg   | 0.181 %       | 39.8 mg/kg | 1810 mg/kg |

Analyst: (b)  
109076-08/04/14 12:29 PM

(b) (6)

Metals Supervisor

Minimum reporting limit: 10.0 µg. EPA Soil Std for bare residential soil: 400 mg/kg by wt in play areas; 1200 mg/kg by wt in bare soil in the remainder of the yard based on an avg of all other samples collected. EPA does not distinguish between lead-contaminated soil and soil-lead hazards. Concentration and Reporting Limit (RL) based on weights provided by client. All internal QC parameters were met. Unusual sample conditions, if any, are described. Values are reported to three significant figures. PPM = mg/kg | PPB = µg/kg. The analysis data reported relates only to the samples as submitted.

Accrediting bodies: AIHA-LAP, LLC 100527, VELAP/NELAC 460135 - Call laboratory for current national and state certifications.



## Analysis Report

## Schneider Laboratories Global, Inc

2512 W. Cary Street • Richmond, Virginia • 23220-5117  
804-353-6778 • 800-785-LABS (5227) • Fax 804-359-1475Customer: ENVIRONMENTAL LEAD DETECTION (482)  
Address: 436 Gardners Neck Rd  
Swansea, MA 02777-3105

Order #: 109080

Matrix  
Received 07/31/14  
Analyzed 07/31/14  
Reported 07/31/14

Attn:

Project:

Location: West Chop 2  
Number: 917 Main St Vinyard Haven

PO Number:

| Sample ID  | Cust. Sample ID | Location          | Sample Date | Area      | Total         | Conc.        | RL           |
|------------|-----------------|-------------------|-------------|-----------|---------------|--------------|--------------|
| Parameter  |                 | Method            |             |           |               |              |              |
| 109080-001 | 11              | FL Liv Rm         | 07/28/14    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 1.00 ft2  | 27.0 µg/wipe  | 27.0 µg/ft2  | 10.0 µg/ft2  |
| 109080-002 | 12              | SL Liv Rm         | 07/28/14    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 0.802 ft2 | 186 µg/wipe   | 232 µg/ft2   | 12.5 µg/ft2  |
| 109080-003 | 13              | FL Kitchen        | 07/28/14    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 1.00 ft2  | 32.5 µg/wipe  | 32.5 µg/ft2  | 10.0 µg/ft2  |
| 109080-004 | 14              | SL Kitchen        | 07/28/14    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 0.734 ft2 | 23.3 µg/wipe  | 31.8 µg/ft2  | 13.6 µg/ft2  |
| 109080-005 | 15              | FL Bed 1          | 07/28/14    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 1.00 ft2  | <10.0 µg/wipe | <10.0 µg/ft2 | 10.0 µg/ft2  |
| 109080-006 | 16              | SL Bed 1          | 07/28/14    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 0.547 ft2 | 14.1 µg/wipe  | 25.7 µg/ft2  | 18.3 µg/ft2  |
| 109080-007 | 17              | FL Bed 3          | 07/28/14    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 1.00 ft2  | 38.1 µg/wipe  | 38.1 µg/ft2  | 10.0 µg/ft2  |
| 109080-008 | 18              | SL Bed 3          | 07/28/14    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 0.711 ft2 | 195 µg/wipe   | 274 µg/ft2   | 14.1 µg/ft2  |
| 109080-009 | 19              | WL Liv Rm         | 07/28/14    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 0.944 ft2 | 697 µg/wipe   | 738 µg/ft2   | 21.2 µg/ft2  |
| 109080-010 | 20              | WL Bed 1          | 07/28/14    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 0.842 ft2 | 339 µg/wipe   | 528 µg/ft2   | 15.6 µg/ft2  |
| 109080-011 | 21              | Blank             | 07/28/14    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             |           | <10.0 µg/wipe |              | 10.0 µg/wipe |

Analyst: (b)

109080-07/31/14 02:14 PM

(b) (6)

Metals Supervisor

Minimum Total Reporting Limit: 10.0 µg/wipe. EPA Clearance Std: 40 µg/ft<sup>2</sup> for floors, 250 µg/ft<sup>2</sup> for interior window sills, and 400 µg/ft<sup>2</sup> for window troughs. All internal QC parameters were met. Unusual sample conditions, if any, are described. Surrogate Spike results designated with "D" indicate that the analyte was diluted out. "MI" indicates matrix interference. Concentration and Reporting Limit (RL) based on areas provided by client. Values are reported to three significant figures. The analysis data reported relates only to the samples as submitted.

Accrediting bodies: AIHA-LAP, LLC 100527, VELAP/NELAC 480135 - Call laboratory for current national and state certifications.

Page 1 of 1



## **APPENDIX III**

### **DUST WIPE ANALYTICAL RESULTS**

---

## Performance Characteristic Sheet

EFFECTIVE DATE: December 1, 2006

EDITION NO.: 5

### MANUFACTURER AND MODEL:

Make: Radiation Monitoring Devices

Model: LPA-1

Source:  $^{57}\text{Co}$ 

Note: This sheet supersedes all previous sheets for the XRF instrument of the make, model, and source shown above for instruments sold or serviced after June 26, 1995. For other instruments, see prior editions.

### FIELD OPERATION GUIDANCE

#### OPERATING PARAMETERS:

Quick mode or 30-second equivalent standard (Time Corrected) mode readings.

#### XRF CALIBRATION CHECK LIMITS:

|                                           |
|-------------------------------------------|
| 0.7 to 1.3 mg/cm <sup>2</sup> (Inclusive) |
|-------------------------------------------|

#### SUBSTRATE CORRECTION:

For XRF results below 4.0 mg/cm<sup>2</sup>, substrate correction is recommended for:

Metal using 30-second equivalent standard (Time Corrected) mode readings.  
None using quick mode readings.

Substrate correction is not needed for:

Brick, Concrete, Drywall, Plaster, and Wood using 30-second equivalent standard (Time Corrected) mode readings  
Brick, Concrete, Drywall, Metal, Plaster, and Wood using quick mode readings

#### THRESHOLDS:

| 30-SECOND EQUIVALENT STANDARD<br>MODE READING DESCRIPTION       | SUBSTRATE | THRESHOLD<br>(mg/cm <sup>2</sup> ) |
|-----------------------------------------------------------------|-----------|------------------------------------|
| Results corrected for substrate bias<br>on metal substrate only | Brick     | 1.0                                |
|                                                                 | Concrete  | 1.0                                |
|                                                                 | Drywall   | 1.0                                |
|                                                                 | Metal     | 0.9                                |
|                                                                 | Plaster   | 1.0                                |
|                                                                 | Wood      | 1.0                                |

| QUICK MODE<br>READING DESCRIPTION                             | SUBSTRATE | THRESHOLD<br>(mg/cm <sup>2</sup> ) |
|---------------------------------------------------------------|-----------|------------------------------------|
| Readings not corrected for substrate bias<br>on any substrate | Brick     | 1.0                                |
|                                                               | Concrete  | 1.0                                |
|                                                               | Drywall   | 1.0                                |
|                                                               | Metal     | 1.0                                |
|                                                               | Plaster   | 1.0                                |
|                                                               | Wood      | 1.0                                |

**APPENDIX V**  
**XRF PERFORMANCE CHARACTERISTIC SHEET**

---



## BACKGROUND INFORMATION

### EVALUATION DATA SOURCE AND DATE:

This sheet is supplemental information to be used in conjunction with Chapter 7 of the HUD *Guidelines for the Evaluation and Control of Lead-Based Paint Hazards in Housing* ("HUD Guidelines"). Performance parameters shown on this sheet are calculated from the EPA/HUD evaluation using archived building components. Testing was conducted on approximately 150 test locations in July 1995. The instrument that performed testing in September had a new source installed in June 1995 with 12 mCi initial strength.

### OPERATING PARAMETERS:

Performance parameters shown in this sheet are applicable only when properly operating the instrument using the manufacturer's instructions and procedures described in Chapter 7 of the HUD Guidelines.

### XRF CALIBRATION CHECK:

The calibration of the XRF instrument should be checked using the paint film nearest 1.0 mg/cm<sup>2</sup> in the NIST Standard Reference Material (SRM) used (e.g., for NIST SRM 2579, use the 1.02 mg/cm<sup>2</sup> film).

If readings are outside the acceptable calibration check range, follow the manufacturer's instructions to bring the instruments into control before XRF testing proceeds.

### SUBSTRATE CORRECTION VALUE COMPUTATION :

Chapter 7 of the HUD Guidelines provides guidance on correcting XRF results for substrate bias. Supplemental guidance for using the paint film nearest 1.0 mg/cm<sup>2</sup> for substrate correction is provided:

XRF results are corrected for substrate bias by subtracting from each XRF result a correction value determined separately in each house for single-family housing or in each development for multifamily housing, for each substrate. The correction value is an average of XRF readings taken over the NIST SRM paint film nearest to 1.0 mg/cm<sup>2</sup> at test locations that have been scraped bare of their paint covering. Compute the correction values as follows:

Using the same XRF instrument, take three readings on a bare substrate area covered with the NIST SRM paint film nearest 1 mg/cm<sup>2</sup>. Repeat this procedure by taking three more readings on a second bare substrate area of the same substrate covered with the NIST SRM.

Compute the correction value for each substrate type where XRF readings indicate substrate correction is needed by computing the average of all six readings as shown below.

For each substrate type (the 1.02 mg/cm<sup>2</sup> NIST SRM is shown in this example; use the actual lead loading of the NIST SRM used for substrate correction):

$$\text{Correction value} = (1^{\text{st}} + 2^{\text{nd}} + 3^{\text{rd}} + 4^{\text{th}} + 5^{\text{th}} + 6^{\text{th}} \text{ Reading}) / 6 - 1.02 \text{ mg/cm}^2$$

Repeat this procedure for each substrate requiring substrate correction in the house or housing development.

### EVALUATING THE QUALITY OF XRF TESTING:

Randomly select ten testing combinations for retesting from each house or from two randomly selected units in multifamily housing. Use either the Quick Mode or 30-second equivalent standard (Time Corrected) Mode readings.

Conduct XRF re-testing at the ten testing combinations selected for retesting.

Determine if the XRF testing in the units or house passed or failed the test by applying the steps below.

Compute the Retest Tolerance Limit by the following steps:

Determine XRF results for the original and retest XRF readings. Do not correct the original or retest results for substrate bias. In single-family and multi-family housing, a result is defined as a single reading. Therefore, there will be ten original and ten retest XRF results for each house or for the two selected units.

Calculate the average of the original XRF result and retest XRF result for each testing combination.

Square the average for each testing combination.

Add the ten squared averages together. Call this quantity C.

Multiply the number C by 0.0072. Call this quantity D.

Add the number 0.032 to D. Call this quantity E.

Take the square root of E. Call this quantity F.

Multiply F by 1.645. The result is the Retest Tolerance Limit.

Compute the average of all ten original XRF results.

Compute the average of all ten re-test XRF results.

Find the absolute difference of the two averages.

If the difference is less than the Retest Tolerance Limit, the inspection has passed the retest. If the difference of the overall averages equals or exceeds the Retest Tolerance Limit, this procedure should be repeated with ten new testing combinations. If the difference of the overall averages is equal to or greater than the Retest Tolerance Limit a second time, then the inspection should be considered deficient.

Use of this procedure is estimated to produce a spurious result approximately 1% of the time. That is, results of this procedure will call for further examination when no examination is warranted in approximately 1 out of 100 dwelling units tested.

#### **BIAS AND PRECISION:**

Do not use these bias and precision data to correct for substrate bias. These bias and precision data were computed without substrate correction from samples with reported laboratory results less than 4.0 mg/cm<sup>2</sup> lead. The data which were used to determine the bias and precision estimates given in the table below have the following properties. During the July 1995 testing, there were 15 test locations with a laboratory-reported result equal to or greater than 4.0 mg/cm<sup>2</sup> lead. Of these, one 30-second standard mode reading was less than 1.0 mg/cm<sup>2</sup> and none of the quick mode readings were less than 1.0 mg/cm<sup>2</sup>. The instrument that tested in July is representative of instruments sold or serviced after June 26, 1995. These data are for illustrative purposes only. Actual bias must be determined on the site. Results provided above already account for bias and precision. Bias and precision ranges are provided to show the variability found between machines of the same model.

| 30-SECOND STANDARD MODE<br>READING MEASURED AT | SUBSTRATE | BIAS (mg/cm <sup>2</sup> ) | PRECISION* (mg/cm <sup>2</sup> ) |
|------------------------------------------------|-----------|----------------------------|----------------------------------|
| 0.0 mg/cm <sup>2</sup>                         | Brick     | 0.0                        | 0.1                              |
|                                                | Concrete  | 0.0                        | 0.1                              |
|                                                | Drywall   | 0.1                        | 0.1                              |
|                                                | Metal     | 0.3                        | 0.1                              |
|                                                | Plaster   | 0.1                        | 0.1                              |
|                                                | Wood      | 0.0                        | 0.1                              |
| 0.5 mg/cm <sup>2</sup>                         | Brick     | 0.0                        | 0.2                              |
|                                                | Concrete  | 0.0                        | 0.2                              |
|                                                | Drywall   | 0.0                        | 0.2                              |
|                                                | Metal     | 0.2                        | 0.2                              |
|                                                | Plaster   | 0.0                        | 0.2                              |
|                                                | Wood      | 0.0                        | 0.2                              |
| 1.0 mg/cm <sup>2</sup>                         | Brick     | 0.0                        | 0.3                              |
|                                                | Concrete  | 0.0                        | 0.3                              |
|                                                | Drywall   | 0.0                        | 0.3                              |
|                                                | Metal     | 0.2                        | 0.3                              |
|                                                | Plaster   | 0.0                        | 0.3                              |
|                                                | Wood      | 0.0                        | 0.3                              |
| 2.0 mg/cm <sup>2</sup>                         | Brick     | -0.1                       | 0.4                              |
|                                                | Concrete  | -0.1                       | 0.4                              |
|                                                | Drywall   | -0.1                       | 0.4                              |
|                                                | Metal     | 0.1                        | 0.4                              |
|                                                | Plaster   | -0.1                       | 0.4                              |
|                                                | Wood      | -0.1                       | 0.4                              |

\*Precision at 1 standard deviation.

#### CLASSIFICATION RESULTS:

XRF results are classified as positive if they are greater than the upper boundary of the inconclusive range, and negative if they are less than the lower boundary of the inconclusive range, or inconclusive if in between. The inconclusive range includes both its upper and lower bounds. Earlier editions of this *XRF Performance Characteristic Sheet* did not include both bounds of the inconclusive range as "inconclusive." While this edition of the *Performance Characteristics Sheet* uses a different system, the specific XRF readings that are considered positive, negative, or inconclusive for a given XRF model and substrate remain unchanged, so previous inspection results are not affected.

#### DOCUMENTATION:

An EPA document titled *Methodology for XRF Performance Characteristic Sheets* provides an explanation of the statistical methodology used to construct the data in the sheets, and provides empirical results from using the recommended inconclusive ranges or thresholds for specific XRF instruments. For a copy of this document call the National Lead Information Center Clearinghouse at 1-800-424-LEAD. A HUD document titled *A Nonparametric Method for Estimating the 5th and 95th Percentile Curves of Variable-Time XRF Readings Based on Monotone Regression* provides supplemental information on the methodology for variable-time XRF instruments. A copy of this document can be obtained from the HUD lead web site, [www.hud.gov/offices/lead](http://www.hud.gov/offices/lead).

This XRF Performance Characteristic Sheet was developed by QuanTech, Inc., under a contract from the U.S. Department of Housing and Urban Development (HUD). HUD has determined that the information provided here is acceptable when used as guidance in conjunction with Chapter 7, Lead-Based Paint Inspection, of HUD's *Guidelines for the Evaluation and Control of Lead-Based Paint Hazards in Housing*.



**EMSL Analytical, Inc.**

7 Constitution Way, Suite 107, Woburn, MA 01801

Phone/Fax: (781) 933-8411 / (781) 933-8412

[bostonlab@emsl.com](mailto:bostonlab@emsl.com)

EMSL Order: 131204616

CustomerID: AXIO80

CustomerPO:

ProjectID:

Attn: (b) (6)

**Axiom Partners, Inc.  
979 Main Street  
Wakefield, MA 01880**Phone: (781) 213-9198  
Fax: (781) 213-6992  
Received: 09/19/12 11:55 AM  
Analysis Date: 9/26/2012  
Collected: 9/17/2012

Project: 01006.025 / USGC; Martha's Vineyard; 921 Main Street; Vineyard Haven, MA

**Test Report: Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 and/or EPA 600/M4-82-020 Method(s) using Polarized Light Microscopy**

| Sample                          | Description                                             | Appearance                                 | Non-Asbestos |                          | Asbestos      |
|---------------------------------|---------------------------------------------------------|--------------------------------------------|--------------|--------------------------|---------------|
|                                 |                                                         |                                            | % Fibrous    | % Non-Fibrous            | % Type        |
| 091712-09-01A<br>131204616-0001 | Basement Walls -<br>Wall Coating on<br>Fieldstone Wall  | Gray/White<br>Non-Fibrous<br>Heterogeneous |              | 100% Non-fibrous (other) | None Detected |
| 091712-09-01B<br>131204616-0002 | Basement Walls -<br>Wall Coating on<br>Fieldstone Wall  | Gray/White<br>Non-Fibrous<br>Heterogeneous |              | 100% Non-fibrous (other) | None Detected |
| 091712-09-01C<br>131204616-0003 | Basement Walls -<br>Wall Coating on<br>Fieldstone Wall  | Gray/White<br>Non-Fibrous<br>Heterogeneous |              | 100% Non-fibrous (other) | None Detected |
| 091712-09-02A<br>131204616-0004 | Basement<br>Stairwell - Wall<br>and Ceiling Plaster     | Gray/White<br>Fibrous<br>Heterogeneous     | 2% Hair      | 98% Non-fibrous (other)  | None Detected |
| 091712-09-02B<br>131204616-0005 | Basement<br>Stairwell - Wall<br>and Ceiling Plaster     | Gray/White<br>Non-Fibrous<br>Heterogeneous | <1% Hair     | 100% Non-fibrous (other) | None Detected |
| 091712-09-02C<br>131204616-0006 | Basement<br>Stairwell - Wall<br>and Ceiling Plaster     | Gray/White<br>Fibrous<br>Heterogeneous     | 2% Hair      | 98% Non-fibrous (other)  | None Detected |
| 091712-09-02D<br>131204616-0007 | Crawl Space in<br>Bedroom - Wall<br>and Ceiling Plaster | White<br>Fibrous<br>Homogeneous            | 5% Hair      | 95% Non-fibrous (other)  | None Detected |
| 091712-09-02E<br>131204616-0008 | Crawl Space in<br>Bedroom - Wall<br>and Ceiling Plaster | White<br>Fibrous<br>Homogeneous            | 5% Hair      | 95% Non-fibrous (other)  | None Detected |

Analyst(s)

(b) (6)

(b) (6)

or other approved signatory

EMSL maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. Interpretation and use of test results are the responsibility of the client. This report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST or any agency of the federal government. Non-halable organically bound materials present a problem matrix and therefore EMSL recommends gravimetric reduction prior to analysis. Samples received in good condition unless otherwise noted. Estimated accuracy, precision and uncertainty data available upon request. Unless requested by the client, building materials manufactured with multiple layers (i.e. linoleum, wallboard, etc.) are reported as a single sample. Reporting limit is 1%.

Samples analyzed by EMSL Analytical, Inc. Woburn, MA NVLAP Lab Code 101147-0, CT PH-0315, MA AA000188, RI AAL-107T3 and VT AL357102

Initial Report from 09/26/2012 14:43:51

**EMSL Analytical, Inc.**

7 Constitution Way, Suite 107, Woburn, MA 01801

Phone/Fax: (781) 933-8411 / (781) 933-8412

[bostonlab@emsl.com](mailto:bostonlab@emsl.com)

EMSL Order: 131204616  
CustomerID: AXIO80  
CustomerPO:  
ProjectID:

Alt#: (b) (6)

**Axiom Partners, Inc.**  
979 Main Street  
Wakefield, MA 01880

Phone: (781) 213-9198  
Fax: (781) 213-6992  
Received: 09/19/12 11:55 AM  
Analysis Date: 9/26/2012  
Collected: 9/17/2012

Project: 01006.025 / USGC; Martha's Vineyard; 921 Main Street; Vineyard Haven, MA

**Test Report: Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 and/or EPA 600/M4-82-020 Method(s) using Polarized Light Microscopy**

| Sample                          | Description                                                 | Appearance                           | Non-Asbestos |                          | Asbestos      |
|---------------------------------|-------------------------------------------------------------|--------------------------------------|--------------|--------------------------|---------------|
|                                 |                                                             |                                      | % Fibrous    | % Non-Fibrous            | % Type        |
| 091712-09-03A<br>131204616-0009 | Kitchen - Mastic Paper on White Floor Sheeting              | Yellow<br>Non-Fibrous<br>Homogeneous |              | 100% Non-fibrous (other) | None Detected |
| 091712-09-03B<br>131204616-0010 | Entryway at Radiator - Mastic Paper on White Floor Sheeting | Yellow<br>Non-Fibrous<br>Homogeneous |              | 100% Non-fibrous (other) | None Detected |
| 091712-09-04A<br>131204616-0011 | Kitchen - White Floor Sheeting                              | White<br>Non-Fibrous<br>Homogeneous  |              | 100% Non-fibrous (other) | None Detected |
| 091712-09-04B<br>131204616-0012 | Entryway at Radiator - Mastic Paper on White Floor Sheeting | White<br>Non-Fibrous<br>Homogeneous  |              | 100% Non-fibrous (other) | None Detected |
| 091712-09-05A<br>131204616-0013 | Bathroom - Mastic Paper on Beige Peel & Stick Floor Tile    | Yellow<br>Non-Fibrous<br>Homogeneous |              | 100% Non-fibrous (other) | None Detected |
| 091712-09-05B<br>131204616-0014 | Bathroom - Mastic Paper on Beige Peel & Stick Floor Tile    | Yellow<br>Non-Fibrous<br>Homogeneous |              | 100% Non-fibrous (other) | None Detected |
| 091712-09-06A<br>131204616-0015 | Bathroom - Beige Peel & Stick Floor Tile                    | Tan<br>Non-Fibrous<br>Homogeneous    |              | 100% Non-fibrous (other) | None Detected |

Analyst(s)

(b) (6)

(b) (6)

or other approved signatory

EMSL maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. Interpretation and use of test results are the responsibility of the client. This report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST or any agency of the federal government. Non-stable organically bound materials present a problem matrix and therefore EMSL recommends gravimetric reduction prior to analysis. Samples received in good condition unless otherwise noted. Estimated accuracy precision and uncertainty data available upon request. Unless requested by the client, building materials manufactured with multiple layers (i.e. linoleum, wallboard, etc.) are reported as a single sample. Reporting limit is 1%.

Samples analyzed by EMSL Analytical, Inc. Woburn, MA NVLAP Lab Code 101147-0, CT PH-0315, MA AA000188, RI AAL-107T3 and VT AL357102

Initial report from 09/26/2012 14:43:51

**EMSL Analytical, Inc.**

7 Constitution Way, Suite 107, Woburn, MA 01801

Phone/Fax: (781) 933-8411 / (781) 933-8412

[bostonlab@emsl.com](mailto:bostonlab@emsl.com)

EMSL Order: 131204616

CustomerID: AXIO80

CustomerPO:

ProjectID:

Attn: (b) (6)

**Axiom Partners, Inc.****979 Main Street****Wakefield, MA 01880**

Phone: (781) 213-9198

Fax: (781) 213-6992

Received: 09/19/12 11:55 AM

Analysis Date: 9/26/2012

Collected: 9/17/2012

Project: 01006.025 / USGC; Martha's Vineyard; 921 Main Street; Vineyard Haven, MA

**Test Report: Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 and/or EPA 600/M4-82-020 Method(s) using Polarized Light Microscopy**

| Sample                          | Description                                                                        | Appearance                           | Non-Asbestos  |                          | Asbestos      |
|---------------------------------|------------------------------------------------------------------------------------|--------------------------------------|---------------|--------------------------|---------------|
|                                 |                                                                                    |                                      | % Fibrous     | % Non-Fibrous            | % Type        |
| 091712-09-06B<br>131204616-0016 | Bathroom - Beige<br>Peel & Stick Floor<br>Tile                                     | Gray<br>Non-Fibrous<br>Homogeneous   |               | 100% Non-fibrous (other) | None Detected |
| 091712-09-07A<br>131204616-0017 | Attic Spaces -<br>Loose Fill<br>Insulation                                         | Tan<br>Fibrous<br>Homogeneous        | 90% Cellulose | 10% Non-fibrous (other)  | None Detected |
| 091712-09-07B<br>131204616-0018 | Attic Spaces -<br>Loose Fill<br>Insulation                                         | Tan<br>Fibrous<br>Homogeneous        | 90% Cellulose | 10% Non-fibrous (other)  | None Detected |
| 091712-09-07C<br>131204616-0019 | Attic Spaces -<br>Loose Fill<br>Insulation                                         | Brown<br>Fibrous<br>Homogeneous      | 90% Cellulose | 10% Non-fibrous (other)  | None Detected |
| 091712-09-08A<br>131204616-0020 | Closet in Child's<br>Bedroom - Mastic<br>on Red Brick<br>Pattern Floor<br>Sheeting | Yellow<br>Non-Fibrous<br>Homogeneous |               | 100% Non-fibrous (other) | None Detected |
| 091712-09-08B<br>131204616-0021 | Closet in Child's<br>Bedroom - Mastic<br>on Red Brick<br>Pattern Floor<br>Sheeting | Yellow<br>Non-Fibrous<br>Homogeneous |               | 100% Non-fibrous (other) | None Detected |
| 091712-09-09A<br>131204616-0022 | Closet in Child's<br>Bedroom - Red<br>Brick Pattern Floor<br>Sheeting              | Red<br>Non-Fibrous<br>Homogeneous    |               | 98% Non-fibrous (other)  | 2% Chrysotile |

Analyst(s)

(b) (6)

(b) (6)

or other approved signatory

EMSL maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. Interpretation and use of test results are the responsibility of the client. This report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST or any agency of the federal government. Non-triatic organically bound materials present a problem matrix and therefore EMSL recommends gravimetric reduction prior to analysis. Samples received in good condition unless otherwise noted. Estimated accuracy, precision and uncertainty data available upon request. Unless requested by the client, building materials manufactured with multiple layers (i.e. linoleum, wallboard, etc.) are reported as a single sample. Reporting limit is 1%.

Samples analyzed by EMSL Analytical, Inc. Woburn, MA NVLAP Lab Code 101147-0, CT PH-0315, MA AA000188, RI AAL-10773 and VT AL357102

Initial report from 09/26/2012 14:43:51



**EMSL Analytical, Inc.**

7 Constitution Way, Suite 107, Woburn, MA 01801

Phone/Fax: (781) 933-8411 / (781) 933-8412

[bostonlab@emsl.com](mailto:bostonlab@emsl.com)

EMSL Order: 131204616  
CustomerID: AXIO80  
CustomerPO:  
ProjectID:

Attn: (b) (6)

**Axiom Partners, Inc.**  
979 Main Street  
Wakefield, MA 01880

Phone: (781) 213-9198  
Fax: (781) 213-6992  
Received: 09/19/12 11:55 AM  
Analysis Date: 9/26/2012  
Collected: 9/17/2012

Project: 01006.025 / USGC; Martha's Vineyard; 921 Main Street; Vineyard Haven, MA

**Test Report: Asbestos Analysis of Bulk Materials via EPA 600/R-93/116 and/or EPA 600/M4-82-020 Method(s) using Polarized Light Microscopy**

| Sample                          | Description                                                  | Appearance                        | Non-Asbestos |                          | Asbestos                     |
|---------------------------------|--------------------------------------------------------------|-----------------------------------|--------------|--------------------------|------------------------------|
|                                 |                                                              |                                   | % Fibrous    | % Non-Fibrous            | % Type                       |
| 091712-09-09B<br>131204616-0023 | Closet in Child's Bedroom - Red Brick Pattern Floor Sheeting |                                   |              |                          | Stop Positive (Not Analyzed) |
| 091712-09-10A<br>131204616-0024 | 6 over 9 Double Hung Units - Exterior Window Glazing         | Tan<br>Non-Fibrous<br>Homogeneous |              | 100% Non-fibrous (other) | None Detected                |
| 091712-09-10B<br>131204616-0025 | 6 over 9 Double Hung Units - Exterior Window Glazing         | Tan<br>Non-Fibrous<br>Homogeneous |              | 100% Non-fibrous (other) | None Detected                |
| 091712-09-10C<br>131204616-0026 | 6 over 9 Double Hung Units - Exterior Window Glazing         | Tan<br>Non-Fibrous<br>Homogeneous |              | 100% Non-fibrous (other) | None Detected                |

Analyst(s)

(b) (6)

(b) (6)

or other approved signatory

EMSL maintains liability limited to cost of analysis. This report relates only to the samples reported and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities or analytical method limitations. Interpretation and use of test results are the responsibility of the client. This report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST or any agency of the federal government. Non-hazardous organic bound materials present a problem matrix and therefore EMSL recommends gravimetric reduction prior to analysis. Samples received in good condition unless otherwise noted. Estimated accuracy, precision and uncertainty data available upon request. Unless requested by the client, building materials manufactured with multiple layers (e.g. linoleum, wallboard, etc.) are reported as a single sample. Reporting limit is 1%.

Samples analyzed by EMSL Analytical, Inc. Woburn, MA NVLAP Lab Code 101147-0, CT PH-0315, MA AA000188, RIAAL-107T3 and VT AL357102

Initial report from 09/26/2012 14:43:51

## **LEAD ABATEMENT WORK PLAN**

**West Chop Housing Repairs  
917 and 921 Main Street  
Tisbury, Massachusetts**

**Contract No. HSCGG1-15-C-PRV100**

**May 21, 2015**

### **GENERAL CONDITIONS**

#### ***1. ABATEMENT ACTION LEVEL & PROTOCOL***

The scope of the work for this project consists of the abatement and disposal, replacement, covering, scraping, and removal of lead-based paint contaminated building components in accordance with the requirements of Federal laws and regulations. Applicable laws and regulations include, but are not limited to, Department of Housing and Urban Development (HUD) *Requirements for Notification, Evaluation and Reduction of Lead-Based Paint Hazards in Federally Owned Residential Property and Housing Receiving Federal Assistance*, also known as the HUD Lead Safe Housing Rule (24 CFR Part 35, subparts B-R).

All lead abatement activities performed shall be in accordance with applicable Federal laws, ordinances, codes or regulations governing evaluation and hazard reduction. In the event of discrepancies, the most protective requirements prevail. These requirements can be found in OSHA 29 CFR 1926-Construction Industry Standards, 29 CFR 1926.62-Construction Industry Lead Standards, 29 CFR 1910.1200-Hazard Communication,

Abatement is to be performed in reliance upon the Lead Assessment Report included in bid documents:

Inspection Date: July 28, 2014, by Inspector (b) (6)

#### ***2. REQUIREMENT TO PRODUCE DELEADED UNITS***

The scope of the work includes all supervision, technical personnel, labor, material, machinery, tools, appurtenances, equipment and services, including transportation services required to produce a abated units, including exterior, in order that the property passes a visual re-inspection with all surfaces abated per scope of work, no visible dust and passing dust wipe levels are achieved. The property is owned by the Federal Government (USCG), and as such, abatement work is not governed by the Massachusetts Lead Law.

#### ***3. METHOD OF ABATEMENT***

Methods of abatement in this contract include enclosing, scraping and removal as required to achieve lead abatement, except as other methods are specified herein.

#### ***4. SCOPE OF THE ABATEMENT WORK***

The scope of the abatement work for interior includes covering walls and ceilings with gypsum board or blue board, either stripping or replacement of doors, stripping or replacement of door casings, stripping or replacement of window casings, covering window wells with aluminum coil stock, stripping paint from stair risers and stringers, covering baseboards with new wood (existing baseboards are not to be removed, except for possibly the top trim piece, do not abate (cover) baseboards behind radiators, make

intact if needed. The scope of the abatement work for exterior includes stripping or replacement of lead components with the exception of support columns which require stripping.

A detailed summary of work to be performed is provided in the attached Lead Abatement Specification Summary Tables.

*5. DESIGNATED INSPECTOR*

A Massachusetts Licensed Lead Inspector will perform any and all re-inspections and/or inspections, along with post-abatement dust wipe clearance sampling prior to reoccupancy.

*6. FAILURE OF INSPECTION*

Should abatement work fail to pass re-inspection, the Lead Abatement Contractor will remedy any and all deficiencies at no additional charge and will bear the cost of all additional testing until a passing visual inspection and passing dust wipes are achieved.

*7. BUILDING PERMIT REQUIREMENT*

A building permit is not required.

*8. WASTE GENERATION*

The Lead Abatement Contractor will segregate all waste generated on this project as to type, in order that a representative sample may be selected by the Owner or representative. Liquid waste generation shall be minimized by all ordinary means, including HEPA - filtering of contaminated liquid to reduce concentration of lead to acceptable levels.

*9. WASTE DISPOSAL*

The Lead Abatement Contractor will be responsible for the disposal of all lead paint wastes according to all applicable rules and regulations. The Lead Abatement Contractor will bear the cost of all transportation and disposal of non-hazardous or exempt waste.



## **SPECIAL CONDITIONS**

### **PART I - GENERAL**

#### **1.01 Related Documents**

- A. General Conditions – The General Conditions of the Contract.
- B. USCG Scope of Work for Repair West Chop Housing at 917 and 921 Main Street (SOW).

#### **1.02 Definitions**

- A. The Owner – United States Coast Guard (USCG).
- B. The Lead Abatement Contractor – The duly licensed Massachusetts deleading contractor selected by the Owner or their representative to complete the contract for the abatement work.
- C. The Occupants – The future residents of the housing unit being abated, as designated by the Owner.

#### **1.03 General Requirements**

A. General Scope – The work of this Section consists of the abatement and disposal of lead-based paint contaminated building components in accordance with all requirements of the applicable Federal laws and regulations. Applicable laws and regulations are listed in Section 1.05.

B. Abatement Methods – The abatement work, including the methods of abatement to be used, are described in detail in the attached SOW. The abatement methods required in the SOW must be used. Alternate methods may not be used unless approved in writing by Owner.

C. Worker Training and Protection – The abatement work includes provision of all worker training, protection, and supervision required to ensure the proper completion of abatement work, and the health and safety of workers performing abatement work. All work of this Section shall be performed using the worker training and protection procedures and equipment specified herein.

D. Control, Containment, and Clean-Up of Lead – The work of this Section includes provision of all temporary construction and other measures to prevent, control, contain, and clean-up lead contamination, including those lead hazards that are pre-existing conditions as well as those which are generated by the abatement work. All abatement work shall be performed using the control, containment, and clean-up methods required. Alternate methods may not be used unless approved in writing by the Owner.

E. Temporary Construction – The abatement work includes the provision, temporary installation and complete removal of all plywood enclosures, blocking, sealant, plastic

sheeting, and other temporary measures required to protect existing structures and fixtures, to maintain structures in weather tight and secure condition services during the work of this Section. All utility services shall be maintained throughout the work.

F. Worker Protection – The Lead Abatement Contractor has the sole responsibility to ensure that supervisors and workers are properly examined and monitored in accordance with applicable laws and to protect their health and safety.

- 1.04 Lines of Communication and Responsibility – The contract for the work shall be completed by a single Lead Abatement Contractor duly licensed under Massachusetts Laws and Regulations. The Lead Abatement Contractor shall designate a qualified Project Manager responsible for overall management of the project and a qualified Site Supervisor who shall provide on-site supervision during all abatement operations and related work. The Project Manager and the Site Supervisor shall have the authority to represent the Lead Abatement Contractor in all matter concerning the abatement work. The Owner shall direct all communications to the Project Manager or the Site Supervisor.

A. The abatement work shall be executed by a single firm, specializing in the type of abatement required here so that there will be undivided responsibility for the performance of the abatement work.

B. All abatement work shall be executed by supervisors and workers who are employees of the Lead Abatement Contractor. Use of subcontractors is not permitted without the written approval of the Owner.

C. TANTARA's Site Supervisor shall be responsible for and have the authority to direct all on-site operations. The Site Supervisor shall be present at the abatement site during all abatement operations, including abatement site preparation, active abatement, clean-up, clearance, waste disposal and all required inspections.

#### 1.05 Quality Assurance

A. Regulations - Nothing in these specifications is intended to relieve the Abatement Contractor of any responsibility to comply with HUD *Requirements for Notification, Evaluation and Reduction of Lead-Based Paint Hazards in Federally Owned Residential Property and Housing Receiving Federal Assistance*, also known as the HUD Lead Safe Housing Rule (24 CFR Part 35, subparts B-R).

B. Applicable Sections of the HUD *Guidelines for the Evaluation and Control of Lead-Based Paint Hazards in Housing*, July 2012 (Guidelines). In addition to the HUD Regulations, compliance with the following sections of the Guidelines is required:

1. Chapter 10: limited to protocols for post-abatement dust wipe clearance sampling and analysis – The abatement work shall not be considered complete until satisfactory dust wipe clearance test results have been obtained in accordance with these HUD protocols. Dust wipe samples shall be collected from window wells, window sills, and floor areas, as required, prior to the application of finish

paint or other finish materials. The results of the dust wipe sampling shall not exceed:

|               |                                        |
|---------------|----------------------------------------|
| Window Wells: | 400 micrograms per square foot of lead |
| Window Sills: | 250 micrograms per square foot of lead |
| Floors:       | 40 micrograms per square foot of lead  |

a. Clean-up to these standards shall be completed by the Lead Abatement Contractor, including clean-up of pre-existing lead contaminated dust and debris.

b. Clearance samples shall be collected by an independent, duly-licensed Mass. Inspector, and analyzed in an independent laboratory. Inspector and Laboratory to be approved by the Owner. The Owner shall advise the Lead Abatement Contractor of the firms selected to perform clearance sample collection and analysis. The Lead Abatement Contractor shall immediately disclose any business or personal relationship with any Inspector or Laboratory involved in clearance sample collection or analysis.

c. The Lead Abatement Contractor shall in no way participate in the collection or analysis of clearance samples.

d. If clearance testing fails, and repeated cleaning is required, all costs associated with repeated cleaning and clearance testing, shall be paid by the Lead Abatement Contractor, including additional testing, relocation and administrative expenses which may be incurred by the Owner or the Occupant as a result of a failure to achieve clearance.

2. Waste Disposal – The Resource Conservation and Recovery Act of 1976 (42 U.S.C. 6901) (RCRA) shall govern all waste disposal resulting from abatement. If not exempt, wastes resulting from abatement work must be "characterized" (tested for their hazardous material content) prior to disposal. The Owner may determine that wastes are categorically exempt from the RCRA. Do not dispose of any waste which has not been tested unless advised by the Owner that such wastes are exempt from RCRA. Until such time as wastes are exempted or tested, they must be handled, stored and transported as hazardous wastes. All untested waste should be stored in a locked, secure area until removed from the site.

C. Qualifications of the Lead Abatement Contractor – The Lead Abatement Contractor must be able to substantiate sufficient prior abatement experience and knowledge to understand and employ the abatement techniques and safety practices described herein, and the ability to adhere to these specifications. The Lead Abatement Contractor must have completed at least three (3) previous LBP abatement contracts involving abatement procedures comparable to the work of this Section, of not less than \$5,000 value for the abatement work in total.

D. Qualifications of the Abatement Workers – The abatement workers must be skilled employees who are thoroughly trained and experienced in the necessary crafts and the methods needed for proper performance of the abatement work. All workers must have



completed such training as required under the DPH and DLI Regulations prior to the start of the work.

E. **Qualifications of Supervisors:** The Lead Abatement Contractor shall provide a full-time, competent Site Supervisor for proper coordination of this work of this Section. The Site Supervisor must have completed such training as required by the Mass. Lead Law.

1.06 **Insurance** – The Lead Abatement Contractor shall maintain the following coverage during the term of the abatement contract.

A. General Liability Insurance

B. Worker's Compensation Insurance

C. Motor Vehicle Insurance

1.07 **Scheduling and Coordination**

A. **Notice to Proceed** – Work of this Section shall not proceed under any circumstances without the issuance of a written Notice to Proceed by the Owner.

B. **Project Scheduling** – The schedule for abatement work is as follows:

The work shall commence on July 6, 2015 or one week after the date of the Contract, whichever is later. Exceptions to this requirement must be in writing and approved by TANTARA.

Proper diligence and cooperation between the contractor, the owner and tenants should allow for completion of all work within 8 weeks, or August 28, 2015. The Lead Abatement Contractor shall comply in all respects with the schedule for abatement work.

C. **Special Scheduling Considerations**

1. **Abatement Work Area Set-Up Inspection** – When the abatement work area has been fully prepared, but prior to any abatement work which disrupts lead-based paint, the Owner (or TANTARA) must inspect the abatement work site. The Lead Abatement Contractor shall notify the Owner no less than 24 hours in advance of completion of abatement site preparations in order to obtain this inspection. Before proceeding with abatement work which disrupts lead-based paint surfaces, the Lead Abatement Contractor shall make all reasonable corrections resulting from this inspection as recommended by the Owner.

2. **Final Inspection and Clearance** – The Lead Abatement Contractor must provide at least 24 hours advance notice of when the abatement work will be complete, including required clean-up. Upon completion of the work a 24-hour dust settlement period will be required.

Thereafter, a visual inspection must be performed. If satisfactory, clearance sampling will be performed. A minimum of two (2) hours for each unit shall be allowed for the performance of clearance sampling. After the collection of

clearance samples, allow until the end of the following working day for the test results to be available.

3. Remedial Cleaning – In the event that the clearance test results are not satisfactory, the Lead Abatement Contractor shall begin remedial work no later than the following working day after notification by the Owner.

4. Building Protection – The Lead Abatement Contractor shall substantially complete the installation of new components necessary to ensure that the unit or building remains weather tight or secure on the same working day that the corresponding existing components are removed, or provide temporary protection to ensure buildings are weather tight and secure against unauthorized entry after removal of existing components. The unit/building must be made weather tight and secure by the end of each working day.

#### 1.07 Preconstruction Meeting/Submittals

A. The Lead Abatement Contractor shall meet with the Owner and other parties as directed by the Owner, for a pre-construction meeting prior to commencing work. The Lead Abatement Contractor's Project Manager and Site Supervisor must attend this meeting. The scope and conditions of the abatement work will be reviewed at this meeting to take place at the work site.

B. At the Pre-Construction Conference, the Lead Abatement Contractor shall provide two (2) copies of the following submittals for review:

1. Copies of all notifications, permits, licenses, and applications as required by DPH and DLI regulations.
2. Copies of medical records as required by DLS Regulations: 1. for each worker and supervisor, a record of the required medical examination, with a determination by the examining physician of fitness for respirator use; 2. for each worker and supervisor, the results of the last venous blood lead test. Venous blood lead tests shall have been conducted within the time frames required by DLS Regulations.
3. For each worker and supervisor, record of a successful respirator fit within the preceding twelve (12) months.
4. A written statement of the Lead Abatement Contractor's Blood Lead Testing Plan, indicating the frequency of venous blood lead testing.
5. The names, addresses, and telephone numbers of the physician and the blood lead testing laboratory to be used for the Lead Abatement Contractor's medical surveillance program.
6. List of Products and Materials – Submit a list identifying products meeting requirements of Section 2.02, below.

7. Hazardous waste, List of waste transport's licensing and the licensing of the landfill where the waste will be disposed of should the waste be determined to be hazardous.

8. A copy of the Lead Abatement Contractor's most recent license certification. To be submitted prior to execution of contract.

9. A copy of the required DPH and DLS notifications for the abatement work, with documentation that they have been filed with DPH and DLI.

The Owner shall review these submittals, and advise the Lead Abatement Contractor within 3 working days working days if they do not comply in all respects with the terms and conditions of the Contract.

## **PART II - Products**

2.01 Quality Assurances – All material and equipment to be for abatement work shall be subject to the approval of the Owner. Do not use materials which have not been submitted, reviewed and approved by the Owner.

2.02 Materials and Equipment

A. Polyethylene sheeting, 6 mils thick, and tape that is of a type that will not damage the surface to which it will be applied.

B. Lead Warning Signs. Submit samples. Must comply with DLS Regulations.

## **PART III - Execution**

3.01 Worksite Preparation – The following requirements apply to all work under this Section.

A. The Lead Abatement Contractor shall obtain the consent of the Owner in all matters involving the use of the property. At no time shall the Lead Abatement Contractor cause or allow to be caused any condition which present hazards to the residents of the property or the general public.

B. The Lead Abatement Contractor is advised that adjacent units to the unit being abated will be fully occupied, and that all necessary protection of adjacent units is included in the abatement work, including: preservation of one unobstructed means of egress and one caution sign at poly barrier.

C. Control of Access: During the working day, temporary fencing, at least four (4) feet high shall be erected and maintained to enclose all exterior abatement work areas, access to common areas or other abatement work areas which cannot be secured by other means. Temporary fencing is required for any exterior work which is within 50 feet of a public walkway or road, or the property of another occupied unit, including exterior yard areas and driveways. If exterior health or safety hazards, including lead hazards, will not be

completely repaired or corrected by the end of each working day, an eight-foot high protection fencing shall be installed and maintained. No unauthorized or unprotected personnel may enter a work site.

D. Decontamination Area – The Lead Abatement Contractor shall provide decontamination rooms, directly connected to all abatement work areas, so that workers must pass through a decontamination room when exiting any area where abatement work will take place. No work which disturbs lead hazards shall begin until the decontamination area(s) is in place. The decontamination room shall be a freestanding frame or existing room, completely lined with one layer of airtight plastic sheeting, with entry/egress airlock barriers.

The decontamination room shall be used by workers to clean and remove protective clothing and to clean work shoes and other items exposed to lead contamination before they are brought out of the work area. All protective clothing shall be HEPA-vacuumed and removed before exiting. All other items shall be thoroughly cleaned by HEPA vacuuming and wet wiping. At the end of the work day, single-use protective clothing shall be disposed of in the decontamination area. Upon exiting the decontamination area, all workers should immediately wash their hands and faces. The decontamination area shall be cleaned daily.

E. Caution Signs – At the entry to each abatement work area, the Lead Abatement Contractor shall post warning signs meeting DLI Regulations prior to the start of abatement work. They shall be maintained until the work area has passed clearance tests.

F. Electrical Set-up Procedures: The Lead Abatement Contractor shall obtain the approval of the Owner in writing if interruptions in utility services are necessary to complete the work. In the event that any electrical work is required to complete the abatement work, it shall be performed by a duly-licensed electrician.

1. If necessary, ensure that all utilities interfering with the abatement work are temporarily relocated or disconnected prior to starting the abatement work. If interruption of existing utility service is necessary, provide advance notice and obtain the Owner's consent.

2. Immediately repair electrical, telephone, cable, etc. damaged by abatement work. Notify the Owner immediately if any utility services are interrupted which may affect occupants.

3. Provide GFI-protected outlets for use during abatement in any abatement area where liquid products are in use.

4. If existing electrical circuits are not adequate, provide temporary circuits with adequate power and protections, or provide power using portable generators.

5. If existing electrical service is adequate, it may be used for abatement work, and the cost of electricity shall be paid for by the Owner.

### 3.02 Work Area Preparation for Interior Abatement Areas.

A. Isolation of Abatement Work Areas – Each abatement work area must be sealed sufficiently to prevent the migration of dust from the abatement work area and secure



against unauthorized entry. The Lead Abatement Contractor shall completely seal-off, isolate and secure all abatement work areas so that:

1. There is at least one entry and one egress for every abatement work area, and as few additional entries/egresses as possible. All other potential points of entry must be secured with a minimum of two layers of plastic sheeting, each layer securely taped on all four sides.
2. There is an airlock barrier at each entry/egress. Use two sheets of plastic, an outside sheet secured at all four sides and slit vertically, an inside sheet taped at the top and completely covering the opening in the outer sheet
3. Place temporary fencing to secure entries/egresses to abatement work areas if they are accessible to the public or other residents of the building.
4. Abatement work shall not begin until all isolation barriers are in place. Barriers shall not be removed until work areas are cleaned as specified herein and the results of clearance samples are satisfactory.

B. Signs – Warning shall be posted at all entries/egresses to the work area per DLI Regulations. Work shall not begin until signs are installed.

C. Floor Cover – Two layers of 6-mil. polyethylene shall be placed to cover all floors in the abatement work area to remain in place until work is completed. Do not begin abatement work until floors are covered.

D. Horizontal and Hard-To-Clean Surfaces – In addition to floors, cover all horizontal surfaces, and other porous and hard-to-clean surfaces in the immediate area of the abatement work, at a distance of eight (8) feet or less from active abatement areas. Maintain covering until completion of the work.

E. Permanent Fixtures, Built-In Cabinets, and Appurtenances – At least one layer of 6 mil plastic sheeting and tape shall be used to cover and seal-off all fixtures, cabinets, and furnishings which cannot be readily removed from the work area. The Owner shall remove or ensure that the residents remove all portable items prior to the start of abatement work.

F. Maintenance of Barriers – The decontamination areas, isolated abatement work area, floor covering, furniture/fixture covering, and covering on other surfaces shall be maintained until all abatement work is complete. Isolation barriers must be maintained until satisfactory clearance results are obtained. Any breeches in isolation barriers and coverings shall be repaired immediately. No work shall proceed until repairs are complete.

- 3.03 Preparation of Exterior and Related Work Areas – Prior to disturbing any lead hazard at exteriors, the Deleading Contractor shall cover all openings in the buildings on the same side of the building where the work is taking place with six (6) mil plastic and tape, and any other opening within 10 feet of any part of an exterior work area, to render a continuous airtight building envelope which prevents lead particles from entering the building. Windows and doors outside of this boundary must be closed and locked if possible. Openings, windows and doors which cannot be locked shall be covered with 6 mil plastic sheeting.

A. Except for abatement identified as interior work in the SOW, all work shall be done from the exterior of the building:

B. Building Openings: The Lead Abatement Contractor shall seal off all building openings and penetrations including vents and HVAC units 6 mil plastic sheeting and tape.

C. Preparation of Ground Areas: The Lead Abatement Contractor shall place 6-mil plastic on the ground extending out from the building foundation wall no less than 10 feet. The plastic shall be secured at the foundation by tape if a sufficient bond can be obtained or by nailing retaining boards to the building if necessary. The seam between the plastic and the building shall be HEPA vacuumed before the plastic is removed to prevent contamination of the soil by lead dust or chips during the removal of the plastic. The perimeter outer edges of the plastic shall be secured in place by laying "two by four" pieces of lumber on the plastic. All shrubs and bushes shall be covered with plastic sheeting. Workers must not be permitted to walk on uncovered areas, only on the plastic.

The Lead Abatement Contractor shall repair any penetrations in this barrier immediately. In the event that ground covering is not sufficient to contain all lead contaminated debris, covering shall be extended an additional ten (10) feet.

3.04 Demolition of Lead Contaminated Components – All demolition work shall be done in a controlled fashion to minimize dust generation, in the following manner:

A. Remove with Care – Surfaces to be demolished or removed shall be misted with water, and carefully detached from the building. Once removed, components shall be placed carefully on the floor/ground within the work area. Components must not be dropped or thrown. Debris is to be carried to disposal containers as soon as the demolition work in the immediate area is complete, and shall not be allowed to accumulate.

B. Temporary Protection – Install all temporary construction to restore buildings to a weather tight condition, to include sealant, blocking, plywood boarding, and 6 mil plastic sheeting, as soon as possible upon removal of any exterior components disrupting the building envelope, and absolutely no later than the end of the working day. The Lead Abatement Contractor shall have complete responsibility for failure to protect the buildings against natural elements. The Lead Abatement Contractor shall promptly repair damage caused by natural elements at no cost to the Owner.

3.05 Worker Protection Requirements

A. Minimum Requirements – Unless the Lead Abatement Contractor can demonstrate the absence of lead hazards to his worker areas by presenting data from similar abatement work, minimum worker protection shall include DLS-approved half-mask air-purifying respirators with HEPA cartridges, disposable coveralls with head covers, gloves and eye protection while in all abatement work areas. In addition, the following items of worker protection are required:

If chemical strippers are being used, chemical resistant gloves and eye protection should be worn in the abatement work area, and an eye wash station should be required to be available at the site.

B. Decontamination Before Exiting – Before leaving the work area, workers shall remove debris, and dust from protective clothing and equipment by completely HEPA vacuuming them in the decontamination area before exiting. Disposable coveralls shall be removed before exiting decontamination areas.

C. Decontamination of Equipment – All tools and equipment used inside the work area shall be left in the work area or thoroughly decontaminated by HEPA vacuuming and TSP wipe down before removal from the work area.

D. Protective Hygiene – Under no circumstances shall workers or supervisory personnel eat, drink, smoke, apply cosmetics, chew gum, or chew tobacco in the abatement work area. Only in case of health and safety emergencies shall respirators be removed while in the work area. All work breaks must be taken outside of the abatement work area.

### 3.06 Cleanup and Site Management

A. Daily Cleanup and Securing of the Premises – All abatement areas shall be cleaned at the end of each working day. Allow sufficient time for clean-up within regular working hours. This requirement applies to both interior and exterior work sites. No abatement work is permitted while daily cleanup is in progress. After daily clean-up, the work site shall be secured to prevent entry. The Lead Abatement Contractor shall be completely responsible for the security of all housing units being abated. The Lead Abatement Contractor shall promptly restore, repair or replace any items damage or stolen as a result of unauthorized entry during non-work hours.

B. Waste Storage - The Lead Abatement Contractor shall identify and obtain the Owner's approval of a secure area for waste storage, if necessary. Waste containers must be locked during non-work hours.

C. Equipment and Materials Storage - The Lead Abatement Contractor shall bear all responsibility for all tools and equipment used and stored at the work site.

D. Final Cleaning - Complete the following:

1. Upon completion of all construction work at the site, the Lead Abatement Contractor will return to the site to perform a final cleanup in all work areas.

a. Remove all gross debris remaining debris. Mist small debris with water for dust control, and carefully sweep into 6 mil plastic bags. If used, fold plastic sheeting inward to contain any remaining dust. Remove sheeting beginning from highest levels, continuing down to floor sheeting. Place immediately in 6-mil poly bags for disposal.

b. HEPA vacuum all surfaces, proceeding down from the top of the walls, including doors, trim, baseboards, fixtures, and all other surfaces. Vacuum the floor last.

c. Hand wash all horizontal surfaces with sponge soaked in an approved cleaning agent, and allow surfaces to dry. Then HEPA vacuum all surfaces again.

d. Cleaning solutions and materials must be changed after cleaning each room or area. Contact local authorities to determine requirements for disposal of waste water.

2. Final Inspection - Final inspection shall be performed only after final clean-up is completed, all surfaces are dry, and, if not waived, the 24-hour dust settlement period has passed. Final inspection shall be performed in accordance with HUD Regulations.

3. Clearance Testing - Clearance testing will be performed only after a satisfactory Final Inspection. No clearance samples will be collected if Final Inspection is not satisfactory.

### 3.07 Post Abatement Documentation and Record keeping

A. The Lead Abatement Contractor shall provide the following records upon completion of the abatement work, prior to a request for final payment:

1. All documentation relative to compliance with solid and liquid waste transport and disposal regulations. Copies of manifests and receipts acknowledging disposal of all hazardous waste materials showing delivery date, quantity, and the signature of the duly-licensed landfill operator and transporter.

2. Results from all worker and supervisor blood lead tests performed during the term of the contract (Notice to Proceed until Final Inspection).



### LBP Abatement Specification Summary Table

**Address:** 917 Main St.

**Type of Building:** Single Family

Vineyard Haven, MA

| Room    | Side          | Surface              | Qty.* | Unit | Abatement method          |
|---------|---------------|----------------------|-------|------|---------------------------|
| Room 1  |               | Baseboards           | ALL   | EA.  | Cover with Wood           |
| Room 1  | B             | Door Casing Header   | 1     | EA.  | Replace or Strip          |
| Room 1  | A(L), A(R), D | Window Casing        | 3     | EA.  | Strip                     |
| Room 1  | A(L),A (R), D | Window Exterior Sill | 3     | EA   | Cover aluminum coil stock |
|         |               |                      |       |      |                           |
| Room 2  |               | Baseboards           | ALL   | EA.  | Cover with Wood           |
| Room 2  | D(L)          | Door Casing          | 1     | EA.  | Replace or Strip          |
| Room 2  | D(R)          | Door Casing          | 1     | EA.  | Replace or Strip          |
| Room 2  | D(R)          | Door Jamb            | 1     | EA   | Replace or Strip          |
| Room 2  | A             | Door Stop            | 1     | EA   | Replace or Strip          |
| Room 2  | B(L)          | Window Exterior Sill | 1     | EA   | Cover aluminum coil stock |
| Room 2  | B(R)          | Window Exterior Sill | 1     | EA   | Cover aluminum coil stock |
| Room 2  | D             | Closet Door Casing   | 1     | EA.  | Replace or Strip          |
| Room 2  | D             | Closet Door Jamb     | 1     | EA   | Replace or Strip          |
| Room 2  | D             | Closet Walls         | ALL   | EA   | Cover with gypsum board   |
| Room 2  | D             | Closet Baseboard     | ALL   | EA   | Cover with Wood           |
| Room 2  | D             | Closet Shelf (upper) | ALL   | EA   | Replace                   |
| Room 2  | D             | Closet Shelf Support | ALL   | EA   | Replace                   |
|         |               |                      |       |      |                           |
| Laundry |               | Baseboards           | ALL   | EA.  | Cover with Wood           |
| Laundry | D             | Door Casing          | 1     | EA.  | Replace or Strip          |
| Laundry | D             | Door Jamb            | 1     | EA   | Replace or Strip          |
| Laundry | C             | Window Casing        | 1     | EA   | Replace or Strip          |
| Laundry | C             | Window Exterior Sill | 1     | EA   | Cover aluminum coil stock |
|         |               |                      |       |      |                           |
| Bath 1  |               | Baseboards           | ALL   | EA.  | Cover with Wood           |
| Bath 1  | A, B          | Door Casing          | 2     | EA.  | Replace or Strip          |
| Bath 1  | A, B          | Door Jamb            | 2     | EA   | Replace or Strip          |
| Bath 1  | C             | Window Casing        | 1     | EA   | Strip                     |
| Bath 1  | C             | Window Exterior Sill | 1     | EA   | Cover aluminum coil stock |

\* Quantities are listed for comparison purposes only. In all cases it is the contractor's responsibility to verify actual measurements.

# LBP Abatement Specification Summary Table

Address: 917 Main St.  
Vineyard Haven, MA

Type of Building: Single Family

| Room                       | Side       | Surface              | Qty.* | Unit | Abatement method          |
|----------------------------|------------|----------------------|-------|------|---------------------------|
| Foyer                      |            | Baseboards           | ALL   | EA.  | Cover with Wood           |
| Foyer                      | A          | Door Casing          | 1     | EA.  | Replace or Strip          |
| Foyer                      | A          | Door Jamb            | 1     | EA   | Replace or Strip          |
| Foyer                      | D          | Door                 | 1     | EA   | Replace or Strip          |
| Foyer                      | D          | Door Jamb            | 1     | EA.  | Replace or Strip          |
|                            |            |                      |       |      |                           |
| Kitchen                    |            | Baseboards           | ALL   | EA.  | Cover with Wood           |
| Kitchen                    | B(L)       | Door Casing          | 1     | EA.  | Replace or Strip          |
| Kitchen                    | B(L)       | Door Jamb            | 1     | EA.  | Replace or Strip          |
| Kitchen                    | B(R)       | Door Casing          | 1     | EA   | Replace or Strip          |
| Kitchen                    | B(R)       | Door Jamb            | 1     | EA   | Replace or Strip          |
| Kitchen                    | C(L) C (R) | Door Casing          | 2     | EA.  | Replace or Strip          |
| Kitchen                    | C, D       | Window Exterior Sill | 2     | EA   | Cover aluminum coil stock |
|                            |            |                      |       |      |                           |
| Staircase                  | ABCD       | Ceiling              |       |      | Cover with Gypsum Board   |
| Staircase                  | ABCD       | Walls                | ALL   |      | Cover with Gypsum Board   |
| Staircase                  |            | Baseboard            | ALL   |      | Cover with Wood           |
| Staircase                  | A          | Door Casing          | 1     | EA.  | Replace or Strip          |
| Staircase                  | A          | Door Jamb            | 1     | EA.  | Replace or Strip          |
| Staircase                  | B          | Door Casing          | 1     | EA   | Replace or Strip          |
| Staircase                  | B          | Door Jamb            | 1     | EA   | Replace or Strip          |
| Staircase                  | D          | Door Casing          | 1     | EA.  | Replace or Strip          |
| Staircase                  | D          | Door Jamb            | 1     | EA.  | Replace or Strip          |
| Staircase                  | A          | Window Casing        | 1     | EA   | Strip                     |
| Staircase                  | A          | Window Apron         | 1     | EA   | Strip                     |
| Staircase                  | A          | Window Exterior Sill | 1     | EA   | Cover aluminum coil stock |
| Staircase                  |            | Stair Risers         | ALL   | EA   | Strip                     |
| Staircase                  |            | Stair Stringer       | ALL   | EA.  | Cover with Wood or Strip  |
|                            |            |                      |       |      |                           |
| Hall 2 <sup>nd</sup> Floor |            | Ceiling              |       | EA   | Cover with Gypsum Board   |
| Hall 2 <sup>nd</sup> Floor | ABCD       | Walls                | ALL   | EA   | Cover with Gypsum Board   |

\* Quantities are listed for comparison purposes only. In all cases it is the contractor's responsibility to verify actual measurements.

### LBP Abatement Specification Summary Table

Address: 917 Main St.

Type of Building: Single Family

Vineyard Haven, MA

| Room                       | Side | Surface              | Qty | Unit | Abatement method               |
|----------------------------|------|----------------------|-----|------|--------------------------------|
| Hall 2 <sup>nd</sup> Floor |      | Baseboards           | ALL | EA.  | Cover with Wood                |
| Hall 2 <sup>nd</sup> Floor | A(L) | Door Jamb            | 1   | EA.  | Replace or Strip               |
| Hall 2 <sup>nd</sup> Floor | A(R) | Door Jamb            | 1   | EA   | Replace or Strip               |
| Hall 2 <sup>nd</sup> Floor | B    | Door Jamb            | 1   | EA.  | Replace or Strip               |
| Hall 2 <sup>nd</sup> Floor | C    | Door Jamb            | 1   | EA   | Replace or Strip               |
| Hall 2 <sup>nd</sup> Floor | A    | Closet Door          | 1   | EA   | Replace or Strip               |
| Hall 2 <sup>nd</sup> Floor | A    | Closet Door Jamb     | 1   | EA   | Replace or Strip               |
| Hall 2 <sup>nd</sup> Floor | A    | Closet Walls         | ALL | EA   | Cover with gypsum board        |
| Hall 2 <sup>nd</sup> Floor | A    | Closet Ceiling       | ALL | EA   | Cover with gypsum board        |
| Hall 2 <sup>nd</sup> Floor | A    | Closet Baseboard     | ALL | EA   | Cover with Gypsum or Wood      |
| Hall 2 <sup>nd</sup> Floor | A    | Closet Shelf         | ALL | EA   | Replace                        |
| Hall 2 <sup>nd</sup> Floor | A    | Closet Shelf Support | ALL | EA   | Replace                        |
| Room 3                     |      | Ceiling              |     |      | Cover with Gypsum Board        |
| Room 3                     | ABCD | Walls                | ALL |      | Cover with Gypsum Board        |
| Room 3                     |      | Baseboard            | ALL |      | Cover with Gypsum or Wood      |
| Room 3                     | C(L) | Door Casing          | 1   | EA.  | Replace or Strip               |
| Room 3                     | C(L) | Door Jamb            | 1   | EA.  | Replace or Strip               |
| Room 3                     | A(L) | Window Sill          | 1   | EA   | Strip                          |
| Room 3                     | A(L) | Window Casing        | 1   | EA   | Strip                          |
| Room 3                     | A(L) | Window Apron         | 1   | EA   | Strip                          |
| Room 3                     | A(L) | Window Exterior Sill | 1   | EA   | Cover with Aluminum coil stock |
| Room 3                     | A(R) | Window Sill          | 1   | EA   | Strip                          |
| Room 3                     | A(R) | Window Casing        | 1   | EA   | Strip                          |
| Room 3                     | A(R) | Window Apron         | 1   | EA   | Strip                          |
| Room 3                     | A(R) | Window Exterior Sill | 1   | EA   | Cover with Aluminum coil stock |
| Room 3                     | C    | Closet Door Casing   | 1   | EA   | Replace or Strip               |
| Room 3                     | C    | Closet Door Jamb     | 1   | EA   | Replace or Strip               |
| Room 3                     | C    | Closet Walls         | ALL | EA   | Cover with gypsum board        |
| Room 3                     | C    | Closet Ceiling       | ALL | EA   | Cover with gypsum board        |
| Room 3                     | C    | Closet Baseboard     | ALL | EA   | Cover with Gypsum or Wood      |
| Room 3                     | C    | Closet Shelf Support | ALL | EA   | Replace                        |

# LBP Abatement Specification Summary Table

Address: 917 Main St.  
Vineyard Haven, MA

Type of Building: Single Family

| Room   | Side | Surface              | Qty | Unit | Abatement method               |
|--------|------|----------------------|-----|------|--------------------------------|
| Room 3 | C    | Shelf in room        | 1   | EA   | Replace                        |
| Room 4 |      | Ceiling              |     |      | Cover with Gypsum Board        |
| Room 4 | ABCD | Walls                | ALL |      | Cover with Gypsum Board        |
| Room 4 |      | Baseboard            | ALL |      | Cover with Gypsum or Wood      |
| Room 4 | D    | Door Casing          | 1   | EA.  | Replace or Strip               |
| Room 4 | D    | Door Jamb            | 1   | EA.  | Replace or Strip               |
| Room 4 | C(R) | Access Door          | 1   | EA   | Remove                         |
| Room 4 | C(R) | Access Door Frame    | 1   | EA   | Remove                         |
| Room 4 | C    | Closet Door          | 1   | EA   | Replace or Strip               |
| Room 4 | C    | Closet Door Casing   | 1   | EA   | Replace or Strip               |
| Room 4 | C    | Closet Door Jamb     | 1   | EA   | Replace or Strip               |
| Room 4 | C    | Closet Walls         | ALL | EA   | Cover with gypsum board        |
| Room 4 | C    | Closet Ceiling       | ALL | EA   | Cover with gypsum board        |
| Room 4 | C    | Closet Baseboard     | ALL | EA   | Cover with Gypsum or Wood      |
| Room 4 | C    | Closet Shelf         | ALL | EA   | Replace                        |
| Room 4 | C    | Closet Shelf Support | ALL | EA   | Replace                        |
| Room 4 | B    | Window Sill          | 1   | EA   | Strip                          |
| Room 4 | B    | Window Casing        | 1   | EA   | Strip                          |
| Room 4 | B    | Window Apron         | 1   | EA   | Strip                          |
| Room 4 | B    | Window Exterior Sill | 1   | EA   | Cover with Aluminum Coil Stock |
| Bath 2 | B    | Window Exterior Sill | 1   | EA   | Cover aluminum coil stock      |
| Room 5 |      | Ceiling              |     |      | Cover with Gypsum Board        |
| Room 5 | ABCD | Walls                | ALL |      | Cover with Gypsum Board        |
| Room 5 |      | Baseboard            | ALL |      | Cover with Gypsum or Wood      |
| Room 5 | A    | Door Jamb            | 1   | EA.  | Replace or Strip               |
| Room 5 | B    | Door Jamb            | 1   | EA.  | Replace or Strip               |
| Room 5 | D    | Window Apron         | 1   | EA   | Strip                          |
| Room 5 | D    | Window Exterior Sill | 1   | EA   | Cover with Aluminum Coil Stock |
| Room 5 | C    | Closet Door Casing   | 1   | EA   | Replace or Strip               |



### LBP Abatement Specification Summary Table

**Address:** 917 Main St.  
Vineyard Haven, MA

**Type of Building:** Single Family

| Room          | Side | Surface              | Qty | Unit | Abatement method          |
|---------------|------|----------------------|-----|------|---------------------------|
| Room 5        | C    | Closet Door Jamb     | 1   | EA   | Replace or Strip          |
| Room 5        | C    | Closet Walls         | ALL | EA   | Cover with gypsum board   |
| Room 5        | C    | Closet Ceiling       | ALL | EA   | Cover with gypsum board   |
| Room 5        | C    | Closet Baseboard     | ALL | EA   | Cover with Gypsum or Wood |
| Room 5        | C    | Closet Shelf Support | ALL | EA   | Replace or Strip          |
|               |      |                      |     |      |                           |
| Stair to Base | ABCD | Walls                | ALL |      | Cover with Gypsum Board   |

# LBP Abatement Specification Summary Table

**Address:** 917 Main St.  
Vineyard Haven, MA

**Type of Building:** Single Family

| Room     | Side  | Surface                        | Qty | Unit | Abatement method |
|----------|-------|--------------------------------|-----|------|------------------|
| Exterior | ABCD  | Corner boards                  | ALL | EA   | Strip            |
| Exterior | A     | Door Jamb                      | 1   | EA   | Replace or Strip |
| Exterior | A     | Threshold                      | 1   | EA   | Replace or Strip |
| Exterior | A     | Kick plate                     | 1   | EA   | Replace or Strip |
| Exterior | A     | Downspout Pan                  | 1   | EA   | Replace          |
| Exterior | A & D | Support Columns                | ALL | EA   | Strip            |
| Exterior | ABCD  | Window Sills (except cellar)   | ALL |      | Strip            |
| Exterior | ABCD  | Window Casings (except cellar) | ALL |      | Strip            |
| Exterior | B     | Access Door                    | 1   | EA.  | Replace or Strip |
| Exterior | B     | Access Door Frame              | 1   | EA.  | Replace or Strip |
| Exterior | B     | Access Door Threshold          | 1   | EA   | Replace or Strip |
| Exterior | D     | Door                           | 1   | EA   | Replace or Strip |
| Exterior | D     | Door Casing                    | 1   | EA   | Replace or Strip |
| Exterior | D     | Door Jamb                      | 1   | EA   | Replace or Strip |
| Exterior | D     | Kick plate                     | 1   | EA   | Replace or Strip |
| Exterior | D     | Wall Corner bead               | 1   | EA   | Replace or Strip |

### LBP Abatement Specification Summary Table

**Address:** 921 Main St.

**Type of Building:** Single Family

Vineyard Haven, MA

| Room    | Side               | Surface                   | Qty.* | Unit | Abatement method                |
|---------|--------------------|---------------------------|-------|------|---------------------------------|
| Room 1  |                    | Baseboards                | ALL   | EA.  | Cover with Wood                 |
| Room 1  | C, D               | Door Casing Molding       | 2     | EA.  | Remove or Strip                 |
| Room 1  | A(L),A(R),<br>B, D | Window Exterior Sill      | 4     | EA   | Cover aluminum coil stock       |
|         |                    |                           |       |      |                                 |
| Kitchen | D                  | Closet Door Casing        | 1     | EA.  | Remove or Strip                 |
| Kitchen | D                  | Closet Walls              | ALL   | EA   | Cover with gypsum board         |
| Kitchen | D                  | Closet Ceiling            | 1     | EA.  | Cover with gypsum board         |
| Kitchen | D                  | Closet Baseboard          | ALL   | EA   | Cover with wood or gypsum board |
| Kitchen | D                  | Closet Shelf              | ALL   | EA   | Replace                         |
| Kitchen | D                  | Closet Shelf Support      | ALL   | EA   | Replace                         |
| Kitchen | A                  | Riser Pipe                | 1     | EA.  | Strip                           |
| Kitchen | B, C               | Window Exterior Sill      | 2     | EA   | Cover aluminum coil stock       |
|         |                    |                           |       |      |                                 |
| Foyer   |                    | Baseboards                | ALL   | EA.  | Cover with Wood                 |
| Foyer   | A                  | Door Casing               | 1     | EA.  | Replace or Strip                |
| Foyer   | A                  | Door Jamb                 | 1     | EA   | Replace or Strip                |
| Foyer   | B                  | Threshold                 | 1     | EA   | Replace or Strip                |
|         |                    |                           |       |      |                                 |
| Laundry | C                  | Window Exterior Sill      | 1     | EA   | Cover aluminum coil stock       |
|         |                    |                           |       |      |                                 |
| Bath 1  |                    | Baseboards                | ALL   | EA.  | Cover with Wood                 |
| Bath 1  | A                  | Door Casing               | 1     | EA.  | Replace or Strip                |
| Bath 1  | C                  | Window Sill               | 1     | EA   | Strip                           |
| Bath 1  | C                  | Window Casing             | 1     | EA   | Strip                           |
| Bath 1  | C                  | Window Exterior Sill      | 1     | EA   | Cover aluminum coil stock       |
|         |                    |                           |       |      |                                 |
| Room 2  |                    | Baseboards                | ALL   | EA.  | Cover with Wood                 |
| Room 2  | C                  | Door Casing               | 1     | EA.  | Remove or Strip                 |
| Room 2  | C                  | Hutch Door Up. &<br>Lower | 1     | EA.  | Strip                           |

\* Quantities are listed for comparison purposes only. In all cases it is the contractor's responsibility to verify actual measurements.

### LBP Abatement Specification Summary Table

**Address:** 921 Main St.  
Vineyard Haven, MA

**Type of Building:** Single Family

| Room      | Side                 | Surface              | Qty.* | Unit | Abatement method                |
|-----------|----------------------|----------------------|-------|------|---------------------------------|
| Room 2    | C                    | Hutch Wall           | ALL   | EA   | Strip                           |
| Room 2    | C                    | Hutch Shelf          | ALL   | EA   | Strip                           |
| Room 2    | C                    | Hutch Shelf Support  | ALL   | EA   | Strip                           |
|           |                      |                      |       |      |                                 |
| Staircase | C, D                 | Walls                | ALL   |      | Cover with gypsum board         |
| Staircase |                      | Baseboard            | ALL   |      | Cover with wood or gypsum board |
| Staircase | A(L),A(R)<br>B, C, D | Door Casing          | 5     | EA.  | Replace or Strip                |
| Staircase | A(L) B, C, D         | Door Jamb            | 4     | EA.  | Replace or Strip                |
| Staircase | C                    | Window Exterior Sill | 1     | EA   | Cover aluminum coil stock       |
| Staircase |                      | Stair Risers         | ALL   | EA   | Strip                           |
| Staircase |                      | Stair Stringer       | ALL   | EA.  | Cover with Wood or Strip        |
| Staircase |                      | Floor Casing         | 1     | EA.  | Cover with Wood or Strip        |
|           |                      |                      |       |      |                                 |
| Room 3    |                      | Ceiling              |       |      | Cover with Gypsum Board         |
| Room 3    | ABCD                 | Walls                | ALL   |      | Cover with Gypsum Board         |
| Room 3    |                      | Baseboard            | ALL   |      | Cover with Gypsum or Wood       |
| Room 3    | C(L), C(R)<br>D      | Door Casing          | 3     | EA.  | Replace or Strip                |
| Room 3    | C(L), C(R)<br>D      | Door Jamb            | 3     | EA.  | Replace or Strip                |
| Room 3    | A(L), A(R)           | Window Sill          | 2     | EA   | Strip                           |
| Room 3    | A(L), A(R)           | Window Casing        | 2     | EA   | Strip                           |
| Room 3    | A(L), A(R)           | Window Exterior Sill | 2     | EA   | Cover with Aluminum coil stock  |
| Room 3    | C                    | Closet Door Casing   | 1     | EA.  | Remove or Strip                 |
| Room 3    | C                    | Closet Walls         | ALL   | EA   | Cover with gypsum board         |
| Room 3    | C                    | Closet Ceiling       | 1     | EA.  | Cover with gypsum board         |
| Room 3    | C                    | Closet Baseboard     | ALL   | EA   | Cover with wood or gypsum board |
| Room 3    | C                    | Closet Shelf         | ALL   | EA   | Replace                         |
| Room 3    | C                    | Closet Shelf Support | ALL   | EA   | Replace                         |

\* Quantities are listed for comparison purposes only. In all cases it is the contractor's responsibility to verify actual measurements.



## LBP Abatement Specification Summary Table

**Address:** 921 Main St.

**Type of Building:** Single Family

Vineyard Haven, MA

| Room                       | Side | Surface              | Qty.* | Unit | Abatement method                |
|----------------------------|------|----------------------|-------|------|---------------------------------|
| Room 3                     | C    | Shelf in room        | 1     | EA   | Replace                         |
| Room 4                     |      | Ceiling              |       |      | Cover with Gypsum Board         |
| Room 4                     | ABCD | Walls                | ALL   |      | Cover with Gypsum Board         |
| Room 4                     |      | Baseboard            | ALL   |      | Cover with Gypsum or Wood       |
| Room 4                     | A, D | Door Casing          | 2     | EA.  | Replace or Strip                |
| Room 4                     | A    | Closet Door Casing   | 1     | EA   | Replace or Strip                |
| Room 4                     | A    | Closet Walls         | ALL   | EA   | Cover with gypsum board         |
| Room 4                     | A    | Closet Ceiling       | ALL   | EA   | Cover with gypsum board         |
| Room 4                     | A    | Closet Baseboard     | ALL   | EA   | Cover with Gypsum or Wood       |
| Room 4                     | C    | Closet Shelf Support | ALL   | EA   | Replace                         |
| Room 4                     | A    | Shelf in room        | 1     | EA   | Replace                         |
| Room 4                     | B    | Window Casing        | 1     | EA   | Strip                           |
| Bath 2                     |      | Baseboard            | ALL   |      | Cover with wood or gypsum board |
| Bath 2                     | A    | Door Casing          | 1     | EA.  | Replace or Strip                |
| Bath 2                     | C    | Window Exterior Sill | 1     | EA   | Cover aluminum coil stock       |
| Room 5                     |      | Ceiling              |       |      | Cover with Gypsum Board         |
| Room 5                     | ABCD | Walls                | ALL   |      | Cover with Gypsum Board         |
| Room 5                     |      | Baseboard            | ALL   |      | Cover with Gypsum or Wood       |
| Room 5                     | C(R) | Access Door          | 1     | EA   | Remove                          |
| Room 5                     | A    | Shelf                | 1     | EA.  | Replace                         |
| Room 5                     | A    | Shelf Supports       | 1     | EA.  | Replace or Strip                |
| Room 5                     | D    | Window Exterior Sill | 1     | EA   | Cover with Aluminum Coil Stock  |
| Hall 2 <sup>nd</sup> Floor |      | Ceiling              |       | EA   | Cover with Gypsum Board         |
| Hall 2 <sup>nd</sup> Floor | B, C | Walls                | ALL   | EA   | Cover with Gypsum Board         |

\* Quantities are listed for comparison purposes only. In all cases it is the contractor's responsibility to verify actual measurements.

# LBP Abatement Specification Summary Table

**Address:** 921 Main St.  
Vineyard Haven, MA

**Type of Building:** Single Family

| Room                       | Side                             | Surface              | Qty.* | Unit | Abatement method                |
|----------------------------|----------------------------------|----------------------|-------|------|---------------------------------|
| Hall 2 <sup>nd</sup> Floor |                                  | Baseboards           | ALL   | EA.  | Cover with Wood                 |
| Hall 2 <sup>nd</sup> Floor | A(L), A(R)<br>B(L), B(R)<br>C, D | Door Casing Molding  | 6     | EA.  | Replace or Strip                |
| Hall 2 <sup>nd</sup> Floor | A(R)                             | Door Jamb            | 1     | EA   | Replace or Strip                |
| Hall 2 <sup>nd</sup> Floor | B                                | Door Jamb            | 1     | EA.  | Replace or Strip                |
| Hall 2 <sup>nd</sup> Floor | C                                | Door Jamb            | 1     | EA   | Replace or Strip                |
| Hall 2 <sup>nd</sup> Floor | A, B                             | Closet Door Casing   | 1     | EA.  | Remove or Strip                 |
| Hall 2 <sup>nd</sup> Floor | A, B                             | Closet Walls         | ALL   | EA   | Cover with gypsum board         |
| Hall 2 <sup>nd</sup> Floor | A, B                             | Closet Ceiling       | 1     | EA.  | Cover with gypsum board         |
| Hall 2 <sup>nd</sup> Floor | A, B                             | Closet Baseboard     | ALL   | EA   | Cover with wood or gypsum board |
| Hall 2 <sup>nd</sup> Floor | A, B                             | Closet Shelf         | ALL   | EA   | Replace                         |
| Hall 2 <sup>nd</sup> Floor | A, B                             | Closet Shelf Support | ALL   | EA   | Replace                         |
|                            |                                  |                      |       |      |                                 |
| Stair to Base              | ABCD                             | Walls                | ALL   |      | Cover with Gypsum Board         |

\* Quantities are listed for comparison purposes only. In all cases it is the contractor's responsibility to verify actual measurements.

## LBP Abatement Specification Summary Table

**Address:** 921 Main St.  
Vineyard Haven, MA

**Type of Building:** Single Family

| Room             | Side | Surface                        | Qty | Unit | Abatement method |
|------------------|------|--------------------------------|-----|------|------------------|
| Porch A & B Side | A, B | Support Columns                | ALL | EA   | Strip            |
| Porch B Side     | B    | Wall Corner bead               | 1   | EA   | Strip            |
| Porch B Side     | B    | Door Casing                    | 1   | EA   | Replace or Strip |
| Porch B Side     | D    | Kick plate                     | 1   | EA   | Strip            |
| Exterior         | A    | Threshold                      | 1   | EA   | Replace or Strip |
| Exterior         | A    | Downspout Pan                  | 1   | EA   | Replace          |
| Exterior         | ABCD | Window Sills (except cellar)   | ALL |      | Strip            |
| Exterior         | ABCD | Window Casings (except cellar) | ALL |      | Strip            |
| Exterior         | C    | Access Door                    | 1   | EA.  | Replace or Strip |

# Environmental Lead Detection

436 Gardners Neck Road, Swansea, MA 02777

Telephone (774) 526-8223

Email (b) (6)

December 11, 2015

(b) (6)

Project Manager  
TANTARA Corporation  
54 Mason Street  
Worcester, MA 01610

Re: West Chop I and West Chop II  
917 and 921 Main Street  
Tisbury, Massachusetts

Dear (b) (6)

On August 3, 2015, (b) (6), Massachusetts Lead Inspector/Risk Assessor, (b) (6) conducted a visual survey of the lead abatement work conducted at 917 Main Street and 921 Main Street, Tisbury, Massachusetts. The properties are known as West Chop I and West Chop II.

The goal of this service was to determine if the work as detailed in the Lead Abatement Work Plan dated May 21, 2015, had been satisfactorily completed. The scope of the work for this project consists of the abatement and disposal, replacement, covering, scraping, and removal of lead-based paint contaminated building components in accordance with the requirements of Federal laws and regulations. Applicable laws and regulations include, but are not limited to, Department of Housing and Urban Development (HUD) *Requirements for Notification, Evaluation and Reduction of Lead-Based Paint Hazards in Federally Owned Residential Property and Housing Receiving Federal Assistance*, also known as the HUD Lead Safe Housing Rule (24 CFR Part 35, subparts B-R).

After a comprehensive examination of the work, it was determined that all surface treatments had been completed as detailed in the Work Plan. Because a final cleanup had not yet been conducted, no post abatement clearance dust wipe samples were taken during this visit.

On October 1, 2015, the inspector returned to the site to conduct post abatement clearance dust wipe sampling. A total of twenty-six dust wipe samples (includes a field blank at each site) were collected, thirteen from each building, in an effort to help to determine the levels of lead-containing dust on the interior window sills and floors. These samples were collected from areas most likely to be lead contaminated if lead-in-dust is present. EPA, HUD and State of Massachusetts regulations define the following as hazardous levels for lead dust in residences: floors –  $\geq 40 \mu\text{g}/\text{ft}^2$  (micrograms per square foot); interior windowsills –  $\geq 250 \mu\text{g}/\text{ft}^2$ ; and, interior window wells –  $\geq 400 \mu\text{g}/\text{ft}^2$ .



917 and 921 Main Street  
Tisbury, Massachusetts  
December 11, 2015

As indicated below, leaded dust in quantities greater than EPA, HUD, and Massachusetts standards were detected in each building. Out of 24 samples collected at random locations, three were over the regulatory thresholds. All other testing locations registered lead levels below the EPA, HUD and State of Massachusetts standards. Please refer to *Appendix I- Dust Wipe Analytical Results* for the laboratory reports.

#### 917 Main Street

| Sample No. | Location | Component | Substrate | Sample Size (ft <sup>2</sup> ) | Test Results (µg/ft <sup>2</sup> ) |
|------------|----------|-----------|-----------|--------------------------------|------------------------------------|
| 145281-003 | Rm #2    | Floor     | Wood      | 1.00                           | 94.3                               |

#### 921 Main Street

| Sample No. | Location | Component | Substrate | Sample Size (ft <sup>2</sup> ) | Test Results (µg/ft <sup>2</sup> ) |
|------------|----------|-----------|-----------|--------------------------------|------------------------------------|
| 145280-003 | Kitchen  | Floor     | Wood      | 1.00                           | 40.0                               |
| 145280-005 | Rm #2    | Floor     | Wood      | 1.00                           | 43.5                               |

#### Laboratory Information:

Schneider Laboratories Global  
2512 W. Cary Street  
Richmond, Virginia 23220  
Phone (800) 785-5227

#### Dust Analysis Protocol

EPA Method 7000B, implementing a microwave-assisted digestion process.

National Lead Laboratory Accreditation  
Program Serial number: #100527

On October 27, 2015, the inspector returned to the site to conduct post failure clearance dust wipe sampling. A total of five dust wipe samples (includes a field blank at each site) were collected, one from 917 Main St., and two from 921 Main St. These samples were collected from areas where there were failures in the previous sampling. None of the samples contained lead above the laboratory detection threshold.

In conclusion, these properties are now in what could be characterized as a lead safe condition. In order that this lead safe condition be maintained, surfaces that were covered as an abatement method must remain covered.

Submitted by:

(b) (6)

Massachusetts Lead Inspector/Risk Assessor (b) (6)  
Expires 10/31/16

SLC

## Analysis Report

## Schneider Laboratories Global, Inc

2512 W. Cary Street • Richmond, Virginia • 23220-5117  
804-353-6778 • 800-785-LABS (5227) • Fax 804-359-1475Customer: ENVIRONMENTAL LEAD DETECTION (482)  
Address: 438 Gardners Neck Rd  
Swansea, MA 02777-3105

Order #: 145281

Attn:

Project:

Location: 917 Main St  
Number: Vineyard HavenMatrix  
Received 10/02/15  
Analyzed 10/02/15  
Reported 10/03/15

PO Number:

| Sample ID  | Cust. Sample ID | Location          | Sample Date | Area      | Total         | Conc.        | RL*          |
|------------|-----------------|-------------------|-------------|-----------|---------------|--------------|--------------|
| Parameter  |                 | Method            |             |           |               |              |              |
| 145281-001 | 1D              | FL Rm 1           | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 1.00 ft2  | 10.3 µg/wipe  | 10.3 µg/ft2  | 10.0 µg/ft2  |
| 145281-002 | 2D              | SL Rm 1           | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 0.479 ft2 | <10.0 µg/wipe | <20.9 µg/ft2 | 20.9 µg/ft2  |
| 145281-003 | 3D              | FL Rm 2           | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 1.00 ft2  | 94.3 µg/wipe  | 94.3 µg/ft2  | 10.0 µg/ft2  |
| 145281-004 | 4D              | SL Rm 2           | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 0.746 ft2 | <10.0 µg/wipe | <13.4 µg/ft2 | 13.4 µg/ft2  |
| 145281-005 | 5D              | FL Kitchen        | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 1.00 ft2  | 29.5 µg/wipe  | 29.5 µg/ft2  | 10.0 µg/ft2  |
| 145281-006 | 6D              | SL Kitchen        | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 0.888 ft2 | 112 µg/wipe   | 163 µg/ft2   | 14.5 µg/ft2  |
| 145281-007 | 7D              | FL Rm 3           | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 1.00 ft2  | 12.0 µg/wipe  | 12.0 µg/ft2  | 10.0 µg/ft2  |
| 145281-008 | 8D              | SL Rm 3           | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 0.489 ft2 | <10.0 µg/wipe | <21.3 µg/ft2 | 21.3 µg/ft2  |
| 145281-009 | 9D              | FL Rm 4           | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 1.00 ft2  | 12.0 µg/wipe  | 12.0 µg/ft2  | 10.0 µg/ft2  |
| 145281-010 | 10D             | SL Rm 4           | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 0.734 ft2 | <10.0 µg/wipe | <13.6 µg/ft2 | 13.6 µg/ft2  |
| 145281-011 | 11D             | FL Rm 5           | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 1.00 ft2  | <10.0 µg/wipe | <10.0 µg/ft2 | 10.0 µg/ft2  |
| 145281-012 | 12D             | SL Rm 5           | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 0.682 ft2 | <10.0 µg/wipe | <14.7 µg/ft2 | 14.7 µg/ft2  |
| 145281-013 | 13D             | Blank             | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             |           | <10.0 µg/wipe |              | 10.0 µg/wipe |

Minimum Total Reporting Limit: 10.0 µg/wipe. EPA Clearance Std: 40 µg/ft² for floors, 250 µg/ft² for interior window sills, and 400 µg/ft² for window troughs. All internal QC parameters were met. Unusual sample conditions, if any, are described. Surrogate Spike results designated with "D" indicate that the analyte was diluted out. "MI" indicates matrix interference. Concentration and \*Reporting Limit (RL) based on areas provided by client. Values are reported to three significant figures. The test results reported relate only to the samples submitted.



## Analysis Report

## Schneider Laboratories Global, Inc

2512 W. Cary Street • Richmond, Virginia • 23220-5117  
804-353-6778 • 800-785-LABS (5227) • Fax 804-359-1475Customer Address ENVIRONMENTAL LEAD DETECTION (482)  
436 Gardners Neck Rd  
Swansea, MA 02777-3105

Order #: 148536

Matrix Wipe  
Received 10/28/15  
Analyzed 10/28/15  
Reported 10/28/15Project Location  
Number 917 Main St  
Vineyard Haven

| Sample ID  | Cust. Sample ID | Location          | Sample Date          |               |                          |                         |
|------------|-----------------|-------------------|----------------------|---------------|--------------------------|-------------------------|
| Parameter  |                 | Method            | Area                 | Total         | Conc.                    | RL*                     |
| 148536-001 | 14P             | Rm 2 FL           | 10/27/15             |               |                          |                         |
| Lead       |                 | EPA 7000B / 3050B | 1.00 ft <sup>2</sup> | <10.0 µg/wipe | <10.0 µg/ft <sup>2</sup> | 10.0 µg/ft <sup>2</sup> |
| 148536-002 | 15P             | Blank             | 10/27/15             |               |                          |                         |
| Lead       |                 | EPA 7000B / 3050B |                      | <10.0 µg/wipe |                          | 10.0 µg/wipe            |

Analysis (b)  
148536-10/28/15 03:08 PM

(b) (6)

Metals Supervisor

Minimum Total Reporting Limit: 10.0 µg/wipe. EPA Clearance Std: 40 µg/ft<sup>2</sup> for floors, 250 µg/ft<sup>2</sup> for interior window sills, and 400 µg/ft<sup>2</sup> for window troughs. All internal QC parameters were met. Unusual sample conditions, if any, are described. Surrogate Spike results designated with "D" indicate that the analyte was diluted out. "MI" indicates matrix interference. Concentration and "Reporting Limit (RL)" based on areas provided by client. Values are reported to three significant figures. The test results reported relate only to the samples submitted.

SLG

## Analysis Report

## Schneider Laboratories Global, Inc

2512 W. Cary Street • Richmond, Virginia • 23220-5117  
804-353-6778 • 800-785-LABS (5227) • Fax 804-359-1475Customer: ENVIRONMENTAL LEAD DETECTION (482)  
Address: 438 Gardners Neck Rd  
Swansea, MA 02777-3105

Order #: 145280

Attn:

Project:

Location: 921 Main St  
Number: Vineyard HavenMatrix Wipe  
Received 10/02/15  
Analyzed 10/02/15  
Reported 10/03/15

PO Number:

| Sample ID  | Cust. Sample ID | Location          | Sample Date | Area                  | Total         | Conc.                    | RL*                     |
|------------|-----------------|-------------------|-------------|-----------------------|---------------|--------------------------|-------------------------|
| Parameter  |                 | Method            |             |                       |               |                          |                         |
| 145280-001 | 1D              | FL Rm 1           | 10/01/15    |                       |               |                          |                         |
| Lead       |                 | EPA 7000B / 3050B |             | 1.00 ft <sup>2</sup>  | <10.0 µg/wipe | <10.0 µg/ft <sup>2</sup> | 10.0 µg/ft <sup>2</sup> |
| 145280-002 | 2D              | SL Rm 1           | 10/01/15    |                       |               |                          |                         |
| Lead       |                 | EPA 7000B / 3050B |             | 0.719 ft <sup>2</sup> | <10.0 µg/wipe | <13.9 µg/ft <sup>2</sup> | 13.9 µg/ft <sup>2</sup> |
| 145280-003 | 3D              | FL Kitchen        | 10/01/15    |                       |               |                          |                         |
| Lead       |                 | EPA 7000B / 3050B |             | 1.00 ft <sup>2</sup>  | 40.0 µg/wipe  | 40.0 µg/ft <sup>2</sup>  | 10.0 µg/ft <sup>2</sup> |
| 145280-004 | 4D              | SL Kitchen        | 10/01/15    |                       |               |                          |                         |
| Lead       |                 | EPA 7000B / 3050B |             | 0.853 ft <sup>2</sup> | <10.0 µg/wipe | <11.7 µg/ft <sup>2</sup> | 11.7 µg/ft <sup>2</sup> |
| 145280-005 | 5D              | FL Rm 2           | 10/01/15    |                       |               |                          |                         |
| Lead       |                 | EPA 7000B / 3050B |             | 1.00 ft <sup>2</sup>  | 43.5 µg/wipe  | 43.5 µg/ft <sup>2</sup>  | 10.0 µg/ft <sup>2</sup> |
| 145280-006 | 6D              | SL Rm 2           | 10/01/15    |                       |               |                          |                         |
| Lead       |                 | EPA 7000B / 3050B |             | 1.03 ft <sup>2</sup>  | <10.0 µg/wipe | <9.70 µg/ft <sup>2</sup> | 9.70 µg/ft <sup>2</sup> |
| 145280-007 | 7D              | FL Rm 3           | 10/01/15    |                       |               |                          |                         |
| Lead       |                 | EPA 7000B / 3050B |             | 1.00 ft <sup>2</sup>  | 13.8 µg/wipe  | 13.8 µg/ft <sup>2</sup>  | 10.0 µg/ft <sup>2</sup> |
| 145280-008 | 8D              | SL Rm 3           | 10/01/15    |                       |               |                          |                         |
| Lead       |                 | EPA 7000B / 3050B |             | 0.719 ft <sup>2</sup> | 29.5 µg/wipe  | 41.1 µg/ft <sup>2</sup>  | 13.9 µg/ft <sup>2</sup> |
| 145280-009 | 9D              | FL Rm 4           | 10/01/15    |                       |               |                          |                         |
| Lead       |                 | EPA 7000B / 3050B |             | 1.00 ft <sup>2</sup>  | 13.8 µg/wipe  | 13.8 µg/ft <sup>2</sup>  | 10.0 µg/ft <sup>2</sup> |
| 145280-010 | 10D             | SL Rm 4           | 10/01/15    |                       |               |                          |                         |
| Lead       |                 | EPA 7000B / 3050B |             | 1.03 ft <sup>2</sup>  | 22.5 µg/wipe  | 21.8 µg/ft <sup>2</sup>  | 9.70 µg/ft <sup>2</sup> |
| 145280-011 | 11D             | FL Rm 5           | 10/01/15    |                       |               |                          |                         |
| Lead       |                 | EPA 7000B / 3050B |             | 1.00 ft <sup>2</sup>  | 20.8 µg/wipe  | 20.8 µg/ft <sup>2</sup>  | 10.0 µg/ft <sup>2</sup> |
| 145280-012 | 12D             | SL Rm 5           | 10/01/15    |                       |               |                          |                         |
| Lead       |                 | EPA 7000B / 3050B |             | 1.02 ft <sup>2</sup>  | 59.3 µg/wipe  | 57.9 µg/ft <sup>2</sup>  | 9.77 µg/ft <sup>2</sup> |
| 145280-013 | 13D             | Blank             | 10/01/15    |                       |               |                          |                         |
| Lead       |                 | EPA 7000B / 3050B |             |                       | <10.0 µg/wipe |                          | 10.0 µg/wipe            |

Minimum Total Reporting Limit: 10.0 µg/wipe. EPA Clearance Std: 40 µg/ft<sup>2</sup> for floors, 250 µg/ft<sup>2</sup> for interior window sills, and 400 µg/ft<sup>2</sup> for window troughs. All internal QC parameters were met. Unusual sample conditions, if any, are described. Surrogate Spike results designated with "D" indicate that the analyte was diluted out. "MI" indicates matrix interference. Concentration and "Reporting Limit (RL)" based on areas provided by client. Values are reported to three significant figures. The test results reported relate only to the samples submitted.



SLG

## Analysis Report

## Schneider Laboratories Global, Inc

2512 W. Cary Street • Richmond, Virginia • 23220-5117  
804-353-6778 • 800-785-LABS (5227) • Fax 804-359-1475Customer: ENVIRONMENTAL LEAD DETECTION (482)  
Address: 436 Gardners Neck Rd  
Swansea, MA 02777-3105

Order #: 148537

Matrix Wipe  
Received 10/28/15  
Analyzed 10/28/15  
Reported 10/28/15

Attn:

Project:

Location: 921 Main St  
Number: Vineyard Haven

PO Number:

| Sample ID  | Cust. Sample ID | Location          | Sample Date | Area    | Total         | Conc.        | RL*          |
|------------|-----------------|-------------------|-------------|---------|---------------|--------------|--------------|
| Parameter  |                 | Method            |             |         |               |              |              |
| 148537-001 | 14D             | Kitchen FL        | 10/27/15    |         |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 1.00 R2 | <10.0 µg/wipe | <10.0 µg/lit | 10.0 µg/lit  |
| 148537-002 | 15D             | Rm 2 FL           | 10/27/15    |         |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 1.00 R2 | <10.0 µg/wipe | <10.0 µg/lit | 10.0 µg/lit  |
| 148537-003 | 16D             | Blank             | 10/27/15    |         |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             |         | <10.0 µg/wipe |              | 10.0 µg/wipe |

Analyst: (b)  
148537-10/28/15 02:13 PM

(b) (6)

Analyst

Minimum Total Reporting Limit: 10.0 µg/wipe. EPA Clearance Std: 40 µg/lit\* for floors, 250 µg/lit\* for interior window sills, and 400 µg/lit\* for window troughs. All internal QC parameters were met. Unusual sample conditions, if any, are described. Surrogate Spike results designated with "D" indicate that the analyte was diluted out. "MI" indicates matrix interference. Concentration and \*Reporting Limit (RL) based on area provided by client. Values are reported to three significant figures. The test results reported relate only to the samples submitted.



Massachusetts Department of Environmental Protection

## **eDEP Transaction Copy**

---

Here is the file you requested for your records.

To retain a copy of this file you must save and/or print.

Username: (b) (6)

Transaction ID: 750232


Document: AQ04-Asbestos Removal Notification Form ANF-001

Size of File: 100.32K

Status of Transaction: Submitted

Date and Time Created: 11/27/2015:9:36:17 AM

**Note:** This file only includes forms that were part of your transaction as of the date and time indicated above. If you need a more current copy of your transaction, return to eDEP and select to "Download a Copy" from the Current Submittals page.



Massachusetts Department of Environmental Protection  
Bureau of Waste Prevention • Air Quality

## **BWP ANF-001 Pre-Form**

Notification Prior to Construction or Demolition

---

- ☐ This is a revision to an existing form.  
Project ID for existing form to be revised: \_\_\_\_\_
- ☐ This job is being conducted under a Blanket Permit  
MassDEP assigned Blanket Authorization ID: \_\_\_\_\_
- ☐ This job is being conducted under a Non Traditional Abatement Work Practice Permit.  
MassDEP assigned Non Traditional Work Practice Authorization ID: \_\_\_\_\_
- ☐ I am a non-licensed contractor removing or disturbing non-friable shingles only.
- ☒ None of the above conditions apply, generate a new form



Commonwealth of Massachusetts  
**Asbestos Notification Form ANF-001**

100222701

Asbestos Project #

☐ Project Revision

☐ Project Cancellation

**A. Asbestos Abatement Description**

**1. Facility Location:**

USCG WEST CHOP HOUSING UNITS

917 & 921 MAIN ST

Name of Facility

Street Address

TISBURY

MA

02568

(b) (6)

City/Town

State

Zip Code

Telephone

(b) (6)

(b) (6)

Facility Contact Person Name

Facility Contact Person Title

Worksite Location:

UNITS 917 AND 921

Building Name, Wing, Floor, Room, etc.

Instructions 1. All sections of this form must be completed in order to comply with MassDEP notification requirements of 310 CMR 7.15 and Department of Labor Standards (DLS) notification requirements of 453 CMR 6.12

2. Is the facility occupied? ☐ Yes ☒ No

3. Is this a fee exempt notification (city, town, district, municipal housing authority, state facility, or owner-occupied residential property of four units or less)? ☐ Yes ☒ No

MassDEP Use Only

4. Blanket Permit Project Approval, if applicable:

Approval ID #

Date Received

5. Non-Traditional Asbestos Abatement Work Practice Approval, if applicable:

Approval ID #

2. Submit Original Form To:  
Commonwealth of Massachusetts  
P.O. Box 4062  
Boston, MA 02211

**6. Asbestos Contractor:**

TANTARA CORPORATION

54 MASON ST

Name

Address

WORCESTER

MA

01610

5087525599

City/Town

State

Zip Code

Telephone

(b) (6)

Contract Type: ☒ Written ☐ Verbal

DLS License #

7. (b) (6)

Name of Contractor's On-Site Supervisor/Foreman

DLS Certification #

8. (b) (6)

Name of Project Monitor

DLS Certification #

9. FLI ENVIRONMENTAL INC

(b) (6)

Name of Asbestos Analytical Lab

DLS Certification #

10. 6/30/2015

7/31/2015

Project Start Date (MM/DD/YYYY)

End Date (MM/DD/YYYY)

0700-1600

0700-1600

Work Hours - Monday Through Friday

Work Hours - Saturday & Sunday

11. What type of project is this?

☐ Demolition ☒ Renovation ☐ Repair ☐ Other - Please Specify: \_\_\_\_\_





Commonwealth of Massachusetts  
**Asbestos Notification Form ANF-001**

100222701

Asbestos Project #

☐ Project Revision

☐ Project Cancellation

**A. Asbestos Abatement Description: (cont.)**

**12. Abatement procedures (check all that apply)**

☐ Glove Bag ☐ Encapsulation ☐ Enclosure ☒ Disposal Only ☐ Cleanup ☐ Full Containment

☐ Other - Please Specify: \_\_\_\_\_

**13. Job is being conducted:** ☒ Indoors ☐ Outdoors

**14. Total amount of each type of asbestos Containing materials (ACM) to be removed, enclosed, or encapsulated:**

| Linear Feet (Lin. Ft.)   |          |         | 220 | Square Feet (Sq. Ft.)       |          |         |
|--------------------------|----------|---------|-----|-----------------------------|----------|---------|
| Boiler, Breaching, Duct, |          |         |     | Transite Pipe               |          |         |
| Tank Surface Coatings    | Lin. Ft. | Sq. Ft. |     |                             | Lin. Ft. | Sq. Ft. |
| Pipe Insulation          |          |         |     | Transite Shingles           |          |         |
|                          | Lin. Ft. | Sq. Ft. |     |                             | Lin. Ft. | Sq. Ft. |
| Spray-On Fireproofing    |          |         |     | Transite Panels             |          |         |
|                          | Lin. Ft. | Sq. Ft. |     |                             | Lin. Ft. | Sq. Ft. |
| Cloths, Woven Fabrics    |          |         |     | Other - Please Specify:     |          |         |
|                          | Lin. Ft. | Sq. Ft. |     |                             |          |         |
| Insulating Cement        |          |         |     | JOINT COMPOUND & FLOOR TILE | 220      |         |
|                          | Lin. Ft. | Sq. Ft. |     |                             | Lin. Ft. | Sq. Ft. |

**15. Describe the decontamination system(s) to be used:**

THREE STAGE PERSONAL DECONTAMINATION UNIT

**16. Describe the containerization/disposal methods to comply with 310 CMR 7.15 and 453 CMR 6.14(2)(g):**

ACM WILL BE WETTED AND DOUBLE BAGGED

**17. For Emergency Asbestos Operations, the MassDEP and DLS officials who evaluated the emergency:**

|                                    |                           |
|------------------------------------|---------------------------|
| Name of MassDEP Official           | Title of MassDEP Official |
| Date of Authorization (MM/DD/YYYY) | Waiver #                  |
| Name of DLS Official               | Title of DLS Official     |
| Date of Authorization (MM/DD/YYYY) | Waiver #                  |

**18. Do prevailing wage rates as per M.G.L. c. 149, § 26, 27 or 27A-F apply to this project?** ☒ Yes ☐ No



Commonwealth of Massachusetts  
**Asbestos Notification Form ANF-001**

100222701

**Asbestos Project #**

☐ Project Revision

☐ Project Cancellation

**B. Facility Description**

1. Current or prior use of facility: RESIDENCE

2. Is the facility owner-occupied residential with 4 units or less? ☐ Yes ☒ No

3. US COAST GUARD 475 KILVERT STREET, SUITE 100  
Facility Owner Name Address  
WARWICK RI 02886 (b) (6)  
City/Town State Zip Code Telephone

4. (b) (6) 475 KILVERT STREET, SUITE 100  
Name of Facility Owner's On-Site Manager Address  
WARWICK RI 02886 (b) (6)  
City/Town State Zip Code Telephone

5. TANTARA CORPORATION 54 MASON STREET  
Name of General Contractor Address  
WORCESTER MA 01610 5087525599  
City/Town State Zip Code Telephone

AIM MUTUAL INSURANCE  
Contractor's Worker's Compensation Insurer  
(b) (6) 5/1/2016  
Policy # Expiration Date (MM/DD/YYYY)

6. What is the size of this facility? 4000 2  
Square Feet # of Floors

Note: Temporary storage of Asbestos containing waste material is only allowed at the place of business of a DLS licensed Asbestos contractor or a transfer station that is permitted by MassDEP and operated in compliance with Solid Waste Regulations 310 CMR 19.000

**C. Asbestos Transportation & Disposal**

1. Transporter of asbestos-containing waste material from site of generation:  
☐ Directly to Landfill or ☒ To Temporary Storage Location/Transfer Station

STG, INC 58 PYLES LANE  
Name of Transporter Address  
NEW CASTLE DE 19720 8779999559  
City/Town State Zip Code Telephone

2. If a temporary storage location/transfer station is used, list name of transporter of asbestos containing waste material from temporary storage location/transfer station to final disposal site:

STG, INC 379 PRIVLEDGE STREET  
Name of Transporter Address  
WOONSOCKET RI 02122 3024461900  
City/Town State Zip Code Telephone



Commonwealth of Massachusetts  
**Asbestos Notification Form ANF-001**

100222701

Asbestos Project #

☐ Project Revision

☐ Project Cancellation

Notification purposes

**C. Asbestos Transportation & Disposal: (cont.)**

3. Name and address of temporary storage location/transfer station for the asbestos containing waste material:

|                                 |       |                     |            |
|---------------------------------|-------|---------------------|------------|
| STG, INC                        |       | 379 PRMLEDGE STREET |            |
| Temporary Storage Location Name |       | Address             |            |
| WOONSOCKET                      | RI    | 02122               | 3024461900 |
| City/Town                       | State | Zip Code            | Telephone  |

4. Name and location of final disposal site (asbestos landfill):

|                          |       |                                |            |
|--------------------------|-------|--------------------------------|------------|
| MINERVA LANDFILL         |       | MINERVA ENTERPRISES            |            |
| Final Disposal Site Name |       | Final Disposal Site Owner Name |            |
| 8955 MINERVA ROAD        |       |                                |            |
| Address                  |       |                                |            |
| WAYNESBURG               | OH    | 44688                          | 3308663435 |
| City/Town                | State | Zip Code                       | Telephone  |

**D. Certification**

"I certify that I have personally examined the foregoing and am familiar with the information contained in this document and all attachments and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including possible fines and imprisonment. The undersigned hereby states that I have read the Commonwealth of Massachusetts regulations governing asbestos abatement (453 CMR 6.00 promulgated by the Department of Labor Standards and 310 CMR 7.15 promulgated by the Department of Environmental Protection), and that I am aware that this permit application or notification shall not be deemed valid unless payment of the applicable fee is made."

(b) (6)

|                 |                      |
|-----------------|----------------------|
| Name            | Authorized Signature |
| PRESIDENT       | 8/16/2015            |
| Position/Title  | Date (MM/DD/YYYY)    |
| (b) (6)         | 061515               |
| Telephone       | Representing         |
| 54 MASON STREET | WORCESTER            |
| Address         | City/Town            |
| MA              | 01610                |
| State           | Zip Code             |



Massachusetts Department of Environmental Protection

## **eDEP Transaction Copy**

---

Here is the file you requested for your records.

To retain a copy of this file you must save and/or print.

Username: (b) (6)

Transaction ID: 776849

Document: AQ04-Asbestos Removal Notification Form ANF-001

Size of File: 57.32K

Status of Transaction: Submitted

Date and Time Created: 11/27/2015:9:28:17 AM

**Note:** This file only includes forms that were part of your transaction as of the date and time indicated above. If you need a more current copy of your transaction, return to eDEP and select to "Download a Copy" from the Current Submittals page.





Massachusetts Department of Environmental Protection  
Bureau of Waste Prevention • Air Quality

## **BWP ANF-001 Pre-Form**

Notification Prior to Construction or Demolition

---

- ☒ This is a revision to an existing form.

Project ID for existing form to be revised: 100227497

- ☐ This job is being conducted under a Blanket Permit

MassDEP assigned Blanket Authorization ID: \_\_\_\_\_

- ☐ This job is being conducted under a Non Traditional Abatement Work Practice Permit.

MassDEP assigned Non Traditional Work Practice Authorization ID: \_\_\_\_\_

- ☐ I am a non-licensed contractor removing or disturbing non-friable shingles only.

- ☐ None of the above conditions apply, generate a new form



Commonwealth of Massachusetts  
**Asbestos Notification Form ANF-001**  
Project Revision Notification

100227497R1

Asbestos Project #

☒ Project Revision

☐ Project Cancellation

## A. Asbestos Abatement Description

### 1. Facility Location:

USCG WEST CHOP HOUSING UNITS

917 & 921 MAIN STREET

Name of Facility

Street Address

TISBURY

MA

02568

(b) (6)

City/Town

State

Zip Code

Telephone

(b) (6)

Facility Contact Person Name

Facility Contact Person Title

Worksite Location:

UNITS 917 & 921

Building Name, Wing, Floor, Room, etc.

### 2. Blanket Permit Project Approval, if applicable:

Approval ID #

### 3. Non-Traditional Asbestos Abatement Work Practice Approval, if applicable:

Approval ID #

Instructions 1. All sections of this form must be completed in order to comply with MassDEP notification requirements of 310 CMR 7.15 and Department of Labor Standards (DLS) notification requirements of 453 CMR 6.12

MassDEP Use Only

Date Received

9/9/2015

10/30/2015

Project Start Date (MM/DD/YYYY)

End Date (MM/DD/YYYY)

0700-1600

0700-1600


Work Hours - Monday Through Friday

Work Hours - Saturday & Sunday

2. Submit Original Form To:  
Commonwealth of Massachusetts  
P.O. Box 4062  
Boston, MA 02211

## B. Other Project Revisions:

Note: Temporary storage of Asbestos containing waste material is only allowed at the place of business of a DLS licensed Asbestos contractor or a transfer station that is permitted by MassDEP and operated in compliance with Solid Waste Regulations 310 CMR 19.000



Commonwealth of Massachusetts

## Asbestos Notification Form ANF-001

Project Revision Notification

100227497R1

Asbestos Project #

☒ Project Revision

☐ Project Cancellation

NOTE: CARPENTERS MUST  
sign this form for DLS  
notification purposes

### C. Certification

"I certify that I have personally examined the foregoing and am familiar with the information contained in this document and all attachments and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including possible fines and imprisonment. The undersigned hereby states that I have read the Commonwealth of Massachusetts regulations governing asbestos abatement (453 CMR 6.00 promulgated by the Department of Labor Standards and 310 CMR 7.15 promulgated by the Department of Environmental Protection), and that I am aware that this permit application or notification shall not be deemed valid unless payment of the applicable fee is made."

(b) (6)

Name  
PRESIDENT

Position/Title

(b) (6)

Telephone  
54 MASON STREET

Address  
MA

State

Authorized Signature  
9/24/2015

Date (MM/DD/YYYY)

Representing  
WORCESTER

City/Town  
01610

Zip Code

**CONTRACT ITEM REVIEW REQUEST**  
**DEPARTMENT OF HOMELAND SECURITY**  
**U.S. COAST GUARD**  
**CIVIL ENGINEERING UNIT PROVIDENCE**

|                                              |                                                                  |                                           |                           |
|----------------------------------------------|------------------------------------------------------------------|-------------------------------------------|---------------------------|
| <b>CONTRACT NUMBER</b><br>HSCGG1-15-C-PRV100 | <b>PROJECT TITLE:</b><br>Repair West Chop hsg, Martha's Vineyard | <b>LOCATION:</b><br>Martha's Vineyard, MA | <b>DATE:</b><br>27-Nov-15 |
|----------------------------------------------|------------------------------------------------------------------|-------------------------------------------|---------------------------|

|                                                                                                             |                                                |                                        |
|-------------------------------------------------------------------------------------------------------------|------------------------------------------------|----------------------------------------|
| <b>SUBMITTAL NUMBER:</b> 08<br><input checked="" type="checkbox"/> NEW <input type="checkbox"/> RESUBMITTAL | <b>CONTRACTOR:</b><br>Tantara Associates Corp. | <b>SUBMITTED BY (NAME):</b><br>(b) (6) |
|-------------------------------------------------------------------------------------------------------------|------------------------------------------------|----------------------------------------|

| ITEM NO | SPECIFICATION SECTION AND PARAGRAPH NO. | DESCRIPTION OF MATERIAL<br>(Include Type, Model Number, Catalog Number, Mfg., Etc.) | FOR GOVERNMENT USE ONLY             |                          |                          |         |
|---------|-----------------------------------------|-------------------------------------------------------------------------------------|-------------------------------------|--------------------------|--------------------------|---------|
|         |                                         |                                                                                     | APPROVED                            | REJECTED                 | SEE BELOW                | INITIAL |
| 1       |                                         | ACM Abatement Documentation                                                         | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | PLN     |
| 2       |                                         |                                                                                     | <input type="checkbox"/>            | <input type="checkbox"/> | <input type="checkbox"/> |         |
| 3       |                                         |                                                                                     | <input type="checkbox"/>            | <input type="checkbox"/> | <input type="checkbox"/> |         |
| 4       |                                         |                                                                                     | <input type="checkbox"/>            | <input type="checkbox"/> | <input type="checkbox"/> |         |
| 5       |                                         |                                                                                     | <input type="checkbox"/>            | <input type="checkbox"/> | <input type="checkbox"/> |         |
|         |                                         |                                                                                     | <input type="checkbox"/>            | <input type="checkbox"/> | <input type="checkbox"/> |         |

**COMMENTS:**

The attached submittal includes documentation of the ACM abatement successfully performed on two separate activities:

- 1) July 2015 - The joint compound in middle bedroom in 917 Main and the floor tiles in the closet of the child's bedroom in 921 Main.
- 2) October 2015 - Pipe insulation in the exterior crawlspace of 921 Main.

The documentation includes:

- Description of confirmed asbestos containing material based on H&S's 2012 hazardous building materials inspection, taken from the October 2012 inspection report, for the joint compound and floor tiles.
- Copy of the MassDEP notification forms, ANF-001.
- Results of asbestos clearance sampling performed by FLI Environmental.
- ACM disposal documentation.

**NOTE:** Review of submittals by the Government is intended to verify general conformance with the design intent as shown on the contract drawings and in the specifications. Review by the Contracting Officer's Representative (COR) does not relieve the Contractor of responsibility for any errors and/or omissions in the submittals, nor from the responsibility for complying with the requirements of the contract, except with respect to variations described and approved in accordance with FAR 52.243-4 CHANGES.

**\*\*FOR GOVERNMENT USE ONLY\*\***

**DESIGN ENGINEER (IF APPLICABLE)**

TO: COR

REVIEWED, RECOMMEND PROCESSING AS INDICATED ABOVE AND SUBJECT TO ANY APPLICABLE COMMENTS ABOVE.

|                    |                      |      |
|--------------------|----------------------|------|
| TYPED NAME & TITLE | SIGNATURE (INITIALS) | DATE |
|--------------------|----------------------|------|

**CONSTRUCTION PROJECT MANAGER (COR)**

TO: CONTRACTOR

1. REVIEWED OR REJECTED AS INDICATED ABOVE AND SUBJECT TO ANY APPLICABLE COMMENTS ABOVE.
2. REQUEST PROMPT RESUBMITTAL ON REJECTED ITEMS.

|                       |                             |                  |
|-----------------------|-----------------------------|------------------|
| TYPED NAME<br>(b) (6) | SIGNATURE<br>(b) (6)<br>PLN | DATE<br>12-23-15 |
|-----------------------|-----------------------------|------------------|

NOTE: Copy Contracting Officer, COR, and Government Inspector on all submittals.



### 3.2.6 ACM Inspection Findings and Recommendations

A total of two (2) building materials from the HBM inspection of the Site were confirmed for the presence of Asbestos. The materials confirmed to contain asbestos in the inspected areas and are summarized as follows:

#### Confirmed Asbestos Containing Material, 921 Main Street, Vineyard Haven, MA

| Sample Number | Material Location                                   | Quantity | Analysis Results |
|---------------|-----------------------------------------------------|----------|------------------|
| 092012-09-09A | Red Brick Patter Flooring Closet in Child's Bedroom | 20 SF    | 2% Chrysotile    |

#### Confirmed Asbestos Containing Material, 917 Main Street, Vineyard Haven, MA

| Sample Number | Material Location                                           | Quantity | Analysis Results |
|---------------|-------------------------------------------------------------|----------|------------------|
| 092012-09-15A | Joint Compound Second Floor Middle Bedroom at Utility Hatch | 200 SF   | 2% Chrysotile    |

The following building materials were identified and sampled and have been classified as Non ACMs in the inspected areas and are summarized as follows:

#### Confirmed Non-Asbestos Containing Material, 917 E. Main Street, Vineyard Haven, MA

| LOCATION                             | MATERIAL               |
|--------------------------------------|------------------------|
| Wall Coating on Fieldstone Wall      | Basement Walls         |
| Wall Coating on Fieldstone Wall      | Basement Walls         |
| Wall Coating on Fieldstone Wall      | Basement Walls         |
| Wall and Ceiling Plaster             | Basement Stairwell     |
| Wall and Ceiling Plaster             | Basement Stairwell     |
| Wall and Ceiling Plaster             | Basement Stairwell     |
| Wall and Ceiling Plaster             | Crawl Space in Bedroom |
| Wall and Ceiling Plaster             | Crawl Space in Bedroom |
| Mastic Paper on White Floor Sheeting | Kitchen                |
| Mastic Paper on White Floor Sheeting | Entryway At Radiator   |



## FLI Environmental

July 13, 2015

Client: Tantara Corp.  
Contractor: Tantara Corp.  
FLI Project #: 15-1698  
Site Location: USCG - West Chop  
917 Main Street  
Tisbury, MA

Dear Sir/Madam:

FLI Environmental, Inc. (FLI) conducted post-abatement final clearance air sampling after asbestos removal at the above referenced location. The identified asbestos materials were abated within a regulated work area and air sampling was conducted according to applicable state and federal regulations. The visual inspection, air sample collection and analysis was completed by FLI's state licensed and EPA accredited Asbestos Project Monitor listed below:

Project Monitor (b) (6)  
License # [REDACTED]

The work area passed the clearance criteria. Each sample was analyzed and found to be below 0.010 fibers per cubic centimeter of air (f/cc), the final clearance level mandated by the Commonwealth of Massachusetts and EPA Asbestos Regulations. The exact sample locations and analytical results are listed in the attached Final Clearance Inspection Checklist.

Samples were collected and analyzed following the NIOSH 7400 Method ("A" rules) using mixed cellulose ester membrane filters with 0.8 micrometer pore size mounted in a 2-stage, 25 mm filter cassette. This method identifies total fibers by Phase Contrast Microscopy (PCM) using 400X magnification and does not distinguish between asbestos and non-asbestos fibers (i.e. fiber glass, mineral wool, cellulose, etc.). All fibers with a length to diameter ratio of 3 to 1 or greater and a length of greater than 5 microns are considered to be asbestos fibers and are counted as such. Sample collection was performed in the open face position by drawing a known volume of air through the filter with a sampling pump. The flow rate for the sample was calibrated using a rotometer. Field blanks were analyzed to determine potential filter contamination.

FLI's laboratory is a successful participant in the NIOSH Proficiency and Analytical Testing (PAT) Program (# 102582) and is licensed by the MA Department of Labor Standards (# AA 000144).

Should you have any questions regarding this letter or project, please do not hesitate to contact us at (781) 251-0040. FLI appreciates the opportunity to provide you with our services.

Sincerely,

*FLI Environmental, Inc.*

(b) (6)  
[REDACTED]

Manager, Field Services



FLI Environmental

# Final Clearance Inspection Checklist

Client: Tanara Corp. Asbestos Contractor: Tanara Corp. Date: July 13, 2015  
Job Site: USCG - West Chop Containment Area: Second Floor Project #: 15-1698  
917 Main Street Decon Type: 3-Stage Time: 12:10  
Tisbury, MA Work Area Size: 20 SF

| Material     | Quantity | Yes                                 | No                                  |
|--------------|----------|-------------------------------------|-------------------------------------|
| Wall Plaster | 20 SF    | <input checked="" type="checkbox"/> | <input type="checkbox"/>            |
|              |          | <input checked="" type="checkbox"/> | <input type="checkbox"/>            |
|              |          | <input checked="" type="checkbox"/> | <input type="checkbox"/>            |
|              |          | <input type="checkbox"/>            | <input checked="" type="checkbox"/> |

Negative Pressure:  
Poly Sheeting in Place:  
Full Containment:  
Glovebag Removal:

## Certification

The undersigned verify the work area outlined above has been inspected and has passed the visual inspection criteria of no visible debris.

Name

(b) (6)

Signature

License #

Project Monitor:

(b) (6)

Supervisor:

Not Present

## Air Sampling Data

Analyst: Richard Bowen

Signature:

(b) (6)

Pass ☒

| Lab ID | Sample # | Location              | Start Time | End Time | Minutes | Flow Rate | Volume | F/100 Field | F/cc  |
|--------|----------|-----------------------|------------|----------|---------|-----------|--------|-------------|-------|
|        | 1698-01  | Second Floor, Bedroom | 12:15      | 13:32    | 77      | 16        | 1232   | 4.5         | <0.05 |
|        | 1698-02  | Field Blank           | 0:00       | 0:00     | 0       | 0         | 0      | 1.0         | N/A   |
|        | 1698-03  | Field Blank           | 0:00       | 0:00     | 0       | 0         | 0      | 0.5         | N/A   |
|        |          |                       |            |          |         |           |        |             |       |
|        |          |                       |            |          |         |           |        |             |       |
|        |          |                       |            |          |         |           |        |             |       |

Additional Notes: The Post Abatement Clearance Level for Recirculation is 0.010 F/cc. Flow Rate in Liters per Minute. Volume in Liters.

MIA Lab License AA000144 - RI Lab License AAL-0998



## FLI Environmental

October 8, 2015

Client: Tantara Corp.  
Contractor: Tantara Corp.  
FLI Project #: 15-1698.1  
Site Location: USCG - West Chop  
921 Main Street  
Tisbury, MA

Dear Sir/Madam:

FLI Environmental, Inc. (FLI) conducted post-abatement final clearance air sampling after asbestos removal at the above referenced location. The identified asbestos materials were abated within a regulated work area and air sampling was conducted according to applicable state and federal regulations. The visual inspection, air sample collection and analysis was completed by FLI's state licensed and EPA accredited Asbestos Project Monitor listed below:

Project Monitor (b) (6)  
License # [REDACTED]

The work area passed the clearance criteria. Each sample was analyzed and found to be below 0.010 fibers per cubic centimeter of air (f/cc), the final clearance level mandated by the Commonwealth of Massachusetts and EPA Asbestos Regulations. The exact sample locations and analytical results are listed in the attached Final Clearance Inspection Checklist.

Samples were collected and analyzed following the NIOSH 7400 Method ("A" rules) using mixed cellulose ester membrane filters with 0.8 micrometer pore size mounted in a 2-stage, 25 mm filter cassette. This method identifies total fibers by Phase Contrast Microscopy (PCM) using 400X magnification and does not distinguish between asbestos and non-asbestos fibers (i.e. fiber glass, mineral wool, cellulose, etc.). All fibers with a length to diameter ratio of 3 to 1 or greater and a length of greater than 5 microns are considered to be asbestos fibers and are counted as such. Sample collection was performed in the open face position by drawing a known volume of air through the filter with a sampling pump. The flow rate for the sample was calibrated using a rotometer. Field blanks were analyzed to determine potential filter contamination.

FLI's laboratory is a successful participant in the NIOSH Proficiency and Analytical Testing (PAT) Program (# 102582) and is licensed by the MA Department of Labor Standards (# AA 000144).

Should you have any questions regarding this letter or project, please do not hesitate to contact us at (781) 251-0040. FLI appreciates the opportunity to provide you with our services.

Sincerely,

FLI Environmental, Inc.

(b) (6)  
[REDACTED]

Manager, Field Services





FLI Environmental

# Final Clearance Inspection Checklist

|                            |                                   |                       |
|----------------------------|-----------------------------------|-----------------------|
| Client: Tantara Corp       | Asbestos Contractor: Tantara Corp | Date: October 8, 2015 |
| Job Site: USCG - West Chop | Containment Area: Basement        | Project #: 15-1698.1  |
| 921 Main Street            | Decon Type: 3-Stage               | Time: 13:20           |
| Tisbury, MA                | Work Area Size: 300 SF            |                       |

| Material        | Quantity | Yes                                 | No                                  |
|-----------------|----------|-------------------------------------|-------------------------------------|
| Pipe Insulation | 65 Lf    | <input checked="" type="checkbox"/> | <input type="checkbox"/>            |
|                 |          | <input checked="" type="checkbox"/> | <input type="checkbox"/>            |
|                 |          | <input checked="" type="checkbox"/> | <input type="checkbox"/>            |
|                 |          | <input type="checkbox"/>            | <input checked="" type="checkbox"/> |

Negative Pressure: ☒  
Poly Sheeting in Place: ☒  
Full Containment: ☒  
Glovebag Removal: ☐

**Certification** The undersigned verify the work area outlined above has been inspected and has passed the visual inspection criteria of no visible debris.

|                  |         |           |                                     |
|------------------|---------|-----------|-------------------------------------|
| Project Monitor: | Name    | Signature | License #                           |
|                  | (b) (6) |           |                                     |
| Supervisor:      | Name    | Signature | Pass                                |
|                  | (b) (6) | (b) (6)   | <input checked="" type="checkbox"/> |

| Air Sampling Data |           | Analyst: (b) (6)          | Signature: (b) (6) | Start Time | End Time | Minutes | Flow Rate | Volume | f/100 fwhl | f/cc  |
|-------------------|-----------|---------------------------|--------------------|------------|----------|---------|-----------|--------|------------|-------|
| Lab ID            | Sample #  | Location                  |                    | 13:20      | 14:35    | 75      | 16        | 1200   | 7.0        | 0.003 |
|                   | 1698.1-01 | Crawlspace, Beneath House |                    | 0:00       | 0:00     | 0       | 0         | 0      | 1.0        | N/A   |
|                   | 1698.1-02 | Field Blank               |                    | 0:00       | 0:00     | 0       | 0         | 0      | 0.5        | N/A   |
|                   | 1698.1-03 | Field Blank               |                    |            |          |         |           |        |            |       |
|                   |           |                           |                    |            |          |         |           |        |            |       |
|                   |           |                           |                    |            |          |         |           |        |            |       |
|                   |           |                           |                    |            |          |         |           |        |            |       |

Additional Notes: The Post Abatement Clearance Level for Neutronium is 0.010 F/cc. Flow Rate is Liters per Minute. Volume in Liters. MA Lab License A4000144 - RI Lab License AAL-028

# SERVICE TRANSPORT GROUP, INC. 317414

58 PYLES LANE, NEW CASTLE, DE 19720

PHONE: (877) 999-9559

Nº 420111

## WASTE SHIPMENT RECORD

S.T.G. # 69419

|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                    |                                                                                                                                      |                                                                                                                                         |                                                                                                    |                       |                                          |  |
|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------|-----------------------|------------------------------------------|--|
| GENERATOR                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                          | 1. Material Origin Site<br>917 & 921 Main St.<br>Vineyard Haven, MA                                                                  |                                                                                                                                         | Generator: Name/Address<br>US Coast Guard - CEU Providence<br>475 Killet Street<br>Wareh, RI 02886 |                       | Generator: Phone #<br>(508)<br>968-6499  |  |
|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                    | 2. Removal Contractor: Name/Address<br>TANTARA Corporation<br>54 Mason St.<br>Worcester MA 01610                                     |                                                                                                                                         |                                                                                                    |                       | Contractor: Phone #<br>(508)<br>752-5599 |  |
|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                    | 3. Responsible Agency: Name/Address<br>USEPA Region 1<br>5 Post Office Square, Ste. 100<br>Boston, MA 02109-3922                     |                                                                                                                                         | 4. US DOT Class - FRIABLE ASBESTOS ONLY<br>NA2212, Asbestos, 9, PG III, RQ                         |                       |                                          |  |
|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                    | 5. Description of Materials<br>Specify <u>Friable</u> or Non-Friable                                                                 |                                                                                                                                         | Containers<br>No. Type                                                                             |                       | Total Quantity                           |  |
|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                    | IF Friable (enter required information)                                                                                              |                                                                                                                                         | 4 Fiber Drums                                                                                      |                       | 1 CY                                     |  |
|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                    | IF Non-Friable (check one) <input type="checkbox"/> Category I <input type="checkbox"/> Category II                                  |                                                                                                                                         |                                                                                                    |                       |                                          |  |
|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                    | 6. Special Handling Instructions<br>Emergency Response Nos. 21401-946-9996                                                           |                                                                                                                                         |                                                                                                    |                       |                                          |  |
| 7. Generator Certification:<br>This is to certify that the above named materials are properly classified, described, packaged, marked and labeled and are in proper condition for transport by highway according to the applicable regulations of the Department of Transportation, US EPA, and any other state government agency I certify that the foregoing is true and correct to the best of my knowledge. If the waste shipment is not as I stated, I accept the RETURN of the COMPLETE LOAD to the generator's facility located at the generator's address. |                                                                                                                                      |                                                                                                                                         |                                                                                                    |                       |                                          |  |
| TRANSPORTER                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                        | (b) (6)                                                                                                                              |                                                                                                                                         | (b) (6)                                                                                            |                       | Date<br>7/20/15                          |  |
|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                    | 8. Transporter 1 (Acknowledgement of Receipt of Materials) If blank, see Transporter 2 or 3 below.                                   |                                                                                                                                         |                                                                                                    |                       |                                          |  |
|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                    | Company Name & Address<br>Tantara Corp.<br>54 Mason St.<br>Worcester, MA 01610                                                       |                                                                                                                                         | Signature: (b) (6)                                                                                 |                       | Telephone No.<br>(b) (6)                 |  |
|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                    |                                                                                                                                      |                                                                                                                                         | Printed Name: (b) (6)                                                                              |                       | Date:<br>7-20-15                         |  |
|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                    |                                                                                                                                      |                                                                                                                                         | Title: SUPERVISOR                                                                                  |                       |                                          |  |
| TRANSPORTER                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                        | 9. Transporter 2 (Acknowledgement of Receipt of Materials) If Transporter 1 & 2 are blank, Transporter 3 serves as sole transporter. |                                                                                                                                         |                                                                                                    |                       |                                          |  |
|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                    | Company Name & Address<br>CAL JONES                                                                                                  |                                                                                                                                         | Signature: (b) (6)                                                                                 |                       | Telephone No.                            |  |
|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                    |                                                                                                                                      |                                                                                                                                         | Printed Name: (b) (6)                                                                              |                       | Date:<br>8-4-15                          |  |
| DISPOSAL SITE                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                      | 10. Transporter 3 (Acknowledgement of Receipt of Materials)                                                                          |                                                                                                                                         |                                                                                                    |                       |                                          |  |
|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                    | Company Name & Address<br>Service Transport Group, Inc.<br>58 Pyles Lane<br>New Castle, DE 19720                                     |                                                                                                                                         | Signature:                                                                                         |                       | Telephone No.<br>877-999-9559            |  |
|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                    |                                                                                                                                      |                                                                                                                                         | Printed Name:                                                                                      |                       | Date:                                    |  |
|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                    |                                                                                                                                      |                                                                                                                                         | Title:                                                                                             |                       |                                          |  |
| 11. Discrepancy Indication Space:                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                  |                                                                                                                                      |                                                                                                                                         |                                                                                                    |                       |                                          |  |
| 12. Waste Disposal Site Owner or Operator's Certification (Receipt of above Waste except as noted in 11)                                                                                                                                                                                                                                                                                                                                                                                                                                                           |                                                                                                                                      |                                                                                                                                         |                                                                                                    |                       |                                          |  |
| Waste Disposal Site (Check One) STG USE ONLY                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                       |                                                                                                                                      |                                                                                                                                         |                                                                                                    |                       |                                          |  |
| Sanitary Landfill <input type="checkbox"/><br>9011 Tyrol Blvd<br>Belle Vernon, PA 15012<br>724-929-7601 Ext 14<br>Permit No. 100277                                                                                                                                                                                                                                                                                                                                                                                                                                |                                                                                                                                      | Minerva Landfill <input checked="" type="checkbox"/><br>8955 Minerva Rd.<br>Waynesburg, OH 44688<br>330 866 3475<br>Permit No. P0104984 |                                                                                                    | Signature: (b) (6)    |                                          |  |
|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                    |                                                                                                                                      |                                                                                                                                         |                                                                                                    | Printed Name: (b) (6) |                                          |  |
|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                    |                                                                                                                                      |                                                                                                                                         |                                                                                                    | Date:<br>8-4-15       |                                          |  |



## SERVICE TRANSPORT GROUP, INC. 322226

47

58 PYLES LANE, NEW CASTLE, DE 19720

PHONE: (877) 999-9559

Nº 420098

## WASTE SHIPMENT RECORD

S.T.G. # 6A03

|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                     |                                                                                                                                        |                                                                                             |                                              |
|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------|----------------------------------------------|
| GENERATOR                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                           | 1. Material Origin Site<br>921 Main Street<br>Tisbury, MA                                                                              | Generator: Name/Address<br>U.S. Coast Guard-CEC<br>475 Keweenaw Street<br>Warwick, RI 02886 | Generator: Phone #<br>508-968-6499           |
|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                     | 2. Removal Contractor: Name/Address<br>TANTARA Corporation Inc.<br>54 Mason Street<br>Worcester, MA                                    | Contact: (b) (6)                                                                            | Contractor: Phone #<br>508-752-5599          |
|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                     | 3. Responsible Agency: Name/Address<br>USEPA Region 1<br>5 Post Office Square, Ste 100<br>Boston, MA 02109-3922                        | 4. US DOT Class - FRIABLE ASBESTOS ONLY<br>NA2212, Asbestos, 9, PG III, RQ                  |                                              |
|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                     | 5. Description of Materials<br>Specify Friable or Non-Friable                                                                          | Containers<br>No. Type                                                                      | Total Quantity                               |
|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                     | IF Friable (enter required information)                                                                                                | 16 Bag                                                                                      | 204<br>16                                    |
|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                     | IF Non-Friable (check one) <input type="checkbox"/> Category I <input type="checkbox"/> Category II                                    |                                                                                             |                                              |
| 6. Special Handling Instructions<br>Emergency Response No. MA 888-304-1133<br>RT 401-946-9996                                                                                                                                                                                                                                                                                                                                                                                                                                                                       |                                                                                                                                        |                                                                                             |                                              |
| 7. Generator Certification:<br>This is to certify that the above named materials are properly classified, described, packaged, marked and labeled and are in proper condition for transport by highway according to the applicable regulations of the Department of Transportation, US EPA, and any other state government agency. I certify that the foregoing is true and correct to the best of my knowledge. If the waste shipment is not as I stated, I accept the RETURN of the COMPLETE LOAD to the generator's service location at the generator's expense. |                                                                                                                                        |                                                                                             |                                              |
| (b) (6)                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                             |                                                                                                                                        | (b) (6)                                                                                     | Date<br>10-8-15                              |
| TRANSPORTER                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                         | 8. Transporter 1 (Acknowledgement of Receipt of Materials) If blank, see Transporter 2 or 3 below.                                     |                                                                                             |                                              |
|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                     | Company Name & Address<br>TANTARA Corporation, Inc.<br>54 Mason Street<br>Worcester, MA 01610                                          | Signature: (b) (6)<br>Printed Name: (b) (6)<br>Title: Site Supervisor                       | Telephone No. 508-871-5627<br>Date: 10-8-15  |
|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                     | 9. Transporter 2 (Acknowledgement of Receipt of Materials) If Transporter 1 & 2 are blank, Transporter 3 serves as sole transporter.   |                                                                                             |                                              |
|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                     | Company Name & Address                                                                                                                 | Signature: (b) (6)<br>Printed Name: (b) (6)<br>Title: (b) (6)                               | Telephone No.<br>Date:                       |
| DISPOSAL SITE                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                       | 10. Transporter 3 (Acknowledgement of Receipt of Materials)                                                                            |                                                                                             |                                              |
|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                     | Company Name & Address<br>Service Transport Group, Inc.<br>58 Pyles Lane<br>New Castle, DE 19720                                       | Signature: (b) (6)<br>Printed Name: (b) (6)<br>Title: Driver                                | Telephone No. 877-999-9559<br>Date: 10-30-15 |
|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                     | 11. Discrepancy Indication Space: (b) (6)                                                                                              |                                                                                             |                                              |
|                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                     | 12. Waste Disposal Site Owner or Operator's Certification (Receipt of above Waste)                                                     |                                                                                             |                                              |
| Waste Disposal Site (Check One)                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                     |                                                                                                                                        | STG USE ONLY                                                                                |                                              |
| Sanitary Landfill <input type="checkbox"/><br>901 Tyrol Blvd<br>Bella Vernon PA 15012<br>724 929-7694 Ext. 14<br>Permit No. 100277                                                                                                                                                                                                                                                                                                                                                                                                                                  | Minerva Landfill <input checked="" type="checkbox"/><br>8955 Minerva Rd.<br>Waynesburg OH 44608<br>330 866-3435<br>Permit No. PN104984 | Signature: (b) (6)<br>Printed Name: (b) (6)<br>Title: (b) (6)                               | Date: 11/2/15                                |

WHITE Generator • GREEN S.T.G. • YELLOW Contractor • PURPLE Landfill • GOLD Pick Up Receipt

# Environmental Lead Detection

436 Gardners Neck Road, Swansea, MA 02777

Telephone (774) 526-8223

Email: (b) (6)

December 11, 2015

(b) (6)

Project Manager  
TANTARA Corporation  
54 Mason Street  
Worcester, MA 01610

Re: West Chop I and West Chop II  
917 and 921 Main Street  
Tisbury, Massachusetts

Dear (b) (6)

On August 3, 2015, (b) (6) Massachusetts Lead Inspector/Risk Assessor (b) (6) conducted a visual survey of the lead abatement work conducted at 917 Main Street and 921 Main Street, Tisbury, Massachusetts. The properties are known as West Chop I and West Chop II.

The goal of this service was to determine if the work as detailed in the Lead Abatement Work Plan dated May 21, 2015, which included covering walls and ceilings on the second floor of both houses with blue board and plaster, covering baseboards throughout both houses with 1/4" birch, and covering window exterior sills throughout both houses with aluminum sheet stock, had been satisfactorily completed. The scope of the work for this project consists of the abatement and disposal, replacement, covering, scraping, and removal of lead-based paint contaminated building components to in accordance with the requirements of Federal laws and regulations. Specifically, these surfaces are identified in the May 21, 2015 Lead Abatement Work Plan and include:

Applicable laws and regulations include, but are not limited to, Department of Housing and Urban Development (HUD) *Requirements for Notification, Evaluation and Reduction of Lead-Based Paint Hazards in Federally Owned Residential Property and Housing Receiving Federal Assistance*, also known as the HUD Lead Safe Housing Rule (24 CFR Part 35, subparts B-R).

After a comprehensive examination of the work, it was determined that all surface treatments had been completed as detailed in the Work Plan. Because a final cleanup had not yet been conducted, no post abatement clearance dust wipe samples were taken during this visit.

On October 1, 2015, the inspector returned to the site to conduct post abatement clearance dust wipe sampling. A total of twenty-six dust wipe samples (includes a field blank at each site) were collected, thirteen from each building, in an effort to help to determine the levels of lead-containing dust on the interior window sills and floors. These samples were collected from areas most likely to be lead contaminated if lead-in-dust is present. EPA, HUD and State of Massachusetts regulations define the following as hazardous levels for lead dust in residences: floors –  $\geq 40 \mu\text{g}/\text{ft}^2$  (micrograms per square foot); interior windowsills –  $\geq 250 \mu\text{g}/\text{ft}^2$ ; and, interior window wells –  $\geq 400 \mu\text{g}/\text{ft}^2$ .



As indicated below, leaded dust in quantities greater than EPA, HUD, and Massachusetts standards were detected in each building. Out of 24 samples collected at random locations, three were over the regulatory thresholds. All other testing locations registered lead levels below the EPA, HUD and State of Massachusetts standards. Please refer to *Appendix I- Dust Wipe Analytical Results* for the laboratory reports.

#### 917 Main Street

| Sample No. | Location | Component | Substrate | Sample Size (ft <sup>2</sup> ) | Test Results (µg/ft <sup>2</sup> ) |
|------------|----------|-----------|-----------|--------------------------------|------------------------------------|
| 145281-003 | Rm #2    | Floor     | Wood      | 1.00                           | 94.3                               |

#### 921 Main Street

| Sample No. | Location | Component | Substrate | Sample Size (ft <sup>2</sup> ) | Test Results (µg/ft <sup>2</sup> ) |
|------------|----------|-----------|-----------|--------------------------------|------------------------------------|
| 145280-003 | Kitchen  | Floor     | Wood      | 1.00                           | 40.0                               |
| 145280-005 | Rm #2    | Floor     | Wood      | 1.00                           | 43.5                               |

#### Laboratory Information:

Schneider Laboratories Global  
2512 W. Cary Street  
Richmond, Virginia 23220  
Phone (800) 785-5227

#### Dust Analysis Protocol

EPA Method 7000B, implementing a microwave-assisted digestion process.

National Lead Laboratory Accreditation  
Program Serial number: #100527

On October 27, 2015, the inspector returned to the site to conduct post failure clearance dust wipe sampling. A total of five dust wipe samples (includes a field blank at each site) were collected, one from 917 Main St., and two from 921 Main St. These samples were collected from areas where there were failures in the previous sampling. None of the samples contained lead above the laboratory detection threshold.

In conclusion, these properties are now in what could be characterized as a lead safe condition. In order that this lead safe condition be maintained, surfaces that were covered as an abatement method must remain covered.

Submitted by:

(b) (6)

Massachusetts Lead Inspector/Risk Assessor  
Expires 10/31/16

(b) (6)



## Analysis Report

## Schneider Laboratories Global, Inc

2512 W. Cary Street • Richmond, Virginia • 23220-5117  
804-353-6778 • 800-785-LABS (5227) • Fax 804-359-1475Customer: ENVIRONMENTAL LEAD DETECTION (482)  
Address: 436 Gardners Neck Rd  
Swansea, MA 02777-3105

Order #: 145281

Matrix Wipe  
Received 10/02/15  
Analyzed 10/02/15  
Reported 10/03/15

Attn:

Project:

Location: 917 Main St  
Number: Vineyard Haven

PO Number:

| Sample ID  | Cust. Sample ID | Location          | Sample Date | Area      | Total         | Conc.        | RL*          |
|------------|-----------------|-------------------|-------------|-----------|---------------|--------------|--------------|
| Parameter  |                 | Method            |             |           |               |              |              |
| 145281-001 | 1D              | FL Rm 1           | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 1.00 ft2  | 10.3 µg/wipe  | 10.3 µg/ft2  | 10.0 µg/ft2  |
| 145281-002 | 2D              | SL Rm 1           | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 0.479 ft2 | <10.0 µg/wipe | <20.9 µg/ft2 | 20.9 µg/ft2  |
| 145281-003 | 3D              | FL Rm 2           | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 1.00 ft2  | 94.3 µg/wipe  | 94.3 µg/ft2  | 10.0 µg/ft2  |
| 145281-004 | 4D              | SL Rm 2           | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 0.745 ft2 | <10.0 µg/wipe | <13.4 µg/ft2 | 13.4 µg/ft2  |
| 145281-005 | 5D              | FL Kitchen        | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 1.00 ft2  | 29.5 µg/wipe  | 29.5 µg/ft2  | 10.0 µg/ft2  |
| 145281-006 | 6D              | SL Kitchen        | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 0.688 ft2 | 112 µg/wipe   | 163 µg/ft2   | 14.5 µg/ft2  |
| 145281-007 | 7D              | FL Rm 3           | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 1.00 ft2  | 12.0 µg/wipe  | 12.0 µg/ft2  | 10.0 µg/ft2  |
| 145281-008 | 8D              | SL Rm 3           | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 0.489 ft2 | <10.0 µg/wipe | <21.3 µg/ft2 | 21.3 µg/ft2  |
| 145281-009 | 9D              | FL Rm 4           | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 1.00 ft2  | 12.0 µg/wipe  | 12.0 µg/ft2  | 10.0 µg/ft2  |
| 145281-010 | 10D             | SL Rm 4           | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 0.734 ft2 | <10.0 µg/wipe | <13.6 µg/ft2 | 13.6 µg/ft2  |
| 145281-011 | 11D             | FL Rm 5           | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 1.00 ft2  | <10.0 µg/wipe | <10.0 µg/ft2 | 10.0 µg/ft2  |
| 145281-012 | 12D             | SL Rm 5           | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 0.682 ft2 | <10.0 µg/wipe | <14.7 µg/ft2 | 14.7 µg/ft2  |
| 145281-013 | 13D             | Blank             | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             |           | <10.0 µg/wipe |              | 10.0 µg/wipe |

Minimum Total Reporting Limit: 10.0 µg/wipe. EPA Clearance Std: 40 µg/ft<sup>2</sup> for floors, 250 µg/ft<sup>2</sup> for interior window sills, and 400 µg/ft<sup>2</sup> for window troughs. All internal QC parameters were met. Unusual sample conditions, if any, are described. Surrogate Spike results designated with "D" indicate that the analyte was diluted out. "MI" indicates matrix interference. Concentration and Reporting Limit (RL) based on areas provided by client. Values are reported to three significant figures. The test results reported relate only to the samples submitted.



## Analysis Report

## Schneider Laboratories Global, Inc

2512 W. Cary Street • Richmond, Virginia • 23220-5117  
804-353-6778 • 800-785-LABS (5227) • Fax 804-359-1475Customer ENVIRONMENTAL LEAD DETECTION (482)  
Address 436 Gardners Neck Rd  
Swansea, MA 02777-3105

Order #: 148536

Matrix Wipe  
Received 10/28/15  
Analyzed 10/28/15  
Reported 10/28/15Project  
Location 917 Main St  
Number Vineyard Haven

| Sample ID  | Cust. Sample ID | Location          | Sample Date |               |              |              |
|------------|-----------------|-------------------|-------------|---------------|--------------|--------------|
| Parameter  |                 | Method            | Area        | Total         | Conc.        | RL*          |
| 148536-001 | 14P             | Rm 2 FL           | 10/27/15    |               |              |              |
| Lead       |                 | EPA 7000B / 3050B | 1.00 ft2    | <10.0 µg/wipe | <10.0 µg/ft2 | 10.0 µg/ft2  |
| 148536-002 | 15P             | Blank             | 10/27/15    |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | <10.0 µg/wipe |              | 10.0 µg/wipe |

Analys(b)  
148536-10/28/15 03:08 PM

(b) (6)

Metals Supervisor

Minimum Total Reporting Limit: 10.0 µg/wipe. EPA Clearance Std: 40 µg/ft² for floors, 250 µg/ft² for interior window sills, and 400 µg/ft² for window troughs. All internal QC parameters were met. Unusual sample conditions, if any, are described. Surrogate Spike results designated with "D" indicate that the analyte was diluted out. "MI" indicates matrix interference. Concentration and \*Reporting Limit (RL) based on areas provided by client. Values are reported to three significant figures. The test results reported relate only to the samples submitted.



## Analysis Report

## Schneider Laboratories Global, Inc

2512 W. Cary Street • Richmond, Virginia • 23220-5117  
804-353-6778 • 800-785-LABS (5227) • Fax 804-359-1475Customer: ENVIRONMENTAL LEAD DETECTION (482)  
Address: 436 Gardners Neck Rd  
Swansea, MA 02777-3105

Order #: 145280

Matrix Wipe  
Received 10/02/15  
Analyzed 10/02/15  
Reported 10/03/15

Attn:

Project:

Location: 921 Main St  
Number: Vineyard Haven

PO Number:

| Sample ID  | Cust. Sample ID | Location          | Sample Date | Area      | Total         | Conc.        | RL*          |
|------------|-----------------|-------------------|-------------|-----------|---------------|--------------|--------------|
| Parameter  |                 | Method            |             |           |               |              |              |
| 145280-001 | 1D              | FL Rm 1           | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 1.00 ft2  | <10.0 µg/wipe | <10.0 µg/ft2 | 10.0 µg/ft2  |
| 145280-002 | 2D              | SL Rm 1           | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 0.719 ft2 | <10.0 µg/wipe | <13.9 µg/ft2 | 13.9 µg/ft2  |
| 145280-003 | 3D              | FL Kitchen        | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 1.00 ft2  | 40.0 µg/wipe  | 40.0 µg/ft2  | 10.0 µg/ft2  |
| 145280-004 | 4D              | SL Kitchen        | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 0.853 ft2 | <10.0 µg/wipe | <11.7 µg/ft2 | 11.7 µg/ft2  |
| 145280-005 | 5D              | FL Rm 2           | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 1.00 ft2  | 43.5 µg/wipe  | 43.5 µg/ft2  | 10.0 µg/ft2  |
| 145280-006 | 6D              | SL Rm 2           | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 1.03 ft2  | <10.0 µg/wipe | <9.70 µg/ft2 | 9.70 µg/ft2  |
| 145280-007 | 7D              | FL Rm 3           | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 1.00 ft2  | 13.8 µg/wipe  | 13.8 µg/ft2  | 10.0 µg/ft2  |
| 145280-008 | 8D              | SL Rm 3           | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 0.719 ft2 | 29.5 µg/wipe  | 41.1 µg/ft2  | 13.9 µg/ft2  |
| 145280-009 | 9D              | FL Rm 4           | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 1.00 ft2  | 13.8 µg/wipe  | 13.8 µg/ft2  | 10.0 µg/ft2  |
| 145280-010 | 10D             | SL Rm 4           | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 1.03 ft2  | 22.5 µg/wipe  | 21.8 µg/ft2  | 9.70 µg/ft2  |
| 145280-011 | 11D             | FL Rm 5           | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 1.00 ft2  | 20.8 µg/wipe  | 20.8 µg/ft2  | 10.0 µg/ft2  |
| 145280-012 | 12D             | SL Rm 5           | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 1.02 ft2  | 59.3 µg/wipe  | 57.9 µg/ft2  | 9.77 µg/ft2  |
| 145280-013 | 13D             | Blank             | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             |           | <10.0 µg/wipe |              | 10.0 µg/wipe |

Minimum Total Reporting Limit: 10.0 µg/wipe. EPA Clearance Std: 40 µg/ft<sup>2</sup> for floors, 250 µg/ft<sup>2</sup> for interior window sills, and 400 µg/ft<sup>2</sup> for window troughs. All internal QC parameters were met. Unusual sample conditions, if any, are described. Surrogate Spike results designated with "D" indicate that the analyte was diluted out. "MI" indicates matrix interference. Concentration and "Reporting Limit (RL)" based on areas provided by client. Values are reported to three significant figures. The test results reported relate only to the samples submitted.





## Analysis Report

## Schneider Laboratories Global, Inc

2512 W. Cary Street • Richmond, Virginia • 23220-5117  
804-353-6778 • 800-785-LABS (5227) • Fax 804-359-1475Customer: ENVIRONMENTAL LEAD DETECTION (482)  
Address: 436 Gardners Neck Rd  
Swansea, MA 02777-3105

Order #: 148537

Matrix Wipe  
Received 10/28/15  
Analyzed 10/28/15  
Reported 10/28/15

Attn:

Project:

Location: 921 Main St  
Number: Vineyard Haven

PO Number:

| Sample ID  | Cust. Sample ID | Location          | Sample Date | Area     | Total         | Conc.        | RL*          |
|------------|-----------------|-------------------|-------------|----------|---------------|--------------|--------------|
| Parameter  |                 | Method            |             |          |               |              |              |
| 148537-001 | 14D             | Kitchen FL        | 10/27/15    |          |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 1.00 ft2 | <10.0 µg/wipe | <10.0 µg/ft2 | 10.0 µg/ft2  |
| 148537-002 | 15D             | Rm 2 FL           | 10/27/15    |          |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 1.00 ft2 | <10.0 µg/wipe | <10.0 µg/ft2 | 10.0 µg/ft2  |
| 148537-003 | 16D             | Blank             | 10/27/15    |          |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             |          | <10.0 µg/wipe |              | 10.0 µg/wipe |

Analyst: (b)  
148537-10/28/15 02:13 PM

(b) (6)

Analyst

Minimum Total Reporting Limit: 10.0 µg/wipe. EPA Clearance Std: 40 µg/ft² for floors, 250 µg/ft² for interior window sills, and 400 µg/ft² for window troughs. All internal QC parameters were met. Unusual sample conditions, if any, are described. Surrogate Spike results designated with "D" indicate that the analyte was diluted out. "MI" Indicates matrix interference. Concentration and \*Reporting Limit (RL) based on areas provided by client. Values are reported to three significant figures. The test results reported relate only to the samples submitted.

U.S. Department of  
Homeland Security

United States  
Coast Guard



United States Coast Guard  
CEU Providence  
Contracting/Inspection  
475 Kilvert St. Suite 100  
Warwick, RI 02886

Attn: (b) (6)  
Phone: (b) (6)  
Email: (b) (6)

4330  
14 December 2015

Tantara Associates Corporation  
54 Mason St.  
Worcester, MA 01610  
Attn: Dawn Dearborn

Subj: CONTRACT HSCGG1-15-C-PRV100, REPAIRS TO WEST CHOP HOUSING,  
MARTHA'S VINEYARD, MA

Dear (b) (6)

This letter constitutes notice that, effective **02 December 2015**, the Government considers the subject contract substantially complete and for warranty purposes has accepted all work pursuant to FAR Clause 52.246-12, entitled "Inspection of Construction." This acceptance is final and conclusive except for latent defects, fraud, gross mistakes amounting to fraud, or the Government's rights under any warranty or guarantees. Warranty of work is in effect from **02 December 2015 through 01 December 2016**.

Final payment will be made upon receipt of the final submission of daily reports, certified payrolls, closeout documentation (including O&Ms for the water heater, boiler, & PEX piping), contractor's release (attached), and Tantara's 1 year contractor warranty.

Should you have any questions, please contact me at (508) 968-6499.

Sincerely,

(b) (6)

Contracting Officer  
U.S. Coast Guard

Contractor Acknowledgement:

---

# Environmental Lead Detection

436 Gardners Neck Road, Swansea, MA 02777

Telephone (774) 526-8223

Email: (b) (6)

December 11, 2015

(b) (6)

Project Manager  
TANTARA Corporation  
54 Mason Street  
Worcester, MA 01610

Re: West Chop I and West Chop II  
917 and 921 Main Street  
Tisbury, Massachusetts

Dear (b) (6)

On August 3, 2015, (b) (6) Massachusetts Lead Inspector/Risk Assessor (b) (6) conducted a visual survey of the lead abatement work conducted at 917 Main Street and 921 Main Street, Tisbury, Massachusetts. The properties are known as West Chop I and West Chop II.

The goal of this service was to determine if the work as detailed in the Lead Abatement Work Plan dated May 21, 2015, had been satisfactorily completed. The scope of the work for this project consists of the abatement and disposal, replacement, covering, scraping, and removal of lead-based paint contaminated building components in accordance with the requirements of Federal laws and regulations. Applicable laws and regulations include, but are not limited to, Department of Housing and Urban Development (HUD) *Requirements for Notification, Evaluation and Reduction of Lead-Based Paint Hazards in Federally Owned Residential Property and Housing Receiving Federal Assistance*, also known as the HUD Lead Safe Housing Rule (24 CFR Part 35, subparts B-R).

After a comprehensive examination of the work, it was determined that all surface treatments had been completed as detailed in the Work Plan. Because a final cleanup had not yet been conducted, no post abatement clearance dust wipe samples were taken during this visit.

On October 1, 2015, the inspector returned to the site to conduct post abatement clearance dust wipe sampling. A total of twenty-six dust wipe samples (includes a field blank at each site) were collected, thirteen from each building, in an effort to help to determine the levels of lead-containing dust on the interior window sills and floors. These samples were collected from areas most likely to be lead contaminated if lead-in-dust is present. EPA, HUD and State of Massachusetts regulations define the following as hazardous levels for lead dust in residences: floors –  $\geq 40 \mu\text{g}/\text{ft}^2$  (micrograms per square foot); interior windowsills –  $\geq 250 \mu\text{g}/\text{ft}^2$ ; and, interior window wells –  $\geq 400 \mu\text{g}/\text{ft}^2$ .

917 and 921 Main Street  
Tisbury, Massachusetts  
December 11, 2015

As indicated below, lead dust in quantities greater than EPA, HUD, and Massachusetts standards were detected in each building. Out of 24 samples collected at random locations, three were over the regulatory thresholds. All other testing locations registered lead levels below the EPA, HUD and State of Massachusetts standards. Please refer to *Appendix I- Dust Wipe Analytical Results* for the laboratory reports.

#### 917 Main Street

| Sample No. | Location | Component | Substrate | Sample Size (ft <sup>2</sup> ) | Test Results (µg/ft <sup>2</sup> ) |
|------------|----------|-----------|-----------|--------------------------------|------------------------------------|
| 145281-003 | Rm #2    | Floor     | Wood      | 1.00                           | 94.3                               |

#### 921 Main Street

| Sample No. | Location | Component | Substrate | Sample Size (ft <sup>2</sup> ) | Test Results (µg/ft <sup>2</sup> ) |
|------------|----------|-----------|-----------|--------------------------------|------------------------------------|
| 145280-003 | Kitchen  | Floor     | Wood      | 1.00                           | 40.0                               |
| 145280-005 | Rm #2    | Floor     | Wood      | 1.00                           | 43.5                               |

#### Laboratory Information:

Schneider Laboratories Global  
2512 W. Cary Street  
Richmond, Virginia 23220  
Phone (800) 785-5227

#### Dust Analysis Protocol

EPA Method 7000B, implementing a microwave-assisted digestion process.

National Lead Laboratory Accreditation  
Program Serial number: #100527

On October 27, 2015, the inspector returned to the site to conduct post failure clearance dust wipe sampling. A total of five dust wipe samples (includes a field blank at each site) were collected, one from 917 Main St., and two from 921 Main St. These samples were collected from areas where there were failures in the previous sampling. None of the samples contained lead above the laboratory detection threshold.

In conclusion, these properties are now in what could be characterized as a lead safe condition. In order that this lead safe condition be maintained, surfaces that were covered as an abatement method must remain covered.

Submitted by:

(b) (6)

Massachusetts Lead Inspector/Risk Assessor (b) (6)  
Expires 10/31/16



SLC

## Analysis Report

## Schneider Laboratories Global, Inc

2512 W. Cary Street • Richmond, Virginia • 23220-5117  
804-353-6778 • 800-785-LABS (5227) • Fax 804-359-1475Customer: ENVIRONMENTAL LEAD DETECTION (482)  
Address: 438 Gardners Neck Rd  
Swansea, MA 02777-3105

Order #: 145281

Matrix Wipe  
Received 10/02/15  
Analyzed 10/02/15  
Reported 10/03/15

Attn:

Project:

Location: 917 Main St  
Number: Vineyard Haven

PO Number:

| Sample ID  | Cust. Sample ID | Location          | Sample Date | Area      | Total         | Conc.        | RL*          |
|------------|-----------------|-------------------|-------------|-----------|---------------|--------------|--------------|
| Parameter  |                 | Method            |             |           |               |              |              |
| 145281-001 | 1D              | FL Rm 1           | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 1.00 ft2  | 10.3 µg/wipe  | 10.3 µg/ft2  | 10.0 µg/ft2  |
| 145281-002 | 2D              | SL Rm 1           | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 0.479 ft2 | <10.0 µg/wipe | <20.9 µg/ft2 | 20.9 µg/ft2  |
| 145281-003 | 3D              | FL Rm 2           | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 1.00 ft2  | 94.3 µg/wipe  | 94.3 µg/ft2  | 10.0 µg/ft2  |
| 145281-004 | 4D              | SL Rm 2           | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 0.745 ft2 | <10.0 µg/wipe | <13.4 µg/ft2 | 13.4 µg/ft2  |
| 145281-005 | 5D              | FL Kitchen        | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 1.00 ft2  | 29.5 µg/wipe  | 29.5 µg/ft2  | 10.0 µg/ft2  |
| 145281-006 | 6D              | SL Kitchen        | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 0.888 ft2 | 112 µg/wipe   | 125 µg/ft2   | 14.5 µg/ft2  |
| 145281-007 | 7D              | FL Rm 3           | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 1.00 ft2  | 12.0 µg/wipe  | 12.0 µg/ft2  | 10.0 µg/ft2  |
| 145281-008 | 8D              | SL Rm 3           | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 0.489 ft2 | <10.0 µg/wipe | <21.3 µg/ft2 | 21.3 µg/ft2  |
| 145281-009 | 9D              | FL Rm 4           | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 1.00 ft2  | 12.0 µg/wipe  | 12.0 µg/ft2  | 10.0 µg/ft2  |
| 145281-010 | 10D             | SL Rm 4           | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 0.734 ft2 | <10.0 µg/wipe | <13.6 µg/ft2 | 13.6 µg/ft2  |
| 145281-011 | 11D             | FL Rm 5           | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 1.00 ft2  | <10.0 µg/wipe | <10.0 µg/ft2 | 10.0 µg/ft2  |
| 145281-012 | 12D             | SL Rm 5           | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 0.882 ft2 | <10.0 µg/wipe | <14.7 µg/ft2 | 14.7 µg/ft2  |
| 145281-013 | 13D             | Blank             | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             |           | <10.0 µg/wipe |              | 10.0 µg/wipe |

Minimum Total Reporting Limit: 10.0 µg/wipe. EPA Clearance Std: 40 µg/ft² for floors, 250 µg/ft² for interior window sills, and 400 µg/ft² for window troughs. All internal QC parameters were met. Unusual sample conditions, if any, are described. Surrogate Spike results designated with "D" indicate that the analyte was diluted out. "MI" indicates matrix interference. Concentration and \*Reporting Limit (RL) based on areas provided by client. Values are reported to three significant figures. The test results reported relate only to the samples submitted.



Analysis Report

Schneider Laboratories Global, Inc

2512 W. Cary Street • Richmond, Virginia • 23220-5117  
804-353-6778 • 800-785-LABS (5227) • Fax 804-359-1475

Customer ENVIRONMENTAL LEAD DETECTION (482)  
Address 438 Gardners Neck Rd  
Swansea, MA 02777-3105

Order #: 148536

Matrix Wipe  
Received 10/28/15  
Analyzed 10/28/15  
Reported 10/28/15

Project  
Location 917 Main St  
Number Vineyard Haven

| Sample ID  | Cust. Sample ID | Location          | Sample Date          |               |                          |                         |  |
|------------|-----------------|-------------------|----------------------|---------------|--------------------------|-------------------------|--|
| Parameter  |                 | Method            | Area                 | Total         | Conc.                    | RL*                     |  |
| 148536-001 | 14P             | Rm 2 Fl.          | 10/27/15             |               |                          |                         |  |
| Lead       |                 | EPA 7000B / 3050B | 1.00 ft <sup>2</sup> | <10.0 µg/wipe | <10.0 µg/ft <sup>2</sup> | 10.0 µg/ft <sup>2</sup> |  |
| 148536-002 | 15P             | Blank             | 10/27/15             |               |                          |                         |  |
| Lead       |                 | EPA 7000B / 3050B |                      | <10.0 µg/wipe |                          | 10.0 µg/wipe            |  |

Analys (b) (6)  
148536-10/28/15 03:08 PM

(b) (6)

Metals Supervisor

Minimum Total Reporting Limit: 10.0 µg/wipe. EPA Clearance Std: 40 µg/ft<sup>2</sup> for floors, 250 µg/ft<sup>2</sup> for interior window sills, and 400 µg/ft<sup>2</sup> for window troughs. All internal QC parameters were met. Unusual sample conditions, if any, are described. Surrogate Spike results designated with "D" indicate that the analyte was diluted out. "MI" indicates matrix interference. Concentration and Reporting Limit (RL) based on areas provided by client. Values are reported to three significant figures. The test results reported relate only to the samples submitted.

SLG

## Analysis Report

## Schneider Laboratories Global, Inc

2512 W. Cary Street • Richmond, Virginia • 23220-5117  
804-353-6778 • 800-785-LABS (5227) • Fax 804-359-1475

Customer: ENVIRONMENTAL LEAD DETECTION (482)  
Address: 438 Gardners Neck Rd  
Swansea, MA 02777-3105

Order #: 145280

Attn:

Project:

Location: 921 Main St  
Number: Vineyard Haven

Matrix Wipe  
Received 10/02/15  
Analyzed 10/02/15  
Reported 10/03/15

PO Number:

| Sample ID  | Cust. Sample ID | Location          | Sample Date | Area      | Total         | Conc.        | RL*          |
|------------|-----------------|-------------------|-------------|-----------|---------------|--------------|--------------|
| Parameter  |                 | Method            |             |           |               |              |              |
| 145280-001 | 1D              | FL Rm 1           | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 1.00 ft2  | <10.0 µg/wipe | <10.0 µg/ft2 | 10.0 µg/ft2  |
| 145280-002 | 2D              | SL Rm 1           | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 0.719 ft2 | <10.0 µg/wipe | <13.9 µg/ft2 | 13.9 µg/ft2  |
| 145280-003 | 3D              | FL Kitchen        | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 1.00 ft2  | 40.0 µg/wipe  | 40.0 µg/ft2  | 10.0 µg/ft2  |
| 145280-004 | 4D              | SL Kitchen        | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 0.853 ft2 | <10.0 µg/wipe | <11.7 µg/ft2 | 11.7 µg/ft2  |
| 145280-005 | 5D              | FL Rm 2           | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 1.00 ft2  | 43.5 µg/wipe  | 43.5 µg/ft2  | 10.0 µg/ft2  |
| 145280-006 | 6D              | SL Rm 2           | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 1.03 ft2  | <10.0 µg/wipe | <9.70 µg/ft2 | 9.70 µg/ft2  |
| 145280-007 | 7D              | FL Rm 3           | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 1.00 ft2  | 13.8 µg/wipe  | 13.8 µg/ft2  | 10.0 µg/ft2  |
| 145280-008 | 8D              | SL Rm 3           | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 0.719 ft2 | 29.5 µg/wipe  | 41.1 µg/ft2  | 13.9 µg/ft2  |
| 145280-009 | 9D              | FL Rm 4           | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 1.00 ft2  | 13.8 µg/wipe  | 13.8 µg/ft2  | 10.0 µg/ft2  |
| 145280-010 | 10D             | SL Rm 4           | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 1.03 ft2  | 22.5 µg/wipe  | 21.8 µg/ft2  | 9.70 µg/ft2  |
| 145280-011 | 11D             | FL Rm 5           | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 1.00 ft2  | 20.8 µg/wipe  | 20.8 µg/ft2  | 10.0 µg/ft2  |
| 145280-012 | 12D             | SL Rm 5           | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 1.02 ft2  | 59.3 µg/wipe  | 57.9 µg/ft2  | 9.77 µg/ft2  |
| 145280-013 | 13D             | Blank             | 10/01/15    |           |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             |           | <10.0 µg/wipe |              | 10.0 µg/wipe |

Minimum Total Reporting Limit: 10.0 µg/wipe. EPA Clearance Std: 40 µg/ft² for floors, 250 µg/ft² for interior window sills, and 400 µg/ft² for window troughs. All internal QC parameters were met. Unusual sample conditions, if any, are described. Surrogate Spike results designated with "D" indicate that the analyte was diluted out. "MI" indicates matrix interference. Concentration and "Reporting Limit (RL)" based on areas provided by client. Values are reported to three significant figures. The test results reported relate only to the samples submitted.

SLG

## Analysis Report

## Schneider Laboratories Global, Inc

2512 W. Cary Street • Richmond, Virginia • 23220-5117  
804-353-6778 • 800-785-LABS (5227) • Fax 804-359-1475Customer: ENVIRONMENTAL LEAD DETECTION (482)  
Address: 436 Gardners Neck Rd  
Swansea, MA 02777-3105

Order #: 148537

Matrix Wipe  
Received 10/28/15  
Analyzed 10/28/15  
Reported 10/28/15

## Attn:

## Project:

Location: 921 Main St  
Number: Vineyard Haven

PO Number:

| Sample ID  | Cust. Sample ID | Location          | Sample Date | Area     | Total         | Conc.        | RL*          |
|------------|-----------------|-------------------|-------------|----------|---------------|--------------|--------------|
| Parameter  |                 | Method            |             |          |               |              |              |
| 148537-001 | 14D             | Kitchen FL        | 10/27/15    |          |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 1.00 ft2 | <10.0 µg/wipe | <10.0 µg/ft2 | 10.0 µg/ft2  |
| 148537-002 | 15D             | Rm 2 FL           | 10/27/15    |          |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             | 1.00 ft2 | <10.0 µg/wipe | <10.0 µg/ft2 | 10.0 µg/ft2  |
| 148537-003 | 16D             | Blank             | 10/27/15    |          |               |              |              |
| Lead       |                 | EPA 7000B / 3050B |             |          | <10.0 µg/wipe |              | 10.0 µg/wipe |

Analyst (b)

148537-10/28/15 02:13 PM

(b) (6)

Minimum Total Reporting Limit: 10.0 µg/wipe. EPA Clearance Std: 40 µg/ft² for floors, 250 µg/ft² for interior window sills, and 400 µg/ft² for window troughs. All internal QC parameters were met. Unusual sample conditions, if any, are described. Surrogate Spike results designated with "D" indicate that the analyte was diluted out. "MI" indicates matrix interference. Concentration and \*Reporting Limit (RL) based on areas provided by client. Values are reported to three significant figures. The test results reported relate only to the samples submitted.





Massachusetts Department of Environmental Protection

## **eDEP Transaction Copy**

Here is the file you requested for your records.

To retain a copy of this file you must save and/or print.

Username: (b) (6)

Transaction ID: 750232

Document: AQ04-Asbestos Removal Notification Form ANF-001

Size of File: 100.32K

Status of Transaction: Submitted

Date and Time Created: 11/27/2015:9:36:17 AM

**Note:** This file only includes forms that were part of your transaction as of the date and time indicated above. If you need a more current copy of your transaction, return to eDEP and select to "Download a Copy" from the Current Submittals page.



Massachusetts Department of Environmental Protection  
Bureau of Waste Prevention • Air Quality

## **BWP ANF-001 Pre-Form**

Notification Prior to Construction or Demolition

---

- ☐ This is a revision to an existing form.  
Project ID for existing form to be revised: \_\_\_\_\_
- ☐ This job is being conducted under a Blanket Permit  
MassDEP assigned Blanket Authorization ID: \_\_\_\_\_
- ☐ This job is being conducted under a Non Traditional Abatement Work Practice Permit.  
MassDEP assigned Non Traditional Work Practice Authorization ID: \_\_\_\_\_
- ☐ I am a non-licensed contractor removing or disturbing non-friable shingles only.
- ☒ None of the above conditions apply, generate a new form



Commonwealth of Massachusetts  
**Asbestos Notification Form ANF-001**

100222701

Asbestos Project #

☐ Project Revision

☐ Project Cancellation

**A. Asbestos Abatement Description**

**1. Facility Location:**

USCG WEST CHOP HOUSING UNITS

917 & 921 MAIN ST

Name of Facility

Street Address

TISBURY

02568

MA

(b) (6)

City/Town

State

Zip Code

Telephone

(b) (6)

(b) (6)

Facility Contact Person Name

Facility Contact Person Title

Worksite Location:

UNITS 917 AND 921

Building Name, Wing, Floor, Room, etc.

Instructions 1. All sections of this form must be completed in order to comply with MassDEP notification requirements of 310 CMR 7.15 and Department of Labor Standards (DLS) notification requirements of 453 CMR 6.12

MassDEP Use Only

Date Received

2. Is the facility occupied? ☐ Yes ☒ No

3. Is this a fee exempt notification (city, town, district, municipal housing authority, state facility, or owner-occupied residential property of four units or less)? ☐ Yes ☒ No

4. Blanket Permit Project Approval, if applicable:

Approval ID #

5. Non-Traditional Asbestos Abatement Work Practice Approval, if applicable:

Approval ID #

2. Submit Original Form To:  
Commonwealth of Massachusetts  
P.O. Box 4062  
Boston, MA 02211

**6. Asbestos Contractor:**

TANTARA CORPORATION

54 MASON ST

Name

Address

WORCESTER

MA

01610

5087525599

City/Town

State

Zip Code

Telephone

(b) (6)

Contract Type: ☒ Written ☐ Verbal

DLS License #

7. (b) (6)

Name of Contractor's On-Site Supervisor/Foreman

DLS Certification #

8. (b) (6)

Name of Project Monitor

DLS Certification #

9. FLU ENVIRONMENTAL INC

(b) (6)

Name of Asbestos Analytical Lab

DLS Certification #

10. 6/30/2015

7/31/2015

Project Start Date (MM/DD/YYYY)

End Date (MM/DD/YYYY)

0700-1600

0700-1600

Work Hours - Monday Through Friday

Work Hours - Saturday & Sunday

11. What type of project is this?

☐ Demolition ☒ Renovation ☐ Repair ☐ Other - Please Specify: \_\_\_\_\_



Commonwealth of Massachusetts  
**Asbestos Notification Form ANF-001**

100222701

Asbestos Project #

☐ Project Revision

☐ Project Cancellation

**A. Asbestos Abatement Description: (cont.)**

**12. Abatement procedures (check all that apply)**

☐ Glove Bag ☐ Encapsulation ☐ Enclosure ☒ Disposal Only ☐ Cleanup ☐ Full Containment

☐ Other - Please Specify: \_\_\_\_\_

**13. Job is being conducted:** ☒ Indoors ☐ Outdoors

**14. Total amount of each type of asbestos Containing materials (ACM) to be removed, enclosed, or encapsulated**

| Linear Feet (Lin Ft)     | 220          | Square Feet (Sq Ft)         |
|--------------------------|--------------|-----------------------------|
| Boiler, Breaching, Duct, |              | Transite Pipe               |
| Tank Surface Coatings    | Lin Ft Sq Ft | Lin Ft Sq Ft                |
| Pipe Insulation          | Lin Ft Sq Ft | Transite Shingles           |
|                          |              | Lin Ft Sq Ft                |
| Spray-On Fireproofing    | Lin Ft Sq Ft | Transite Panels             |
|                          |              | Lin Ft Sq Ft                |
| Cloths, Woven Fabrics    | Lin Ft Sq Ft | Other - Please Specify:     |
|                          |              |                             |
| Insulating Cement        | Lin Ft Sq Ft | JOINT COMPOUND & FLOOR TILE |
|                          |              | 220                         |
|                          |              | Lin Ft Sq Ft                |

**15. Describe the decontamination system(s) to be used:**

THREE STAGE PERSONAL DECONTAMINATION UNIT

**16. Describe the containerization/disposal methods to comply with 310 CMR 7.15 and 453 CMR 6.14(2)(g)**

ACM WILL BE WETTED AND DOUBLE BAGGED

**17. For Emergency Asbestos Operations, the MassDEP and DLS officials who evaluated the emergency:**

Name of MassDEP Official

Title of MassDEP Official

Date of Authorization (MM/DD/YYYY)

Waiver #

Name of DLS Official

Title of DLS Official

Date of Authorization (MM/DD/YYYY)

Waiver #

**18. Do prevailing wage rates as per M.G.L. c. 149, § 26, 27 or 27A-F apply to this project?** ☒ Yes ☐ No





Commonwealth of Massachusetts  
**Asbestos Notification Form ANF-001**

100222701

Asbestos Project #

☐ Project Revision

☐ Project Cancellation

## B. Facility Description

1. Current or prior use of facility: RESIDENCE

2. Is the facility owner-occupied residential with 4 units or less?

☐ Yes

☒ No

3. US COAST GUARD

475 KILVERT STREET, SUITE 100

Facility Owner Name

Address

WARWICK

RI

02886

(b) (6)

City/Town

State

Zip Code

Telephone

(b) (6)

475 KILVERT STREET, SUITE 100

Name of Facility Owner's On-Site Manager

Address

WARWICK

RI

02886

(b) (6)

City/Town

State

Zip Code

Telephone

5. TANTARA CORPORATION

54 MASON STREET

Name of General Contractor

Address

WORCESTER

MA

01610

5087525599

City/Town

State

Zip Code

Telephone

AIM MUTUAL INSURANCE

Contractor's Worker's Compensation Insurer

(b) (6)

5/1/2016

Policy #

Expiration Date (MM/DD/YYYY)

6. What is the size of this facility?

4000

2

Square Feet

# of Floors

## C. Asbestos Transportation & Disposal

1. Transporter of asbestos-containing waste material from site of generation:

☐ Directly to Landfill or

☒ To Temporary Storage Location/Transfer Station

STG, INC

58 PYLES LANE

Name of Transporter

Address

NEW CASTLE

DE

19720

8779889559

City/Town

State

Zip Code

Telephone

2. If a temporary storage location/transfer station is used, list name of transporter of asbestos containing waste material from temporary storage location/transfer station to final disposal site:

STG, INC

379 PRINGLE STREET

Name of Transporter

Address

WOONSOCKET

RI

02122

3024461900

City/Town

State

Zip Code

Telephone

Note: Temporary storage of Asbestos containing waste material is only allowed at the place of business of a DLS licensed Asbestos contractor or a transfer station that is permitted by MassDEP and operated in compliance with Solid Waste Regulations 310 CMR 19.000



Commonwealth of Massachusetts  
**Asbestos Notification Form ANF-001**

100222701

Asbestos Project #

☐ Project Revision

☐ Project Cancellation

Notification purposes

**C. Asbestos Transportation & Disposal: (cont.)**

3. Name and address of temporary storage location/transfer station for the asbestos containing waste material:

|                                 |                          |
|---------------------------------|--------------------------|
| STG, INC                        | 379 PRIVLEDGE STREET     |
| Temporary Storage Location Name | Address                  |
| WOONSOCKET                      | RI 02122 3024461900      |
| City/Town                       | State Zip Code Telephone |

4. Name and location of final disposal site (asbestos landfill):

|                          |                                |
|--------------------------|--------------------------------|
| MINERVA LANDFILL         | MINERVA ENTERPRISES            |
| Final Disposal Site Name | Final Disposal Site Owner Name |
| 8955 MINERVA ROAD        |                                |
| Address                  |                                |
| WAYNESBURG               | OH 44688 3308663435            |
| City/Town                | State Zip Code Telephone       |

**D. Certification**

"I certify that I have personally examined the foregoing and am familiar with the information contained in this document and all attachments and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including possible fines and imprisonment. The undersigned hereby states that I have read the Commonwealth of Massachusetts regulations governing asbestos abatement (453 CMR 6.00 promulgated by the Department of Labor Standards and 310 CMR 7.15 promulgated by the Department of Environmental Protection), and that I am aware that this permit application or notification shall not be deemed valid unless payment of the applicable fee is made."

(b) (6)

|                 |                      |
|-----------------|----------------------|
| Name            | Authorized Signature |
| PRESIDENT       | 6/16/2015            |
| Position/Title  | Date (MM/DD/YYYY)    |
| (b) (6)         | 061515               |
| Telephone       | Representing         |
| 54 MASON STREET | WORCESTER            |
| Address         | City/Town            |
| MA              | 01610                |
| State           | Zip Code             |



Massachusetts Department of Environmental Protection

## **eDEP Transaction Copy**

Here is the file you requested for your records.

To retain a copy of this file you must save and/or print.

Username: (b) (6)

Transaction ID: 776849

Document: AQ04-Asbestos Removal Notification Form ANF-001

Size of File: 57.32K

Status of Transaction: Submitted

Date and Time Created: 11/27/2015:9:28:17 AM

**Note:** This file only includes forms that were part of your transaction as of the date and time indicated above. If you need a more current copy of your transaction, return to eDEP and select to "Download a Copy" from the Current Submittals page.



Massachusetts Department of Environmental Protection  
Bureau of Waste Prevention • Air Quality

## **BWP ANF-001 Pre-Form**

Notification Prior to Construction or Demolition

☒ This is a revision to an existing form.

Project ID for existing form to be revised: 100227497

☐ This job is being conducted under a Blanket Permit

MassDEP assigned Blanket Authorization ID: \_\_\_\_\_


☐ This job is being conducted under a Non Traditional Abatement Work Practice Permit.

MassDEP assigned Non Traditional Work Practice Authorization ID: \_\_\_\_\_

☐ I am a non-licensed contractor removing or disturbing non-friable shingles only.

☐ None of the above conditions apply, generate a new form





Commonwealth of Massachusetts  
**Asbestos Notification Form ANF-001**  
Project Revision Notification

100227497R1

Asbestos Project #

☒ Project Revision

☐ Project Cancellation

### A. Asbestos Abatement Description

1. Facility Location:

USCG WEST CHOP HOUSING UNITS

917 & 921 MAIN STREET

Name of Facility

Street Address

TISBURY

MA

02568

(b) (6)

City/Town

State

Zip Code

Telephone

(b) (6)

Facility Contact Person Name

Facility Contact Person Title

Worksite Location:

UNITS 917 & 921

Building Name, Wing, Floor, Room, etc

2. Blanket Permit Project Approval, if applicable:

Approval ID #

3. Non-Traditional Asbestos Abatement Work Practice Approval, if applicable:

Approval ID #

Instructions 1. All sections of this form must be completed in order to comply with MassDEP notification requirements of 310 CMR 7.15 and Department of Labor Standards (DLS) notification requirements of 453 CMR 6.12

MassDEP Use Only

9/9/2015

10/30/2015

Date Received

Project Start Date (MM/DD/YYYY)

End Date (MM/DD/YYYY)

0700-1600

0700-1600

Work Hours - Monday Through Friday

Work Hours - Saturday & Sunday

2. Submit Original Form To:  
Commonwealth of Massachusetts  
P.O. Box 4062  
Boston, MA 02211

### B. Other Project Revisions:

Note: Temporary storage of Asbestos containing waste material is only allowed at the place of business of a DLS licensed Asbestos contractor or a transfer station that is permitted by MassDEP and operated in compliance with Solid Waste Regulations 310 CMR 19.000



Commonwealth of Massachusetts  
**Asbestos Notification Form ANF-001**  
Project Revision Notification

100227497R1

Asbestos Project #

☒ Project Revision

☐ Project Cancellation

Note: Contractor must  
sign this form for DLS  
notification purposes

### C. Certification

"I certify that I have personally examined the foregoing and am familiar with the information contained in this document and all attachments and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including possible fines and imprisonment. The undersigned hereby states that I have read the Commonwealth of Massachusetts regulations governing asbestos abatement (453 CMR 6.00 promulgated by the Department of Labor Standards and 310 CMR 7.15 promulgated by the Department of Environmental Protection), and that I am aware that this permit application or notification shall not be deemed valid unless payment of the applicable fee is made."

(b) (6)

Name  
PRESIDENT

Position/Title

(b) (6)

Telephone  
54 MASON STREET

Address  
MA

State

Authorized Signature  
9/24/2015

Date (MM/DD/YYYY)

Representing  
WORCESTER

City/Town  
01610

Zip Code

**CONTRACT ITEM REVIEW REQUEST**  
DEPARTMENT OF HOMELAND SECURITY  
U.S. COAST GUARD  
CIVIL ENGINEERING UNIT PROVIDENCE

|                                       |                                                           |                                    |                    |
|---------------------------------------|-----------------------------------------------------------|------------------------------------|--------------------|
| CONTRACT NUMBER<br>HSCGG1-15-C-PRV100 | PROJECT TITLE:<br>Repair West Chop hsg, Martha's Vineyard | LOCATION:<br>Martha's Vineyard, MA | DATE:<br>27-Nov-15 |
|---------------------------------------|-----------------------------------------------------------|------------------------------------|--------------------|

|                                                                                                         |                                         |                                 |
|---------------------------------------------------------------------------------------------------------|-----------------------------------------|---------------------------------|
| SUBMITTAL NUMBER:<br>08<br><input checked="" type="checkbox"/> NEW <input type="checkbox"/> RESUBMITTAL | CONTRACTOR:<br>Tantara Associates Corp. | SUBMITTED BY (NAME):<br>(b) (6) |
|---------------------------------------------------------------------------------------------------------|-----------------------------------------|---------------------------------|

| ITEM NO | SPECIFICATION SECTION AND PARAGRAPH NO. | DESCRIPTION OF MATERIAL<br>(include Type, Model Number, Catalog Number, Mfg. Etc.) | FOR GOVERNMENT USE ONLY             |                          |                          |         |
|---------|-----------------------------------------|------------------------------------------------------------------------------------|-------------------------------------|--------------------------|--------------------------|---------|
|         |                                         |                                                                                    | APPROVED                            | REJECTED                 | SEE BELOW                | INITIAL |
| 1       |                                         | ACM Abatement Documentation                                                        | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | PLN     |
| 2       |                                         |                                                                                    | <input type="checkbox"/>            | <input type="checkbox"/> | <input type="checkbox"/> |         |
| 3       |                                         |                                                                                    | <input type="checkbox"/>            | <input type="checkbox"/> | <input type="checkbox"/> |         |
| 4       |                                         |                                                                                    | <input type="checkbox"/>            | <input type="checkbox"/> | <input type="checkbox"/> |         |
| 5       |                                         |                                                                                    | <input type="checkbox"/>            | <input type="checkbox"/> | <input type="checkbox"/> |         |
|         |                                         |                                                                                    | <input type="checkbox"/>            | <input type="checkbox"/> | <input type="checkbox"/> |         |

**COMMENTS:**

The attached submittal includes documentation of the ACM abatement successfully performed on two separate activities:

- 1) July 2015 - The joint compound in middle bedroom in 917 Main and the floor tiles in the closet of the child's bedroom in 921 Main.
- 2) October 2015 - Pipe insulation in the exterior crawlspace of 921 Main.

The documentation includes:

- Description of confirmed asbestos containing material based on H&S's 2012 hazardous building materials inspection, taken from the October 2012 inspection report, for the joint compound and floor tiles.
- Copy of the MassDEP notification forms, ANF-001.
- Results of asbestos clearance sampling performed by FLI Environmental.
- ACM disposal documentation.

**NOTE:** Review of submittals by the Government is intended to verify general conformance with the design intent as shown on the contract drawings and in the specifications. Review by the Contracting Officer's Representative (COR) does not relieve the Contractor of responsibility for any errors and/or omissions in the submittals, nor from the responsibility for complying with the requirements of the contract, except with respect to variations described and approved in accordance with FAR 52.243-4 CHANGES.

**\*\*FOR GOVERNMENT USE ONLY\*\***

**DESIGN ENGINEER (IF APPLICABLE)**

TO: COR

REVIEWED, RECOMMEND PROCESSING AS INDICATED ABOVE AND SUBJECT TO ANY APPLICABLE COMMENTS ABOVE.

|                    |                      |      |
|--------------------|----------------------|------|
| TYPED NAME & TITLE | SIGNATURE (INITIALS) | DATE |
|--------------------|----------------------|------|

**CONSTRUCTION PROJECT MANAGER (COR)**

TO: CONTRACTOR

1. REVIEWED OR REJECTED AS INDICATED ABOVE AND SUBJECT TO ANY APPLICABLE COMMENTS ABOVE.
2. REQUEST PROMPT RESUBMITTAL ON REJECTED ITEMS.

|                       |                             |                  |
|-----------------------|-----------------------------|------------------|
| TYPED NAME<br>(b) (6) | SIGNATURE<br>(b) (6)<br>PLN | DATE<br>12-23-15 |
|-----------------------|-----------------------------|------------------|

NOTE: Copy Contracting Officer, COR, and Government Inspector on all submittals.

### 3.2.6 ACM Inspection Findings and Recommendations

A total of two (2) building materials from the HBM inspection of the Site were confirmed for the presence of Asbestos. The materials confirmed to contain asbestos in the inspected areas and are summarized as follows:

#### Confirmed Asbestos Containing Material, 921 Main Street, Vineyard Haven, MA

| Sample Number | Material Location                                   | Quantity | Analysis Results |
|---------------|-----------------------------------------------------|----------|------------------|
| 092012-09-09A | Red Brick Patter Flooring Closet in Child's Bedroom | 20 SF    | 2% Chrysotile    |

#### Confirmed Asbestos Containing Material, 917 Main Street, Vineyard Haven, MA

| Sample Number | Material Location                                           | Quantity | Analysis Results |
|---------------|-------------------------------------------------------------|----------|------------------|
| 092012-09-15A | Joint Compound Second Floor Middle Bedroom at Utility Hatch | 200 SF   | 2% Chrysotile    |

The following building materials were identified and sampled and have been classified as Non ACMs in the inspected areas and are summarized as follows:

#### Confirmed Non-Asbestos Containing Material, 917 E. Main Street, Vineyard Haven, MA

| LOCATION                             | MATERIAL               |
|--------------------------------------|------------------------|
| Wall Coating on Fieldstone Wall      | Basement Walls         |
| Wall Coating on Fieldstone Wall      | Basement Walls         |
| Wall Coating on Fieldstone Wall      | Basement Walls         |
| Wall and Ceiling Plaster             | Basement Stairwell     |
| Wall and Ceiling Plaster             | Basement Stairwell     |
| Wall and Ceiling Plaster             | Basement Stairwell     |
| Wall and Ceiling Plaster             | Crawl Space in Bedroom |
| Wall and Ceiling Plaster             | Crawl Space in Bedroom |
| Mastic Paper on White Floor Sheeting | Kitchen                |
| Mastic Paper on White Floor Sheeting | Entryway At Radiator   |



**EMSL Analytical, Inc.**

200 Route 130 North, Cinnaminson, NJ 08077

Phone/Fax: (856) 303-2500 / (856) 786-5974

<http://www.EMSL.com>

(b) (6)

EMSL Order: 201809481  
CustomerID: USCG30  
CustomerPO: 372018346672  
ProjectID:

Attn: (b) (6)

**US Coast Guard Maintenance & Logistics  
Command Atlantic  
300 E. Main Street, Suite 1000  
Norfolk, VA 23510-9104**

Phone: (757) 628-4410  
Fax: (757) 628-4418  
Received: 08/24/18 10:30 AM  
Collected: 8/22/2018

Project: 917 Main, Wipes

**Test Report: Lead in Dust by Flame AAS (SW 846 3050B/7000B)\***

| <i>Client Sample Description</i>                           | <i>Lab ID</i>  | <i>Collected</i> | <i>Analyzed</i> | <i>Area Sampled</i> | <i>Lead Concentration</i> |
|------------------------------------------------------------|----------------|------------------|-----------------|---------------------|---------------------------|
| 917 Main W-01<br>Site: Upstairs Bathroom; Vinyl            | 201809481-0001 | 8/22/2018        | 8/27/2018       | 1 ft <sup>2</sup>   | <10 µg/ft <sup>2</sup>    |
| 917 Main W-02<br>Site: Girl Bathroom; Hardwood             | 201809481-0002 | 8/22/2018        | 8/27/2018       | 1 ft <sup>2</sup>   | <10 µg/ft <sup>2</sup>    |
| 917 Main W-03<br>Site: Boy Bathroom; Hardwood              | 201809481-0003 | 8/22/2018        | 8/27/2018       | 1 ft <sup>2</sup>   | <10 µg/ft <sup>2</sup>    |
| 917 Main W-04<br>Site: Master Bedroom, Hardwood, 1st Floor | 201809481-0004 | 8/22/2018        | 8/27/2018       | 1 ft <sup>2</sup>   | <10 µg/ft <sup>2</sup>    |
| 917 Main W-05<br>Site: Bottom of Stairs; Vinyl             | 201809481-0005 | 8/22/2018        | 8/27/2018       | 1 ft <sup>2</sup>   | <10 µg/ft <sup>2</sup>    |
| 917 Main W-06<br>Site: 1st Floor Living Room, Vinyl        | 201809481-0006 | 8/22/2018        | 8/27/2018       | 1 ft <sup>2</sup>   | <10 µg/ft <sup>2</sup>    |
| 917 Main W-07<br>Site: Kitchen by the Front Door; Vinyl    | 201809481-0007 | 8/22/2018        | 8/27/2018       | 1 ft <sup>2</sup>   | <10 µg/ft <sup>2</sup>    |
| 917 Main W-08<br>Site: Den Off Kitchen; Hardwood           | 201809481-0008 | 8/22/2018        | 8/27/2018       | 1 ft <sup>2</sup>   | <10 µg/ft <sup>2</sup>    |
| 917 Main W-09<br>Site: 1st Floor Bathroom; Vinyl           | 201809481-0009 | 8/22/2018        | 8/27/2018       | 1 ft <sup>2</sup>   | <10 µg/ft <sup>2</sup>    |
| 917 Main W-10<br>Site: Basement                            | 201809481-0010 | 8/22/2018        | 8/27/2018       | 1 ft <sup>2</sup>   | 2200 µg/ft <sup>2</sup>   |

(b) (6)

or other approved signatory

\*Analysis following Lead in Dust by EMSL SOP/ Determination of Environmental Lead by FLAA. Reporting limit is 10 µg/wipe. ug/wipe =µg/ft<sup>2</sup> x area sampled in ft<sup>2</sup>. Unless noted, results in this report are not blank corrected. This report relates only to the samples reported above and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities (such as volume sampled) or analytical method limitations. Samples received in good condition unless otherwise noted. The lab is not responsible for data reported in µg/ft<sup>2</sup> which is dependent on the area provided by non-lab personnel. The test results contained within this report meet the requirements of NELAC unless otherwise noted. "<" (less than) results signifies that the analyte was not detected at or above the reporting limit. Measurement of uncertainty is available upon request. The QC data associated with the sample results included in this report meet the recovery and precision requirements unless specifically indicated otherwise. Definitions of modifications are available upon request.

Samples analyzed by EMSL Analytical, Inc. Cinnaminson, NJ NELAP Certifications: NJ 03036, NY 10872, PA 68-00367, AIHA-LAP, LLC ELLAP 100194, A2LA 2845.01

Initial report from 08/28/2018 10:11:35

**EMSL Analytical, Inc.**

200 Route 130 North, Cinnaminson, NJ 08077

Phone/Fax: (856) 303-2500 / (856) 786-5974

<http://www.EMSL.com>

EMSL Order: 201809482  
CustomerID: USCG30  
CustomerPO: 372618346672  
ProjectID:

Attn: (b) (6)

**US Coast Guard Maintenance & Logistics  
Command Atlantic  
300 E. Main Street, Suite 1000  
Norfolk, VA 23510-9104**

Phone: (757) 628-4410  
Fax: (757) 628-4418  
Received: 08/24/18 10:30 AM  
Collected: 8/22/2018

Project: 921 Main, Wipes

**Test Report: Lead in Dust by Flame AAS (SW 846 3050B/7000B)\***

| Client Sample Description                              | Lab ID         | Collected | Analyzed  | Area Sampled      | Lead Concentration     |
|--------------------------------------------------------|----------------|-----------|-----------|-------------------|------------------------|
| 921 Main W-01                                          | 201809482-0001 | 8/22/2018 | 8/27/2018 | 1 ft <sup>2</sup> | 14 µg/ft <sup>2</sup>  |
| Site: Upstairs Bathroom in Front of Sink - Tile Floor  |                |           |           |                   |                        |
| 921 Main W-02                                          | 201809482-0002 | 8/22/2018 | 8/27/2018 | 1 ft <sup>2</sup> | 66 µg/ft <sup>2</sup>  |
| Site: Crib Room Toy Chest Bottom Inside                |                |           |           |                   |                        |
| 921 Main W-03                                          | 201809482-0003 | 8/22/2018 | 8/27/2018 | 1 ft              | <10 µg/wipe            |
| Site: Crib Room Behind Door, Floor, Hardwood Floor     |                |           |           |                   |                        |
| 921 Main W-04                                          | 201809482-0004 | 8/22/2018 | 8/27/2018 | 1 ft <sup>2</sup> | 18 µg/ft <sup>2</sup>  |
| Site: Bunkbed Room, Plastic Tub, Bottom of Lego Bucket |                |           |           |                   |                        |
| 921 Main W-05                                          | 201809482-0005 | 8/22/2018 | 8/27/2018 | 1 ft <sup>2</sup> | <10 µg/ft <sup>2</sup> |
| Site: Bunkbed, Under Bed Hardwood Floor                |                |           |           |                   |                        |
| 921 Main W-06                                          | 201809482-0006 | 8/22/2018 | 8/27/2018 | 1 ft <sup>2</sup> | 11 µg/ft <sup>2</sup>  |
| Site: Bunkbed, Behind Door, Hardwood Floor             |                |           |           |                   |                        |
| 921 Main W-07                                          | 201809482-0007 | 8/22/2018 | 8/27/2018 | 1 ft <sup>2</sup> | <10 µg/ft <sup>2</sup> |
| Site: Master Bedroom, Closet Hardwood Floor            |                |           |           |                   |                        |
| 921 Main W-08                                          | 201809482-0008 | 8/22/2018 | 8/27/2018 | 1 ft <sup>2</sup> | <10 µg/ft <sup>2</sup> |
| Site: Upstairs Closet at Top of Stairs, Hardwood Floor |                |           |           |                   |                        |
| 921 Main W-09                                          | 201809482-0009 | 8/22/2018 | 8/27/2018 | 1 ft <sup>2</sup> | 23 µg/ft <sup>2</sup>  |
| Site: Staircase Midway; Wood Stairs w/ Maroon Paint    |                |           |           |                   |                        |
| 921 Main W-10                                          | 201809482-0010 | 8/22/2018 | 8/27/2018 | 1 ft <sup>2</sup> | 11 µg/ft <sup>2</sup>  |
| Site: Base of Stairs 1st Floor; Linoleum Floor         |                |           |           |                   |                        |
| 921 Main W-11                                          | 201809482-0011 | 8/22/2018 | 8/27/2018 | 1 ft <sup>2</sup> | <10 µg/ft <sup>2</sup> |
| Site: Den 1st Floor; Hardwood Floor                    |                |           |           |                   |                        |
| 921 Main W-12                                          | 201809482-0012 | 8/22/2018 | 8/27/2018 | 1 ft <sup>2</sup> | <10 µg/ft <sup>2</sup> |
| Site: First Floor Bathroom Tile Floor                  |                |           |           |                   |                        |
| 921 Main W-13                                          | 201809482-0013 | 8/22/2018 | 8/27/2018 | 1 ft <sup>2</sup> | 17 µg/ft <sup>2</sup>  |
| Site: Living Room Couch; Leather                       |                |           |           |                   |                        |
| 921 Main W-14                                          | 201809482-0014 | 8/22/2018 | 8/27/2018 | 1 ft <sup>2</sup> | <10 µg/ft <sup>2</sup> |
| Site: Living Room Coffee Table, Wood                   |                |           |           |                   |                        |
| 921 Main W-15                                          | 201809482-0015 | 8/22/2018 | 8/27/2018 | 1 ft <sup>2</sup> | 11 µg/ft <sup>2</sup>  |
| Site: Living Room Floor, Hardwood                      |                |           |           |                   |                        |

(b) (6)

or other approved signatory

\*Analysis following Lead in Dust by EMSL SOP/ Determination of Environmental Lead by FLAA. Reporting limit is 10 µg/wipe. ug/wipe = µg/ft<sup>2</sup> x area sampled in ft<sup>2</sup>. Unless noted, results in this report are not blank corrected. This report relates only to the samples reported above and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities (such as volume sampled) or analytical method limitations. Samples received in good condition unless otherwise noted. The lab is not responsible for data reported in µg/ft<sup>2</sup> which is dependent on the area provided by non-lab personnel. The test results contained within this report meet the requirements of NELAP unless otherwise noted. "<" (less than) results signifies that the analyte was not detected at or above the reporting limit. Measurement of uncertainty is available upon request. The QC data associated with the sample results included in this report meet the recovery and precision requirements unless specifically indicated otherwise. Definitions of modifications are available upon request.

Samples analyzed by EMSL Analytical, Inc. Cinnaminson, NJ NELAP Certifications: NJ 03036, NY 10872, PA 68-00367, AIHA-LAP, LLC ELLAP 100194, A2LA 2845 01

Initial report from 08/28/2018 10:55:40

**EMSL Analytical, Inc.**

200 Route 130 North, Cinnaminson, NJ 08077

Phone/Fax: (856) 303-2500 / (856) 786-5974

<http://www.EMSL.com>

EMSL Order: 201809482  
CustomerID: USCG30  
CustomerPO: 372618346672  
ProjectID:

Attn: (b) (6)

**US Coast Guard Maintenance & Logistics  
Command Atlantic  
300 E. Main Street, Suite 1000  
Norfolk, VA 23510-9104**

Phone: (757) 628-4410  
Fax: (757) 628-4418  
Received: 08/24/18 10:30 AM  
Collected: 8/22/2018

Project: 921 Main, Wipes

**Test Report: Lead in Dust by Flame AAS (SW 846 3050B/7000B)\***

| Client Sample Description                            | Lab ID         | Collected | Analyzed  | Area Sampled      | Lead Concentration      |
|------------------------------------------------------|----------------|-----------|-----------|-------------------|-------------------------|
| 921 Main W-16                                        | 201809482-0016 | 8/22/2018 | 8/27/2018 | 1 ft <sup>2</sup> | <10 µg/ft <sup>2</sup>  |
| Site: Kitchen Baby High Chair Tray, Plastic & Fabric |                |           |           |                   |                         |
| 921 Main W-17                                        | 201809482-0017 | 8/22/2018 | 8/27/2018 | 1 ft <sup>2</sup> | 13 µg/ft <sup>2</sup>   |
| Site: Kitchen Floor, Tile Vinyl                      |                |           |           |                   |                         |
| 921 Main W-18                                        | 201809482-0018 | 8/22/2018 | 8/27/2018 | 1 ft <sup>2</sup> | 13 µg/ft <sup>2</sup>   |
| Site: Inside Front Door, Mud Room Vinyl Floor        |                |           |           |                   |                         |
| 921 Main W-19                                        | 201809482-0019 | 8/22/2018 | 8/27/2018 | 1 ft <sup>2</sup> | 13 µg/ft <sup>2</sup>   |
| Site: Laundry Room, Vinyl Floor                      |                |           |           |                   |                         |
| 921 Main W-20                                        | 201809482-0020 | 8/22/2018 | 8/27/2018 | 1 ft <sup>2</sup> | 2000 µg/ft <sup>2</sup> |
| Site: Basement, Concrete                             |                |           |           |                   |                         |

(b) (6)

or other approved signatory

\*Analysis following Lead in Dust by EMSL SOP/ Determination of Environmental Lead by FLAA. Reporting limit is 10 µg/wipe. ug/wipe = µg/ft<sup>2</sup> \* area sampled in ft<sup>2</sup>. Unless noted, results in this report are not blank corrected. This report relates only to the samples reported above and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities (such as volume sampled) or analytical method limitations. Samples received in good condition unless otherwise noted. The lab is not responsible for data reported in µg/ft<sup>2</sup> which is dependent on the area provided by non-lab personnel. The test results contained within this report meet the requirements of NELAP unless otherwise noted. "<" (less than) results signifies that the analyte was not detected at or above the reporting limit. Measurement of uncertainty is available upon request. The QC data associated with the sample results included in this report meet the recovery and precision requirements unless specifically indicated otherwise. Definitions of modifications are available upon request.

Samples analyzed by EMSL Analytical, Inc. Cinnaminson, NJ NELAP Certifications: NJ 03036, NY 10872, PA 68-00367, AIHA-LAP, LLC ELLAP 100194, A2LA 2845.01

Initial report from 08/28/2018 10:55:40

**EMSL Analytical, Inc.**

200 Route 130 North, Cinnaminson, NJ 08077  
Phone/Fax: (856) 303-2500 / (856) 786-5974  
<http://www.EMSL.com>

EMSL Order: 201809479  
CustomerID: USCG30  
CustomerPO: 372018346672  
ProjectID:

Attn: (b) (6)

**US Coast Guard Maintenance & Logistics  
Command Atlantic  
300 E. Main Street, Suite 1000  
Norfolk, VA 23510-9104**

Phone: (757) 628-4410  
Fax: (757) 628-4418  
Received: 08/24/18 10:30 AM  
Collected: 8/22/2018

Project: West Chop Wipes

**Test Report: Lead in Dust by Flame AAS (SW 846 3050B/7000B)\***

| Client Sample Description                            | Lab ID         | Collected | Analyzed  | Area Sampled      | Lead Concentration     |
|------------------------------------------------------|----------------|-----------|-----------|-------------------|------------------------|
| WC-01                                                | 201809479-0001 | 8/22/2018 | 8/27/2018 | 1 ft <sup>2</sup> | 570 µg/ft <sup>2</sup> |
| Site: Concrete Floor Red Paint by Water Facing Door  |                |           |           |                   |                        |
| WC-02                                                | 201809479-0002 | 8/22/2018 | 8/27/2018 | 1 ft <sup>2</sup> | 460 µg/ft <sup>2</sup> |
| Site: Concrete Floor, Gray Paint, Street Facing Door |                |           |           |                   |                        |
| WC-03                                                | 201809479-0003 | 8/22/2018 | 8/27/2018 | 1 ft <sup>2</sup> | 550 µg/ft <sup>2</sup> |
| Site: Concrete Floor, Grey / Red Paint Side Room     |                |           |           |                   |                        |
| WC-04                                                | 201809479-0004 | 8/22/2018 | 8/27/2018 | 1 ft <sup>2</sup> | 94 µg/ft <sup>2</sup>  |
| Site: Quad Bike Seat Black Leather                   |                |           |           |                   |                        |
| WC-05                                                | 201809479-0005 | 8/22/2018 | 8/27/2018 | 1 ft <sup>2</sup> | 100 µg/ft <sup>2</sup> |
| Site: Canoe in Shed; Red Plastic                     |                |           |           |                   |                        |
| WC-06                                                | 201809479-0006 | 8/22/2018 | 8/27/2018 | 1 ft <sup>2</sup> | <10 µg/ft <sup>2</sup> |
| Site: Love Seat Swing; Wood                          |                |           |           |                   |                        |
| WC-07                                                | 201809479-0007 | 8/22/2018 | 8/27/2018 | 1 ft <sup>2</sup> | 110 µg/ft <sup>2</sup> |
| Site: Kid Sand Toy; Plastic                          |                |           |           |                   |                        |
| WC-08                                                | 201809479-0008 | 8/22/2018 | 8/27/2018 | 1 ft <sup>2</sup> | 22 µg/ft <sup>2</sup>  |
| Site: Grill, Metal, Black                            |                |           |           |                   |                        |
| WC-09                                                | 201809479-0009 | 8/22/2018 | 8/27/2018 | 1 ft <sup>2</sup> | <10 µg/ft <sup>2</sup> |
| Site: Kids Bike Red & Black Paint                    |                |           |           |                   |                        |
| WC-10                                                | 201809479-0010 | 8/22/2018 | 8/27/2018 | 1 ft <sup>2</sup> | 98 µg/ft <sup>2</sup>  |
| Site: Garage Floor; Concrete, Blue Paint             |                |           |           |                   |                        |

(b) (6)

or other approved signatory

\*Analysis following Lead in Dust by EMSL SOP/ Determination of Environmental Lead by FLAA. Reporting limit is 10 µg/wipe, µg/wipe = µg/ft<sup>2</sup> x area sampled in ft<sup>2</sup>. Unless noted, results in this report are not blank corrected. This report relates only to the samples reported above and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities (such as volume sampled) or analytical method limitations. Samples received in good condition unless otherwise noted. The lab is not responsible for data reported in µg/ft<sup>2</sup> which is dependent on the area provided by non-lab personnel. The test results contained within this report meet the requirements of NELAP unless otherwise noted. "<" (less than) results signifies that the analyte was not detected at or above the reporting limit. Measurement of uncertainty is available upon request. The QC data associated with the sample results included in this report meet the recovery and precision requirements unless specifically indicated otherwise. Definitions of modifications are available upon request.

Samples analyzed by EMSL Analytical, Inc. Cinnaminson, NJ NELAP Certifications: NJ 03036, NY 10872, PA 68-00367, AIHA-LAP, LLC ELLAP 100194, A2LA 2845.01

Initial report from 08/28/2018 10:09:25













SS-22  
(Background)



SS-23



SS-26



SS-27



SS-28



SS-29

**EMSL Analytical, Inc.**

200 Route 130 North, Cinnaminson, NJ 08077

Phone/Fax: (856) 303-2500 / (856) 786-5974

<http://www.EMSL.com>

(b) (6)

EMSL Order: 201809514

CustomerID: USCG30

CustomerPO:

ProjectID:

Attn: (b) (6)

**US Coast Guard Maintenance & Logistics  
Command Atlantic  
300 E. Main Street, Suite 1000  
Norfolk, VA 23510-9104**

Phone: (757) 628-4410  
Fax: (757) 628-4418  
Received: 08/24/18 10:30 AM  
Collected: 8/22/2018

Project: West Chop Soil / Tisbury, MA (Vineyard Haven)

**Test Report: Lead in Soils by Flame AAS (SW 846 3050B/7000B)\***

| Client Sample Description                      | Lab ID         | Collected | Analyzed  | Weight   | Lead Concentration |
|------------------------------------------------|----------------|-----------|-----------|----------|--------------------|
| SS-1                                           | 201809514-0001 | 8/22/2018 | 8/31/2018 | 0.5089 g | 7400 ppm           |
| Site: Lighthouse Area                          |                |           |           |          |                    |
| SS-2                                           | 201809514-0002 | 8/22/2018 | 8/31/2018 | 0.5017 g | 2200 ppm           |
| Site: Lighthouse Area                          |                |           |           |          |                    |
| SS-3                                           | 201809514-0003 | 8/22/2018 | 8/31/2018 | 0.5069 g | 4400 ppm           |
| Site: Lighthouse Area Near Water Table Toy     |                |           |           |          |                    |
| SS-4                                           | 201809514-0004 | 8/22/2018 | 8/31/2018 | 0.5061 g | 1400 ppm           |
| Site: Lighthouse Area                          |                |           |           |          |                    |
| SS-5                                           | 201809514-0005 | 8/22/2018 | 8/31/2018 | 0.5025 g | 3300 ppm           |
| Site: Lighthouse Area                          |                |           |           |          |                    |
| SS-6                                           | 201809514-0006 | 8/22/2018 | 8/31/2018 | 0.5037 g | 2600 ppm           |
| Site: Lighthouse Area                          |                |           |           |          |                    |
| SS-7                                           | 201809514-0007 | 8/22/2018 | 8/31/2018 | 0.5015 g | 2200 ppm           |
| Site: 921 Main Exterior                        |                |           |           |          |                    |
| SS-8                                           | 201809514-0008 | 8/22/2018 | 8/31/2018 | 0.5042 g | 3600 ppm           |
| Site: 921 Main Exterior                        |                |           |           |          |                    |
| SS-9                                           | 201809514-0009 | 8/22/2018 | 8/31/2018 | 0.5060 g | 490 ppm            |
| Site: 921 Main Exterior                        |                |           |           |          |                    |
| SS-10                                          | 201809514-0010 | 8/22/2018 | 8/31/2018 | 0.5073 g | 1800 ppm           |
| Site: 917 Main Exterior (Kids' Garden)         |                |           |           |          |                    |
| SS-11                                          | 201809514-0011 | 8/22/2018 | 8/31/2018 | 0.5096 g | 1400 ppm           |
| Site: 917 Main Exterior                        |                |           |           |          |                    |
| SS-12                                          | 201809514-0012 | 8/22/2018 | 8/31/2018 | 0.5035 g | 10000 ppm          |
| Site: 917 Main Exterior                        |                |           |           |          |                    |
| SS-13                                          | 201809514-0013 | 8/22/2018 | 8/31/2018 | 0.5030 g | 1700 ppm           |
| Site: 917 Main Exterior (Patio Furniture Area) |                |           |           |          |                    |
| SS-14                                          | 201809514-0014 | 8/22/2018 | 8/31/2018 | 0.5078 g | 1300 ppm           |
| Site: Fog Sign Bldg                            |                |           |           |          |                    |
| SS-15                                          | 201809514-0015 | 8/22/2018 | 8/31/2018 | 0.5056 g | 2300 ppm           |
| Site: Fog Sign Bldg (Near Pink Table)          |                |           |           |          |                    |

(b) (6)

or other approved signatory

\*Analysis following Lead in Soil/Solids by EMSL SOP/Determination of Environmental Lead by FLAA. Reporting limit is 40 mg/kg based on the minimum sample weight per our SOP. Unless noted, results in this report are not blank corrected. This report relates only to the samples reported above and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities. Samples received in good condition unless otherwise noted. Results reported based on dry weight. "<" (less than) result signifies that the analyte was not detected at or above the reporting limit. Measurement of uncertainty is available upon request. The QC data associated with the sample results included in this report meet the recovery and precision requirements unless specifically indicated otherwise. Definitions of modifications are available upon request.

Samples analyzed by EMSL Analytical, Inc. Cinnaminson, NJ NELAP Certifications: NJ 03036, NY 10872, PA 68-00367, AIHA-LAP, LLC ELLAP 100194, A2LA 2845.01

Initial report from 08/31/2018 13:18:57



**EMSL Analytical, Inc.**

200 Route 130 North, Cinnaminson, NJ 08077

Phone/Fax: (856) 303-2500 / (856) 786-5974

<http://www.EMSL.com>

EMSL Order: 201809514  
CustomerID: USCG30  
CustomerPO:  
ProjectID:

Attn: (b) (6)

**US Coast Guard Maintenance & Logistics  
Command Atlantic  
300 E. Main Street, Suite 1000  
Norfolk, VA 23510-9104**

Phone: (757) 628-4410  
Fax: (757) 628-4418  
Received: 08/24/18 10:30 AM  
Collected: 8/22/2018

Project: West Chop Soil / Tisbury, MA (Vineyard Haven)

**Test Report: Lead in Soils by Flame AAS (SW 846 3050B/7000B)\***

| Client Sample Description                   | Lab ID         | Collected | Analyzed  | Weight   | Lead Concentration |
|---------------------------------------------|----------------|-----------|-----------|----------|--------------------|
| SS-16                                       | 201809514-0016 | 8/22/2018 | 8/31/2018 | 0.5036 g | 1400 ppm           |
| Site: Fog Sign Between Bldg & Fire Pit      |                |           |           |          |                    |
| SS-17                                       | 201809514-0017 | 8/22/2018 | 8/31/2018 | 0.5032 g | 2300 ppm           |
| Site: Fog Sign Bldg                         |                |           |           |          |                    |
| SS-18                                       | 201809514-0018 | 8/22/2018 | 8/31/2018 | 0.5053 g | 240 ppm            |
| Site: Tree Swing B/T Fog Signal & Oil House |                |           |           |          |                    |
| SS-19                                       | 201809514-0019 | 8/22/2018 | 8/31/2018 | 0.5061 g | 91 ppm             |
| Site: Oil Shed/House                        |                |           |           |          |                    |
| SS-20                                       | 201809514-0020 | 8/22/2018 | 8/31/2018 | 0.5038 g | 110 ppm            |
| Site: Tee Pee Near Oil House                |                |           |           |          |                    |
| SS-21                                       | 201809514-0021 | 8/22/2018 | 8/29/2018 | 0.5005 g | 96 ppm             |
| Site: North of Oil House                    |                |           |           |          |                    |
| SS-22                                       | 201809514-0022 | 8/22/2018 | 8/29/2018 | 0.5020 g | <40 ppm            |
| Site: Background                            |                |           |           |          |                    |
| SS-23                                       | 201809514-0023 | 8/22/2018 | 8/29/2018 | 0.5208 g | 720 ppm            |
| Site: North of Garage                       |                |           |           |          |                    |
| SS-24                                       | 201809514-0024 | 8/22/2018 | 8/29/2018 | 0.5035 g | 410 ppm            |
| Site: Garage                                |                |           |           |          |                    |
| SS-25                                       | 201809514-0025 | 8/22/2018 | 8/29/2018 | 0.5149 g | 2500 ppm           |
| Site: Between 921 Main & Lighthouse         |                |           |           |          |                    |
| SS-26                                       | 201809514-0026 | 8/22/2018 | 8/29/2018 | 0.5156 g | 190 ppm            |
| Site: Lighthouse Tree Swing                 |                |           |           |          |                    |
| SS-27                                       | 201809514-0027 | 8/22/2018 | 8/29/2018 | 0.5099 g | 56 ppm             |
| Site: Kids Play Area Near Trees             |                |           |           |          |                    |
| SS-28                                       | 201809514-0028 | 8/22/2018 | 8/29/2018 | 0.5031 g | 87 ppm             |
| Site: Fog Signal, Front                     |                |           |           |          |                    |
| SS-29                                       | 201809514-0029 | 8/22/2018 | 8/29/2018 | 0.5010 g | 42 ppm             |
| Site: Rope Swing, Northeast                 |                |           |           |          |                    |
| SS-30                                       | 201809514-0030 | 8/22/2018 | 8/29/2018 | 0.5100 g | 180 ppm            |
| Site: Flower Bed                            |                |           |           |          |                    |

(b) (6)

or other approved signatory

\*Analysis following Lead in Soil/Solids by EMSL SOP/Determination of Environmental Lead by FLAA. Reporting limit is 40 mg/kg based on the minimum sample weight per our SOP. Unless noted, results in this report are not blank corrected. This report relates only to the samples reported above and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities. Samples received in good condition unless otherwise noted. Results reported based on dry weight. "<" (less than) result signifies that the analyte was not detected at or above the reporting limit. Measurement of uncertainty is available upon request. The QC data associated with the sample results included in this report meet the recovery and precision requirements unless specifically indicated otherwise. Definitions of modifications are available upon request.


Samples analyzed by EMSL Analytical, Inc. Cinnaminson, NJ NELAP Certifications: NJ 03036, NY 10872, PA 68-00367, AIHA-LAP, LLC ELLAP 100194, A2LA 2845.01

Initial report from 08/31/2018 13:18:57







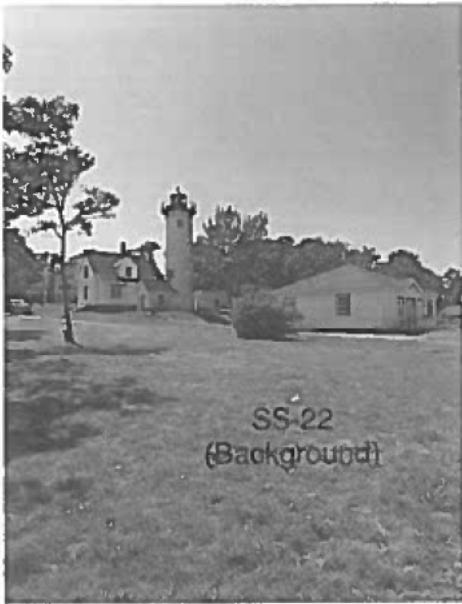



**APPENDIX B: West Chop Housing Lead Assessment Sampling Results**
**917 Main Street - Dust Wipe Results**

| Sample #      | Sample Description                              | Date Sample Collected | Time Sample Collected | Area Sampled      | Results ( $\mu\text{g}/\text{ft}^2$ ) | Within Acceptable Range/Limit (Y/N) |
|---------------|-------------------------------------------------|-----------------------|-----------------------|-------------------|---------------------------------------|-------------------------------------|
| 917 Main W-01 | 2nd Floor, Upstairs Bathroom; Vinyl             | 22-Aug-18             | 1209                  | 1.0 $\text{ft}^2$ | ND                                    | Yes                                 |
| 917 Main W-02 | 2nd Floor, Girl's Bedroom Floor; Hardwood       | 22-Aug-18             | 1210                  | 1.0 $\text{ft}^2$ | ND                                    | Yes                                 |
| 917 Main W-03 | 2nd Floor, Boy's Bedroom Floor; Hardwood        | 22-Aug-18             | 1211                  | 1.0 $\text{ft}^2$ | ND                                    | Yes                                 |
| 917 Main W-04 | 2nd Floor, Master Bedroom Floor; Hardwood       | 22-Aug-18             | 1215                  | 1.0 $\text{ft}^2$ | ND                                    | Yes                                 |
| 917 Main W-05 | 1st Floor, Bottom of Stairs; Vinyl              | 22-Aug-18             | 1217                  | 1.0 $\text{ft}^2$ | ND                                    | Yes                                 |
| 917 Main W-06 | 1st Floor, Living Room Floor; Vinyl             | 22-Aug-18             | 1219                  | 1.0 $\text{ft}^2$ | ND                                    | Yes                                 |
| 917 Main W-07 | 1st Floor, Kitchen Floor (By Front Door); Vinyl | 22-Aug-18             | 1221                  | 1.0 $\text{ft}^2$ | ND                                    | Yes                                 |
| 917 Main W-08 | 1st Floor, Den Floor (Off of Kitchen); Hardwood | 22-Aug-18             | 1225                  | 1.0 $\text{ft}^2$ | ND                                    | Yes                                 |
| 917 Main W-09 | 1st Floor, Bathroom Floor; Vinyl                | 22-Aug-18             | 1228                  | 1.0 $\text{ft}^2$ | ND                                    | Yes                                 |
| 917 Main W-10 | Basement Floor; Concrete                        | 22-Aug-18             | 1230                  | 1.0 $\text{ft}^2$ | 2200                                  | NO                                  |

**Note:**

ND = Indicates that the analyte was not detected at the reporting limit.

Reporting Limit = 10.0  $\mu\text{g}/\text{wipe}$ ;  $\mu\text{g}/\text{wipe} = \mu\text{g}/\text{ft}^2 \times \text{area sampled in ft}^2$

Samples analyzed by EMSL Analytical, Inc. Cinnaminson, NJ. NELAP Certifications: NJ 03036, NY 10872, PA 68-00367, AIHA-LAP, LLC ELLAP 100194, A2LA 2845.01

**Evaluation Criteria:**

- Water: EPA action level for lead is 15 parts-per-billion (ppb) or micrograms per liter ( $\mu\text{g}/\text{L}$ ).
- Evaluation of Surface Cleanliness ("Level of Acceptable Decontamination"):
  - Hygienic Areas (i.e. change areas, classrooms, offices, berthing spaces, messing facilities, and lunchrooms/eating areas): 40 micrograms per square feet ( $\mu\text{g}/\text{ft}^2$ )
  - Non-Hygienic Areas (i.e. ship bilges, firing ranges, armory, and engine rooms): 200 micrograms per square feet ( $\mu\text{g}/\text{ft}^2$ )
- Lead in Soil:
  - Bare Residential Soil around Building and Perimeters and Yards: 1200 - 5000 ppm (Action Level) and >5000 ppm (Major Finding Level)
  - Play Area and High-Contact Areas for Children: 200 - 400ppm (Action Level) and >400 ppm (Major Finding Level)
- Lead in Paint:
  - CG units must make every effort to only use non-lead paint. When non-lead paint is an absolute non-feasible option, units must use paints, coatings systems, adhesives etc. containing less than 0.009% lead by dry weight.
  - Interior or exterior paint with lead content greater than or equal to 0.5% by dry weight and in fair or poor condition requires corrective actions.
  - OSHA considers any paint containing detectable lead as lead paint for purposes of complying with OSHA regulations to determine worker exposure. OSHA does not define lead paint based on content. Therefore, a detectable concentration of lead in paint indicates that the material is a potential source of lead exposure when disturbed/damaged and any work must comply with personal protection and work practice requirements.
  - CG personnel are only authorized to engage in minor repair and maintenance activities on CG Shore Units with lead-containing paint.

Sample Collected By: (b) (6)

**Sampling Products Used:**

HACH Chlorine, Free + Total & pH Test Kit: Model CN-67, CAT #14111-00

DPD Free Chlorine Reagent Powder Pillows: CAT # 1407799, LOT A5156, EXP. May 2020

Phenol Red Indicator Solution: CAT #21132, LOT A5152, EXP. May 2020

Ghost Wipes: Meets ASTM 1792, EXP. March 2020

**APPENDIX B: West Chop Housing Lead Assessment Sampling Results**
**921 Main Street - Dust Wipe Results**

| Sample #      | Sample Description                                                                            | Date Sample Collected | Time Sample Collected | Area Sampled | Results (µg/ft²) | Within Acceptable Range/Limit (Y/N) |
|---------------|-----------------------------------------------------------------------------------------------|-----------------------|-----------------------|--------------|------------------|-------------------------------------|
| 921 Main W-01 | 2nd Floor, Upstairs Bathroom Floor; Tile Vinyl                                                | 22-Aug-18             | 1054                  | 1.0 ft²      | 14               | Yes                                 |
| 921 Main W-02 | 2nd Floor, Bedroom with Crib - Bottom of Toy Chest; Wood                                      | 22-Aug-18             | 1100                  | 1.0 ft²      | 66               | NO                                  |
| 921 Main W-03 | 2nd Floor, Bedroom with Crib Floor - Behind Door/In Corner (Common Sweep Away Area); Hardwood | 22-Aug-18             | 1105                  | 1.0 ft²      | ND               | Yes                                 |
| 921 Main W-04 | 2nd Floor, Bunk Bed Room - Bottom of LEGO Bucket; Plastic                                     | 22-Aug-18             | 1109                  | 1.0 ft²      | 18               | Yes                                 |
| 921 Main W-05 | 2nd Floor, Bunk Bed Room Floor - Under the Bed; Hardwood                                      | 22-Aug-18             | 1110                  | 1.0 ft²      | ND               | Yes                                 |
| 921 Main W-06 | 2nd Floor, Bunk Bed Room Floor - Behind Door/In Corner (Common Sweep Away Area); Hardwood     | 22-Aug-18             | 1111                  | 1.0 ft²      | 11               | Yes                                 |
| 921 Main W-07 | 2nd Floor, Master Bedroom Floor - Closet (Shoe Storage Area); Hardwood                        | 22-Aug-18             | 1118                  | 1.0 ft²      | ND               | Yes                                 |
| 921 Main W-08 | 2nd Floor, Upstairs Hall Closet/Top of Stairs Floor; Hardwood                                 | 22-Aug-18             | 1120                  | 1.0 ft²      | ND               | Yes                                 |
| 921 Main W-09 | Maroon Staircase (Midway); Wood                                                               | 22-Aug-18             | 1122                  | 1.0 ft²      | 23               | Yes                                 |
| 921 Main W-10 | 1st Floor, Bottom of Staircase Floor; Linoleum                                                | 22-Aug-18             | 1124                  | 1.0 ft²      | 11               | Yes                                 |
| 921 Main W-11 | 1st Floor, Den Floor; Hardwood                                                                | 22-Aug-18             | 1127                  | 1.0 ft²      | ND               | Yes                                 |
| 921 Main W-12 | 1st Floor, Bathroom Floor; Tile Vinyl                                                         | 22-Aug-18             | 1130                  | 1.0 ft²      | ND               | Yes                                 |
| 921 Main W-13 | 1st Floor, Living Room Couch, Middle Seat; Leather                                            | 22-Aug-18             | 1133                  | 1.0 ft²      | 17               | Yes                                 |
| 921 Main W-14 | 1st Floor, Living Room Coffee Table; Wood                                                     | 22-Aug-18             | 1134                  | 1.0 ft²      | ND               | Yes                                 |
| 921 Main W-15 | 1st Floor, Living Room Floor; Hardwood                                                        | 22-Aug-18             | 1135                  | 1.0 ft²      | 11               | Yes                                 |
| 921 Main W-16 | 1st Floor, Dining Table - Baby High Chair Tray; Plastic and Fabric                            | 22-Aug-18             | 1141                  | 1.0 ft²      | ND               | Yes                                 |
| 921 Main W-17 | 1st Floor, Kitchen Floor; Tile Vinyl                                                          | 22-Aug-18             | 1143                  | 1.0 ft²      | 13               | Yes                                 |
| 921 Main W-18 | 1st Floor, Mud Room/Entry Way; Vinyl                                                          | 22-Aug-18             | 1146                  | 1.0 ft²      | 13               | Yes                                 |
| 921 Main W-19 | 1st Floor, Laundry Room; Vinyl                                                                | 22-Aug-18             | 1148                  | 1.0 ft²      | 13               | Yes                                 |
| 921 Main W-20 | Basement Floor; Concrete                                                                      | 22-Aug-18             | 1153                  | 1.0 ft²      | 2000             | NO                                  |

**Note:**

ND = Indicates that the analyte was not detected at the reporting limit.

Reporting Limit = 10.0 µg/wipe; µg/wipe = µg/ft² x area sampled in ft².

Samples analyzed by EMSL Analytical, Inc. Cinnaminson, NJ. NELAP Certifications: NJ 03036, NY 10872, PA 68-00367, AIHA-LAP, LLC ELLAP 100194, A2LA 2845.01

**Evaluation Criteria:**

- Water: EPA action level for lead is 15 parts-per-billion (ppb) or micrograms per liter (µg/L).
- Evaluation of Surface Cleanliness ("Level of Acceptable Decontamination"):
  - Hygienic Areas (i.e. change areas, classrooms, offices, berthing spaces, messing facilities, and lunchrooms/catering areas): 40 micrograms per square feet (µg/ft²)
  - Non-Hygienic Areas (i.e. ship bilges, firing ranges, armory, and engine rooms): 200 micrograms per square feet (µg/ft²)
- Lead in Soil:
  - Bare Residential Soil around Building and Perimeters and Yards: 1200 - 5000 ppm (Action Level) and >5000 ppm (Major Finding Level)
  - Play Area and High-Contact Areas for Children: 200 - 400ppm (Action Level) and >400 ppm (Major Finding Level)
- Lead in Paint:
  - CG units must make every effort to only use non-lead paint. When non-lead paint is an absolute non-feasible option, units must use paints, coatings systems, adhesives etc. containing less than 0.009% lead by dry weight.
  - Interior or exterior paint with lead content greater than or equal to 0.5% by dry weight and in fair or poor condition requires corrective actions.
  - OSHA considers any paint containing detectable lead as lead paint for purposes of complying with OSHA regulations to determine worker exposure. OSHA does not define lead paint based on content. Therefore, a detectable concentration of lead in paint indicates that the material is a potential source of lead exposure when disturbed/damaged and any work must comply with personal protection and work practice requirements.
  - CG personnel are only authorized to engage in minor repair and maintenance activities on CG Shore Units with lead-containing paint.

Sample Collected By (b) (6)

**Sampling Products Used:**

HACH Chlorine, Free + Total & pH Test Kit: Model CN-67, CAT #14111-00  
 DPD Free Chlorine Reagent Powder Pillows: CAT # 1407799, LOT A5156, EXP. May 2020  
 Phenol Red Indicator Solution: CAT #21132, LOT A5152, EXP. May 2020  
 Ghost Wipes: Meets ASTM 1792, EXP. March 2020

**APPENDIX B: West Chop Housing Lead Assessment Sampling Results**
**West Chop (Other Structures Besides Homes) - Dust Wipe Results**

| Sample # | Sample Description                                                    | Date Sample Collected | Time Sample Collected | Area Sampled | Results (µg/ft²) | Within Acceptable Range/Limit (Y/N)                           |
|----------|-----------------------------------------------------------------------|-----------------------|-----------------------|--------------|------------------|---------------------------------------------------------------|
| WC-01    | Fog Signal Building, Concrete Floor by Water Facing Door; Red Paint   | 22-Aug-18             | 1319                  | 1.0 ft²      | 570              | NO                                                            |
| WC-02    | Fog Signal Building, Concrete Floor by Street Facing Door; Gray Paint | 22-Aug-18             | 1320                  | 1.0 ft²      | 460              | NO                                                            |
| WC-03    | Fog Signal Building, Concrete Floor of Side Room; Red & Gray Paint    | 22-Aug-18             | 1322                  | 1.0 ft²      | 550              | NO                                                            |
| WC-04    | Fog Signal Building, Quad Bike Seat; Black Leather                    | 22-Aug-18             | 1354                  | 1.0 ft²      | 94               | NO                                                            |
| WC-05    | Fog Signal Building, Canoe; Plastic                                   | 22-Aug-18             | 1355                  | 1.0 ft²      | 100              | NO                                                            |
| WC-06    | Love Seat Swing in Yard; Wood                                         | 22-Aug-18             | 1402                  | 1.0 ft²      | ND               | Yes                                                           |
| WC-07    | Kid's Water Table Toy; Plastic                                        | 22-Aug-18             | 1403                  | 1.0 ft²      | 110              | NO                                                            |
| WC-08    | Grill in Yard; Black Metal                                            | 22-Aug-18             | 1408                  | 1.0 ft²      | 22               | Yes                                                           |
| WC-09    | Kid's Red and Black Bicycle Outside House; Red & Black Paint on Metal | 22-Aug-18             | 1409                  | 1.0 ft²      | ND               | Yes                                                           |
| WC-10    | Garage, Concrete Floor; Blue Paint                                    | 22-Aug-18             | 1412                  | 1.0 ft²      | 98               | NO; Classified as Hygienic Area due to High-Children Activity |

**Note:**

ND = Indicates that the analyte was not detected at the reporting limit.

Reporting Limit = 10.0 µg/wipe; µg/wipe = µg/ft² x area sampled in ft².

Samples analyzed by EMSL Analytical, Inc. Cinnaminson, NJ. NELAP Certifications: NJ 03036, NY 10872, PA 68-00367, AIHA-LAP, LLC ELLAP 100194, A2LA 2845.01

**Evaluation Criteria:**

- Water: EPA action level for lead is 15 parts-per-billion (ppb) or micrograms per liter (µg/L).
- Evaluation of Surface Cleanliness ("Level of Acceptable Decontamination"):
  - Hygienic Areas (i.e. change areas, classrooms, offices, berthing spaces, messing facilities, and lunchrooms/eating areas): 40 micrograms per square feet (µg/ft²)
  - Non-Hygienic Areas (i.e. ship bilges, firing ranges, armory, and engine rooms): 200 micrograms per square feet (µg/ft²)
- Lead in Soil:
  - Bare Residential Soil around Building and Perimeters and Yards: 1200 - 5000 ppm (Action Level) and >5000 ppm (Major Finding Level)
  - Play Area and High-Contact Areas for Children: 200 - 400ppm (Action Level) and >400 ppm (Major Finding Level)
- Lead in Paint:
  - CG units must make every effort to only use non-lead paint. When non-lead paint is an absolute non-feasible option, units must use paints, coatings systems, adhesives etc. containing less than 0.009% lead by dry weight.
  - Interior or exterior paint with lead content greater than or equal to 0.5% by dry weight and in fair or poor condition requires corrective actions.
  - OSHA considers any paint containing detectable lead as lead paint for purposes of complying with OSHA regulations to determine worker exposure. OSHA does not define lead paint based on content. Therefore, a detectable concentration of lead in paint indicates that the material is a potential source of lead exposure when disturbed/damaged and any work must comply with personal protection and work practice requirements.
  - CG personnel are only authorized to engage in minor repair and maintenance activities on CG Shore Units with lead-containing paint.

Sample Collected By: (b) (6)

**Sampling Products Used:**

HACH Chlorine, Free + Total & pH Test Kit: Model CN-67, CAT #14111-00

DPD Free Chlorine Reagent Powder Pillows: CAT # 1407799, LOT A5156, EXP. May 2020

Phenol Red Indicator Solution: CAT #21132, LOT A5152, EXP. May 2020

Ghost Whipes: Meets ASTM 1792, EXP. March 2020

**APPENDIX B: West Chop Housing Lead Assessment Sampling Results**
**West Chop Paint Chip Analysis - Sample Results**

| Sample # | Sample Description                                                                  | Date Sample Collected | Time Sample Collected | Results (% Lead by Dry Weight) | Is this Lead Containing Paint (LCP) Y/N | SEI Manual Classification          |
|----------|-------------------------------------------------------------------------------------|-----------------------|-----------------------|--------------------------------|-----------------------------------------|------------------------------------|
| WC-B-01  | 917 Main Street, Basement - Gray Cabinet with Small Green Area; Gray Paint on Wood  | 22-Aug-18             | 1235                  | 16.000                         | YES                                     | ACTION LEVEL                       |
| WC-B-02  | 917 Main Street, Basement Floor - Cement Floor with Red Paint                       | 22-Aug-18             | 1237                  | 0.076                          | YES                                     | N/A; LESS THAN 0.5% LEAD BY WEIGHT |
| WC-B-03  | 917 Main Street, Basement - Gray Cabinet with Small Green Area; Green Paint on Wood | 22-Aug-18             | 1240                  | 17.000                         | YES                                     | ACTION LEVEL                       |
| WC-B-04  | 917 Main Street, Basement - Deteriorating White Paint on Wall                       | 22-Aug-18             | 1241                  | 0.023                          | YES                                     | N/A; LESS THAN 0.5% LEAD BY WEIGHT |
| WC-B-05  | Fog Signal Building, Drywall, Green Paint, Poor Condition                           | 22-Aug-18             | 1329                  | 0.057                          | YES                                     | N/A; LESS THAN 0.5% LEAD BY WEIGHT |
| WC-B-06  | Fog Signal Building, Brick Wall, White Paint, Poor Condition                        | 22-Aug-18             | 1330                  | 7.800                          | YES                                     | ACTION LEVEL                       |
| WC-B-07  | Fog Signal Building, Floor, Concrete with Red Paint                                 | 22-Aug-18             | 1332                  | 6.500                          | YES                                     | ACTION LEVEL                       |
| WC-B-08  | Fog Signal Building, Door Frame, Gray Paint on Wood                                 | 22-Aug-18             | 1334                  | 0.340                          | YES                                     | N/A; LESS THAN 0.5% LEAD BY WEIGHT |
| WC-B-09  | Fog Signal Building, Shelf, Black Paint on Wood                                     | 22-Aug-18             | 1341                  | 0.590                          | YES                                     | ACTION LEVEL                       |
| WC-B-10  | Fog Signal Building, Floor, Concrete with Gray Paint                                | 22-Aug-18             | 1342                  | 0.340                          | YES                                     | N/A; LESS THAN 0.5% LEAD BY WEIGHT |
| WC-B-11  | Fog Signal Building, Drywall, Green Paint                                           | 22-Aug-18             | 1349                  | 0.130                          | YES                                     | N/A; LESS THAN 0.5% LEAD BY WEIGHT |
| WC-B-12  | 921 Main Street, Garage, Drywall, Yellow Paint                                      | 22-Aug-18             | 1414                  | 0.680                          | YES                                     | MAJOR FINDING                      |
| WC-B-13  | 921 Main Street, Garage, Door Frame, Green Paint                                    | 22-Aug-18             | 1416                  | 1.300                          | YES                                     | MAJOR FINDING                      |
| WC-B-14  | 921 Main Street, Garage, Outer Wall, Wood Siding, White Paint                       | 22-Aug-18             | 1418                  | 5.600                          | YES                                     | MAJOR FINDING                      |
| WC-B-15  | Paint and Oil Locker, Floor, Concrete, Red Paint                                    | 22-Aug-18             | 1436                  | 7.000                          | YES                                     | ACTION LEVEL                       |
| WC-B-16  | Paint and Oil Locker, Outside Wood Trim, White and Red Paint                        | 22-Aug-18             | 1438                  | 16.000                         | YES                                     | ACTION LEVEL                       |

**Note:**

All paint chips collected were in poor condition.

ND = Indicates that the analyte was not detected at the reporting limit.

Reporting Limit = 0.008% Lead by Dry Weight

Samples analyzed by EMSL Analytical, Inc. Cinnaminson, NJ. NELAP Certifications: NJ 03036, NY 10872, PA 68-00367, AIIA-LAP, LLC ELLAP 100194, A2LA 2845.01

**Evaluation Criteria:**

- \* Water: EPA action level for lead is 15 parts-per-billion (ppb) or micrograms per liter ( $\mu\text{g/L}$ ).
- \* Evaluation of Surface Cleanliness ("Level of Acceptable Decontamination"):
  - Hygienic Areas (i.e. change areas, classrooms, offices, berthing spaces, messing facilities, and lunchrooms/eating areas): 40 micrograms per square feet ( $\mu\text{g}/\text{ft}^2$ )
  - Non-Hygienic Areas (i.e. ship bilges, firing ranges, armory, and engine rooms): 200 micrograms per square feet ( $\mu\text{g}/\text{ft}^2$ )
- \* Lead in Soil:
  - Bare Residential Soil around Building and Perimeters and Yards: 1200 - 5000 ppm (Action Level) and >5000 ppm (Major Finding Level)
  - Play Area and High-Contact Areas for Children: 200 - 400ppm (Action Level) and >400 ppm (Major Finding Level)
- \* Lead in Paint:
  - CG units must make every effort to only use non-lead paint. When non-lead paint is an absolute non-feasible option, units must use paints, coatings systems, adhesives etc. containing less than 0.009% lead by dry weight.
  - Interior or exterior paint with lead content greater than or equal to 0.5% by dry weight and in fair or poor condition requires corrective actions.
  - OSHA considers any paint containing detectable lead as lead paint for purposes of complying with OSHA regulations to determine worker exposure. OSHA does not define lead paint based on content. Therefore, a detectable concentration of lead in paint indicates that the material is a potential source of lead exposure when disturbed/damaged and any work must comply with personal protection and work practice requirements.
  - CG personnel are only authorized to engage in minor repair and maintenance activities on CG Shore Units with lead-containing paint.

Sample Collected By: (b) (6)

**Sampling Products Used:**

HACH Chlorine, Free + Total & pH Test Kit: Model CN-67, CAT #14111-00

DPD Free Chlorine Reagent Powder Pillows: CAT # 1407799, LOT A5156, EXP. May 2020

Phenol Red Indicator Solution: CAT #21132, LOT A5152, EXP. May 2020

Ghost Wipes: Meets ASTM 1792, EXP. March 2020



**APPENDIX B: West Chop Housing Lead Assessment Sampling Results**

**West Chop Housing - Water Assessment Results**

| Sample #        | Sample Description                         | Date Sample Collected | Time Sample Collected | Results (µg/L) | pH  | Disinfectant Residual, Free Chlorine (ppm) | Disinfectant Residual, Total Chlorine (ppm) |
|-----------------|--------------------------------------------|-----------------------|-----------------------|----------------|-----|--------------------------------------------|---------------------------------------------|
| 921Main H20 001 | 921 Main Street, Kitchen Sink Faucet       | 22-Aug-18             | 10:24 AM              | ND             | 7.5 | No Trace                                   | No Trace                                    |
| 921Main H20 002 | 921 Main Street, 2nd Floor Bathroom Sink F | 22-Aug-18             | 10:36 AM              | 1.70           | 7.8 | No Trace                                   | No Trace                                    |
| 917Main H20 001 | 917 Main Street, Kitchen Sink Faucet       | 22-Aug-18             | 12:05 PM              | ND             | 7.2 | No Trace                                   | No Trace                                    |
| 917Main H20 002 | 917 Main Street, 2nd Floor Bathroom Sink F | 22-Aug-18             | 12:14 PM              | 3.10           | 7.3 | No Trace                                   | No Trace                                    |

**Note:**

ND = Indicates that the analyte was not detected at the reporting limit.

Reporting Limit = 1.0 µg/L (1.0 ppb)

Samples analyzed by EMSL Analytical, Inc. Cinnaminson, NJ. NELAP Certifications: NJ 03036, NY 10872, PA 68-00367, AIHA-LAP, LLC ELLAP 100194, A2LA 2845.01

**Evaluation Criteria:**

- Water: EPA action level for lead is 15 parts-per-billion (ppb) or micrograms per liter (µg/L).
- Evaluation of Surface Cleanliness ("Level of Acceptable Decontamination"):
  - Hygienic Areas (i.e. change areas, classrooms, offices, berthing spaces, messing facilities, and lunchrooms/eating areas): 40 micrograms per square feet (µg/ft<sup>2</sup>)
  - Non-Hygienic Areas (i.e. ship bilges; firing ranges, armory, and engine rooms): 200 micrograms per square feet (µg/ft<sup>2</sup>)
- Lead in Soil:
  - Bare Residential Soil around Building and Perimeters and Yards: 1200 - 5000 ppm (Action Level) and >5000 ppm (Major Finding Level)
  - Play Area and High-Contact Areas for Children: 200 - 400ppm (Action Level) and >400 ppm (Major Finding Level)
- Lead in Paint:
  - CG units must make every effort to only use non-lead paint. When non-lead paint is an absolute non-feasible option, units must use paints, coatings systems, adhesives etc. containing less than 0.009% lead by dry weight.
  - Interior or exterior paint with lead content greater than or equal to 0.5% by dry weight and in fair or poor condition requires corrective actions.
  - OSHA considers any paint containing detectable lead as lead paint for purposes of complying with OSHA regulations to determine worker exposure. OSHA does not define lead paint based on content. Therefore, a detectable concentration of lead in paint indicates that the material is a potential source of lead exposure when disturbed/damaged and any work must comply with personal protection and work practice requirements.
  - CG personnel are only authorized to engage in minor repair and maintenance activities on CG Shore Units with lead-containing paint.

**Sample Collected By**

(b) (6)

**Sampling Products Used:**

HACH Chlorine, Free + Total & pH Test Kit: Model CN-67, CAT #14111-00  
 DPD Free Chlorine Reagent Powder Pillows: CAT # 1407799, LOT A5156, EXP. May 2020  
 Phenol Red Indicator Solution: CAT #21132. LOT A5152, EXP. May 2020  
 Ghost Whipes: Meets ASTM 1792, EXP. March 2020

**APPENDIX B: West Chop Housing Lead Assessment Sampling Results**

**West Chop Soil Analysis - Sample Results**

| Sample # | Sample Description                                                                          | Date Sample Collected | Time Sample Collected | 2018 Results (ppm) | SEI Manual Classification |
|----------|---------------------------------------------------------------------------------------------|-----------------------|-----------------------|--------------------|---------------------------|
| SS-01    | Lighthouse, Entrance Door Side, Approx. 3 ft from Structure                                 | 22-Aug-18             | 1316                  | 7,400              | MAJOR FINDING             |
| SS-02    | Lighthouse, Entrance Door Side, Approx. 6 ft from Structure                                 | 22-Aug-18             | 1317                  | 2,200              | MAJOR FINDING             |
| SS-03    | Lighthouse, East Side, Next to Water Table Toy                                              | 22-Aug-18             | 1319                  | 4,400              | MAJOR FINDING             |
| SS-04    | Lighthouse, East Side, Approx. 6 ft from Structure                                          | 22-Aug-18             | 1320                  | 1,400              | MAJOR FINDING             |
| SS-05    | Lighthouse, Window Side (NW), Approx. 3 ft from Structure                                   | 22-Aug-18             | 1322                  | 3,300              | MAJOR FINDING             |
| SS-06    | Lighthouse, Window Side (NW), Approx. 6 ft from Structure                                   | 22-Aug-18             | 1323                  | 2,600              | MAJOR FINDING             |
| SS-07    | 921 Main Street, Next to Basement Access                                                    | 22-Aug-18             | 1325                  | 2,200              | MAJOR FINDING             |
| SS-08    | 921 Main Street, Street Facing Side                                                         | 22-Aug-18             | 1328                  | 3,600              | MAJOR FINDING             |
| SS-09    | 921 Main Street, Garage Facing Side                                                         | 22-Aug-18             | 1329                  | 490                | MAJOR FINDING             |
| SS-10    | 917 Main Street, Kids' Garden Space                                                         | 22-Aug-18             | 1329                  | 1,800              | MAJOR FINDING             |
| SS-11    | 917 Main Street, Street Facing Side                                                         | 22-Aug-18             | 1333                  | 1,400              | MAJOR FINDING             |
| SS-12    | 917 Main Street, Side Facing 921 Main Street                                                | 22-Aug-18             | 1336                  | 10,000             | MAJOR FINDING             |
| SS-13    | 917 Main Street, Water Facing Side, Location of Outdoor Patio Furniture                     | 22-Aug-18             | 1336                  | 1,700              | MAJOR FINDING             |
| SS-14    | Fog Signal Building, Facing Homes, Approx. 3 ft from Structure                              | 22-Aug-18             | 1338                  | 1,300              | MAJOR FINDING             |
| SS-15    | Fog Signal Building, Concrete Pad Side, In Line with Picnic Table                           | 22-Aug-18             | 1342                  | 2,300              | MAJOR FINDING             |
| SS-16    | Fog Signal Building, Water Side, Between Building and Fire Pit, Approx. 10 ft from Building | 22-Aug-18             | 1343                  | 1,400              | MAJOR FINDING             |
| SS-17    | Fog Signal Building, Facing Asphalt Path                                                    | 22-Aug-18             | 1344                  | 2,300              | MAJOR FINDING             |
| SS-18    | Tree Swing North of Paint and Oil Locker                                                    | 22-Aug-18             | 1356                  | 240                | ACTION LEVEL              |
| SS-19    | Paint and Oil Locker, Side Facing House                                                     | 22-Aug-18             | 1358                  | 91                 | N/A                       |
| SS-20    | Kids' Play Area, Tee-Pee, Near Paint and Oil Locker                                         | 22-Aug-18             | 1402                  | 110                | MONITORING LEVEL          |
| SS-21    | Paint and Oil Locker, Water Facing Side                                                     | 22-Aug-18             | 1403                  | 96                 | N/A                       |
| SS-22    | Background                                                                                  | 22-Aug-18             | 1405                  | ND                 | N/A                       |
| SS-23    | Garage, North Side, Approx. 6 ft from Structure                                             | 22-Aug-18             | 1412                  | 720                | MAJOR FINDING             |
| SS-24    | Garage, Side Facing 921 Main Street                                                         | 22-Aug-18             | 1330                  | 410                | MAJOR FINDING             |
| SS-25    | Walkway between 921 Main Street and Lighthouse                                              | 22-Aug-18             | 1324                  | 2,500              | MAJOR FINDING             |
| SS-26    | Tree Swing Near Lighthouse                                                                  | 22-Aug-18             | 1415                  | 190                | MONITORING LEVEL          |
| SS-27    | Kids' Play Area, Northern Corner of Property                                                | 22-Aug-18             | 1349                  | 56                 | N/A                       |
| SS-28    | Fog Signal, Water Facing Side, Approx. 1 ft from Structure                                  | 22-Aug-18             | 1352                  | 87                 | N/A                       |
| SS-29    | Rope Swing Area                                                                             | 22-Aug-18             | 1407                  | 42                 | N/A                       |
| SS-30    | Flower Beds Near Lighthouse                                                                 | 22-Aug-18             | 1321                  | 180                | MONITORING LEVEL          |

Notes  
 ND = Indicates that the analyte was not detected at the reporting limit.  
 Reporting Limit = 40.0 parts per million (ppm)  
 Samples analyzed by EMSI Analytical, Inc. Cincinnati, NJ. NELAP Certifications: NJ 03036, NY 10872, PA 68-00367, AIHA-LAP, LLC ELLAP 100194, A2LA 2845.01

**Evaluation Criteria:**

- Water: EPA action level for lead is 15 parts-per-billion (ppb) or micrograms per liter (µg/L)
- Evaluation of Surface Cleanliness ("Level of Acceptable Decontamination"):
  - Hygienic Areas (i.e. change areas, classrooms, offices, berthing spaces, messing facilities, and lunchrooms/eating areas): 40 micrograms per square feet (µg/ft<sup>2</sup>)
  - Non-Hygienic Areas (i.e. ship bilges, firing ranges, armory, and engine rooms): 200 micrograms per square feet (µg/ft<sup>2</sup>)
- Lead in Soil:
  - Bare Residential Soil around Building and Perimeters and Yards: 1200 - 5000 ppm (Action Level) and >5000 ppm (Major Finding Level)
  - Play Area and High-Contact Areas for Children: 100 - 200 PPM (Monitoring Level), 200 - 400ppm (Action Level), and >400 ppm (Major Finding Level)
- Lead in Paint:
  - CG units must make every effort to only use non-lead paint. When non-lead paint is an absolute non-feasible option, units must use paints, coatings systems, adhesives etc. containing less than 0.0099% lead by dry weight.
  - Interior or exterior paint with lead content greater than or equal to 0.5% by dry weight and in fair or poor condition requires corrective actions.
  - OSHA considers any paint containing detectable lead as lead paint for purposes of complying with OSHA regulations to determine worker exposure. OSHA does not define lead paint based on content. Therefore, a detectable concentration of lead in paint indicates that the material is a potential source of lead exposure when disturbed/damaged and any work must comply with personal protection and work practice requirements.
  - CG personnel are only authorized to engage in minor repair and maintenance activities on CG Shore Units with lead-containing paint.

Sample Collected By: (b) (6)

**Sampling Products Used:**

HACH Chlorine, Free + Total & pH Test Kit: Model CN-67, CAT #J4111-00  
 DPD Free Chlorine Reagent Powder Pillows: CAT # 1407799, LOT A5156, EXP. May 2020  
 Phenol Red Indicator Solution: CAT #21132, LOT A5152, EXP. May 2020  
 Ghost Wipes: Meets ASTM 1792, EXP. March 2020

**APPENDIX B: West Chop Housing Lead Assessment Sampling Results**
**West Chop Soil Analysis - Sample Results**

| Sample # | CEU Providence's 2008 Phase I/II Environmental Site Assessment Results<br>Samples Collected 13NOV07 | 2018 Results<br>(ppm)   |
|----------|-----------------------------------------------------------------------------------------------------|-------------------------|
| SS-01    | 1,469                                                                                               | 7,400                   |
| SS-02    | 2,643                                                                                               | 2,200                   |
| SS-03    | 3,902                                                                                               | 4,400                   |
| SS-04    | 1,129                                                                                               | 1,400                   |
| SS-05    | 2,449                                                                                               | 3,300                   |
| SS-06    | 3,513                                                                                               | 2,600                   |
| SS-07    | 1,168                                                                                               | 2,200                   |
| SS-08    | 1,165                                                                                               | 3,600                   |
| SS-09    | 706                                                                                                 | 490                     |
| SS-10    | 1,376                                                                                               | 1,800                   |
| SS-11    | 613                                                                                                 | 1,400                   |
| SS-12    | 1,667                                                                                               | 10,000                  |
| SS-13    | 2,068                                                                                               | 1,700                   |
| SS-14    | 1,176                                                                                               | 1,300                   |
| SS-15    | 504                                                                                                 | 2,300                   |
| SS-16    | 647                                                                                                 | 1,400                   |
| SS-17    | 1,287                                                                                               | 2,300                   |
| SS-18    | NOT MIRRORING LOCATIONS                                                                             | NOT MIRRORING LOCATIONS |
| SS-19    | 75                                                                                                  | 91                      |
| SS-20    | NOT MIRRORING LOCATIONS                                                                             | NOT MIRRORING LOCATIONS |
| SS-21    | 124                                                                                                 | 96                      |
| SS-22    | 28                                                                                                  | ND                      |
| SS-23    | 622                                                                                                 | 720                     |
| SS-24    | 463                                                                                                 | 410                     |
| SS-25    | SAMPLE NOT COLLECTED                                                                                | 2,500                   |
| SS-26    | SAMPLE NOT COLLECTED                                                                                | 190                     |
| SS-27    | SAMPLE NOT COLLECTED                                                                                | 56                      |
| SS-28    | SAMPLE NOT COLLECTED                                                                                | 87                      |
| SS-29    | SAMPLE NOT COLLECTED                                                                                | 42                      |
| SS-30    | SAMPLE NOT COLLECTED                                                                                | 180                     |

**Note:**

ND = Indicates that the analyte was not detected at the reporting limit.

Reporting Limit = 40.0 parts per million (ppm)

2018 sample sites were selected to closely mirror CEU Providence's 2008 report; collected in close proximity to 13NOV07 samples

Samples analyzed by EMSL Analytical, Inc. Cinnaminson, NJ. NELAP Certifications: NJ 03036, NY 10872, PA 68-00367, AIHA-LAP, LLC ELLAP 100194, A2LA 2845.01

*CEU Providence's 2008 Report: Samples collected by EA Engineering, Science, and Technology on 13NOV07; collected a total of 24 samples. All samples were collected from 0 to 1 ft below ground surface using a hand shovel, which was decontaminated between samples. Soil samples were transferred to a disposable aluminum tray for homogenization and removal of gravel and organics, and then placed within the appropriate containers for subsequent x-ray fluorescence (XRF) analysis.*

**Evaluation Criteria:**

- Water: EPA action level for lead is 15 parts-per-billion (ppb) or micrograms per liter (µg/L).
- Evaluation of Surface Cleanliness ("Level of Acceptable Decontamination"):
  - Hygienic Areas (i.e. change areas, classrooms, offices, berthing spaces, messing facilities, and lunchrooms/eating areas): 40 micrograms per square feet (µg/ft<sup>2</sup>)
  - Non-Hygienic Areas (i.e. ship bilges, firing ranges, armory, and engine rooms): 200 micrograms per square feet (µg/ft<sup>2</sup>)
- Lead in Soil:
  - Bare Residential Soil around Building and Perimeters and Yards: 1200 - 5000 ppm (Action Level) and >5000 ppm (Major Finding Level)
  - Play Area and High-Contact Areas for Children: 100 - 200ppm (Monitoring Level), 200 - 400ppm (Action Level), and >400 ppm (Major Finding Level)
- Lead in Paint:
  - CG units must make every effort to only use non-lead paint. When non-lead paint is an absolute non-feasible option, units must use paints, coatings systems, adhesives etc. containing less than 0.009% lead by dry weight.
  - Interior or exterior paint with lead content greater than or equal to 0.5% by dry weight and in fair or poor condition requires corrective actions.
  - OSHA considers any paint containing detectable lead as lead paint for purposes of complying with OSHA regulations to determine worker exposure. OSHA does not define lead paint based on content. Therefore, a detectable concentration of lead in paint indicates that the material is a potential source of lead exposure when disturbed/damaged and any work must comply with personal protection and work practice requirements.
  - CG personnel are only authorized to engage in minor repair and maintenance activities on CG Shore Units with lead-containing paint.

Sample (b) (6)

**Sampling Products Used:**

HIACH Chlorine, Free + Total & pH Test Kit: Model CN-67, CAT #14111-00

DPD Free Chlorine Reagent Powder Pillows: CAT # 1407799, LOT A5156, EXP. May 2020

Phenol Red Indicator Solution: CAT #21132, LOT A5152, EXP. May 2020

Ghost Wipes: Meets ASTM 1792, EXP. March 2020

**EMSL Analytical, Inc.**

200 Route 130 North, Cinnaminson, NJ 08077

Phone/Fax: (856) 303-2500 / (856) 786-5974

<http://www.EMSL.com>

(b) (6)

EMSL Order: 201809478

CustomerID: USCG30

CustomerPO:

ProjectID:

Attn: (b) (6)

**US Coast Guard Maintenance & Logistics  
Command Atlantic  
300 E. Main Street, Suite 1000  
Norfolk, VA 23510-9104**

Phone: (757) 628-4410  
Fax: (757) 628-4418  
Received: 08/24/18 10:30 AM  
Collected: 8/22/2018

Project: West Chop Chips

**Test Report: Lead in Paint Chips by Flame AAS (SW 846 3050B/7000B)\***

| <i>Client Sample Description</i>                  | <i>Lab ID</i>  | <i>Collected</i> | <i>Analyzed</i> | <i>Weight</i> | <i>Lead Concentration</i> |
|---------------------------------------------------|----------------|------------------|-----------------|---------------|---------------------------|
| WC-B-01                                           | 201809478-0001 | 8/22/2018        | 8/27/2018       | 0.2564 g      | 16 % wt                   |
| Site: Basement Grey Cabinet Wood with Gray Paint  |                |                  |                 |               |                           |
| WC-B-02                                           | 201809478-0002 | 8/22/2018        | 8/27/2018       | 0.2554 g      | 0.076 % wt                |
| Site: Basement Floor Cement with Red Paint        |                |                  |                 |               |                           |
| WC-B-03                                           | 201809478-0003 | 8/22/2018        | 8/27/2018       | 0.1663 g      | 17 % wt                   |
| Site: Basement Grey Cabinet Wood with Green Paint |                |                  |                 |               |                           |
| WC-B-04                                           | 201809478-0004 | 8/22/2018        | 8/27/2018       | 0.2579 g      | 0.023 % wt                |
| Site: Basement Wall Cement White Paint            |                |                  |                 |               |                           |
| WC-B-05                                           | 201809478-0005 | 8/22/2018        | 8/27/2018       | 0.2522 g      | 0.057 % wt                |
| Site: Drywall, Green Paint, Poor Condition        |                |                  |                 |               |                           |
| WC-B-06                                           | 201809478-0006 | 8/22/2018        | 8/27/2018       | 0.2534 g      | 7.8 % wt                  |
| Site: Brick Wall, White Paint, Poor Condition     |                |                  |                 |               |                           |
| WC-B-07                                           | 201809478-0007 | 8/22/2018        | 8/27/2018       | 0.2560 g      | 6.5 % wt                  |
| Site: Floor, Concrete, Red Paint                  |                |                  |                 |               |                           |
| WC-B-08                                           | 201809478-0008 | 8/22/2018        | 8/27/2018       | 0.2526 g      | 0.34 % wt                 |
| Site: Door Frame, Wood, Grey Paint                |                |                  |                 |               |                           |
| WC-B-09                                           | 201809478-0009 | 8/22/2018        | 8/27/2018       | 0.1038 g      | 0.59 % wt                 |
| Site: Shelf, Wood Black Paint                     |                |                  |                 |               |                           |
| WC-B-10                                           | 201809478-0010 | 8/22/2018        | 8/27/2018       | 0.2531 g      | 0.34 % wt                 |
| Site: Floor, Concrete, Grey Paint                 |                |                  |                 |               |                           |
| WC-B-11                                           | 201809478-0011 | 8/22/2018        | 8/27/2018       | 0.2554 g      | 0.13 % wt                 |
| Site: Drywall, Green Paint - Asbestos Room        |                |                  |                 |               |                           |
| WC-B-12                                           | 201809478-0012 | 8/22/2018        | 8/27/2018       | 0.2534 g      | 0.68 % wt                 |
| Site: Garage Drywall, Yellow Paint                |                |                  |                 |               |                           |
| WC-B-13                                           | 201809478-0013 | 8/22/2018        | 8/27/2018       | 0.2525 g      | 1.3 % wt                  |
| Site: Garage Door Frame, Green Paint              |                |                  |                 |               |                           |
| WC-B-14                                           | 201809478-0014 | 8/22/2018        | 8/27/2018       | 0.2527 g      | 5.6 % wt                  |
| Site: Garage Outer Wall, Wood Siding White Paint  |                |                  |                 |               |                           |
| WC-B-15                                           | 201809478-0015 | 8/22/2018        | 8/27/2018       | 0.2504 g      | 7.0 % wt                  |
| Site: Floor, Concrete Red Paint                   |                |                  |                 |               |                           |

(b) (6)

\*Analysis following Lead in Paint by EMSL SOP/Determination of Environmental Lead by FLAA. Reporting limit is 0.008 % wt based on the minimum sample weight per our SOP. Unless noted, results in this report are not blank corrected. This report relates only to the samples reported above and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities. Samples received in good condition unless otherwise noted. "<" (less than) result signifies that the analyte was not detected at or above the reporting limit. Measurement of uncertainty is available upon request. The QC data associated with the sample results included in this report meet the recovery and precision requirements unless specifically indicated otherwise. Definitions of modifications are available upon request.

Samples analyzed by EMSL Analytical, Inc. Cinnaminson, NJ NELAP Certifications: NJ 03036, NY 10872, PA 68-00367, AIHA-LAP, LLC ELLAP 100194, A2LA 2845.01

Initial report from 08/28/2018 10:07:59



**EMSL Analytical, Inc.**

200 Route 130 North, Cinnaminson, NJ 08077

Phone/Fax: (856) 303-2500 / (856) 786-5974

<http://www.EMSL.com>

(b) (6)

EMSL Order: 201809478

CustomerID: USCG30

CustomerPO:

ProjectID:

Attn: (b) (6)

**US Coast Guard Maintenance & Logistics  
Command Atlantic  
300 E. Main Street, Suite 1000  
Norfolk, VA 23510-9104**

Phone: (757) 628-4410  
Fax: (757) 628-4418  
Received: 08/24/18 10:30 AM  
Collected: 8/22/2018

Project: West Chop Chips

**Test Report: Lead in Paint Chips by Flame AAS (SW 846 3050B/7000B)\***

| <i>Client Sample Description</i>          | <i>Lab ID</i>  | <i>Collected</i> | <i>Analyzed</i> | <i>Weight</i> | <i>Lead Concentration</i> |
|-------------------------------------------|----------------|------------------|-----------------|---------------|---------------------------|
| WC-B-16                                   | 201809478-0016 | 8/22/2018        | 8/27/2018       | 0.2582 g      | 16 % wt                   |
| Site: Outside Wood Trim White / Red Paint |                |                  |                 |               |                           |

(b) (6)

or other approved signatory

\*Analysis following Lead in Paint by EMSL SOP/Determination of Environmental Lead by FLAA. Reporting limit is 0.008 % wt based on the minimum sample weight per our SOP. Unless noted, results in this report are not blank corrected. This report relates only to the samples reported above and may not be reproduced, except in full, without written approval by EMSL. EMSL bears no responsibility for sample collection activities. Samples received in good condition unless otherwise noted. "<" (less than) result signifies that the analyte was not detected at or above the reporting limit. Measurement of uncertainty is available upon request. The QC data associated with the sample results included in this report meet the recovery and precision requirements unless specifically indicated otherwise. Definitions of modifications are available upon request.

Samples analyzed by EMSL Analytical, Inc. Cinnaminson, NJ NELAP Certifications: NJ 03036, NY 10872, PA 68-00367, AIHA-LAP, LLC ELLAP 100194, A2LA 2845.01

Initial report from 08/28/2018 10:07:59



**EMSL Analytical, Inc.**

200 Route 130 North, Cinnaminson, NJ 08077

Phone: (856) 303-2500 Fax: (856) 858-4571 Email: [EnvChemistry2@emsl.com](mailto:EnvChemistry2@emsl.com)

Attn:

8/29/2018

**US Coast Guard Maintenance & Logistics**

**Command Atlantic**

**300 E. Main Street, Suite 1000**

**Norfolk, VA 23510-9104**

Phone: (757) 628-4410

Fax: (757) 628-4418

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 8/24/2018. The results are tabulated on the attached data pages for the following client designated project:

**West Chop Housing Water**

The reference number for these samples is EMSL Order #011806797. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (856) 303-2500.

(b) (6)



The test results contained within this report meet the requirements of NELAP and/or the specific certification program that is applicable, unless otherwise noted.

NELAP Certifications: NJ 03036, NY 10872, PA 68-00367, CA ELAP 1877

may not be reproduced except in full and without written approval by EMSL Analytical, Inc.

Client Sample Description 921Main-H20-001

Collected: 8/22/2018  
10:24:00 AM

Lab ID: 011806797-0001

| Method | Parameter | Result | RL | Units     | Prep Date | Analyst | Analysis Date | Analyst |
|--------|-----------|--------|----|-----------|-----------|---------|---------------|---------|
| METALS |           |        |    |           |           |         |               |         |
| 200.8  | Lead      | ND     |    | 1.00 µg/L | 8/27/2018 | SM      | 8/27/2018     | SM      |

Client Sample Description 921Main-H20-002

Collected: 8/22/2018  
10:36:00 AM

Lab ID: 011806797-0002

| Method | Parameter | Result | RL | Units     | Prep Date | Analyst | Analysis Date | Analyst |
|--------|-----------|--------|----|-----------|-----------|---------|---------------|---------|
| METALS |           |        |    |           |           |         |               |         |
| 200.8  | Lead      | 1.70   |    | 1.00 µg/L | 8/27/2018 | SM      | 8/27/2018     | SM      |

Client Sample Description 917Main-H20-001

Collected: 8/22/2018  
12:05:00 PM

Lab ID: 011806797-0003

| Method | Parameter | Result | RL | Units     | Prep Date | Analyst | Analysis Date | Analyst |
|--------|-----------|--------|----|-----------|-----------|---------|---------------|---------|
| METALS |           |        |    |           |           |         |               |         |
| 200.8  | Lead      | ND     |    | 1.00 µg/L | 8/27/2018 | SM      | 8/27/2018     | SM      |

Client Sample Description 917Main-H20-002

Collected: 8/22/2018  
12:14:00 PM

Lab ID: 011806797-0004

| Method | Parameter | Result | RL | Units     | Prep Date | Analyst | Analysis Date | Analyst |
|--------|-----------|--------|----|-----------|-----------|---------|---------------|---------|
| METALS |           |        |    |           |           |         |               |         |
| 200.8  | Lead      | 3.10   |    | 1.00 µg/L | 8/27/2018 | SM      | 8/27/2018     | SM      |



### EMSL Analytical, Inc.

200 Route 130 North, Cinnaminson, NJ 08077

Phone/Fax: (856) 303-2500 / (856) 858-4571

<http://www.EMSL.com>

[EnvChemistry2@emsl.com](mailto:EnvChemistry2@emsl.com)

EMSL Order: 011806797  
CustomerID: USCG30  
CustomerPO:  
ProjectID:

Attn:

**US Coast Guard Maintenance & Logistics  
Command Atlantic  
300 E. Main Street, Suite 1000  
Norfolk, VA 23510-9104**

Phone: (757) 628-4410  
Fax: (757) 628-4418  
Received: 08/24/18 9:15 AM

Project: West Chop Housing Water

## Analytical Results

### Definitions:

ND - indicates that the analyte was not detected at the reporting limit

RL - Reporting Limit (Analytical)

D - Dilution

